


Waste Site Reclassification Form

Date Submitted: 10/21/1998	Operable Unit(s): 300-PF-2	Control Number: 98-140
Originator: Brian Dixon, G3-26	Waste Site ID: 300-211	
Phone: (509) 376-7053	Type of Reclassification Action:	
	Rejected <input checked="" type="radio"/> Closed-Out <input type="radio"/> No Action <input type="radio"/>	

This form documents agreement among the parties listed below authorizing classification of the subject unit as rejected, closed-out, or no action and authorizing backfill of the site, if appropriate. Final removal from the NPL of no action or closed-out sites will occur at a future date.

Description of current waste site condition:

The site is a french drain that receives steam condensate. The drain is a clay pipe covered by a 1.12 meter (3.67 foot) metal lid. The top of the clay pipe is a few centimeters above grade. The lid has three holes cut into it and is labeled "Confined Space." A metal pipe approximately 2.5 centimeters in diameter and labeled "LPD-TRP-016" enters the drain through one of these holes. During the site walkdown, steam could be seen rising from the drain and the sound of a liquid being discharged into the drain could be heard. The site is listed in the "Inventory of Miscellaneous Streams," Revision 3, as stream #429.

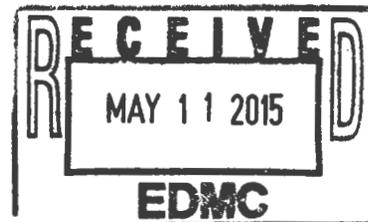

Basis for reclassification:

Steam is produced from sanitary water that has been sent through a water softener system to remove minerals (calcium and magnesium). The treated water is introduced into boilers to produce steam. This steam is superheated before distribution to facilities for heating and process use. Disposal sites receive steam condensate from the steam distribution lines. When used for heating purposes, this is a seasonal discharge. Non-regulated chemicals are added to dechlorinate the water, prevent scale, and control corrosion. The site is an active structure that receives less than 0.01 gallons per minute steam condensate only. Disposal structures meeting the definition of "underground injection control", as stated in Washington Administrative Code (WAC) 173-218, are registered (listed) as underground injection wells. This site is exempt from permitting under WAC 173-216 because Ecology considers the WAC 173-218 registration to be sufficient for sites that received steam condensate only. The flow rate is less than 0.038 liters (0.01 gallons per minute).

<i>Stewart T. Berman</i>		<i>12/15/98</i>
DOE Project Manager	Signature	Date
<i>David R. Fein</i>	<i>David R. Fein</i>	<i>12/15/98</i>
EPD Project Manager	Signature	Date