AR TARGET SHEET

The following document was too large to scan as one unit, therefore, it has been divided into sections.

EDMC#:	0074410
SECTION:	3 OF 4
DOCUMENT #:	Not Numbered
TITLE:	Environmental Restoration Disposal Facility (ERDF) Cells 7-10 Detailed Design Package, Rev. 0

EXHIBIT "F"
DRAWINGS

DRAWINGS			
	Title	Drawing No.	Revision & Date
1	Title, Location & Hanford Area Maps	0600X-DD-G0026	Rev. 0 9/28/2007
2	Drawing List	0600X-DD-G0027	Rev. 0 9/28/2007
3	Symbols	0600X-DD-G0028	Rev. 0 9/28/2007
4	Abbreviations	0600X-DD-G0029	Rev. 0 9/28/2007
5	Overall Site Plan	0600X-DD-C0258	Rev. 0 9/28/2007
6	Construction Limits and Fence Location - Cells 7 & 8	0600X-DD-C0259	Rev. 0 9/28/2007
7	Construction Limits and Fence Location - Cells 9 & 10	0600X-DD-C0260	Rev. 0 9/28/2007
8	Coordinate Table	0600X-DD-C0261	Rev. 0 9/28/2007
9	Fence Details	0600X-DD-C0262	Rev. 0 9/28/2007
10	Sign Details	0600X-DD-C0263	Rev. 0 9/28/2007
11	Existing Topography	0600X-DD-C0265	Rev. 0 9/28/2007
12	Project Office Trailer Placement	0600X-DD-C0266	Rev. 0 9/28/2007
13	Subgrade & Cell Berm Contours - Cells 7 & 8	0600X-DD-C0267	Rev. 0 9/28/2007
14	Subgrade & Cell Berm Contours - Cells 9 & 10	0600X-DD-C0268	Rev. 0 9/28/2007
15	Subgrade Survey Control Cells 7 & 8	0600X-DD-C0269	Rev. 0 9/28/2007
16	Subgrade Survey Control - Cells 9 & 10	0600X-DD-C0270	Rev. 0 9/28/2007
17	Admix Layer Contours - Cells 7 & 8	0600X-DD-C0271	Rev. 0 9/28/2007
18	Admix Layer Contours - Cells 9 & 10	0600X-DD-C0272	Rev. 0 9/28/2007
19	Secondary Drainage Layer Contours - Cells 7 & 8	0600X-DD-C0273	Rev. 0 9/28/2007
20	Secondary Drainage Layer Contours - Cells 9 & 10	0600X-DD-C0274	Rev. 0 9/28/2007
21	Primary Drainage Layer Contours - Cells 7 & 8	0600X-DD-C0275	Rev. 0 9/28/2007
22	Primary Drainage Layer Contours - Cells 9 & 10	0600X-DD-C0276	Rev. 0 9/28/2007
23	Operations Layer Contours - Cells 7 & 8	0600X-DD-C0277	Rev. 0 9/28/2007
24	Operations Layer Contours - Cells 9 & 10	0600X-DD-C0278	Rev. 0 9/28/2007
25	Civil Sections	0600X-DD-C0279	Rev. 0 9/28/2007
26	General Cross Sections	0600X-DD-C0280	Rev. 0 9/28/2007
27	Liner System Details - 1	0600X-DD-C0281	Rev. 0 9/28/2007
28	Liner System Details - 2	0600X-DD-C0282	Rev. 0 9/28/2007
29	Liner Termination Details - 1	0600X-DD-C0283	Rev. 0 9/28/2007
30	Liner Termination Details- 2	0600X-DD-C0284	Rev. 0 9/28/2007
31	Sump Layout Plan - Cell 7	0600X-DD-C0285	Rev. 0 9/28/2007
32	Sump Layout Plan - Cell 8	0600X-DD-C0286	Rev. 0 9/28/2007
33	Sump Layout Plan - 9	0600X-DD-C0287	Rev. 0 9/28/2007
34	Sump Layout Plan - Cell 10	0600X-DD-C0288	Rev. 0 9/28/2007
35	Sump Details - 1	0600X-DD-C0289	Rev. 0 9/28/2007
36	Sump Details - 2	0600X-DD-C0290	Rev. 0 9/28/2007
37	In-Cell Leachate Piping Plan - Cells 7 & 8	0600X-DD-C0291	Rev. 0 9/28/2007
38	In-Cell Leachate Piping Plan - Cells 9 & 10	0600X-DD-C0292	Rev. 0 9/28/2007
39	Crest Pad Plan and Elevation	0600X-DD-C0293	Rev. 0 9/28/2007
40	Yard Piping Plan - Cells 7 & 8	0600X-DD-C0294	Rev. 0 9/28/2007
41	Yard Piping Plan - Cells 9 & 10	0600X-DD-C0295	Rev. 0 9/28/2007
42	Stockpile Plan - Cells 7 & 8	0600X-DD-C0297	Rev. 0 9/28/2007
43	Stockpile Plan Cells 9 & 10	0600X-DD-C0298	Rev. 0 9/28/2007
44	Vadose Zone Monitoring System	0600X-DD-C0299	Rev. 0 9/28/2007
45	Vadose Zone Monitoring System Details	0600X-DD-C0300	Rev. 0 9/28/2007
46	Access Road Plan and Profile	0600X-DD-C0301	Rev. 0 9/28/2007
47	Access Road Plan and Profile	0600X-DD-C0302	Rev. 0 9/28/2007
48	Access Road Details	0600X-DD-C0304	Rev. 0 9/28/2007
49	Test Pits and Boring Locations	0600X-DD-C0308	Rev. 0 9/28/2007
50	Soil Boring Logs - 1	0600X-DD-C0309	Rev. 0 9/28/2007
51	Soil Boring Logs - 2	0600X-DD-C0310	Rev. 0 9/28/2007
52	Soil Boring Logs - 3	0600X-DD-C0311	Rev. 0 9/28/2007
53	Soil Test Pit Logs - 1	0600X-DD-C0312	Rev. 0 9/28/2007

EXHIBIT "F"
DRAWINGS

DRAWINGS			
	Title	Drawing No.	Revision & Date
54	Soil Test Pit Logs - 2	0600X-DD-C0313	Rev. 0 9/28/2007
55	Soil Test Pit Logs - 3	0600X-DD-C0315	Rev. 0 9/28/2007
56	Crest Pad Bldg Structural Plans and Sections	0600X-DD-C0316	Rev. 0 9/28/2007
57	Structural Details - 1	0600X-DD-C0317	Rev. 0 9/28/2007
58	Structural Details - 2	0600X-DD-C0318	Rev. 0 9/28/2007
59	Crest Pad Bldg - Plans and Elevations	0600X-DD-A0014	Rev. 0 9/28/2007
60	Architectural Details - 1	0600X-DD-A0015	Rev. 0 9/28/2007
61	Architectural Details - 2	0600X-DD-A0016	Rev. 0 9/28/2007
62	Finish Schedules	0600X-DD-A0017	Rev. 0 9/28/2007
63	Electrical Symbols	0600X-DD-E0104	Rev. 0 9/28/2007
64	Electrical Abbreviations and General Notes	0600X-DD-E0105	Rev. 0 9/28/2007
65	Electrical Details - 1	0600X-DD-E0106	Rev. 0 9/28/2007
66	Electrical Details - 2	0600X-DD-E0107	Rev. 0 9/28/2007
67	Electrical Cable and Raceway Schedule	0600X-DD-E0109	Rev. 0 9/28/2007
68	Electrical Cable and Raceway Schedule	0600X-DD-E0110	Rev. 0 9/28/2007
69	Electrical Site Plan - Cell 7 & 8	0600X-DD-E0111	Rev. 0 9/28/2007
70	Electrical Site Plan - Cell 9 & 10	0600X-DD-E0112	Rev. 0 9/28/2007
71	Electrical One-Line Switchgear	0600X-DD-E0113	Rev. 0 9/28/2007
72	MCC One-Line Diagrams	0600X-DD-E0114	Rev. 0 9/28/2007
73	MCC Details	0600X-DD-E0116	Rev. 0 9/28/2007
74	Electrical Schedules	0600X-DD-E0117	Rev. 0 9/28/2007
75	Control Schematics - 1	0600X-DD-E0118	Rev. 0 9/28/2007
76	Control Schematics - 2	0600X-DD-E0119	Rev. 0 9/28/2007
77	Control Schematics - 3	0600X-DD-E0120	Rev. 0 9/28/2007
78	Control Schematics - 4	0600X-DD-E0121	Rev. 0 9/28/2007
79	Control Schematics - 5	0600X-DD-E0122	Rev. 0 9/28/2007
80	Crest Pad Electrical Power Plan	0600X-DD-E0123	Rev. 0 9/28/2007
81	Crest Pad Electrical Lighting Plan	0600X-DD-E0124	Rev. 0 9/28/2007
82	Piping Details	0600X-DD-M0022	Rev. 0 9/28/2007
83	Mechanical Schedules	0600X-DD-M0023	Rev. 0 9/28/2007
84	Mechanical Details	0600X-DD-M0024	Rev. 0 9/28/2007
85	Mechanical Schedules	0600X-DD-M0025	Rev. 0 9/28/2007
86	Crest Pad Details - 1	0600X-DD-M0027	Rev. 0 9/28/2007
87	Crest Pad Details - 2	0600X-DD-M0028	Rev. 0 9/28/2007

DRAWING NO.	REV. NO.
0600X-DD-G0027	0

DRAWING LIST

GENERAL

DRAWING NUMBER	DRAWING TITLE
0600X-DD-G0026	TITLE, LOCATION & HANFORD AREA MAPS
0600X-DD-G0027	DRAWING LIST
0600X-DD-G0028	SYMBOLS
0600X-DD-G0029	ABBREVIATIONS

CIVIL

0600X-DD-C0258	OVERALL SITE PLAN
0600X-DD-C0259	CONSTRUCTION LIMITS AND FENCE LOCATION – CELLS 7 & 8
0600X-DD-C0260	CONSTRUCTION LIMITS AND FENCE LOCATION – CELLS 9 & 10
0600X-DD-C0261	COORDINATE TABLE
0600X-DD-C0262	FENCE DETAILS
0600X-DD-C0263	SIGN DETAILS
0600X-DD-C0264	RESERVE FOR FUTURE USE -- (NOT USED)
0600X-DD-C0265	EXISTING TOPOGRAPHY
0600X-DD-C0266	PROJECT OFFICE TRAILER PLACEMENT
0600X-DD-C0267	SUBGRADE & CELL BERM CONTOURS – CELLS 7 & 8
0600X-DD-C0268	SUBGRADE & CELL BERM CONTOURS – CELLS 9 & 10
0600X-DD-C0269	SUBGRADE SURVEY CONTROL – CELLS 7 & 8
0600X-DD-C0270	SUBGRADE SURVEY CONTROL – CELLS 9 & 10
0600X-DD-C0271	ADMIX LAYER CONTOURS – CELLS 7 & 8
0600X-DD-C0272	ADMIX LAYER CONTOURS – CELLS 9 & 10
0600X-DD-C0273	SECONDARY DRAINAGE LAYER CONTOURS – CELLS 7 & 8
0600X-DD-C0274	SECONDARY DRAINAGE LAYER CONTOURS – CELLS 9 & 10
0600X-DD-C0275	PRIMARY DRAINAGE LAYER CONTOURS – CELLS 7 & 8
0600X-DD-C0276	PRIMARY DRAINAGE LAYER CONTOURS – CELLS 9 & 10
0600X-DD-C0277	OPERATIONS LAYER CONTOURS – CELLS 7 & 8
0600X-DD-C0278	CPERATIONS LAYER CONTOURS – CELLS 9 & 10
0600X-DD-C0279	CIVIL SECTIONS
0600X-DD-C0280	GENERAL CROSS SECTIONS
0600X-DD-C0281	LINER SYSTEM DETAILS – 1
0600X-DD-C0282	LINER SYSTEM DETAILS – 2
0600X-DD-C0283	LINER TERMINATION DETAILS – 1
0600X-DD-C0284	LINER TERMINATION DETAILS – 2
0600X-DD-C0285	SUMP LAYOUT PLAN – CELL 7
0600X-DD-C0286	SUMP LAYOUT PLAN – CELL 8
0600X-DD-C0287	SUMP LAYOUT PLAN – CELL 9
0600X-DD-C0288	SUMP LAYOUT PLAN – CELL 10
0600X-DD-C0289	SUMP DETAILS – 1
0600X-DD-C0290	SUMP DETAILS – 2
0600X-DD-C0291	IN-CELL LEACHATE PIPING PLAN – CELLS 7 & 8
0600X-DD-C0292	IN-CELL LEACHATE PIPING PLAN – CELLS 9 & 10
0600X-DD-C0293	CREST PAD PLAN AND ELEVATION
0600X-DD-C0294	YARD PIPING PLAN – CELLS 7 & 8
0600X-DD-C0295	YARD PIPING PLAN – CELLS 9 & 10
0600X-DD-C0296	RESERVE FOR DETAILS -- (NOT USED)
0600X-DD-C0297	STOCKPILE PLAN – CELLS 7 & 8
0600X-DD-C0298	STOCKPILE PLAN – CELLS 9 & 10
0600X-DD-C0299	VADOSE ZONE MONITORING SYSTEM
0600X-DD-C0300	VADOSE ZONE MONITORING SYSTEM DETAILS
0600X-DD-C0301	ACCESS ROAD PLAN AND PROFILE
0600X-DD-C0302	ACCESS ROAD PLAN AND PROFILE
0600X-DD-C0303	RESERVE FOR FUTURE USE -- (NOT USED)
0600X-DD-C0304	ACCESS ROAD DETAILS
0600X-DD-C0305	RESERVE FOR FUTURE USE -- (NOT USED)
0600X-DD-C0306	RESERVE FOR FUTURE USE -- (NOT USED)
0600X-DD-C0307	RESERVE FOR FUTURE USE -- (NOT USED)
0600X-DD-C0308	TEST PITS AND BORING LOCATIONS
0600X-DD-C0309	SOIL BORING LOGS – 1
0600X-DD-C0310	SOIL BORING LOGS – 2
0600X-DD-C0311	SOIL BORING LOGS – 3
0600X-DD-C0312	SOIL TEST PIT LOGS – 1
0600X-DD-C0313	SOIL TEST PIT LOGS – 2
0600X-DD-C0314	RESERVE FOR FUTURE USE -- (NOT USED)
0600X-DD-C0315	SOIL TEST PIT LOGS – 3

STRUCTURAL CIVIL

DRAWING NUMBER	DRAWING TITLE
0600X-DD-C0316	CREST PAD BLDG STRUCTURAL PLANS AND SECTIONS
0600X-DD-C0317	STRUCTURAL DETAILS – 1
0600X-DD-C0318	STRUCTURAL DETAILS – 2
0600X-DD-C0319	RESERVE FOR FUTURE USE -- (NOT USED)

ARCHITECTURAL

0600X-DD-A0014	CREST PAD BLDG – PLANS AND ELEVATIONS
0600X-DD-A0015	ARCHITECTURAL DETAILS – 1
0600X-DD-A0016	ARCHITECTURAL DETAILS – 2
0600X-DD-A0017	FINISH SCHEDULES

ELECTRICAL

0600X-DD-E0104	ELECTRICAL SYMBOLS
0600X-DD-E0105	ELECTRICAL ABBREVIATIONS AND GENERAL NOTES
0600X-DD-E0106	ELECTRICAL DETAILS – 1
0600X-DD-E0107	ELECTRICAL DETAILS – 2
0600X-DD-E0108	(NOT USED)
0600X-DD-E0109	ELECTRICAL RACEWAY AND CABLE SCHEDULE
0600X-DD-E0110	ELECTRICAL RACEWAY AND CABLE SCHEDULE
0600X-DD-E0111	ELECTRICAL SITE PLAN – CELL 7 & 8
0600X-DD-E0112	ELECTRICAL SITE PLAN – CELL 9 & 10
0600X-DD-E0113	ELECTRICAL ONE-LINE SWITCHGEAR
0600X-DD-E0114	MCC ONE-LINE DIAGRAMS
0600X-DD-E0115	(NOT USED)
0600X-DD-E0116	MCC DETAILS
0600X-DD-E0117	ELECTRICAL SCHEDULES
0600X-DD-E0118	CONTROL SCHEMATICS – 1
0600X-DD-E0119	CONTROL SCHEMATICS – 2
0600X-DD-E0120	CONTROL SCHEMATICS – 3
0600X-DD-E0121	CONTROL SCHEMATICS – 4
0600X-DD-E0122	CONTROL SCHEMATICS – 5
0600X-DD-E0123	CREST PAD ELECTRICAL POWER PLAN
0600X-DD-E0124	CREST PAD ELECTRICAL LIGHTING PLAN

MECHANICAL

0600X-DD-M0022	PIPING DETAILS
0600X-DD-M0023	MECHANICAL SCHEDULES
0600X-DD-M0024	MECHANICAL DETAILS
0600X-DD-M0025	MECHANICAL SCHEDULES
0600X-DD-M0026	RESERVE FOR FUTURE USE -- (NOT USED)
0600X-DD-M0027	CREST PAD DETAILS – 1
0600X-DD-M0028	CREST PAD DETAILS – 2
0600X-DD-M0029	RESERVE FOR FUTURE USE -- (NOT USED)

NOTES

THIS PORTION OF THE TECHNICAL SUBMISSION DESCRIBED BELOW HAS BEEN PREPARED UNDER THE DIRECT SUPERVISION AND RESPONSIBLE CHARGE OF THE UNDERSIGNED.

NAME JOHN C. BRIEST
DISCIPLINE PROFESSIONAL ENGINEER
SHEETS COVERED BY THIS SEAL G0026–C0315

JOHN CARL BRIEST – STATE OF WASHINGTON – 42158 REGISTERED PROFESSIONAL ENGINEER – 9/28/07
EXPIRES: 5/28/08

THIS PORTION OF THE TECHNICAL SUBMISSION DESCRIBED BELOW HAS BEEN PREPARED UNDER THE DIRECT SUPERVISION AND RESPONSIBLE CHARGE OF THE UNDERSIGNED.

NAME DAVE E. NIELSON
DISCIPLINE PROFESSIONAL ENGINEER
SHEETS COVERED BY THIS SEAL C0316–A0017

DAVID E. NIELSON – STATE OF WASHINGTON – 28592 REGISTERED PROFESSIONAL ENGINEER – 9/26/07
EXPIRES 9/23/08

THIS PORTION OF THE TECHNICAL SUBMISSION DESCRIBED BELOW HAS BEEN PREPARED UNDER THE DIRECT SUPERVISION AND RESPONSIBLE CHARGE OF THE UNDERSIGNED.

NAME RAYMOND E. MERRIMAN
DISCIPLINE PROFESSIONAL ENGINEER
SHEETS COVERED BY THIS SEAL E0104–E0124

RAYMOND E. MERRIMAN – STATE OF WASHINGTON – 2322 REGISTERED PROFESSIONAL ENGINEER – 9/27/07
EXPIRES: 11-30-08

THIS PORTION OF THE TECHNICAL SUBMISSION DESCRIBED BELOW HAS BEEN PREPARED UNDER THE DIRECT SUPERVISION AND RESPONSIBLE CHARGE OF THE UNDERSIGNED.

NAME TONY R. BENEGAS
DISCIPLINE PROFESSIONAL ENGINEER
SHEETS COVERED BY THIS SEAL M0022–M0029

TONY R. BENEGAS – STATE OF WASHINGTON – 27910 REGISTERED PROFESSIONAL ENGINEER – 9-27-07
EXPIRES 11-22-08

DOCUMENT CONTROL mlc 10/11/07

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJW	DB		REM	N/A	DB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7–10
DRAWING LIST

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDG0027.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-G0027	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15592 SHT01	600G	0000

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☑ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borlaug 10/9/07
0600X-SC-G0524 05-19 003
S00X524H00

River Corridor Closure Contract — Dedicated To Safety/Excellence — WCH

DRAWING NO.	REV. NO.
0600X-DD-G0026	0

PROJECT TITLE:

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY (ERDF) CELLS 7 THROUGH 10 CONSTRUCTION DRAWINGS

FOR:

WASHINGTON CLOSURE HANFORD, LLC

BY:

WEAVER BOOS CONSULTANTS, LLC

WASHINGTON CLOSURE HANFORD | JOB NO. 14655

SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. [X] Work may proceed.
2. [ ] Revise and resubmit. Work may proceed prior to resubmittal.
3. [ ] Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. [ ] Revise and resubmit. Work may not proceed.
5. [ ] Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Barlowe 10/9/07

DOCUMENT ID NUMBER: 0600X-SC-G0024 05-19 002

SUBMITTAL

500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

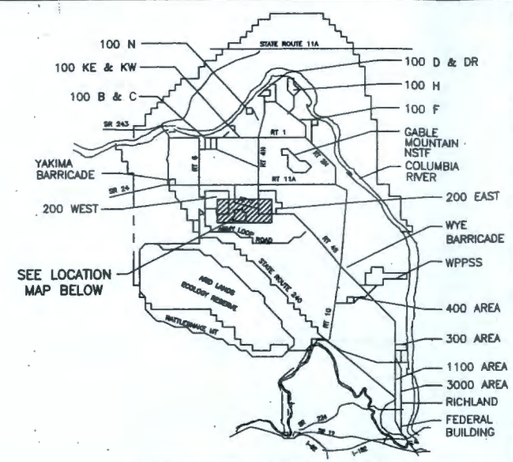

HANFORD AREA MAP
NTS

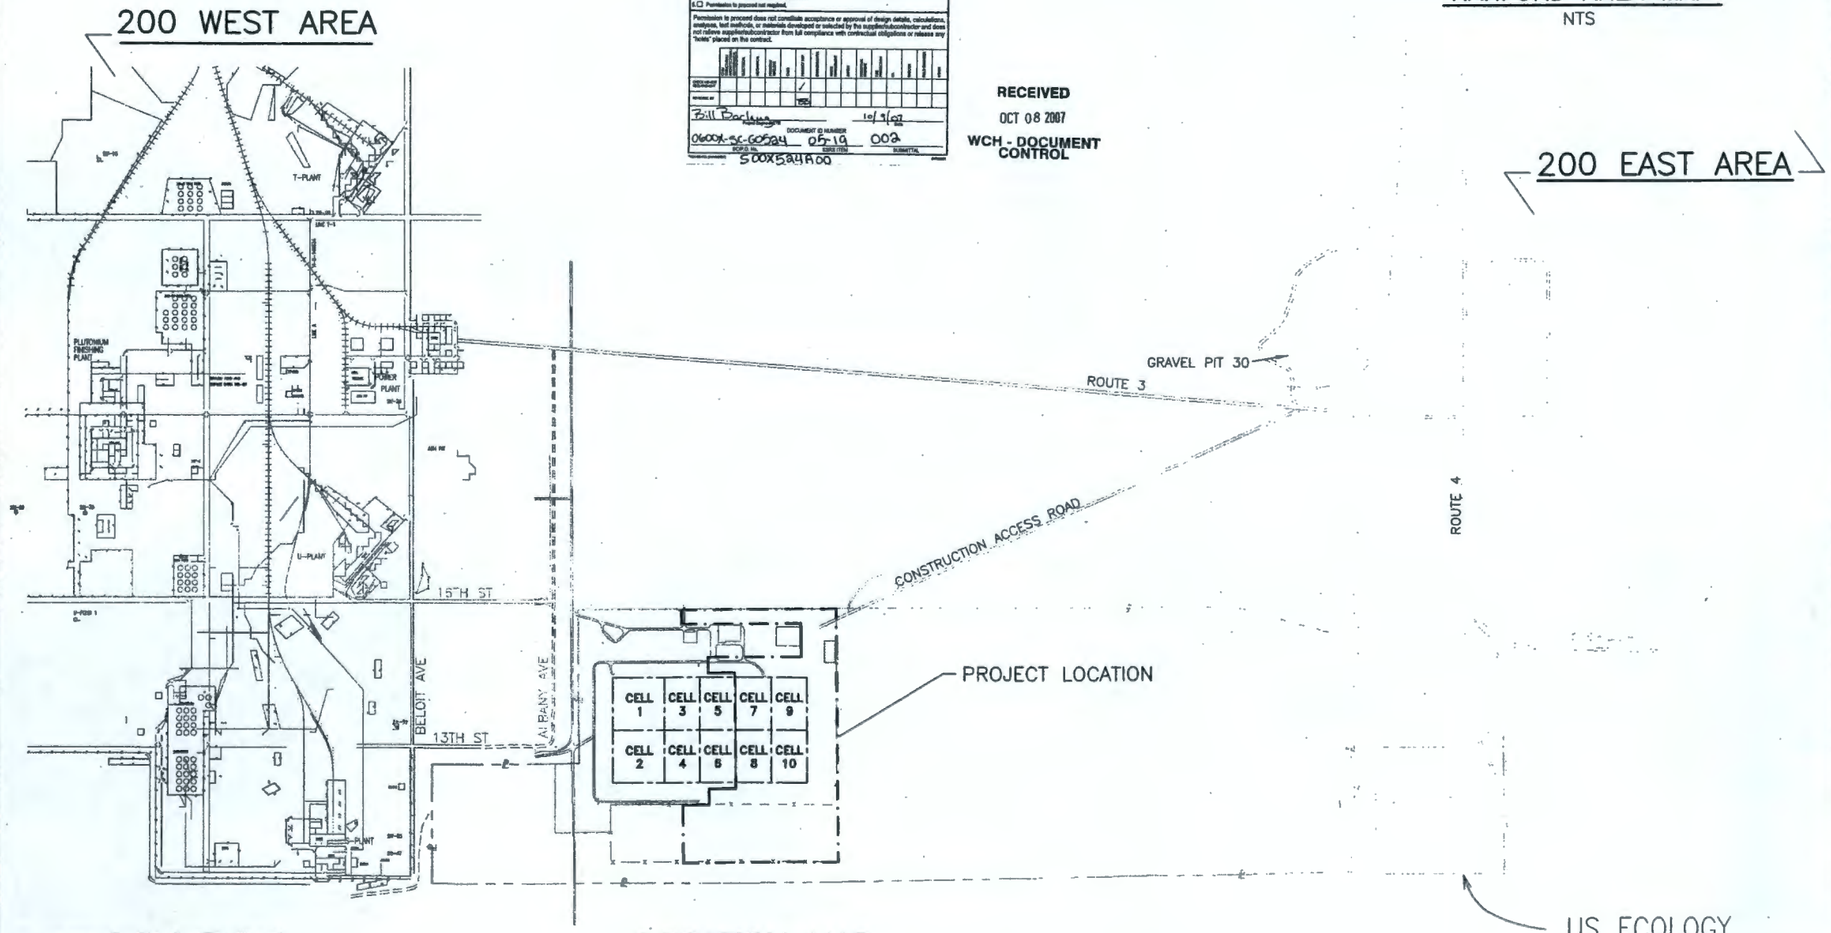

LOCATION MAP
NTS

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15591 SHT01	600G	0100

Dedicated To Safety Excellence

NOTES

THIS PORTION OF THE TECHNICAL SUBMISSION DESCRIBED BELOW HAS BEEN PREPARED UNDER THE DIRECT SUPERVISION AND RESPONSIBLE CHARGE OF THE UNDERSIGNED.
NAME JOHN C. BRIEST
DISCIPLINE PROFESSIONAL ENGINEER
SHEETS COVERED BY THIS SEAL G0026-C0315
JOHN CARL BRIEST, STATE OF WASHINGTON, 42158, REGISTERED PROFESSIONAL ENGINEER, 9/21/07
EXPIRES: 5/28/08

THIS PORTION OF THE TECHNICAL SUBMISSION DESCRIBED BELOW HAS BEEN PREPARED UNDER THE DIRECT SUPERVISION AND RESPONSIBLE CHARGE OF THE UNDERSIGNED.
NAME DAVE E. NIELSON
DISCIPLINE PROFESSIONAL ENGINEER
SHEETS COVERED BY THIS SEAL C0316-A0017
DAVID E. NIELSON, STATE OF WASHINGTON, 28392, REGISTERED PROFESSIONAL ENGINEER, 9/24/07
EXPIRES 9/23/08

THIS PORTION OF THE TECHNICAL SUBMISSION DESCRIBED BELOW HAS BEEN PREPARED UNDER THE DIRECT SUPERVISION AND RESPONSIBLE CHARGE OF THE UNDERSIGNED.
NAME RAYMOND E. MERRIMAN
DISCIPLINE PROFESSIONAL ENGINEER
SHEETS COVERED BY THIS SEAL E0104-E0124
RAYMOND E. MERRIMAN, STATE OF WASHINGTON, 12302, REGISTERED PROFESSIONAL ENGINEER
EXPIRES 11-30-08

THIS PORTION OF THE TECHNICAL SUBMISSION DESCRIBED BELOW HAS BEEN PREPARED UNDER THE DIRECT SUPERVISION AND RESPONSIBLE CHARGE OF THE UNDERSIGNED.
NAME TONY R. BENEGAS
DISCIPLINE PROFESSIONAL ENGINEER
SHEETS COVERED BY THIS SEAL M0022-M0029
TONY R. BENEGAS, STATE OF WASHINGTON, 27910, REGISTERED PROFESSIONAL ENGINEER, 9-3-07
EXPIRES 11-22-08

DOCUMENT CONTROL mac 10/11/07

Best Available Copy

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JTW					

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON | WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 – 10
TITLE, LOCATION & HANFORD AREA MAPS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDG0026.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-G0026	0

DRAWING NO.	REV. NO.
0600X-DD-G0027	0

DRAWING LIST

GENERAL

DRAWING NUMBER	DRAWING TITLE
0600X-DD-G0026	TITLE, LOCATION & HANFORD AREA MAPS
0600X-DD-G0027	DRAWING LIST
0600X-DD-G0028	SYMBOLS
0600X-DD-G0029	ABBREVIATIONS

CIVIL

0600X-DD-C0258	OVERALL SITE PLAN
0600X-DD-C0259	CONSTRUCTION LIMITS AND FENCE LOCATION – CELLS 7 & 8
0600X-DD-C0260	CONSTRUCTION LIMITS AND FENCE LOCATION – CELLS 9 & 10
0600X-DD-C0261	COORDINATE TABLE
0600X-DD-C0262	FENCE DETAILS
0600X-DD-C0263	SIGN DETAILS
0600X-DD-C0264	RESERVE FOR FUTURE USE -- (NOT USED)
0600X-DD-C0265	EXISTING TOPOGRAPHY
0600X-DD-C0266	PROJECT OFFICE TRAILER PLACEMENT
0600X-DD-C0267	SUBGRADE & CELL BERM CONTOURS – CELLS 7 & 8
0600X-DD-C0268	SUBGRADE & CELL BERM CONTOURS – CELLS 9 & 10
0600X-DD-C0269	SUBGRADE SURVEY CONTROL – CELLS 7 & 8
0600X-DD-C0270	SUBGRADE SURVEY CONTROL – CELLS 9 & 10
0600X-DD-C0271	ADMIX LAYER CONTOURS – CELLS 7 & 8
0600X-DD-C0272	ADMIX LAYER CONTOURS – CELLS 9 & 10
0600X-DD-C0273	SECONDARY DRAINAGE LAYER CONTOURS – CELLS 7 & 8
0600X-DD-C0274	SECONDARY DRAINAGE LAYER CONTOURS – CELLS 9 & 10
0600X-DD-C0275	PRIMARY DRAINAGE LAYER CONTOURS – CELLS 7 & 8
0600X-DD-C0276	PRIMARY DRAINAGE LAYER CONTOURS – CELLS 9 & 10
0600X-DD-C0277	OPERATIONS LAYER CONTOURS – CELLS 7 & 8
0600X-DD-C0278	OPERATIONS LAYER CONTOURS – CELLS 9 & 10
0600X-DD-C0279	CIVIL SECTIONS
0600X-DD-C0280	GENERAL CROSS SECTIONS
0600X-DD-C0281	LINER SYSTEM DETAILS – 1
0600X-DD-C0282	LINER SYSTEM DETAILS – 2
0600X-DD-C0283	LINER TERMINATION DETAILS – 1
0600X-DD-C0284	LINER TERMINATION DETAILS – 2
0600X-DD-C0285	SUMP LAYOUT PLAN – CELL 7
0600X-DD-C0286	SUMP LAYOUT PLAN – CELL 8
0600X-DD-C0287	SUMP LAYOUT PLAN – CELL 9
0600X-DD-C0288	SUMP LAYOUT PLAN – CELL 10
0600X-DD-C0289	SUMP DETAILS – 1
0600X-DD-C0290	SUMP DETAILS – 2
0600X-DD-C0291	IN-CELL LEACHATE PIPING PLAN – CELLS 7 & 8
0600X-DD-C0292	IN-CELL LEACHATE PIPING PLAN – CELLS 9 & 10
0600X-DD-C0293	CREST PAD PLAN AND ELEVATION
0600X-DD-C0294	YARD PIPING PLAN – CELLS 7 & 8
0600X-DD-C0295	YARD PIPING PLAN – CELLS 9 & 10
0600X-DD-C0296	RESERVE FOR DETAILS -- (NOT USED)
0600X-DD-C0297	STOCKPILE PLAN – CELLS 7 & 8
0600X-DD-C0298	STOCKPILE PLAN – CELLS 9 & 10
0600X-DD-C0299	VADOSE ZONE MONITORING SYSTEM
0600X-DD-C0300	VADOSE ZONE MONITORING SYSTEM DETAILS
0600X-DD-C0301	ACCESS ROAD PLAN AND PROFILE
0600X-DD-C0302	ACCESS ROAD PLAN AND PROFILE
0600X-DD-C0303	RESERVE FOR FUTURE USE -- (NOT USED)
0600X-DD-C0304	ACCESS ROAD DETAILS
0600X-DD-C0305	RESERVE FOR FUTURE USE -- (NOT USED)
0600X-DD-C0306	RESERVE FOR FUTURE USE -- (NOT USED)
0600X-DD-C0307	RESERVE FOR FUTURE USE -- (NOT USED)
0600X-DD-C0308	TEST PITS AND BORING LOCATIONS
0600X-DD-C0309	SOIL BORING LOGS – 1
0600X-DD-C0310	SOIL BORING LOGS – 2
0600X-DD-C0311	SOIL BORING LOGS – 3
0600X-DD-C0312	SOIL TEST PIT LOGS – 1
0600X-DD-C0313	SOIL TEST PIT LOGS – 2
0600X-DD-C0314	RESERVE FOR FUTURE USE -- (NOT USED)
0600X-DD-C0315	SOIL TEST PIT LOGS – 3

STRUCTURAL CIVIL

DRAWING NUMBER	DRAWING TITLE
0600X-DD-C0316	CREST PAD BLDG STRUCTURAL PLANS AND SECTIONS
0600X-DD-C0317	STRUCTURAL DETAILS – 1
0600X-DD-C0318	STRUCTURAL DETAILS – 2
0600X-DD-C0319	RESERVE FOR FUTURE USE -- (NOT USED)

ARCHITECTURAL

0600X-DD-A0014	CREST PAD BLDG – PLANS AND ELEVATIONS
0600X-DD-A0015	ARCHITECTURAL DETAILS – 1
0600X-DD-A0016	ARCHITECTURAL DETAILS – 2
0600X-DD-A0017	FINISH SCHEDULES

ELECTRICAL

0600X-DD-E0104	ELECTRICAL SYMBOLS
0600X-DD-E0105	ELECTRICAL ABBREVIATIONS AND GENERAL NOTES
0600X-DD-E0106	ELECTRICAL DETAILS – 1
0600X-DD-E0107	ELECTRICAL DETAILS – 2
0600X-DD-E0108	(NOT USED)
0600X-DD-E0109	ELECTRICAL RACEWAY AND CABLE SCHEDULE
0600X-DD-E0110	ELECTRICAL RACEWAY AND CABLE SCHEDULE
0600X-DD-E0111	ELECTRICAL SITE PLAN – CELL 7 & 8
0600X-DD-E0112	ELECTRICAL SITE PLAN – CELL 9 & 10
0600X-DD-E0113	ELECTRICAL ONE-LINE SWITCHGEAR
0600X-DD-E0114	MCC ONE-LINE DIAGRAMS
0600X-DD-E0115	(NOT USED)
0600X-DD-E0116	MCC DETAILS
0600X-DD-E0117	ELECTRICAL SCHEDULES
0600X-DD-E0118	CONTROL SCHEMATICS – 1
0600X-DD-E0119	CONTROL SCHEMATICS – 2
0600X-DD-E0120	CONTROL SCHEMATICS – 3
0600X-DD-E0121	CONTROL SCHEMATICS – 4
0600X-DD-E0122	CONTROL SCHEMATICS – 5
0600X-DD-E0123	CREST PAD ELECTRICAL POWER PLAN
0600X-DD-E0124	CREST PAD ELECTRICAL LIGHTING PLAN

MECHANICAL

0600X-DD-M0022	PIPING DETAILS
0600X-DD-M0023	MECHANICAL SCHEDULES
0600X-DD-M0024	MECHANICAL DETAILS
0600X-DD-M0025	MECHANICAL SCHEDULES
0600X-DD-M0026	RESERVE FOR FUTURE USE -- (NOT USED)
0600X-DD-M0027	CREST PAD DETAILS – 1
0600X-DD-M0028	CREST PAD DETAILS – 2
0600X-DD-M0029	RESERVE FOR FUTURE USE -- (NOT USED)

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1 ☑ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmission.
3 ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4 ☐ Review and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Deblaere 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G0026A 05-10 003
SCPS NO. | SEQ ITEM | SUBMITTAL
500X524H00

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15592 SHT01	600G	0000

NOTES

THIS PORTION OF THE TECHNICAL SUBMISSION DESCRIBED BELOW HAS BEEN PREPARED UNDER THE DIRECT SUPERVISION AND RESPONSIBLE CHARGE OF THE UNDERSIGNED.
NAME JOHN C. BRIEST
DISCIPLINE PROFESSIONAL ENGINEER
SHEETS COVERED BY THIS SEAL G0026–C0315
JOHN CARL BRIEST, STATE OF WASHINGTON, 42158, REGISTERED PROFESSIONAL ENGINEER
EXPIRES: 5/28/08

THIS PORTION OF THE TECHNICAL SUBMISSION DESCRIBED BELOW HAS BEEN PREPARED UNDER THE DIRECT SUPERVISION AND RESPONSIBLE CHARGE OF THE UNDERSIGNED.
NAME DAVE E. NIELSON
DISCIPLINE PROFESSIONAL ENGINEER
SHEETS COVERED BY THIS SEAL C0316–A0017
DAVID E. NIELSON, STATE OF WASHINGTON, 28592, REGISTERED PROFESSIONAL ENGINEER
EXPIRES 9/23/08

THIS PORTION OF THE TECHNICAL SUBMISSION DESCRIBED BELOW HAS BEEN PREPARED UNDER THE DIRECT SUPERVISION AND RESPONSIBLE CHARGE OF THE UNDERSIGNED.
NAME RAYMOND E. MERRIMAN
DISCIPLINE PROFESSIONAL ENGINEER
SHEETS COVERED BY THIS SEAL E0104–E0124
RAYMOND E. MERRIMAN, STATE OF WASHINGTON, 12322, REGISTERED PROFESSIONAL ENGINEER
EXPIRES: 11-30-08

THIS PORTION OF THE TECHNICAL SUBMISSION DESCRIBED BELOW HAS BEEN PREPARED UNDER THE DIRECT SUPERVISION AND RESPONSIBLE CHARGE OF THE UNDERSIGNED.
NAME TONY R. BENEGAS
DISCIPLINE PROFESSIONAL ENGINEER
SHEETS COVERED BY THIS SEAL M0022–M0029
TONY R. BENEGAS, STATE OF WASHINGTON, 27910, REGISTERED PROFESSIONAL ENGINEER
11-22-08

DOCUMENT CONTROL 10/11/07

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	DRG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJV	TB		REM	NIA	TB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON
WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7–10
DRAWING LIST

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDG0027.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-G0027	0

River Corridor Closure Contract
Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-G0028	0

- N400000 — HANFORD COORDINATE GRID LINE
- EXISTING SURFACE FEATURE OR PIPE
- EXISTING UNDERGROUND PIPE
- NEW PIPELINE (CIVIL SHEETS) 10" DIA OR SMALLER
- CELL BOUNDARY
- NEW FENCE
- EXISTING FENCE
- EXIST. RAILING
- NEW RAILING
- CENTERLINE
- PROPERTY LINE
- 123 — CONTOUR LINE, FINISHED GRADE
- 123 — CONTOUR LINE, EXISTING GRADE
- 123.20 — FINISHED ELEVATION
- (123.20) — EXISTING ELEVATION
- NEW A.C. PAVING
- EXISTING A.C. PAVING
- NEW RAILROAD
- EXISTING RAILROAD
- SLOPE INDICATION
- LIMITS OF CONSTRUCTION
- FUTURE STRUCTURE OR FACILITY
- EXISTING STRUCTURE OR FACILITY
- EXISTING UNDERGROUND STRUCTURE OR FACILITY
- POTENTIAL FUTURE STRUCTURE OR FACILITY
- GRAVEL
- CONCRETE
- EARTH
- SAND
- GRATING
- LOW PERMEABILITY SOIL LINER
- GATE VALVE, BURIED WITH VALVE BOX
- BUTTERFLY VALVE, BURIED WITH VALVE BOX
- ECCENTRIC PLUG VALVE, BURIED WITH VALVE BOX
- FH — FIRE HYDRANT
- MH — MANHOLE
- PCOTG — PRESSURE CLEANOUT TO GRADE
- COTG — CLEANOUT TO GRADE
- CB — CATCH BASIN
- BULK WATER STATION
- BOLLARD
- SOIL TEST PIT
- SURVEY MONUMENTS

RIVER CORRIDOR CONTRACTORS
Dedicated To Safety Excellence
WCH

- SURVEY CONTROL POINT
- EXISTING WELL
- FUTURE WELL
- SOIL BORING LOCATION
- 3400 — COORDINATE POINT.
- DOWN GUY
- TELEPHONE/POWER POLE
- CHANGE IN PIPING MATERIAL
- ROUND OR DIAMETER
- SQUARE
- AT
- ANGLE
- 12" RW (24) — PIPE CALLOUT (DIA, FLUID ABBR, MATERIAL GROUP NO.)
- ME-2 — EQUIPMENT NUMBER (SEE EQUIPMENT SCHEDULE)
- NIC — EQUIPMENT, ITEMS OR DETAILS NOT PERTAINING TO THIS CONTRACT OR PROJECT ARE SHOWN THUS WITH THE NIC = NOT IN CONTRACT
- GATE VALVE
- BUTTERFLY VALVE
- ECCENTRIC PLUG VALVE
- GLOBE VALVE
- BALL VALVE
- DIAPHRAGM VALVE
- CHECK VALVE
- PRESSURE REGULATING VALVE
- BACK-PRESSURE VALVE
- FLOAT OPERATED VALVE
- NEEDLE VALVE
- PRESSURE RELIEF VALVE
- M P — MOTOR OPERATOR FOR VALVES (M = ELECTRIC, P = PNEUMATIC)
- S — SOLENOID VALVE
- HOSE BIBB (H/B)
- B — BUBBLER LEVEL CONTROL
- CENTRIFUGAL OR TURBINE PUMP OR FAN
- CHEMICAL FEED PUMP
- PROGRESSING CAVITY, POSITIVE DISPLACEMENT PUMP
- BLOWER OR COMPRESSOR
- INJECTOR OR EDUCTOR

- AIR VACUUM AND AIR RELEASE ASSEMBLY
- THERMOMETER
- PIPE ANCHOR
- STOP GATE
- SLIDE GATE
- SLUICE GATE
- INLINE STATIC MIXER
- HUB DRAIN
- FLOOR DRAIN
- DRAIN
- DRAIN TRAP
- CUT PIPE
- FEXT — FIRE EXTINGUISHER
- G — PRESSURE GAUGE
- G — PRESSURE GAUGE WITH DIAPHRAGM SEAL
- S — PRESSURE SWITCH
- S — PRESSURE SWITCH WITH DIAPHRAGM SEAL
- FLANGED FITTING
- WELDED FITTING
- MECHANICAL-TYPE FITTING (GROOVED)
- SCREWED, SOCKET-WELD, BELL AND SPIGOT OR HUBLESS FITTING
- SLEEVE-TYPE COUPLING
- FLANGED ADAPTER COUPLING
- FLANGED ADAPTER - SET SCREW TYPE
- EXPANSION JOINT
- MECHANICAL TYPE COUPLING
- FLEXIBLE COUPLING
- UNION
- QUICK DISCONNECT COUPLER
- CAPPED END OR PLUGGED END
- BLIND FLANGE
- REDUCER OR EXPANDER
- STRAINER
- M M — MAGNETIC METER
- D M — DENSITY METER
- ORIFICE PLATE AND FLANGES
- ROTAMETER

- PIPE SUPPORT (IN PLAN ONLY)
- MALE FIRE HOSE CONNECTION WITH CAP

SECTION AND DETAIL IDENTIFICATION

SECTION IDENTIFICATION

(1) SECTION CUT SHOWN ON DRAWING AS:

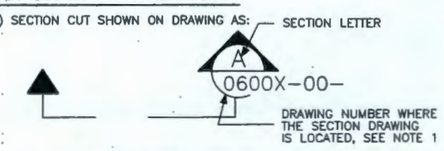

(2) ON DRAWING NUMBER 0600X-DD- THIS SECTION IS IDENTIFIED AS:

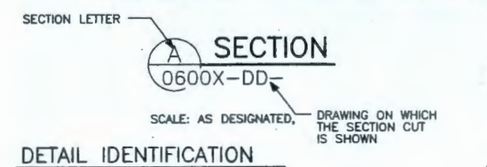

DETAIL IDENTIFICATION

(1) DETAIL IDENTIFICATION SHOWN ON DRAWING AS:

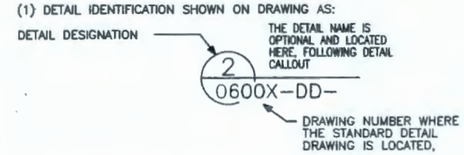

(2) ON DRAWING NUMBER 0600X-DD-- THIS DETAIL IDENTIFIED AS:



RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15593 SHT01	600G	0000

NOTES

1. IF PLAN AND SECTION (OR DETAIL CALL-OUT AND DETAIL) ARE SHOWN ON SAME DRAWING, DRAWING NUMBER IS REPLACED BY A HORIZONTAL LINE.
2. SOME SYMBOLS SHOWN ON THIS DRAWING MAY NOT BE USED ON OTHER DRAWINGS.
3. ELECTRICAL SYMBOLS SHOWN ON DRAWING 0600X-DD-E0104.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1 ☒ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3 ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

REVIEW DISPOSITION	1	2	3	4	5
		✓			

REVIEWER: Bill Dorlaug — 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G0528 — 05-19 — 004
SCOPE No. — SUBJECT ITEM — SUBMITTAL
SCOPE SUBMITTAL: 5COX 528 A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL date 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEPREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRANDT — STATE OF WASHINGTON — 9/28/07 — 42158 — REGISTERED PROFESSIONAL ENGINEER

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JW	CJB	Ebm	JCB	N/A	JCB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
SYMBOLS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDG0028.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-G0028	0

DRAWING NO.	REV. NO.
0600X-DD-G0029	0

AB	ANCHOR BOLT
ABAND	ABANDONED
ABBR	ABBREVIATION
AC	ASPHALT CONCRETE
A/C	AIR CONDITIONING
ACFM	ACTUAL CUBIC FEET PER MINUTE
ACOUS	ACOUSTIC OR ACOUSTICAL
ACP	ASPHALTIC CONCRETE PAVEMENT
AER	AERATION
AH	AHEAD
AL	ALUM
ALUM	ALUMINUM
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE (FORMERLY A.S.A.)
API	AMERICAN PETROLEUM INSTITUTE
APPVD	APPROVED
APPROX	APPROXIMATE
ARCH	ARCHITECTURAL
ASME	AMERICAN SOCIETY OF MECHANICAL ENGINEERS
ASPH	ASPHALT
ASTM	AMERICAN SOCIETY FOR TESTING AND MATERIAL
ASSY	ASSEMBLY
ATM	ATMOSPHERE
AVAR	AIR VACUUM AND AIR RELEASE
AWWA	AMERICAN WATER WORKS ASSOCIATION
BC	BEGIN CURVE OR BOLT CIRCLE
BCR	BEGIN CURB RETURN
BD	BOARD
BFP	BACK FLOW PREVENTER
BHP	BRAKE HORSEPOWER
BK	BACK
BLDG	BUILDING
BLD FLG	BLIND FLANGE
BLK	BLACK OR BLOCK
BLKG	BLOCKING
BM	BEAM OR BENCH MARK
BO	BLOW-OFF ASSEMBLY
BOD	BIOCHEMICAL OXYGEN DEMAND
BOT	BOTTOM
BPV	BACK PRESSURE VALVE
B & S	BELL AND SPIGOT
BRG	BEARING
BSMT	BASEMENT
BTU	BRITISH THERMAL UNIT
BTUH	BRITISH THERMAL UNIT PER HOUR
BETW	BETWEEN
BFV	BUTTERFLY VALVE
BVC	BEGIN VERTICAL CURVE
BWV	BACK WATER VALVE
C	CELSIUS
CAP	CAPACITY
CATH	CATHODIC
CB	CATCH BASIN
CC	CENTER TO CENTER
CD	CEILING DIFFUSER
CFH	CUBIC FEET PER HOUR
CFM	CUBIC FEET PER MINUTE
CFS	CUBIC FEET PER SECOND
CHEM	CHEMICAL
CHK V	CHECK VALVE
CHKD PL	CHECKERED PLATE
CHLR	CHLORINATOR
CI	CAST IRON
CKT	CIRCUIT
CL	CHLORINE GAS, CHAIN LINK OR CENTERLINE
CLR	CLEAR OR CLEARANCE
CLG	COOLING
CM	CENTIMETER
CML & C	CEMENT MORTAR LINED AND COATED
CMP	CORRUGATED METAL PIPE
CMU	CONCRETE MASONRY UNITS
CO	CLEANOUT
COL	COLUMN
COMB	COMBINATION
COND	CONDUIT
COORD	COORDINATE
COR	CORNER
CONC	CONCRETE
CONN	CONNECTION
CONSTR	CONSTRUCTION OR CONSTRUCT
CONT	CONTINUED OR CONTINUOUS
CONTR	CONTRACTOR
COMP	COMPRESSOR
COTG	CLEAN-OUT TO GRADE
CPLG	COUPLING
CS	CAUSTIC SODA
CT STL	CAST STEEL
CTSK	COUNTERSUNK
CTR	CENTER
CU	COPPER OR CUBIC
CYL	CYLINDER
CWO	CHAIN WHEEL OPERATOR
DET	DETAIL
DF	DRINKING FOUNTAIN
DG	DOOR GRILLE
DI	DUCTILE IRON
DIA	DIAMETER
DIAG	DIAGONAL
DIAPH	DIAPHRAGM
DISCH	DISCHARGE
DISP	DISPENSER
DN	DOWN OR DECANT
DO	DISSOLVED OXYGEN
DOCS	DAILY OPERATIONAL COVER STOCKPILE
DOE	DEPARTMENT OF ENERGY
DR	DRAIN
DS	DRENCH SHOWER AND EYE WASH
DWG(S)	DRAWING(S)
DIFF	DIFFUSER
DIFRTL	DIFFERENTIAL
E	EAST
EA	EACH
EC	END CURVE
ECC	ECCENTRIC
ECR	END CURB RETURN
EF	EACH FACE
EFL	EFFLUENT
EG	EXHAUST GRILLE
EL	ELEVATION
ELEC	ELECTRICAL OR ELECTRONIC
EMBED	EMBEDMENT
ENC	ENCASEMENT
ENCL	ENCLOSURE
ENG	ENGINE
EQL	EQUAL
EQUIP	EQUIPMENT
EVAP	EVAPORATION, EVAPORATOR
EVC	END VERTICAL CURVE
EW	EACH WAY
EWH	EYE WASH
EXH	EXHAUST
EXHF	EXHAUST FAN
EX-HY	EXTRA HEAVY
EXST	EXISTING
EXP	EXPANSION
EXP JT	EXPANSION JOINT
EXT	EXTERIOR OR EXTENSION
F	FAHRENHEIT
FABR	FABRICATION, FABRICATE OR FABRICATED
FAI	FRESH AIR INTAKE
FB	FLAT BAR
FCO	FLOOR CLEANOUT
FD	FLOOR DRAIN
FD BK	FIELD BOOK
FDN	FOUNDATION
FDR	FEEDER
FE	FINAL EFFLUENT
FEXT	FIRE EXTINGUISHER
FF	FLAT FACE OR FAR FACE
F TO F	FACE TO FACE
FG	FINISHED GRADE
FH	FIRE HYDRANT
FIG	FIGURE
FIT	FUEL ISLAND TERMINAL
FL	FLOWLINE
FLEX	FLEXIBLE
FLOCC	FLOCCULATOR OR FLOCCULATION
FLG	FLANGE
FLGD	FLANGED
FLR	FLOOR
FLR BM	FLOOR BEAM
FMH	FLEXIBLE METAL HOSE
FNSH	FINISH OR FINISHED
FOC	FACE OF CONCRETE
FOM	FACE OF MASONRY
FOS	FACE OF STUDS
FOW	FACE OF WALL
FPC	FLEXIBLE PIPE COUPLING
FPM	FEET PER MINUTE
FPS	FEET PER SECOND
FRP	FIBERGLASS REINFORCED PLASTIC
FS	FAR SIDE, FLOOR SINK, FINISHED SURFACE, FORGED STEEL OR FROTH SPRAY
FT	FEET OR FOOT
FTG	FOOTING
FUT	FUTURE
FWW	FILTER WASTE WASHWATER
GA	GAGE OR GAUGE
GAL	GALLON
GALV	GALVANIZED
GEN	GENERAL OR GENERATOR
GFA	GROOVED FLANGE ADAPTER
GI	GALVANIZED IRON
GLV	GLOBE VALVE
GND	GROUND
GPD	GALLONS PER DAY
GPH	GALLONS PER HOUR
GPM	GALLONS PER MINUTE
GPR	GROUND PENETRATING RADAR
GRD	GRADE
GR BRK	GRADE BREAK
GV	GATE VALVE
GVL	GRAVEL
GYP	GYPSUM
H	HEIGHT
H/B	HOSE BIBB
HDR	HEADER
HDPE	HIGH DENSITY POLYETHYLENE
HEX	HEXAGONAL
Hg	MERCURY
HORIZ	HORIZONTAL
HP	HORSEPOWER
HPR	HIGH PRESSURE
HPT	HIGH POINT
HR	HEATING RETURN OR HOUR
HTG	HEATING
HTR	HEATER
H & V	HEATING AND VENTILATING
HVAC	HEATING, VENTILATING AND AIR CONDITIONING
HWO	HANDWHEEL OPERATED
HYD	HYDRAULIC OR HYDRANT
ICFM	INLET CUBIC FEET PER MINUTE
	INSIDE DIAMETER
IO	INSIDE FACE
IF	INCH
INFL	INFLUENT
INSUL	INSULATION OR INSULATED
INSTR	INSTRUMENT OR INSTRUMENTATION
INTFC	INTERFACE
INVT	INVERT ELEVATION
I/O	INPUT/OUTPUT
IP	IRON PIPE
IPS	IRON PIPE STANDARD
IRRG	IRRIGATION
JAN	JANITOR
JT	JOINT
KG	KILOGRAM
KM	KILOMETER
KV	KILOVOLT
KW	KILOWATT
KWH	KILOWATT HOUR
L	LITER OR LENGTH
LAV	LAVATORY
LB	POUND
LCU	LOCAL CONTROL UNIT
LVL	LEVEL
LG	LONG
LO	LEVER OPERATED
LOC	LOCATION
LPT	LIGHT POLE
LP	LOW POINT
LPV	LUBRICATED PLUG VALVE
LT	LEFT
LWR	LOWER
LGTH	LENGTH
M	METER
MAG	MAGNETIC
MAN	MANUAL
MACH	MACHINE
MAX	MAXIMUM
MCC	MOTOR CONTROL CENTER
MECH	MECHANICAL
MFR	MANUFACTURER
MGD	MILLION GALLONS PER DAY
MH	MANHOLE
MI	MALLEABLE IRON
MIN	MINIMUM
MISC	MISCELLANEOUS
MK	MARK
MO	MOTOR OPERATED OR MASONRY OPENING
MOD	MODEL
MS	MOP SINK
MTC	MECHANICAL-TYPE COUPLING
MT	MOUNT
MATL	MATERIAL
MTR	MOTOR
N	NORTH
NAD	NORTH AMERICAN DATUM
NAVD	NORTH AMERICAN VERTICAL DATUM
NBS	NATIONAL BUREAU OF STANDARDS
NC	NORMALLY CLOSED
NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
NF	NEAR FACE
NIC	NOT IN CONTRACT
NO	NUMBER OR NORMALLY OPEN
NPS	NOMINAL PIPE SIZE (FORMERLY I.P.S.)
NPT	NATIONAL PIPE THREAD
NRS	NON-RISING STEM
NS	NEAR SIDE
NTS	NOT TO SCALE
OC	ON CENTER
OD	OUTSIDE DIAMETER
OF	OVERFLOW OR OUTSIDE FACE
OPER	OPERATOR OR OPERATING
OPNG	OPENING
OS & Y	OUTSIDE SCREW AND YOKE
OVHD	OVERHEAD
OZ	OUNCE
P	POLE OR PAGE
PAVMT	PAVEMENT
PC	PRIMARY CLARIFIER OR PORTLAND CEMENT
PCOTG	PRESSURE CLEANOUT TO GRADE
PE	POLYELECTROLYTE OR POLYMER
PEF	PLANT EFFLUENT
PEN	PENETRATION
PER	PERIMETER
PG	PRESSURE GAGE
pH	HYDROGEN ION CONCENTRATION
PI	POINT OF INTERSECTION
PIV	POST INDICATOR VALVE
PL	PLACES
PLAS	PLASTER OR PLASTIC
PNEU	PNEUMATIC
POB	POINT OF BEGINNING
POE	POINT OF END
PP	POWER POLE
PLT	PLANT
PNLBD	PANEL BOARD
PPD	POUNDS PER DAY
PPH	POUNDS PER HOUR
PPM	PARTS PER MILLION
PR	PAIR
PRC	POINT OF REVERSE CURVATURE
PRE	PREVIOUS
PRESS	PRESSURE
PRV	PRESSURE REGULATING, RELIEF OR REDUCING VALVE
PS	PRESSURE SWITCH
PSF	POUNDS PER SQUARE FOOT
PSI	POUNDS PER SQUARE INCH
PSIA	POUNDS PER SQUARE INCH ABSOLUTE
PSIG	POUNDS PER SQUARE INCH GAUGE
PT	POINT OR POINT OF TANGENCY
PV	PLUG VALVE
PVC	POLYVINYL CHLORIDE
PW	POTABLE WATER
PWR	POWER
RAD	RADIUS
RADN	RADIATION
RAG	RETURN AIR GRILLE
RC	REINFORCED CONCRETE
RCA	RADIOLOGICAL CONTROLLED AREA
RCP	REINFORCED CONCRETE PIPE
RD	ROOF DRAIN, ROUND, OR ROAD
RDWD	REDWOOD
RDCR	REDUCER
RECM	RECOMMENDATION
REF	REFERENCE OR REFER
REG	REGULATING
REINF	REINFORCE OR REINFORCED
RE-STL	REINFORCING STEEL
REQD	REQUIRED
RET	RETURN
REV	REVISION
RF	RAISED FACE
RLF	RELIEF
RM	ROOM
ROS	RATE OF SLOPE
RPM	REVOLUTIONS PER MINUTE OR REINFORCED PLASTIC MORTAR
RR	RAILROAD
RT	RIGHT
RW	RAW WATER
R/W	RIGHT OF WAY
RWL	RAINWATER LEADER
S	SOUTH
SA	SAMPLE
SC	SPARE CHEMICAL OR SECONDARY CLARIFIER
SCC	SOLIDS CONTACT CLARIFIER
SCD	SCREWED
SCFM	STANDARD CUBIC FEET PER MINUTE
SCH	SCHEDULE
SCHED	SCHEDULE
SDR	STORM DRAINS
SCA	SOIL CONTAMINATION AREA
SEC	SECONDARY
SECT	SECTION
SER	SERIES
SER SK	SERVICE SINK
SETT	SETTLING
SH	SHOWER
SHT	SHEET
SIM	SIMILAR
SL	SLUDGE
SLP	SLOPE
SLV	SLEEVE
SP	SPACING
SPECS	SPECIFICATIONS
SQ	SQUARE
SS	SANITARY SEWER
SST	STAINLESS STEEL
SSU	SECONDS SAYBOLT UNIVERSAL
STA	STATION
STC	SLEEVE-TYPE COUPLING
STD	STANDARD
STL	STEEL
STM	STEAM
STN	STAINLESS
SST	STAINLESS STEEL
STR TRD	STAIR TREAD
STRUCT	STRUCTURAL OR STRUCTURE
SUBST	SUBSTITUTE
SUCT	SUCTION
SURV	SURVEY
SV	SOLENOID VALVE
SW	SANITARY WATER
SWR	SIDEWALL REGISTER
SYM	SYMMETRICAL OR SYMBOL
SYS	SYSTEM
T	THERMOSTAT OR TANGENT
TB	THRUST BLOCK
T & B	TOP AND BOTTOM
TBC	TOP BACK OF CURB
TBE	THREAD BOTH ENDS
TBM	TEMPORARY BENCH MARK
TC	TOP OF CURB
TDH	TOTAL DYNAMIC HEAD
TELE	TELEPHONE
TEMP	TEMPORARY
TERM	TERMINAL
T & G	TONGUE AND GROOVE
THK	THICK OR THICKNESS
THD	THREADED
THRHLD	THRESHOLD
TK	TANK
TOE	THREAD ONE END
TOG	TOP OF GRATING
TOL	TOLERANCE
TOS	TOP OF STEEL
TOW	TOP OF WALL
TP	TELEPHONE POLE OR TELEGRAPH POLE
TRANS	TRANSITION
TRTMT	TREATMENT
TV	THERMOSTATIC VALVE
TW	THERMOMETER WELL
TYP	TYPICAL
UBC	UNIFORM BUILDING CODE
UC	UNDER-CROSSING
UGND	UNDERGROUND
UGC	UNDERGROUND CONDUIT
UH	UNIT HEATER
UL	UNDERWRITERS LABORATORIES
UNO	UNLESS NOTED OTHERWISE
UP	UTILITY POLE
UR	URINAL
USACE	UNITED STATES ARMY CORP OF ENGINEERS
V	VENT, VOLT
VAC	VACUUM
VAR	VARIES OR VARIABLE
VCP	VITRIFIED CLAY PIPE
VERT	VERTICAL
VLV	VALVE
VOL	VOLUME
VPC	VERT POINT OF CURVATURE
VPI	VERT POINT OF INTERSECTION
VPRC	VERT POINT OF REVERSE CURVE
VPT	VERT POINT OF TANGENCY
VTC	VENT TO CEILING
VTR	VENT THROUGH ROOF
W	WEST OR WIDTH
W/	WITH
WC	WATER COLUMN OR WATER CLOSET
WCO	WALL CLEANOUT
WD	WOOD
WOG	WATER, OIL, GAS
W/O	WITHOUT
WS	WATER SURFACE
WSCOT	WAINSCOT
WSTP	WATER STOP
WT	WEIGHT
WWF	WELDED WIRE FABRIC
WWM	WELDED WIRE MESH
XFR	TRANSFER
XFMR	TRANSFORMER
XING	CROSSING
XMTR	TRANSMITTER
XS	EXTRA STRONG
YD	YARD

RIVER CORRIDOR CLOSURE CONTRACT
Dedicated To Safety Excellence
WCH

NOTES

1. SOME ABBREVIATIONS SHOWN ON THIS DRAWING MAY NOT BE USED ON THESE CONTRACT DRAWINGS.
2. FOR ABBREVIATIONS NOT LISTED, SEE "ABBREVIATIONS FOR USE ON DRAWINGS AND TEXT" PUBLISHED BY THE AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI) UNDER STANDARD ABBREVIATIONS Y14.38.
3. ELECTRICAL ABBREVIATIONS SHOWN ON DRAWING 0600X-DD-E0105.
4. PIPING ABBREVIATIONS SHOWN ON DRAWING 0600X-DD-M0023.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☑ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borlaug — 10/9/07
0600X-SC-G0524 — 05-19 — 005
S00X524 A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

Best Available Copy

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIEST — STATE OF WASHINGTON — 42158 REGISTERED PROFESSIONAL ENGINEER — 9/28/07
EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJV	CJB	[illegible]	BH	N/A	CB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
ABBREVIATIONS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDG0029.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-G0029	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15594 SHT01	600G	0000

DRAWING NO.	REV. NO.
0600X-DD-C0258	0

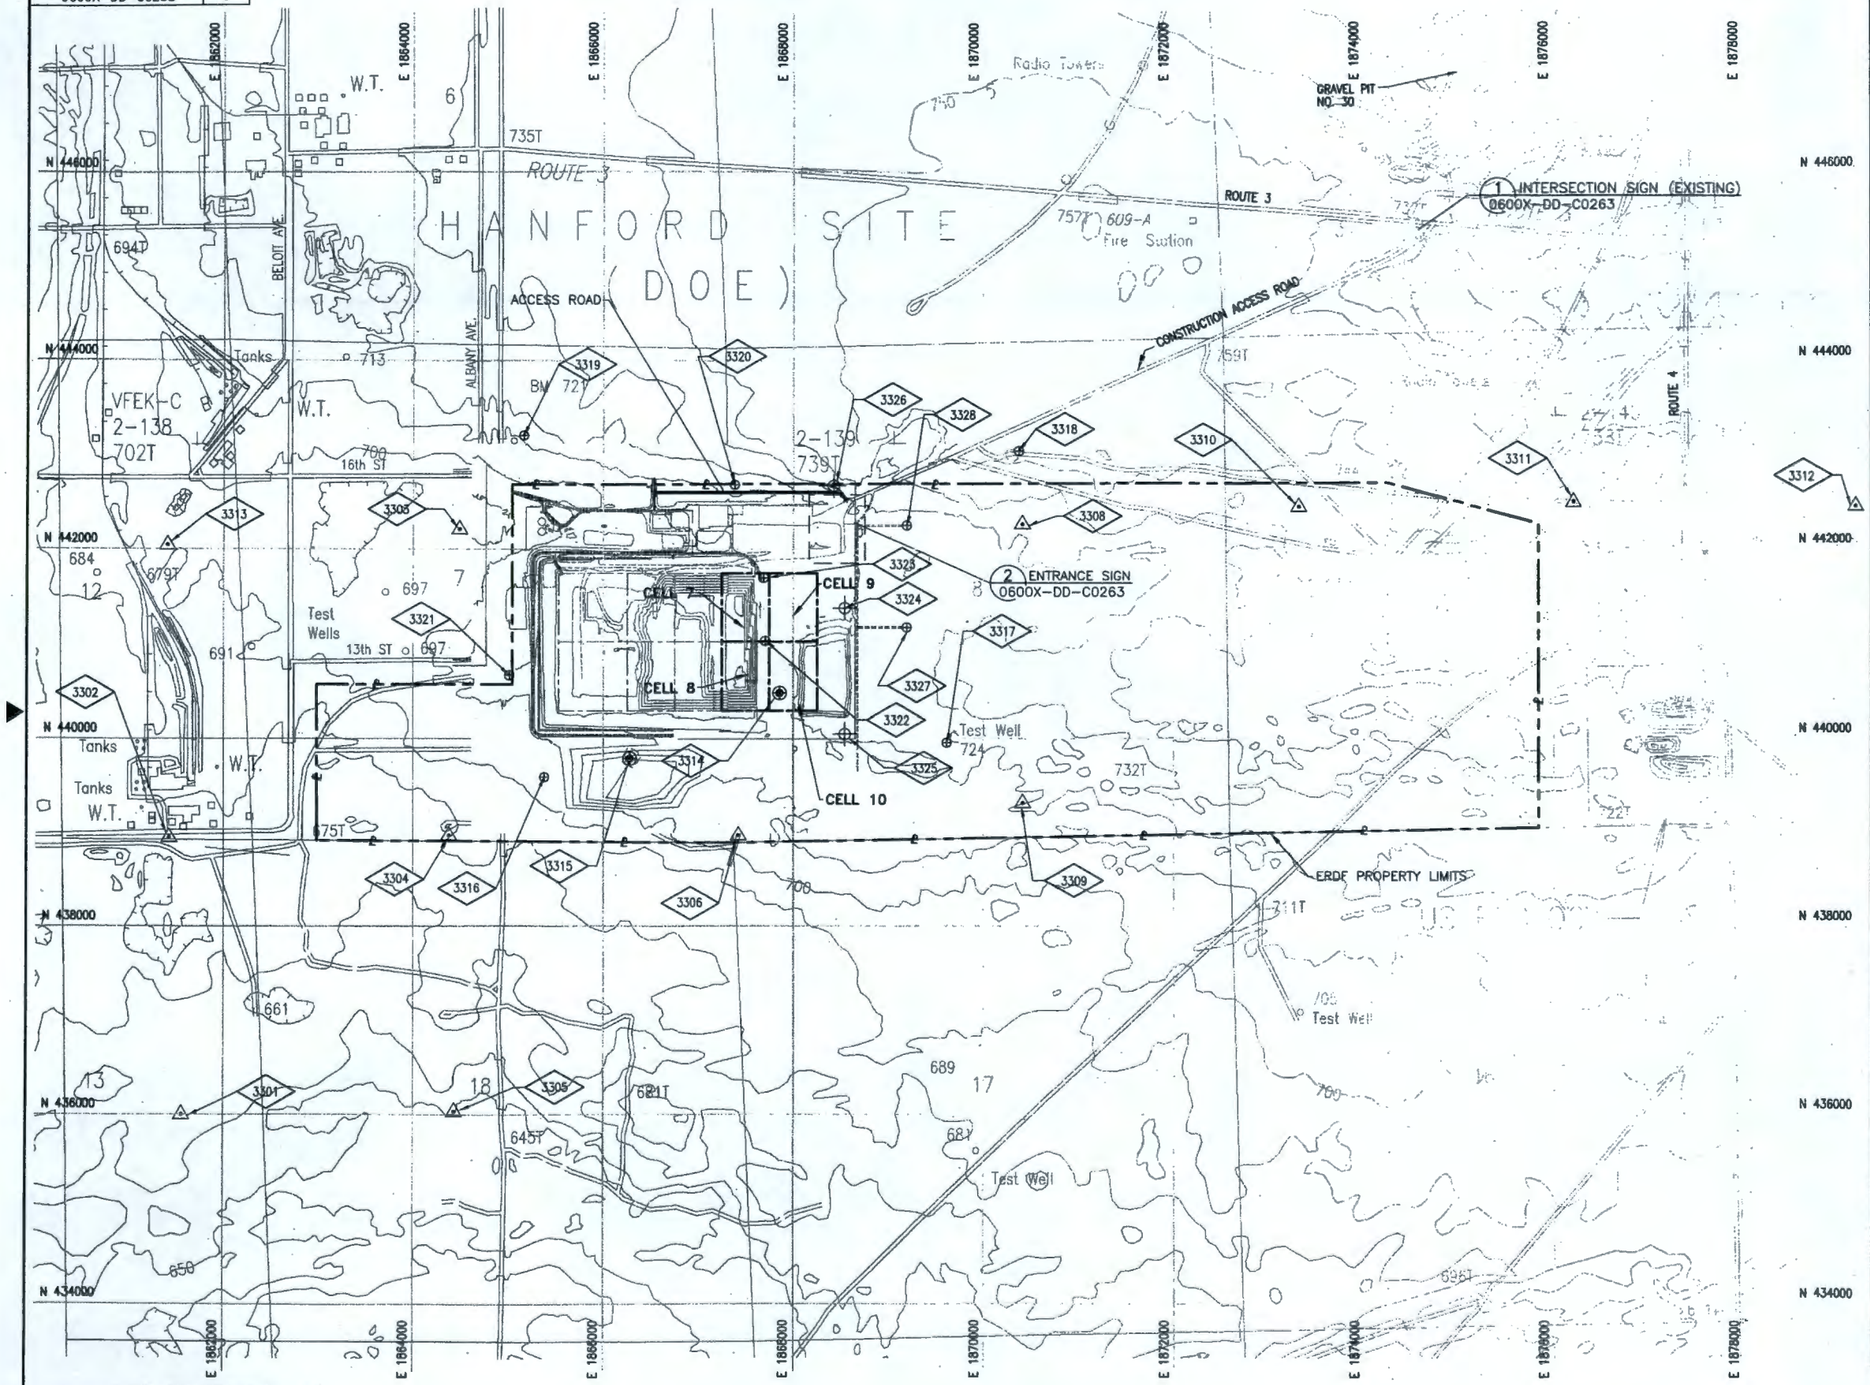

NOTES

1. REGIONAL TOPOGRAPHY SHOWN IS FROM THE ORIGINAL SURVEY FOR THE ERDF SITE PRIOR TO CONSTRUCTION OF CELLS 1,2, 3 AND 4. SOME VARIATION WILL BE FOUND IN EXISTING CONTOURS AND ELEVATIONS FROM THAT SHOWN.
2. TOPOGRAPHY IN THE VICINITY OF THE PROJECT IS FROM FIELD SURVEY FROM ROGERS SURVEYING, INC., JULY 2006.
3. TOPOGRAPHY IS SHOWN IN FEET ABOVE SEA LEVEL.
4. SUBCONTRACTOR ACCESS TO PROJECT SITE SHALL BE FROM THE CONSTRUCTION ACCESS ROAD.
5. SUBCONTRACTOR SHALL VERIFY ALL CONTOURS AND ELEVATIONS THAT EFFECT CONSTRUCTION ACTIVITIES.
6. SURVEY DATUM
   VERTICAL NAVD 88
   HORIZONTAL NAD 83 (91)
7. SEE DRAWING 0600X-DD-C0261 FOR COORDINATE INFORMATION.

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may not proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the original.
Bill Boelake 10/7/07
DOCUMENT ID NUMBER: 0600X-SC-G0589 06-19 006
SCALE: 500X594A00

N

SCALE
0 750 1500 feet
CONTOUR INTERVAL: 10 FT

DOCUMENT CONTROL date 10/11/07

Best Available Copy

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGGS — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/24/07
EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/24/07	ISSUED FOR CONSTRUCTION	JJV	CJB	[illegible]	BJH	NIA	PB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7–10
OVERALL SITE PLAN

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0258.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0258	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15595 SHT01	600G	0110

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0259	0

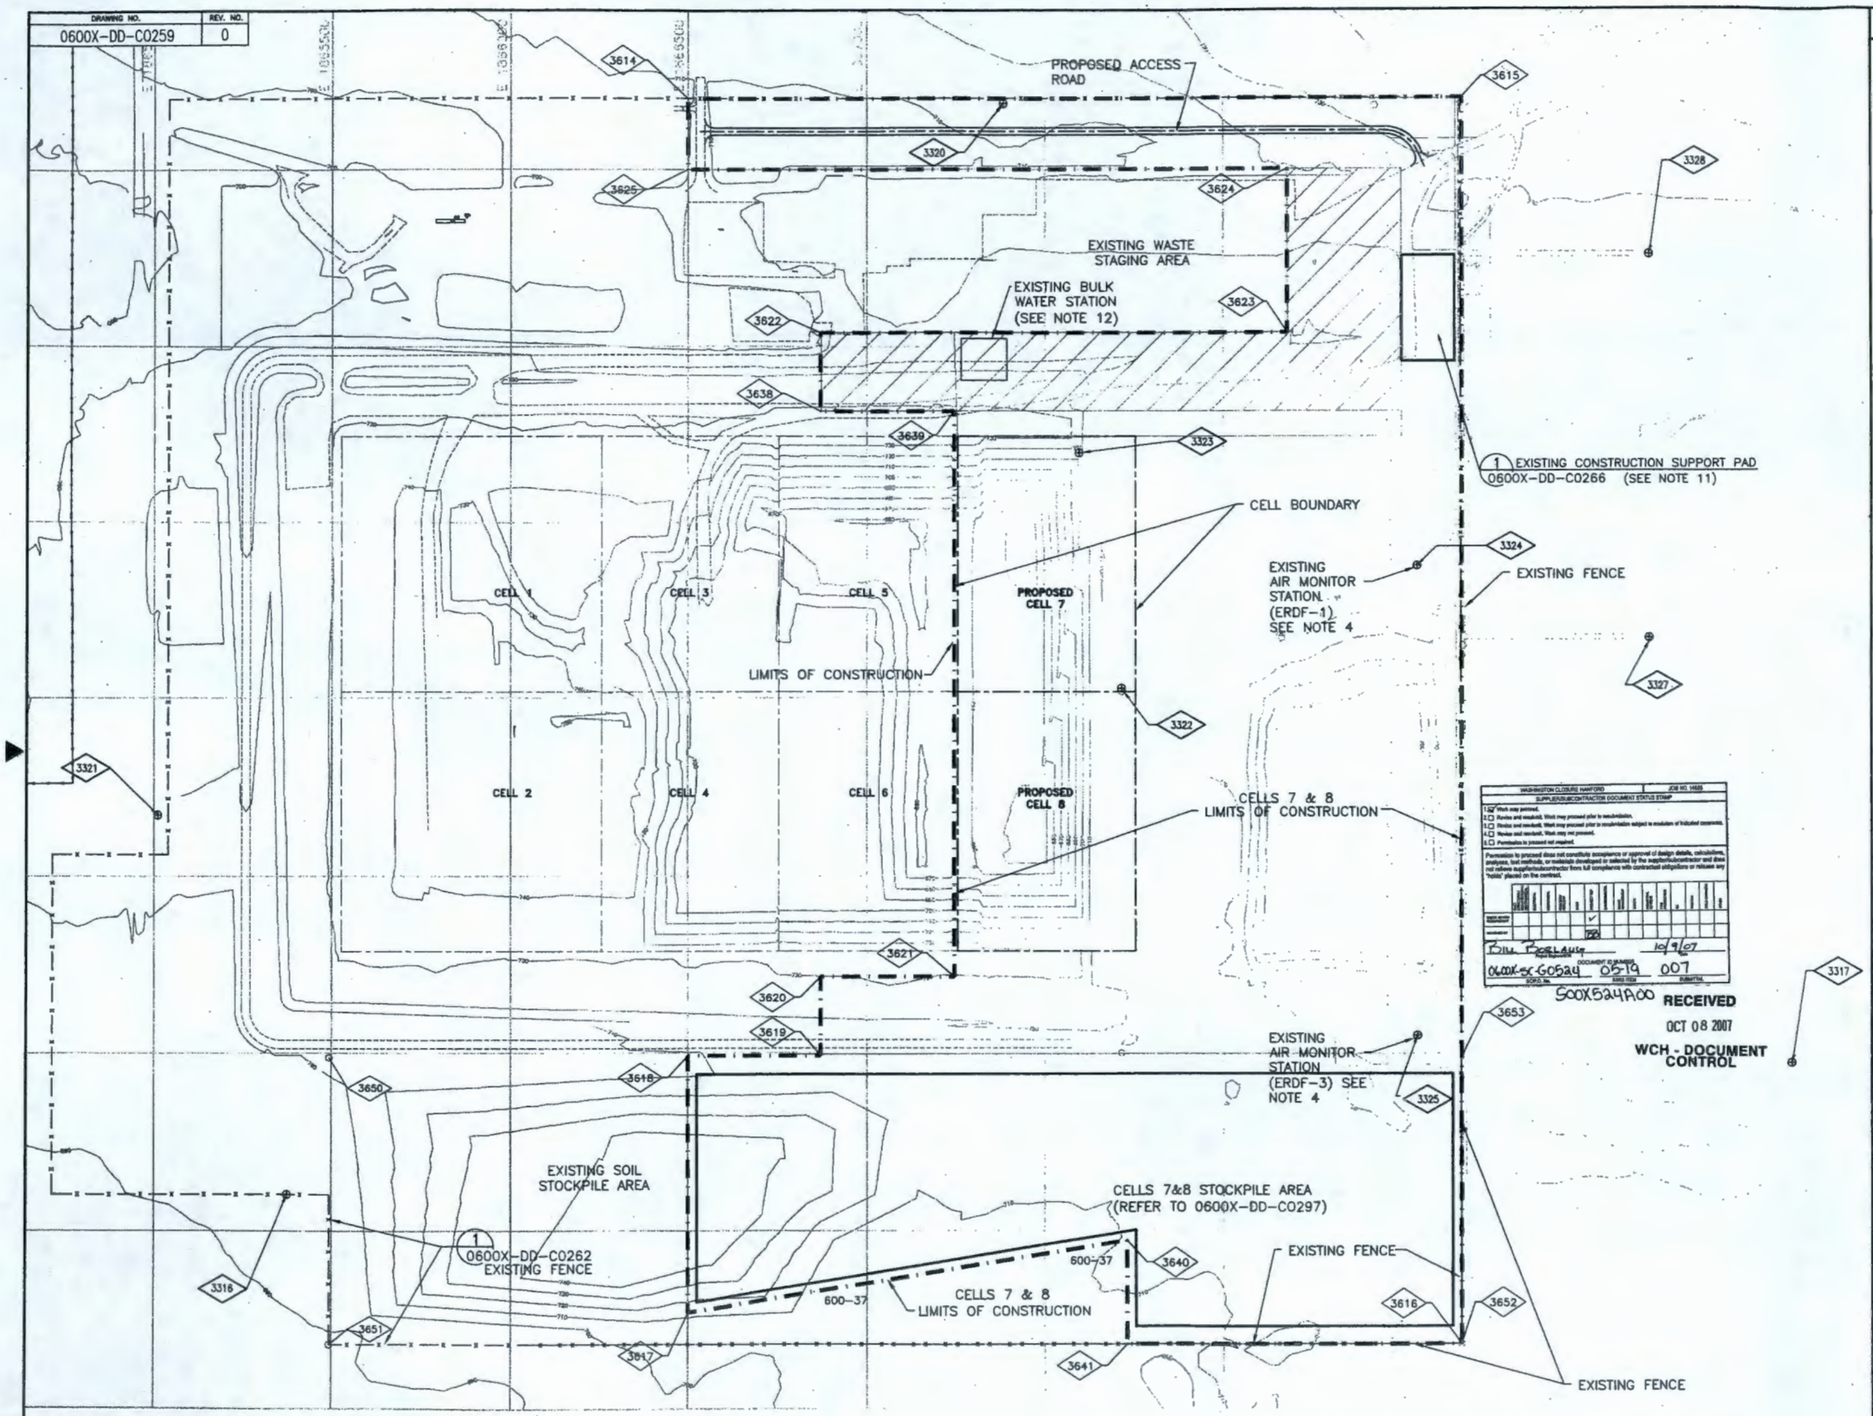

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "hold" placed on the contract.

REVIEW DISCIPLINE								
ENGINEERING								
CONSTRUCTION								

Bill Boelaus 10/9/07
DOCUMENT NUMBER: 0600X-SC-G0524 0519 007
SUBCONTRACTOR NO. — SUBCONTRACT NO. — SUBMITTAL
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

NOTES

1. ALL WORK AREAS WITHIN THE LIMITS OF CONSTRUCTION SHALL BE CLEARED UNLESS OTHERWISE NOTED. OBTAIN CONTRACTO APPROVAL PRIOR TO CLEARING AREAS.
2. PROTECT AND MAINTAIN EXISTING FENCE AND GATE. AT ALL TIMES. WHEN THE ERDF PERIMETER FENCE IS NOT CONTINUOUS AND SOUND, SUBCONTRACTOR SHALL PROVIDE AND MAINTAIN MANNED SECURITY. ONE SECURITY OFFICER SHALL BE PROVIDED AT EACH UNSECURED LOCATION AND FOR EVERY 100m(328 FT) OF UNSECURED FENCE LINE.
3. SURVEY DATUM:
   VERTICAL NAVD 88
   HORIZONTAL NAD 83 (91)
4. SUBCONTRACTOR SHALL PROTECT AIR MONITORING STATIONS.
5. SEE DWG 0600X-DD-C0261 FOR COORDINATE INFORMATION.
6. SHARED ACCESS AREA WITH ERDF OPERATIONS. SUBCONTRACTOR SHALL COORDINATE ACTIVITIES WITH CONTRACTOR. AREA MUST BE ACCESSIBLE BY ERDF OPERATIONS AT ALL TIMES UNLESS AUTHORIZED OTHERWISE BY THE CONTRACTOR.
7. EXACT STOCKPILE BOUNDARIES VARY DUE TO ERDF OPERATION. A GENERAL REPRESENTATION IS SHOWN.
8. THE LIMITS OF CONSTRUCTION INDICATE THE AREA WITHIN WHICH THE SUBCONTRACTOR HAS FREE ACCESS. IN SOME CASES, THE SUBCONTRACTOR MAY BE REQUIRED TO PERFORM WORK OUTSIDE THE LIMITS SHOWN (e.g. PULLING WIRE THROUGH EXISTING PULL BOXES AND TIE NEW WORK INTO EXISTING) IN THESE INSTANCES THE SUBCONTRACTOR SHALL NOTIFY THE CONTRACTOR 48 HOURS IN ADVANCE AND SHALL MINIMIZE THE TIME REQUIRED TO PERFORM THE WORK.
9. TOPOGRAPHY IN THE VICINITY OF THE PROJECT IS FROM FIELD SURVEY BY ROGERS SURVEYING INC., JULY 2006.
10. CONSTRUCTION ACCESS GATE AND ROAD MAY BE USED BY OTHERS.
11. CONTRACTOR AND SUBCONTRACTOR TRAILERS TO BE LOCATED AT CONSTRUCTION SUPPORT PAD.
12. SUBCONTRACTOR MAY CONNECT TO EXISTING BULK WATER STATION LINE. SUBCONTRACTOR MAY PROVIDE AND INSTALL PIPELINE TO SUPPORT SUBCONTRACTOR'S WORK.

DOCUMENT CONTROL mle 10/11/07

Best Available Copy

0 100' 200' 400'

N

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGGS — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRFT CHK	DRG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJV	CJB	[illegible]	JH	NA	JBB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7–10
CONSTRUCTION LIMITS AND FENCE LOCATION–CELLS 7 & 8

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0259.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0259	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15596 SHT01	600G	0110

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0260	0

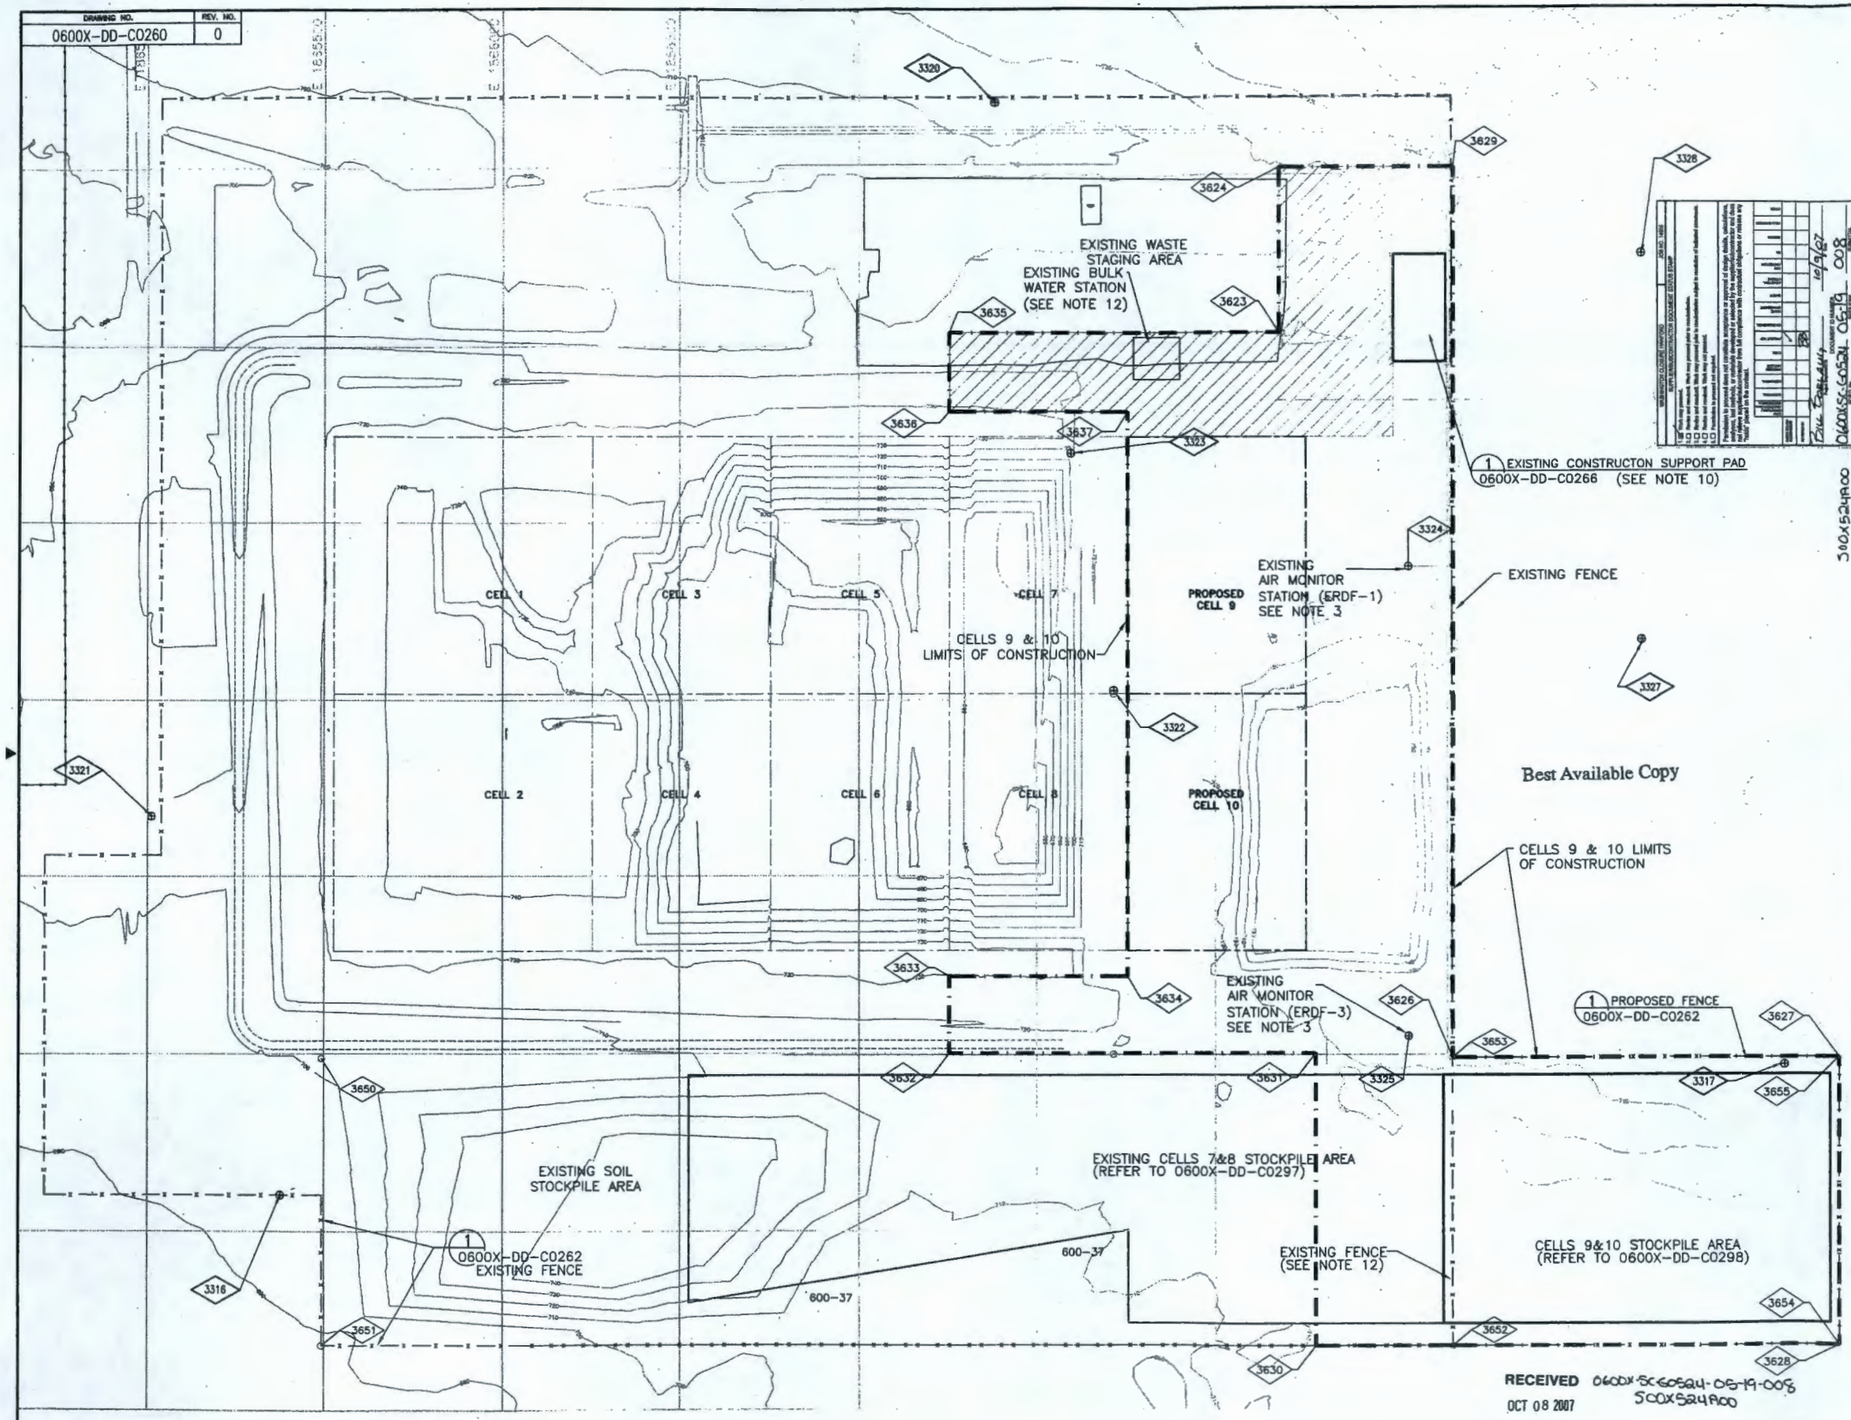

Best Available Copy

NOTES

1. ALL WORK AREAS WITHIN THE LIMITS OF CONSTRUCTION SHALL BE CLEARED UNLESS OTHERWISE NOTED. OBTAIN CONTRACTOR APPROVAL PRIOR TO CLEARING AREAS.
2. SURVEY DATUM:
   VERTICAL NAVD 88
   HORIZONTAL NAD 83 (91)
3. SUBCONTRACTOR SHALL PROTECT AIR MONITORING STATIONS.
4. SEE DWG 0600X-DD-C0261 FOR COORDINATE INFORMATION.
5. SHARED ACCESS AREA WITH ERDF OPERATIONS. SUBCONTRACTOR SHALL COORDINATE ACTIVITIES WITH CONTRACTOR. AREA MUST BE ACCESSIBLE BY ERDF OPERATIONS AT ALL TIMES UNLESS AUTHORIZED OTHERWISE BY THE CONTRACTOR.
6. EXACT STOCKPILE BOUNDARIES VARY DUE TO ERDF OPERATION. A GENERAL REPRESENTATION IS SHOWN.
7. THE LIMITS OF CONSTRUCTION INDICATE THE AREA WITHIN WHICH THE SUBCONTRACTOR HAS FREE ACCESS. IN SOME CASES, THE SUBCONTRACTOR MAY BE REQUIRED TO PERFORM WORK OUTSIDE THE LIMITS SHOWN (e.g. PULLING WIRE THROUGH EXISTING PULL BOXES AND TIE NEW WORK INTO EXISTING) IN THESE INSTANCES THE SUBCONTRACTOR SHALL NOTIFY THE CONTRACTOR 48 HOURS IN ADVANCE AND SHALL MINIMIZE THE TIME REQUIRED TO PERFORM THE WORK.
8. TOPOGRAPHY IN THE VICINITY OF THE PROJECT IS FROM FIELD SURVEY BY ROGERS SURVEYING, INC., JULY 2006.
9. CONSTRUCTION ACCESS GATE AND ROAD MAY BE USED BY OTHERS.
10. CONTRACTOR AND SUBCONTRACTOR TRAILERS TO BE LOCATED AT CONSTRUCTION SUPPORT PAD.
11. SUBCONTRACTOR MAY CONNECT TO EXISTING BULK WATER STATION LINE. SUBCONTRACTOR MAY PROVIDE AND INSTALL PIPELINE TO SUPPORT SUBCONTRACTORS WORK.
12. RELOCATE EXISTING FENCE AND GATE TO NEW FENCE LINE. ADDITIONAL FENCING WILL BE REQUIRED TO COMPLETE THE FENCE. AT ALL TIMES WHEN THE ERDF PERIMETER FENCE IS NOT CONTINUOUS AND SOUND, THE SUBCONTRACTOR SHALL PROVIDE MANNED SECURITY. ONE SECURITY OFFICER SHALL BE PROVIDED AT EACH LOCATION AND FOR EVERY 100m(328 FT) OF UNSECURED FENCE LINE.

DOCUMENT CONTROL mjc 10/11/07

0 100' 200' 400'

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIEST — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JW	CJB	Sm	RJH	NA	TCB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
CONSTRUCTION LIMITS AND FENCE LOCATION-CELLS 9&10

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0260.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0260	0

RECEIVED 0600X-SC60524-05-19-008 500X524R00
OCT 08 2007
WCH - DOCUMENT CONTROL

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15597 SHT01	600G	0501

Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0261	0

COORDINATES

POINT NO.	DESCRIPTION	NORTH	EAST	ELEVATION	REMARKS	POINT NO.	DESCRIPTION	NORTH	EAST	ELEVATION	REMARKS
	EXISTING & GENERAL SITE FEATURES										
3301	SURVEY CONTROL POINT HSM-149	436000.7378	1861560.7550	669.29		3650	EXISTING FENCE CORNER	439987.66	1865493.10		
3302	SURVEY CONTROL POINT HSM-142	438947.3668	1861429.3610	678.071		3651	EXISTING FENCE CORNER	439182.66	1865493.10		
3303	SURVEY CONTROL POINT HSM-136	442215.0768	1864490.3260	690.541		3652	EXISTING FENCE CORNER	439182.66	1868666.15		
3304	SURVEY CONTROL POINT HSM-143	438966.7238	1864376.9180	680.440		3653	EXISITING FENCE CORNER	439987.66	1868667.29		
3305	SURVEY CONTROL POINT HSM-150	436034.9668	1864430.9920	655.77							
3306	SURVEY CONTROL POINT HSM-144	438966.6118	1867428.5820	704.728		3654	PROPOSED CELL 9,10 FENCE CORNER	439182.66	1869750.00		
						3655	PROPOSED CELL 9,10 FENCE CORNER	439987.66	1869750.00		
3308	SURVEY CONTROL POINT HSM-138	442270.2478	1870411.8430	733.576			YARD PIPING				
3309	SURVEY CONTROL POINT HSM-145	439312.8478	1870414.9040	722.01							
3310	SURVEY CONTROL POINT HSM-139	442458.0198	1873311.5000	745.93		3901	TEE	441912.93	1867859.78		AS-BUILT
3311	SURVEY CONTROL POINT HSM-140	442510.2408	1876208.3110	739.27		3902	VALVE	441988.94	1867859.78		AS-BUILT
3312	SURVEY CONTROL POINT HSM-141	442459.5518	1879193.4860	744.91		3903	FIRE HYDRANT	441953.61	1867849.43		AS-BUILT
3313	SURVEY CONTROL POINT HSM-135	442045.8388	1861410.8770	692.42							
3314	BORING 699-35-68B	440475.56	1867862.63	713.90	ABANDONED BY OTHERS	3906	BLIND FLANGE (END OF PIPE)	441924.30	1867024.60		AS-BUILT
3315	BORING 699-35-69B	439789.36	1866279.31	701.40		3907	254mm(10") ELBOW	441857.00	1867014.24		AS-BUILT
3316	WELL 699-35-70	439591.81	1865375.65	692.10		3908	END DOUBLE CONTAINMENT	441857.00	1867010.24		AS-BUILT
3317	WELL 699-35-66	439958.15	1869612.46	732.50		3909	END DOUBLE CONTAINMENT	440177.00	1867010.24		AS-BUILT
3318	WELL 699-36-70A	440666.01	1865009.84	702.74		3910	254mm(10") ELBOW	440177.00	1867014.24		AS-BUILT
3319	WELL 6-38-70	443206.08	1865160.94	714.25		3911	BLIND FLANGE (END OF PIPE)	440089.80	1867012.60		AS-BUILT
3320	WELL 699-38-68A	442688.78	1867389.45	718.17		3912	90° ELBOW TO BACKFLOW PREVENTER	441796.03	1867302.56		AS-BUILT
3321	WELL 6-38-65	443044.13	1870374.64	756.92		3913	BLIND FLANGE (END OF PIPE)	441924.30	1867528.36		CELL 7
3322	WELL 699-36-67	441027.00	1867715.00		SEE NOTE 2	3914	254mm(10") ELBOW	441857.00	1867518.00		CELL 7
3323	WELL 696-37-68	441697.76	1867695.67		SEE NOTE 2	3915	END DOUBLE CONTAINMENT	441857.00	1867514.00		CELL 7
3324	AIR MONITOR N-517 T353 (ERDF-1)	441376.40	1868543.50			3916	END DOUBLE CONTAINMENT	440177.00	1867514.00		CELL 8
3325	AIR MONITOR N-517 T351 (ERDF-3)	440048.20	1868543.50			3917	254mm(10") ELBOW	440177.00	1867518.00		CELL 8
						3918	BLIND FLANGE (END OF PIPE)	440089.80	1867516.36		CELL 8
3327	WELL	441170.80	1869191.80			3919	BLIND FLANGE (END OF PIPE)	441892.20	1868078.97		CELL 9
3328	WELL	442257.88	1869191.88			3920	254mm(10") ELBOW	441857.00	1868018.00		CELL 9
	MANHOLE LOCATIONS					3921	END DOUBLE CONTAINMENT	441857.00	1868014.00		CELL 9
3525	MANHOLE #28	441859.40	1867009.80	730.30	AS-BUILT	3922	END DOUBLE CONTAINMENT	440177.00	1868014.00		CELL 10
3527	MANHOLE #29	440163.20	1866998.10	730.30	AS-BUILT	3923	254mm(10") ELBOW	440177.00	1868018.00		CELL 10
3528	MANHOLE #30	441857.00	1867504.00	730.30	TOP OF MANHOLE ELEV.	3924	BLIND FLANGE (END OF PIPE)	440052.64	1868015.66		CELL 10
3529	MANHOLE #31	440177.00	1867504.00	730.30	TOP OF MANHOLE ELEV.						
3530	MANHOLE #32	441857.00	1868004.00	730.30	TOP OF MANHOLE ELEV.						
3531	MANHOLE #33	440177.00	1868004.00	730.30	TOP OF MANHOLE ELEV.						
	FUTURE SITE FEATURES										
3614	LIMITS OF CONSTRUCTION-CELLS 7 & 8	442699.69	1866500.00								
3615	LIMITS OF CONSTRUCTION-CELLS 7 & 8	442699.69	1868671.15								
3616	LIMITS OF CONSTRUCTION-CELLS 7 & 8	439182.66	1868666.15								
3617	LIMITS OF CONSTRUCTION-CELLS 7 & 8	439272.49	1866500.00								
3618	LIMITS OF CONSTRUCTION-CELLS 7 & 8	439992.28	1866500.00								
3619	LIMITS OF CONSTRUCTION-CELLS 7 & 8	439992.28	1866871.15								
3620	LIMITS OF CONSTRUCTION-CELLS 7 & 8	440217.24	1866871.15								
3621	LIMITS OF CONSTRUCTION-CELLS 7 & 8	440216.81	1867244.50								
3622	LIMITS OF CONSTRUCTION-CELLS 7 & 8	442038.89	1867244.50								
3623	LIMITS OF CONSTRUCTION-CELLS 7,8,9,10	442038.89	1868178.20								
3624	LIMITS OF CONSTRUCTION-CELLS 7,8,9,10	442500.00	1868178.20								
3625	LIMITS OF CONSTRUCTION-CELLS 7 & 8	442500.00	1866500.00								
3626	LIMITS OF CONSTRUCTION-CELLS 9 & 10	439987.66	1868667.29								
3627	LIMITS OF CONSTRUCTION-CELLS 9 & 10	439987.66	1869750.00								
3628	LIMITS OF CONSTRUCTION-CELLS 9 & 10	439182.66	1869750.00								
3629	LIMITS OF CONSTRUCTION-CELLS 9 & 10	442500.00	1868670.87								
3630	LIMITS OF CONSTRUCTION-CELLS 9 & 10	439182.66	1868281.00								
3631	LIMITS OF CONSTRUCTION-CELLS 9 & 10	440000.00	1868281.00								
3632	LIMITS OF CONSTRUCTION-CELLS 9 & 10	440000.00	1867254.00								
3633	LIMITS OF CONSTRUCTION-CELLS 9 & 10	440216.81	1867254.00								
3634	LIMITS OF CONSTRUCTION-CELLS 9 & 10	440216.81	1867754.00								
3635	LIMITS OF CONSTRUCTION-CELLS 9 & 10	442038.89	1867254.00								
3636	LIMITS OF CONSTRUCTION-CELLS 9 & 10	441817.19	1867254.00								
3637	LIMITS OF CONSTRUCTION-CELLS 9 & 10	441817.19	1867754.00								
3638	LIMITS OF CONSTRUCTION-CELLS 7 & 8	441817.19	1866871.15								
3639	LIMITS OF CONSTRUCTION-CELLS 7 & 8	441817.19	1867244.50								
3640	LIMITS OF CONSTRUCTION-CELLS 7 & 8	439473.17	1867730.10								
3641	LIMITS OF CONSTRUCTION-CELLS 7 & 8	439182.66	1867730.10								

NOTES

1. COORDINATES FOR THE TRENCH CELLS ARE SHOWN ON DRAWINGS 0600X-DD-C0269, C0270, C0271, C0285, C0286, C0287, C0288, C0297 AND C0298.
2. DECOMMISSIONED GROUNDWATER MONITORING WELLS. SUBCONTRACTOR SHALL REMOVE CASING DURING EXCAVATION OF CELLS 7 AND 8. CASING WAS PERFORATED IN 10-FOOT SECTIONS DURING DECOMMISSIONING. CASING SHALL BE PLACED IN ROLL ON/ROLL OFF CONTAINERS PROVIDED BY THE CONTRACTOR. CONTRACTOR WILL DISPOSE OF CASING.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1 ☑ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3 ☐ Revise and resubmit. Work may proceed subject to resolution of indicated comments.
4 ☐ Review and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Bollacke — 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-60524 — 05-19 — 009
SCPO NO.: 500X524A00 — SUBMITTAL

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGHT — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	DJW	CJB	[illegible]	BH	N/A	SB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. — RICHLAND, WASHINGTON
WEAVER BOOS CONSULTANTS, LLC — DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
COORDINATE TABLE

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0261.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0261	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15598 SHT01	600G	0110

Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0262	0



TWISTED AND BARBED SELVAGE



PIPE POST TIE

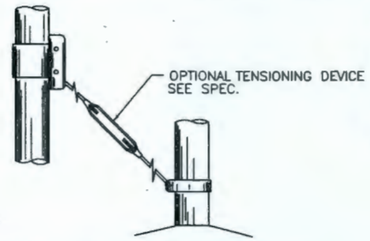

BRACE AND TRUSS CONNECTIONS

HEIGHT OF FABRIC	DEPTH OF POSTS	LENGTH OF END, CORNER OR PULL POSTS	LENGTH OF LINE POSTS	SIZE OF POSTS (O.D.)				
				END, CORNER & PULL		LINE POST (MIN. SIZE)		
				PIPE OPTION	RECTANGULAR OPTION	PIPE OPTION	H POST OPTION	POST OPTION
2.44m (8')	SEE DETAIL	3.35 (11')+	3.25m (10'8")	76mm (3")	89mm (3 1/2")	64mm (2 1/2")	48mm X 41mm (1 7/8" X 1 5/8")	52mm X 43mm (2 1/16" X 1 11/16")

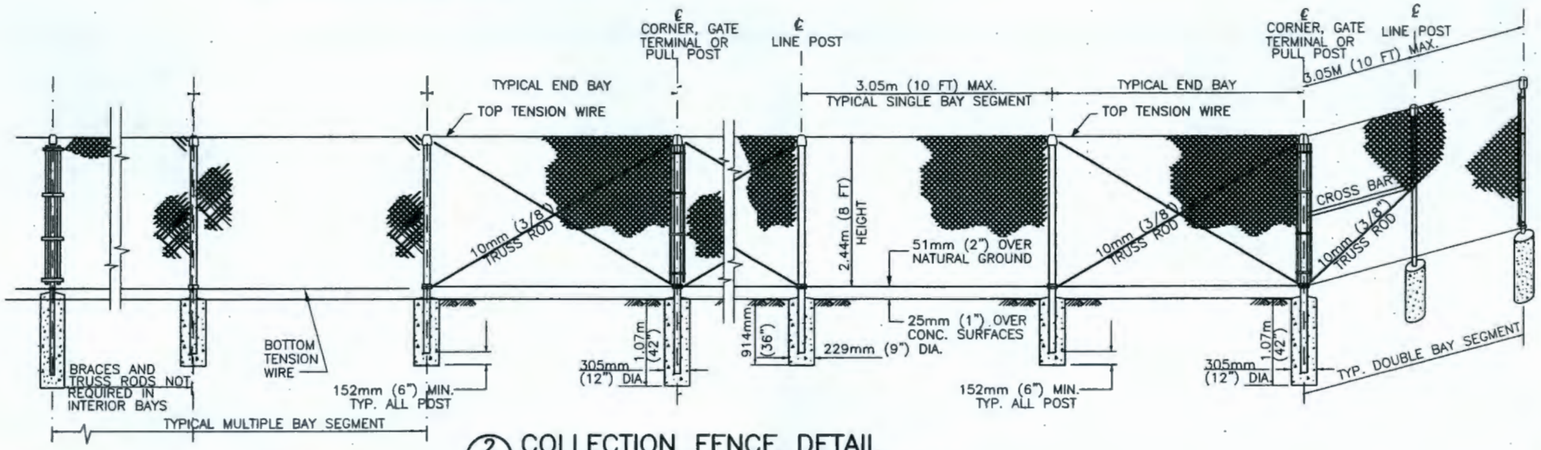

2 COLLECTION FENCE DETAIL

0600X-DD-C0277,C0278,C0283 NTS (SEE NOTES 1 AND 2)

HEIGHT OF FABRIC	DEPTH OF POSTS	LENGTH OF END, CORNER OR PULL POSTS	LENGTH OF LINE POSTS	SIZE OF POSTS (O.D.)				
				END, CORNER & PULL		LINE POST (MIN. SIZE)		
				PIPE OPTION	RECTANGULAR OPTION	PIPE OPTION	H POST OPTION	POST OPTION
1.83m (6')	SEE DETAIL	2.74m (9')+	2.64m (8'-8")	76mm (3")	89mm (3 1/2")	64mm (2 1/2")	48mm X 41mm (1 7/8" X 1 5/8")	52mm X 43mm (2 1/16" X 1 11/16")

GATES			
GATE POSTS AND GATE FRAMES			
HEIGHT	GATE OPENING	GATE POST	GATE FRAME
1.83m (6 FT) AND OVER	SINGLE TO 1.83m (6 FT) OR DOUBLE TO 3.66m (12 FT)	64mm (2 1/2")	51mm (2")
	SINGLE OVER 1.83m (6 FT) TO 3.96m (13 FT) OR DOUBLE OVER 3.66m (12 FT) TO 7.32m (24 FT)	102mm (4")	
	SINGLE OVER 3.96m (13 FT) TO 5.49m (18 FT) OR DOUBLE OVER 7.32m (24 FT) TO 10.97m (36 FT)	152mm (6")	
	SINGLE OVER 5.49m (18 FT) OR DOUBLE 10.97m (36 FT)	203mm (8")	

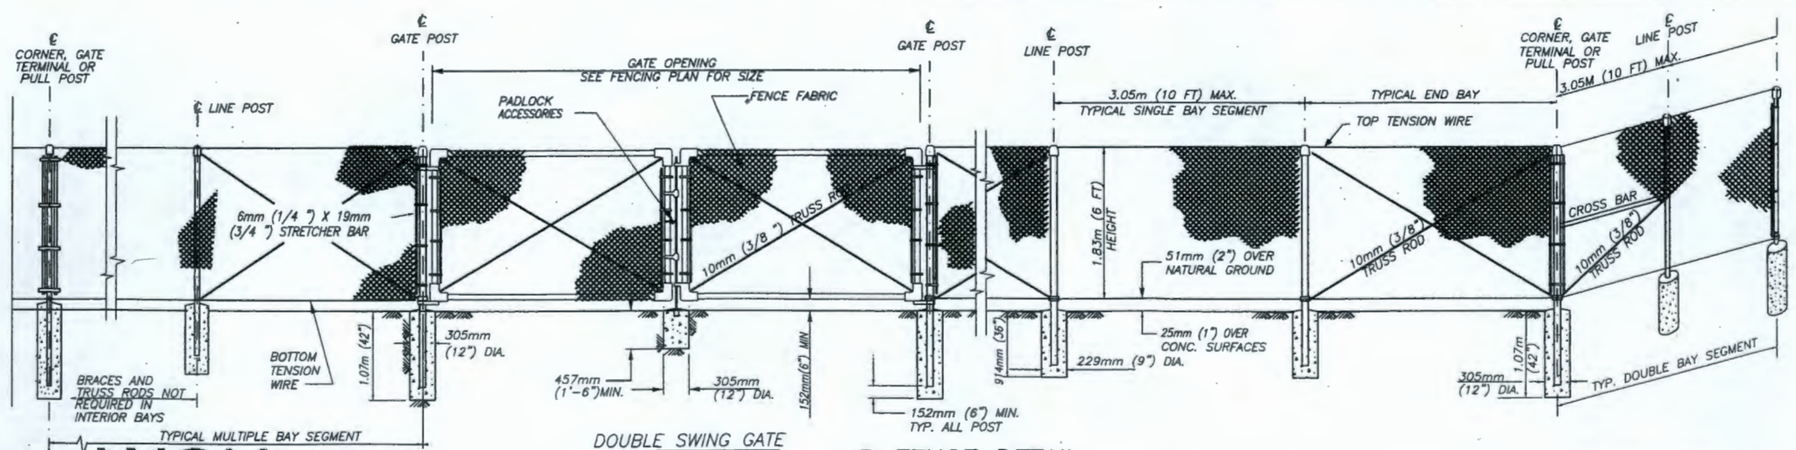

1 FENCE DETAIL

0600X-DD-C0259,C0260 NTS

RIVER CORRIDOR CLOSURE CONTRACT WCH Dedicated To Safety Excellence

RECORD INFORMATION		
RECORD NO.	BLDG NO.	INDEX NO.
H-6-15599 SHT01	600G	0200

NOTES

1. COLLECTION FENCE SHALL BE INSTALLED ON 3-FT TALL OPERATIONS BERM.
2. CARE MUST BE TAKEN SUCH THAT UNDERLYING GEOSYNTHETIC LAYERS ARE NOT DAMAGED.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Dorland 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G00344 — 002-10 — 010
500X524A00

RECEIVED OCT 08 2007 WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mjc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGHT — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/18/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJW	CJB	[illegible]	BJH	NIA	JCB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
7-10
FENCE DETAILS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0262.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0262	0

DRAWING NO.	REV. NO.
0600X-DD-C0263	0

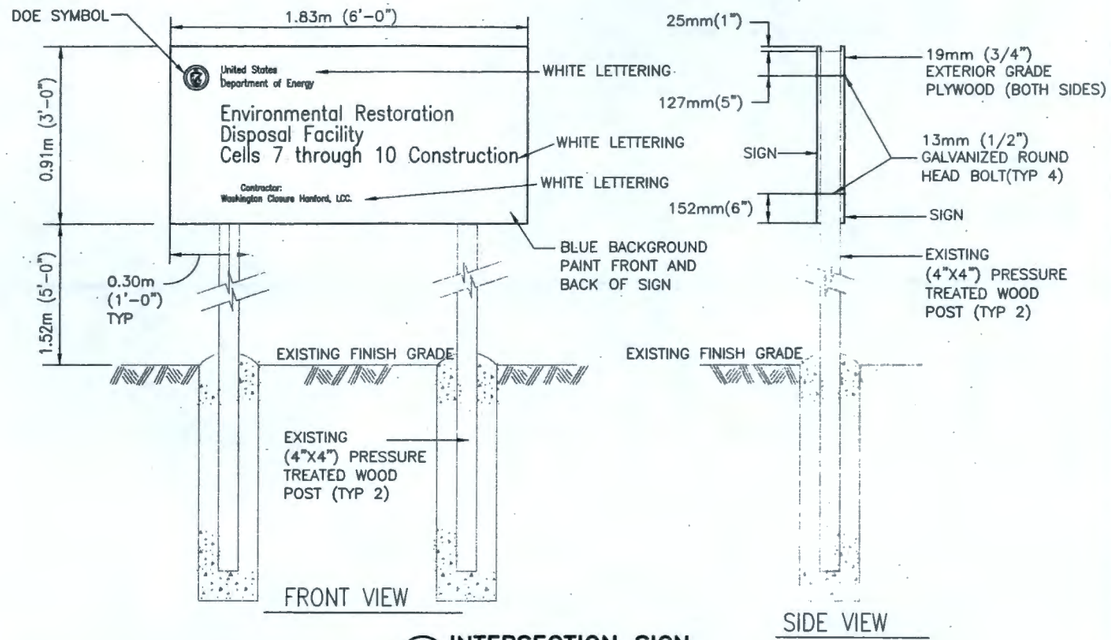

1 INTERSECTION SIGN
0600X-DD-C0258 NTS

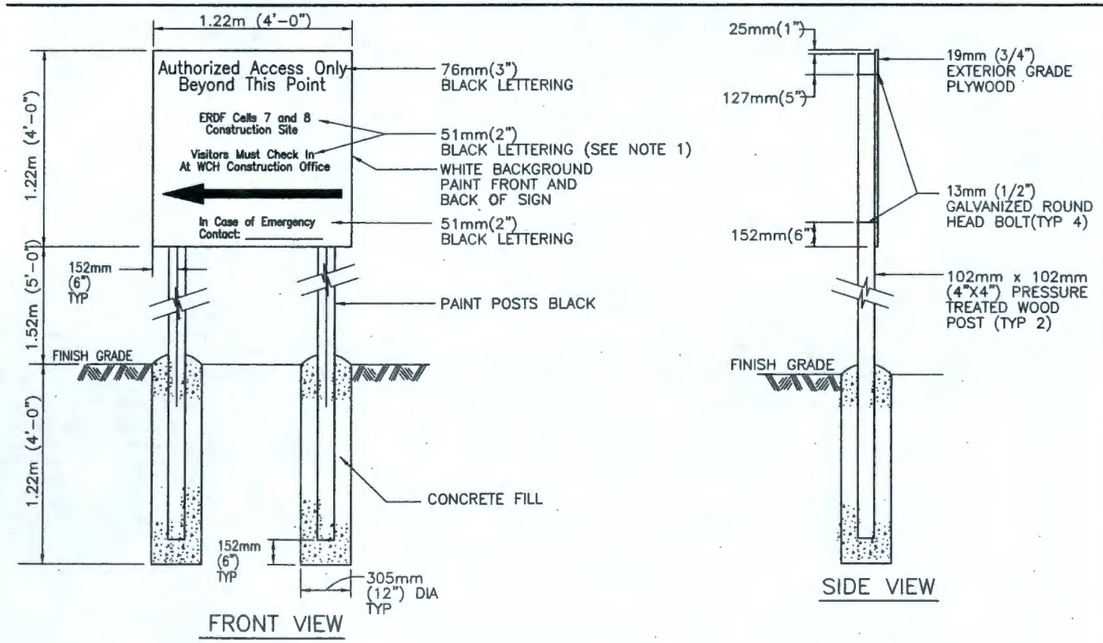

2 ENTRANCE SIGN
0600X-DD-C0258 NTS

Dedicated To Safety Excellence

NOTES

1. ENTRANCE SIGN SHALL INDICATE 7 & 8 OR 9 & 10 AS APPLICABLE.
2. TYPEFACE SHALL BE HELVETICA.
3. SIGN LAYOUT AND COLORS SHALL BE IN ACCORDANCE WITH DOE'S GRAPHIC DESIGN STANDARD.
4. INTERSECTION SIGN WILL BE MOUNTED ON BOTH SIDES OF POSTS, AND INSTALLED BY CONTRACTOR.
5. SUBCRONTRACTOR SHALL INSTALL ENTRANCE SIGN.

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1 ☒ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmission.
3 ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Berlanga 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G0524 05-19 011
SCP-01 No. | SUBMITTAL

500X 524 A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

Best Available Copy

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGGS, STATE OF WASHINGTON, 42158, REGISTERED PROFESSIONAL ENGINEER, 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JDV	CJB	[illegible]	BJH	N/A	RDB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SIGN DETAILS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0263.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0263	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15600 SHT01	600G	0200

DRAWING NO.	REV. NO.
0600X-DD-C0265	0

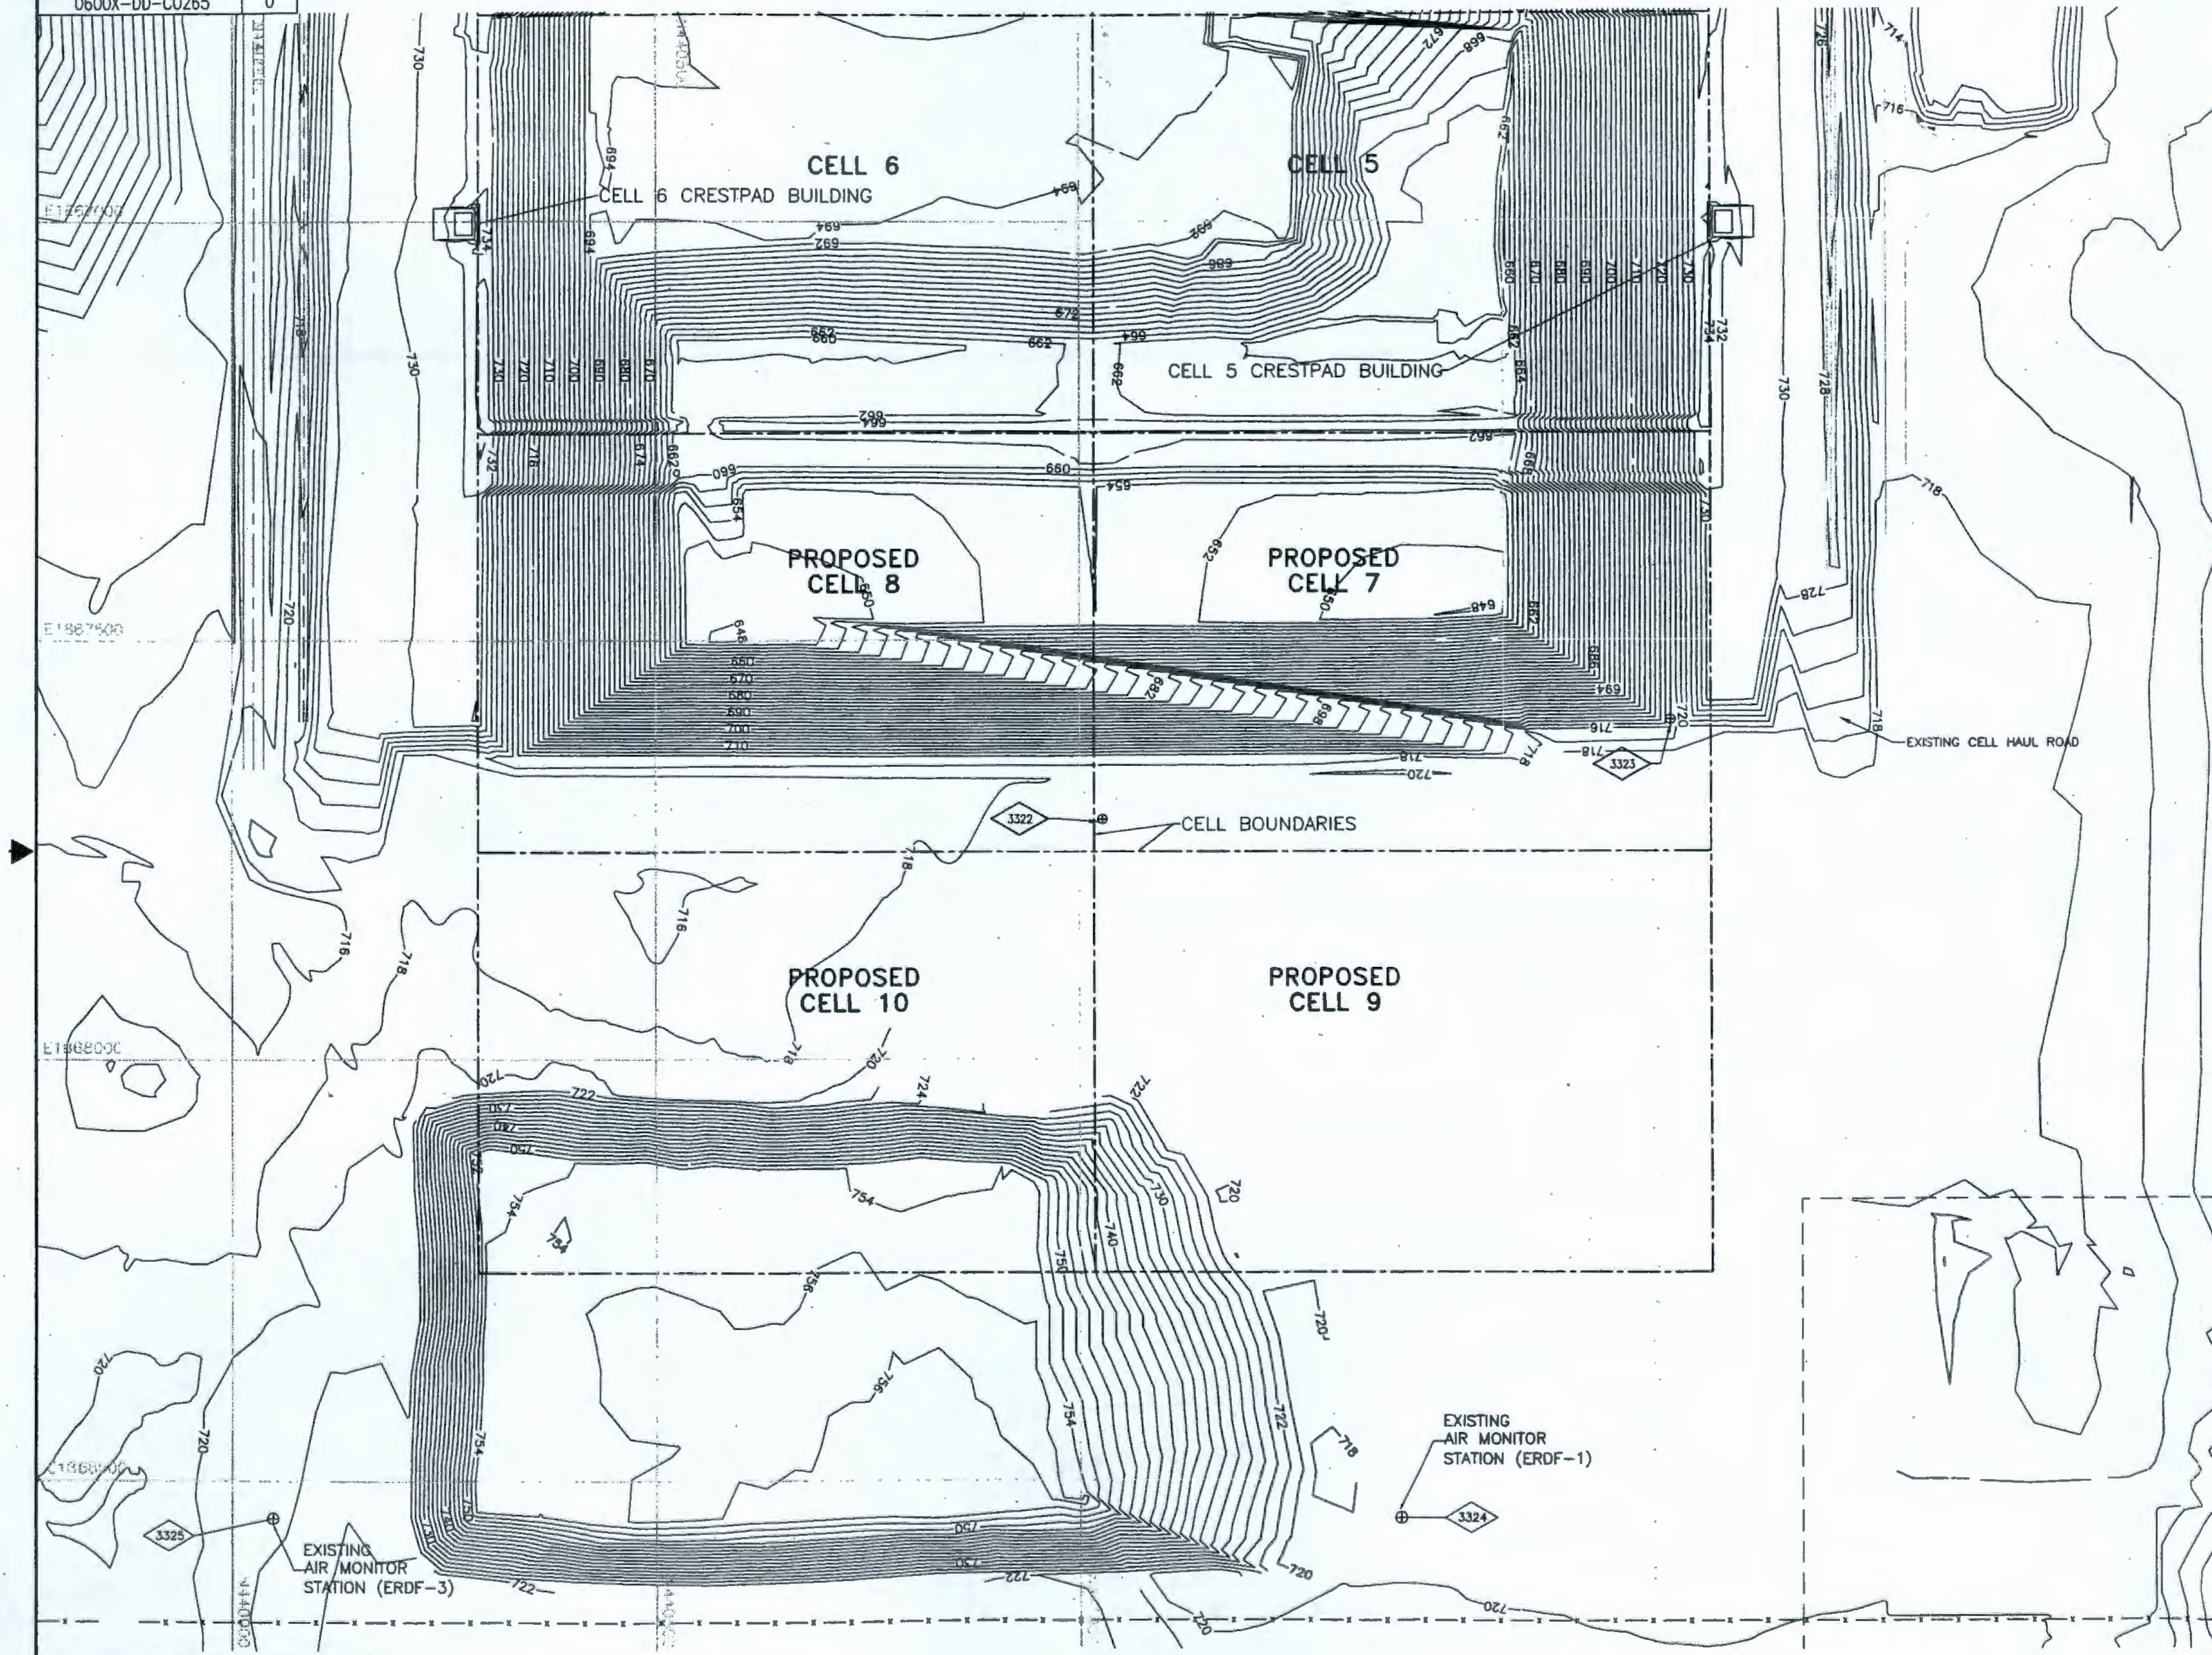

RIVER CORRIDOR CLOSURE CONTRACT
Dedicated To Safety Excellence
WCH

RECORD INFORMATION		
RECORD NO.	BLDG NO.	INDEX NO.
H-6-15845 SHT01	600G	0110

NOTES

1. EXISTING COUNTOURS FROM FIELD SURVEY PREPARED BY ROGERS SURVEYING, INC., DATED JULY, 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCRONTRACTOR SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
SURVEY DATUM:
2. VERTICAL NAVD: 88
HORIZONTAL NAD: 83 (91)

N

0 50' 100' 200'

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☑ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borlaug 10/9/07
0600X-SC-G0524 05-19 012
S00X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIEST — STATE OF WASHINGTON — 42158 REGISTERED PROFESSIONAL ENGINEER — 9/28/07
EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJW	CJB	[illegible]	BJL	N/A	CB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
EXISTING TOPOGRAPHY

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0265.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0265	0

DRAWING NO.	REV. NO.
0600X-DD-C0266	0

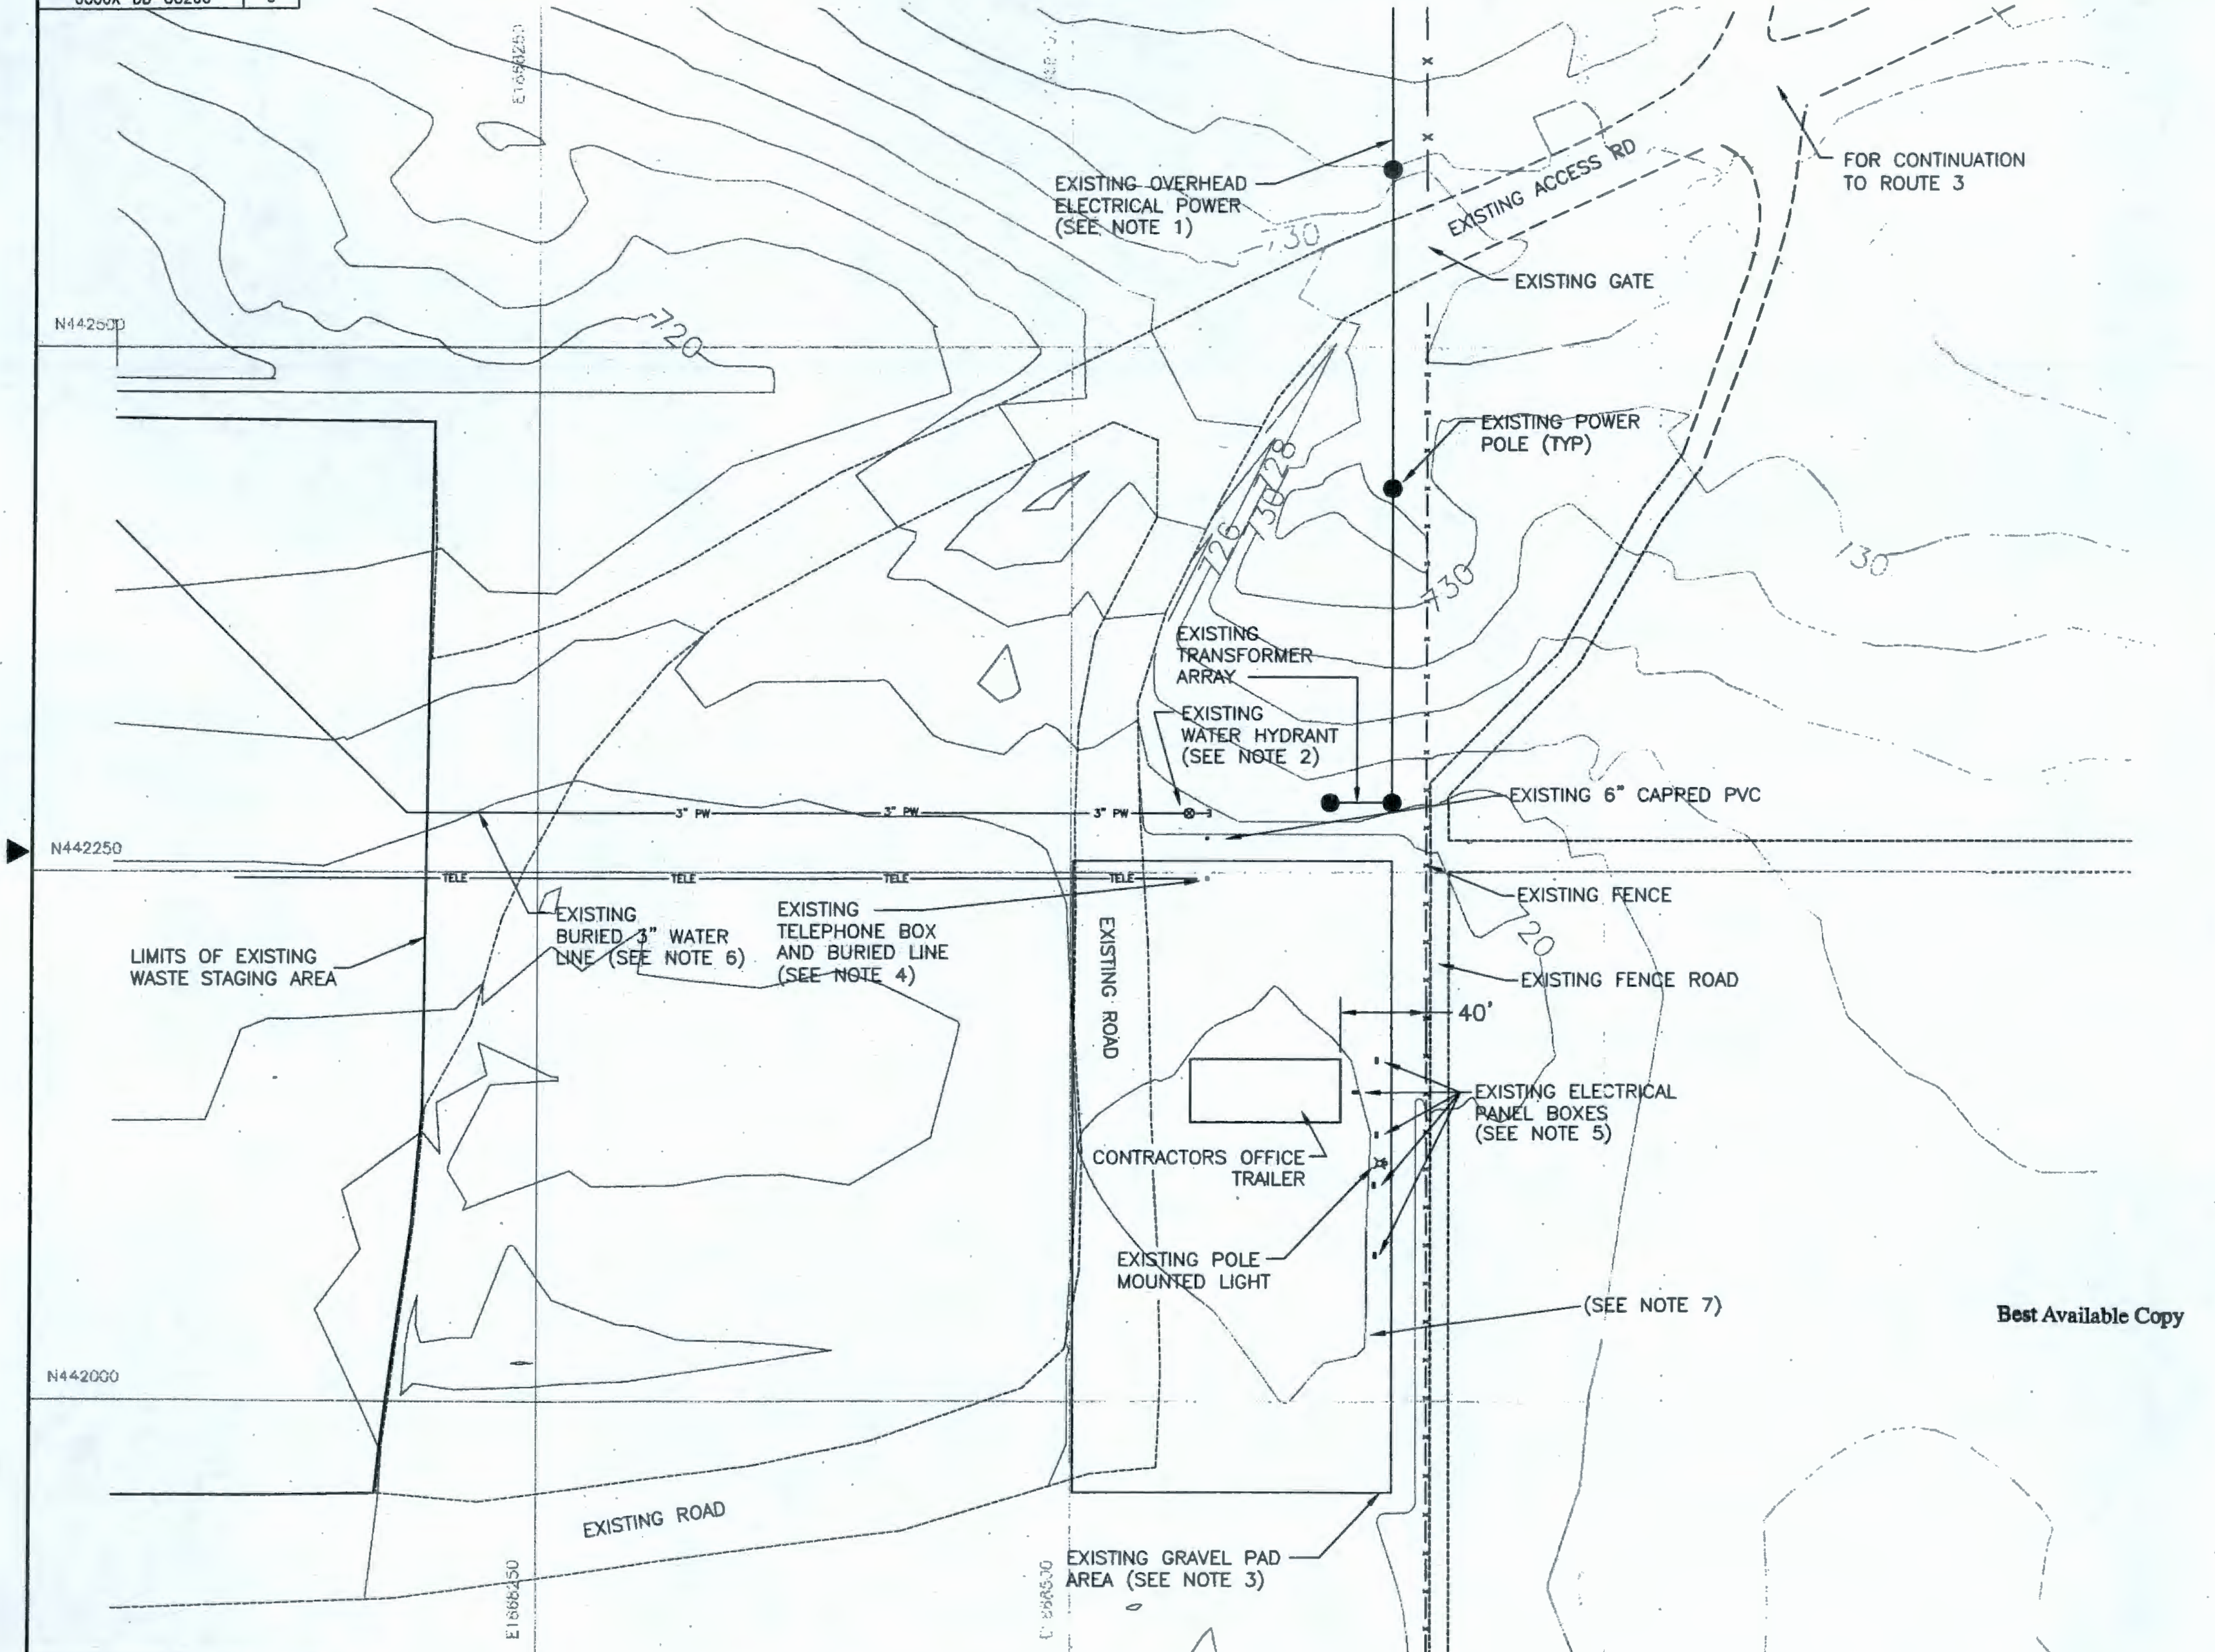

1 EXISTING CONSTRUCTON SUPPORT PAD
0600X-DD-C0259,C0260

RIVER CORRIDOR CLOSURE CONTRACT
Dedicated To Safety Excellence
WCH

Best Available Copy

NOTES

1. OVERHEAD ELECTRICAL POWER LINE. SUBCONTRACTOR SHALL NOT DISTURB THIS ENERGIZED POWER DISTRIBUTION LINE.
2. EXISTING ABOVE GRADE WATER HYDRANT WITH VALVE. SUBCONTRACTOR SHALL PROTECT FROM DAMAGE.
3. EXISTING GRAVEL PAD AREA TO BE REUSED FOR PROJECT FACITLITES. SUBCONTRACTOR SHALL BE REQUIRED TO REPLACE GRAVEL SURFACING IN AREAS THAT WERE PREVIOUSLY DISTURBED AND REGRADE TO DRAIN.
4. EXISTING TELEPHONE BOX. SUBCONTRACTOR SHALL PROTECT FROM DAMAGE.
5. EXISTING ELECTRICAL PANEL BOXES. SUBCONTRACTOR SHALL PROTECT FROM DAMAGE. SUBCONTRACTOR SHALL PROTECT ALL UNDERGROUND ELECTRICAL CONDUIT RUNS BACK TO THE EXISTING POLE MOUNTED TRANSFORMER ARRAY.
6. EXISTING BURIED ACTIVE 3" POTABLE WATER LINE. SUBCONTRACTOR SHALL PROTECT PIPE FROM DAMAGE.
7. SUBCONTRACTOR SHALL INSTALL OFFICE TRAILERS ON EXISTING CONSTRUCTION SUPPORT PAD.
8. TOPOGRAPHY SHOWN REPRESENTS CURRENT CONFIGURATION. CONTOUR INTERVAL IS 2 FEET.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☑ Work may proceed.
Bill Borlaug 10/9/07
0600X-SC-G0529 05-19 013
500X524H00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

0 20' 40' 80'

N

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIESE — STATE OF WASHINGTON — 42158 REGISTERED PROFESSIONAL ENGINEER
EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJW	CJB	Sm	BJH	N/A	JCB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY CELLS 7-10 PROJECT OFFICE TRAILER PLACEMENT

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0266.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0266	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15846 SHT01	600G	0110

DRAWING NO.	REV. NO.
0600X-DD-C0267	0

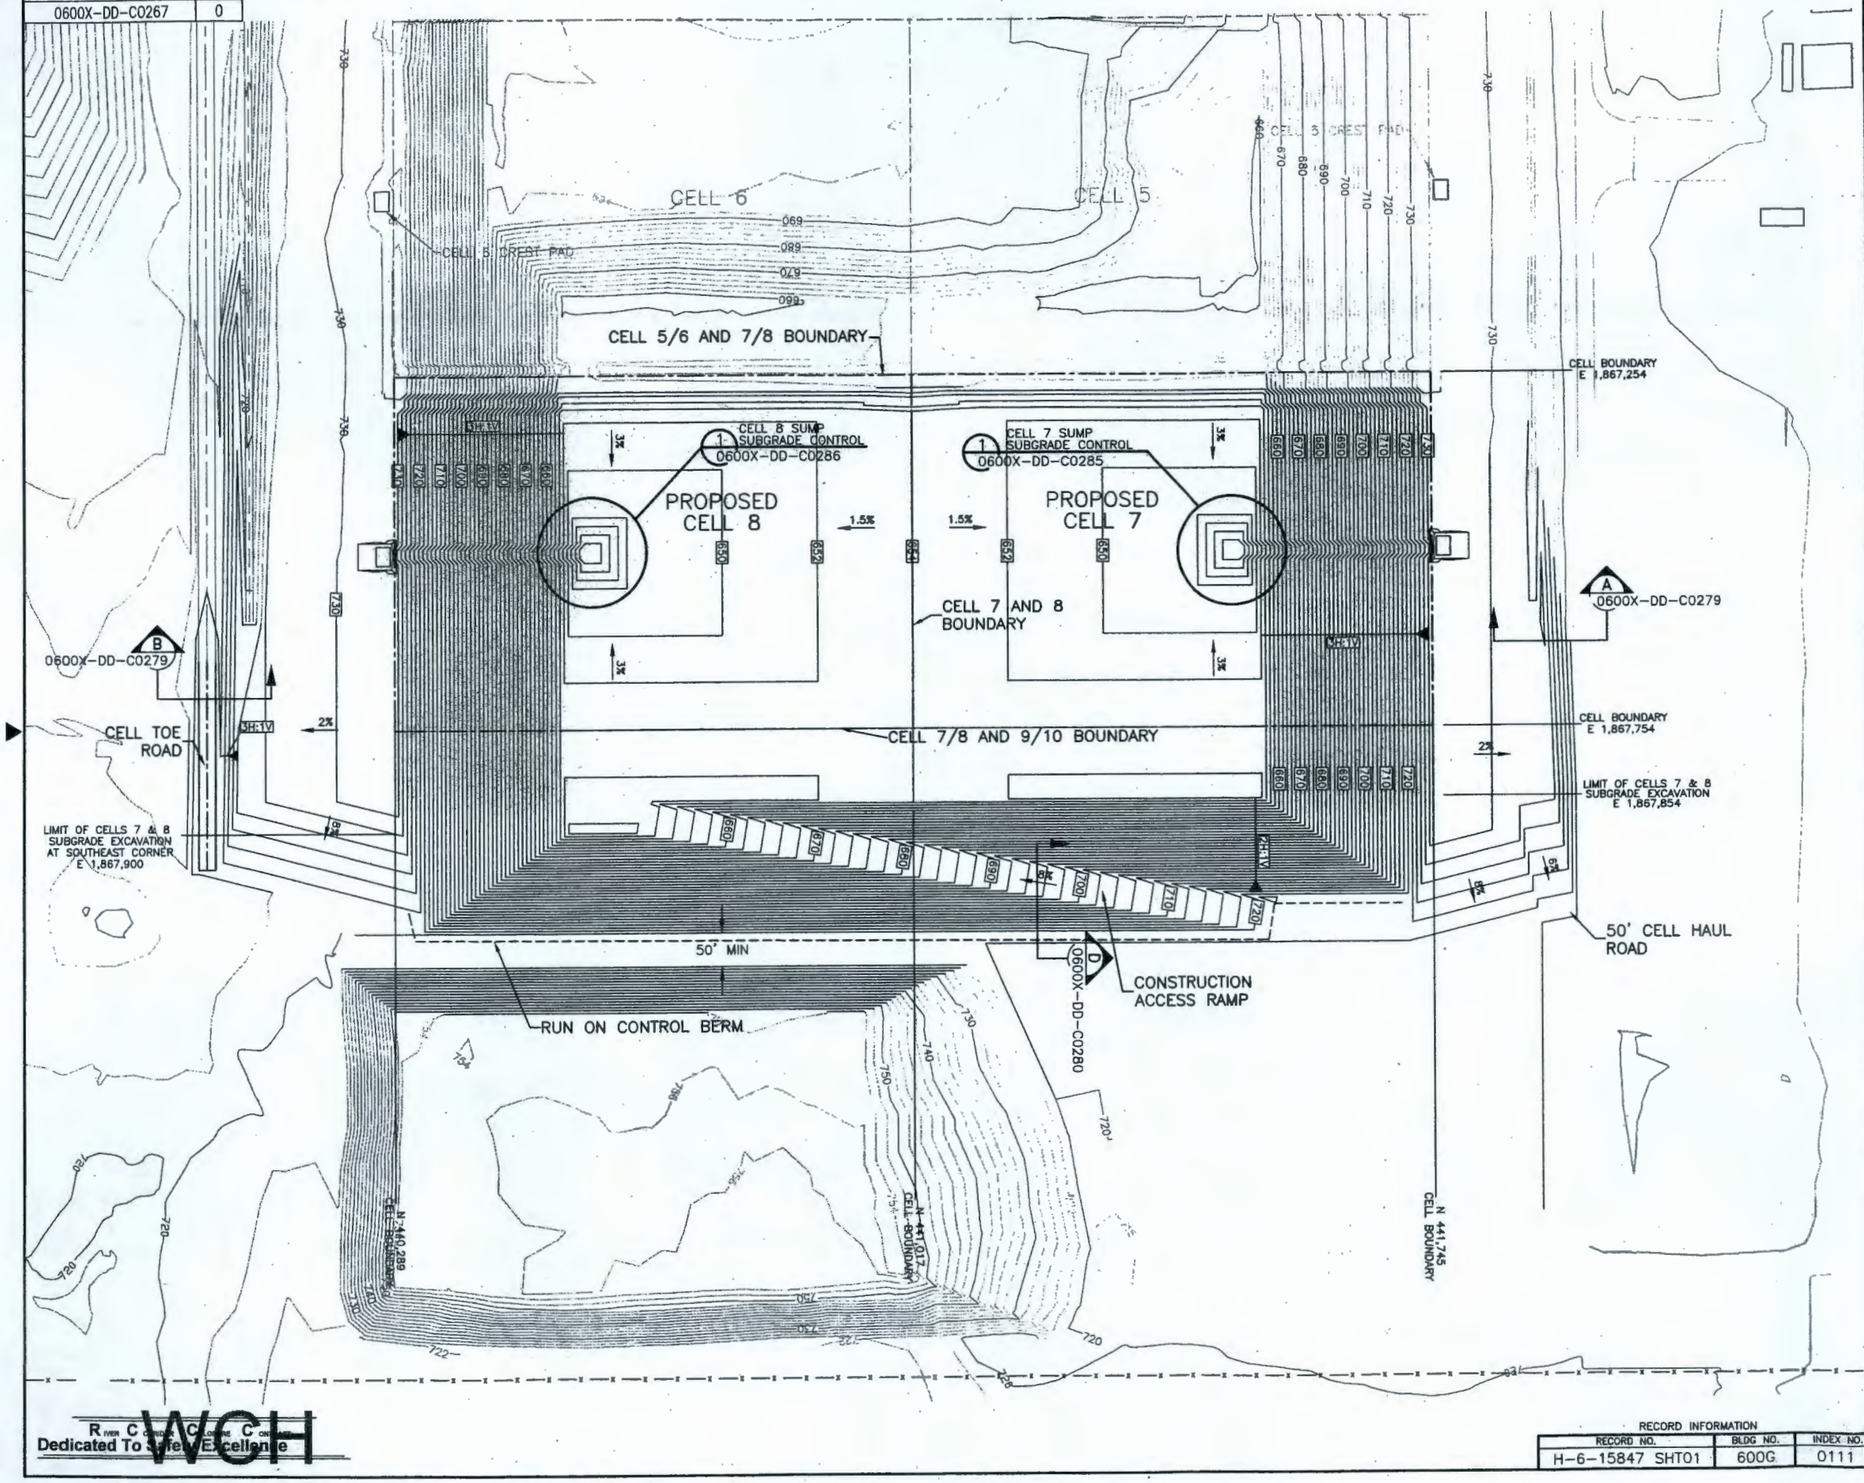

NOTES

1. GRADING TOLERANCES SHOWN ON DWG. NO. 0600-DD-C0281.
2. LIMIT OF LINER COMPONENT CONSTRUCTION INDICATES EXTENT OF FULL-DEPTH CONSTRUCTION.
3. EXISTING CONTOURS FROM FIELD SURVEY PREPARED BY ROGERS SURVEYING, INC., DATED JULY 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCONTRACTORS SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
4. SURVEY DATUM:
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)

0 50' 100' 200'

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☐ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to construction subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Borlaug 10/9/07
DOCUMENT NUMBER 0600X-EC-G00244 05-19 014
BCP/A No. EDMS ITEM SUBNOTAL
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

Best Available Copy

DOCUMENT CONTROL date 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIXEY — STATE OF WASHINGTON — 9/28/07 — 42158 — REGISTERED PROFESSIONAL ENGINEER

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG ENGR	ENGR CHK	SYS ENGR	PROJ ENGR
0	9/28/07	ISSUED FOR CONSTRUCTION	JTV	CJB	[illegible]	[illegible]	N/A	[illegible]

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SUBGRADE & CELL BERM CONTOURS - CELLS 7 & 8

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0267.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0267	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15847 SHT01	600G	0111

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0268	0

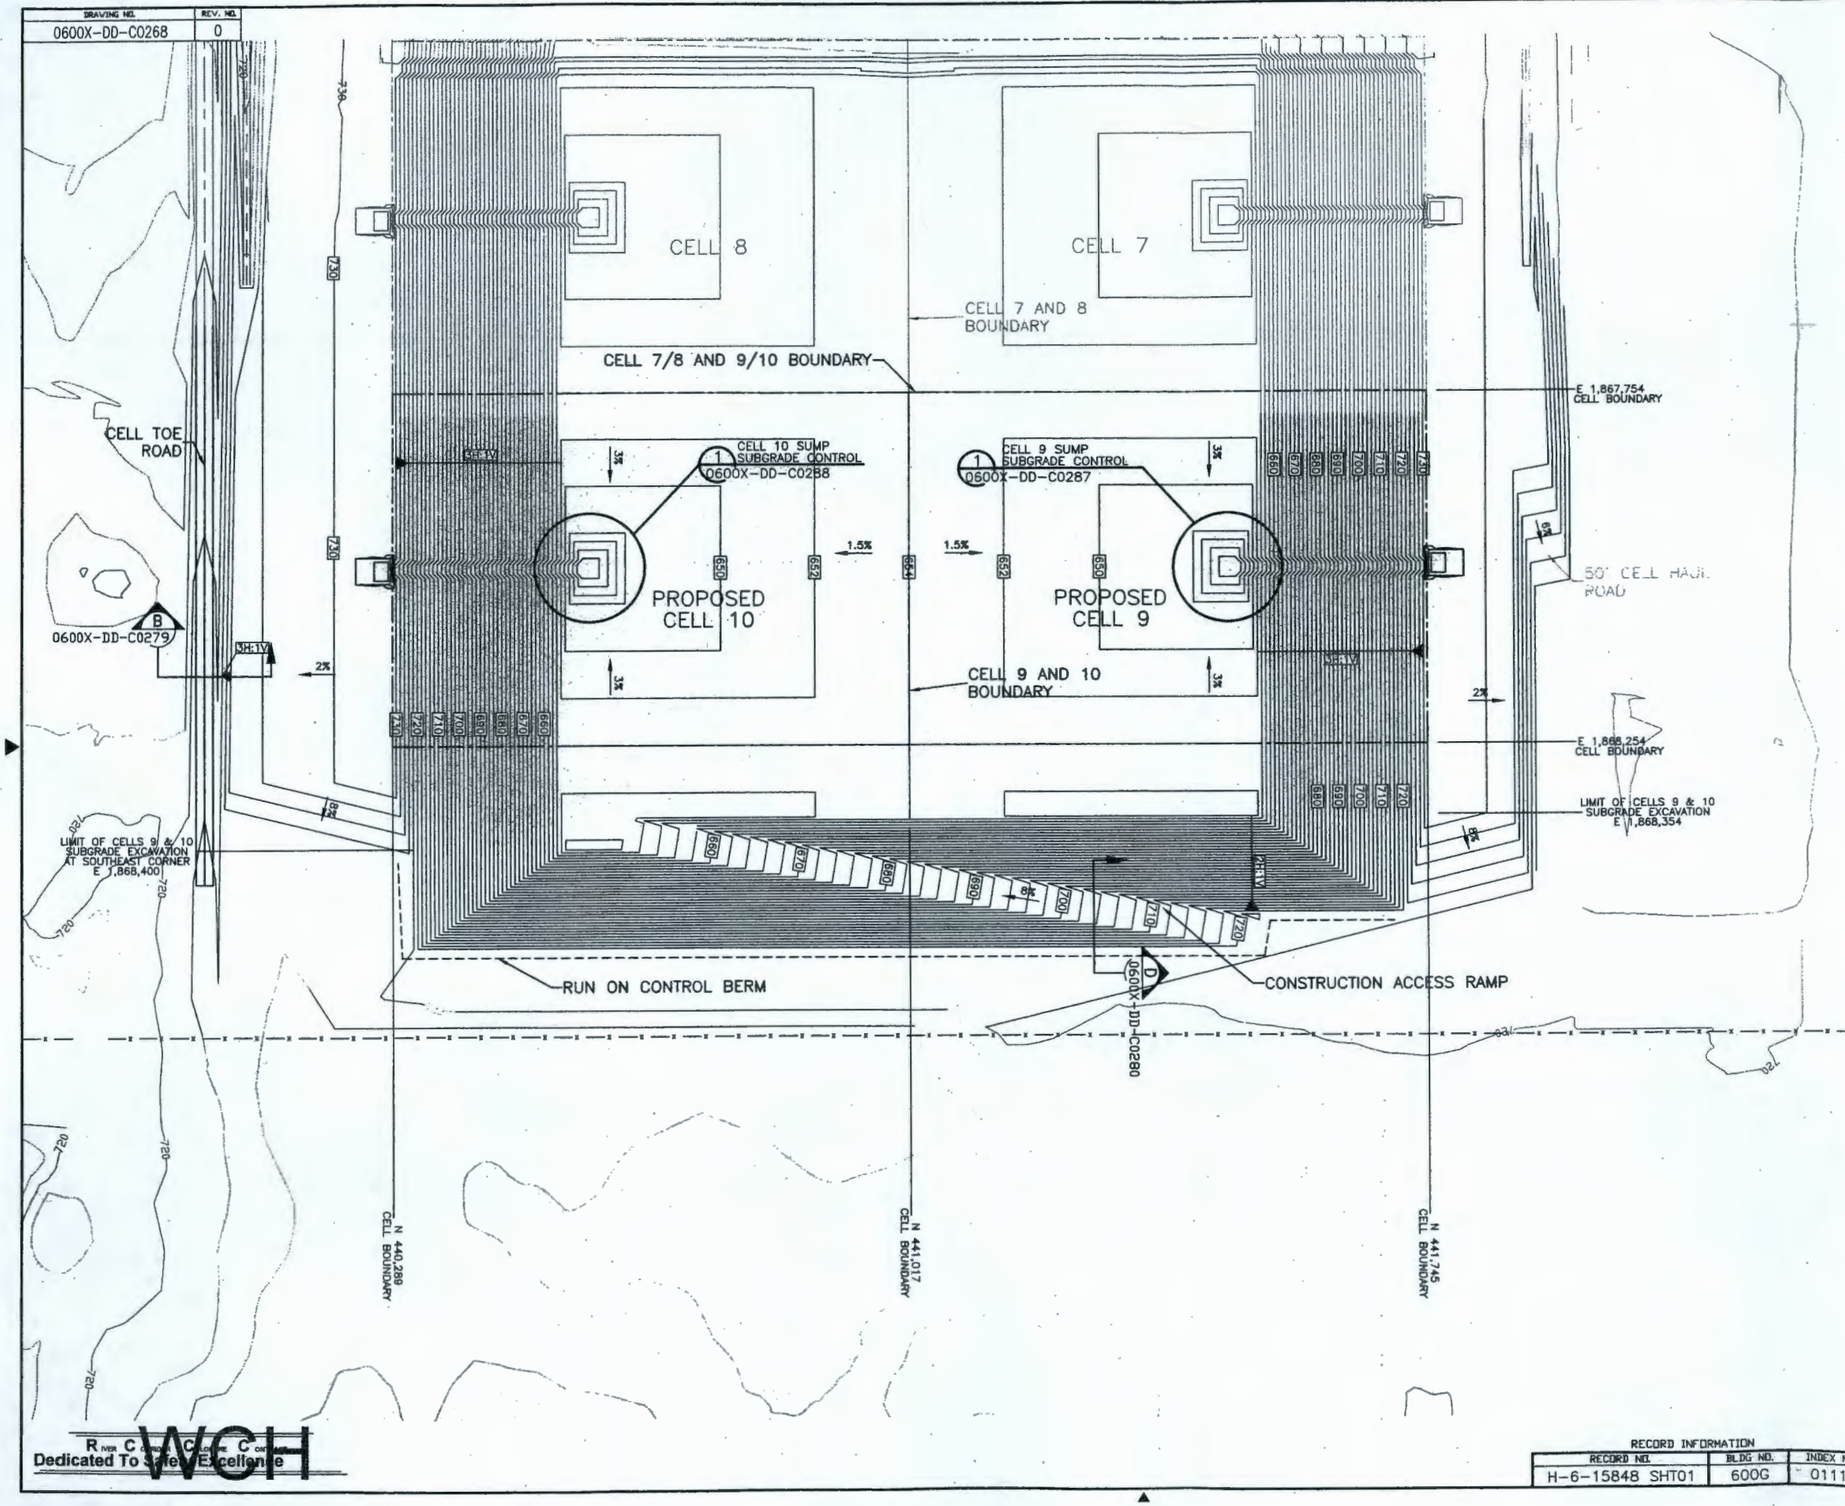

NOTES

1. GRADING TOLERANCES SHOWN ON DWG. NO. 0600-DD-C0281.
2. LIMITS OF LINER COMPONENT CONSTRUCTION INDICATES EXTENT OF FULL-DEPTH CONSTRUCTION.
3. EXISTING CONTOURS FROM FIELD SURVEY PREPARED BY ROGERS SURVEYING, INC. DATED JULY, 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCONTRACTOR SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
4. SURVEY DATUM:
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)

DOCUMENT CONTROL mec 10/11/07

Best Available Copy

0 50' 100' 200'

WASHINGTON CLOSURE HANFORD — JOB NO. 14652
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1.☒ Work may proceed.
2.☐ Review and resubmit. Work may proceed prior to resubmittal.
3.☐ Review and resubmit. Work may proceed prior to resubmittal subject to resolution of substantial comments.
4.☐ Review and resubmit. Work may not proceed.
5.☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Roelofs 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G0624 05-19 015
SCHED. NO. — REPR. ITEM — SUBMITTAL
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGGS — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	DESIG ENG'R	ENG'R CHK	SYS ENG'R	FIELD ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JW	CJB	[illegible]	BWH	N/A	JBS

SCALE AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SUBGRADE & CELL BERM CONTOURS - CELLS 9 & 10

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0268.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0268	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15848 SHT01	600G	0111

RIVER CORRIDOR CLOSURE CONTRACT
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0269	0

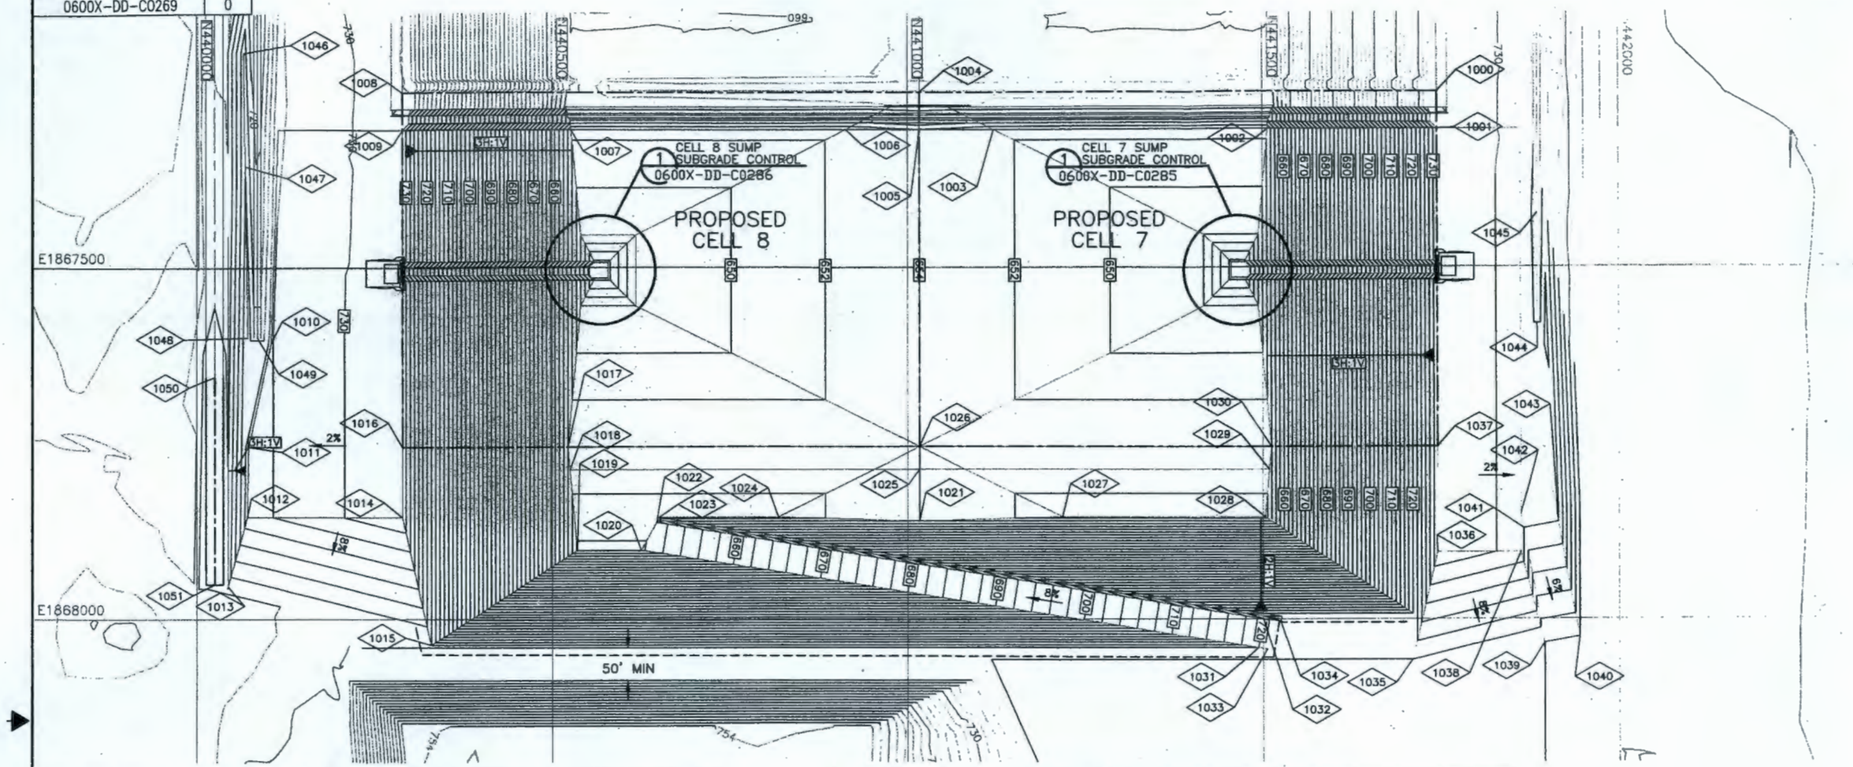

NOTES

1. GRADING TOLERANCES SHOWN ON DWG. NO. 0600-DD-C0281
2. LIMIT OF LINER COMPONENT CONSTRUCTION INDICATES EXTENT OF FULL-DEPTH CONSTRUCTION.
3. EXISTING CONTOURS FROM FIELD SURVEY PREPARED BY ROGERS SURVEYING, INC., DATED JULY, 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCONTRACTOR SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
4. SURVEY DATUM:
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)

0 50' 100' 200'

DOCUMENT CONTROL mle 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BAKER — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	DESIG ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JW	CSB		BJH	NIA	DB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SUBGRADE SURVEY CONTROL CELLS 7 & 8

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0269.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0269	0

SUBGRADE DESIGN CONTROL POINTS COORDINATES (WASHINGTON STATE PLANE, FT)

POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION
1000	441744.90	1867254.00	733.96	CELL BOUNDARY FOR CELLS 5 & 7
1001	441744.90	1867306.00	731.64	SLOPE CREST TIE IN FOR CELLS 5 & 7
1002	441507.29	1867306.00	652.44	TOE OF SLOPE TIE IN FOR CELLS 5 & 7
1003	441121.00	1867306.00	652.44	GRADE BREAK TIE IN FOR CELLS 5 & 7
1004	441017.00	1867254.00	662.00	CELL BOUNDARY FOR CELLS 5, 6, 7, & 8
1005	441017.00	1867306.00	654.00	CELL BOUNDARY FOR CELLS 7 & 8 TIE IN
1006	440913.00	1867306.00	652.44	GRADE BREAK TIE IN FOR CELLS 6 & 8
1007	440526.71	1867306.00	652.44	TOE OF SLOPE TIE IN FOR CELLS 6 & 8
1008	440289.10	1867254.00	733.51	CELL BOUNDARY FOR CELLS 6 & 8
1009	440289.10	1867306.00	731.64	SLOPE CREST TIE IN FOR CELLS 6 & 8
1010	440104.32	1867605.44	727.95	GRADE BREAK
1011	440072.43	1867754.00	727.31	GRADE BREAK
1012	440070.84	1867854.00	727.28	GRADE BREAK
1013	440043.20	1867955.90	718.57	GRADE BREAK
1014	440289.10	1867854.00	731.64	SLOPE CREST – LIMIT OF OVERBUILD
1015	440330.03	1868037.36	718.00	SLOPE CREST – GRADE BREAK
1016	440289.10	1867754.00	731.64	SLOPE CREST – CELL BOUNDARY
1017	440522.04	1867754.00	654.00	TOE OF SLOPE – CELL BOUNDARY
1018	440524.91	1867786.00	653.04	TOE OF SLOPE – LIMIT OF CELL 8 OVERBUILD
1019	440535.22	1867900.56	649.60	TOE OF SLOPE – EDGE OF CELL 8 EXCAVATION
1020	440624.88	1867900.56	649.60	TOE OF SLOPE – EDGE OF CELL 8 EXCAVATION
1021	441017.00	1867860.00	654.00	TOE OF SLOPE–CELL 7 & 8 BOUNDARY
1022	440646.08	1867861.45	650.78	BASE OF CONSTRUCTION ACCESS RAMP BERM
1023	440650.12	1867854.00	651.00	BASE OF CONSTRUCTION ACCESS RAMP BERM
1024	440817.00	1867854.00	651.00	TOE OF SLOPE – EDGE OF CELL 8 EXCAVATION
1025	441017.00	1867786.00	654.00	GRADE BREAK – LIMIT OF CELL 7 & 8 OVERBUILD
1026	441017.00	1867754.00	654.00	GRADE BREAK – CELL BOUNDARY

SUBGRADE DESIGN CONTROL POINTS COORDINATES (WASHINGTON STATE PLANE, FT)

POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION
1027	441217.00	1867854.00	651.00	TOE OF SLOPE – LIMIT OF CELL 7 EXCAVATION
1028	441502.97	1867854.00	651.00	TOE OF SLOPE – EDGE OF CELL 7 EXCAVATION
1029	441509.09	1867786.00	653.04	TOE OF SLOPE – LIMIT OF CELL 7 OVERBUILD
1030	441511.96	1867754.00	654.00	TOE OF SLOPE – CELL BOUNDARY
1031	441493.50	1868041.36	720.00	TOP OF CONSTRUCTION RAMP
1032	441500.22	1867999.90	720.00	TOP OF CONSTRUCTION RAMP
1033	441505.84	1868043.36	721.00	GRADE BREAK
1034	441524.90	1868003.90	722.00	GRADE BREAK
1035	441709.97	1868058.26	720.00	GRADE BREAK
1036	441744.90	1867904.00	731.64	SLOPE CREST – GRADE BREAK
1037	441744.90	1867754.00	731.64	SLOPE CREST – CELL BOUNDARY
1038	441862.00	1867904.00	729.30	GRADE BREAK
1039	441895.90	1868034.26	718.00	BASE OF HAUL ROAD
1040	441945.08	1868025.26	718.00	BASE OF HAUL ROAD
1041	441865.90	1867870.31	728.00	TOP OF HAUL ROAD
1042	441862.00	1867849.00	729.30	GRADE BREAK
1043	441915.08	1867861.31	728.00	TOP OF HAUL ROAD
1044	441885.91	1867579.11	728.00	DITCH CL (EAST LIMITS)
1045	441885.91	1867424.15	727.07	DITCH CL (WEST LIMITS)
CELL BERM				
1046	440065.67	1867197.50	723.20	GRADE BREAK
1047	440068.00	1867356.86	724.00	GRADE BREAK
1048	440071.51	1867597.74	725.20	GRADE BREAK
1049	440084.80	1867596.76	722.43	GRADE BREAK
1050	440025.00	1867653.80	718.49	CELL TOE ROAD CL (WEST LIMITS)
1051	440025.00	1867950.00	719.97	CELL TOE ROAD CL (EAST LIMITS)

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
(SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP)
1 Work may proceed.
2 Revise and resubmit. Work may proceed prior to resubmittal.
3 Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4 Revise and resubmit. Work may not proceed.
5 Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or relieve any "notes" placed on the contract.
Bill Roblauer — 10/9/07
0600X-SC-C0528L 05-R9 016
S00X524A00

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15849 SHT01	600G	0111

WCH Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0270	0

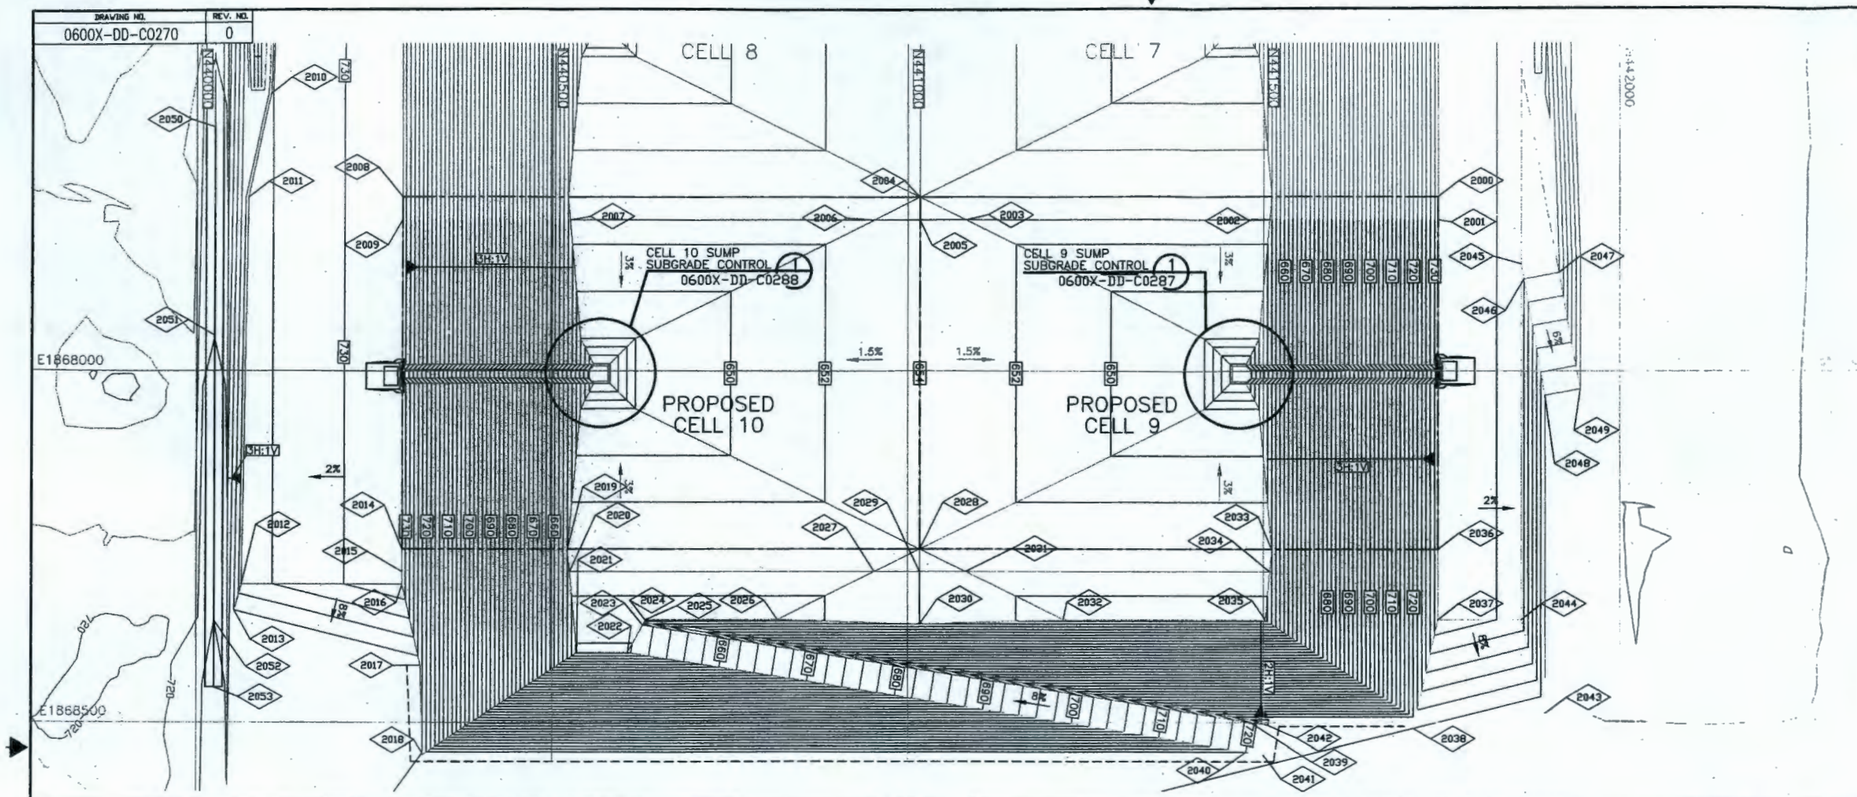

NOTES

1. GRADING TOLERANCES SHOWN ON DWG. NO. 0600-DD-C0281
2. LIMIT OF LINER COMPONENT CONSTRUCTION INDICATES EXTENT OF FULL-DEPTH CONSTRUCTION.
3. EXISTING CONTOURS FROM FIELD SURVEY PREPARED BY ROGERS SURVEYING, INC., DATED JULY, 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCONTRACTOR SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
4. SURVEY DATUM:
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. ☐ Work may proceed.
2. ☐ Review and resubmit. Work may proceed prior to resubmittal.
3. ☐ Review and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Review and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

DISCIPLINE									
ENGINEER									
REVIEWER									
DISPOSITION									

Bill Bohanan 10/9/07
DOCUMENT ID NUMBER 0600X-SL-G0524 0574 017
SCOX S24A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

0 50' 100' 200'

DOCUMENT CONTROL mjc 10/11/07

Best Available Copy

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIANT — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	DISC ENGR	ENGR CHK	SYS ENGR	FIELD ENGR
0	9/28/07	ISSUED FOR CONSTRUCTION	DW	CJB	Sam	DHT	MA	RCB

SCALE: AS SHOWN

SUBGRADE DESIGN CONTROL POINTS COORDINATES (WASHINGTON STATE PLANE, FT)

POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION
2000	441744.90	1867754.00	731.64	CELL BOUNDARY FOR CELLS 7 & 9
2001	441744.90	1867786.00	731.64	SLOPE CREST TIE IN – LIMIT OF CELL 7 OVERBUILD
2002	441509.09	1867786.00	653.04	TOE OF SLOPE TIE IN – LIMIT OF CELL 7 OVERBUILD
2003	441081.00	1867786.00	653.04	GRADE BREAK TIE IN – LIMIT OF CELL 7 OVERBUILD
2004	441017.00	1867754.00	654.00	CELL BOUNDARY FOR CELLS 7, 8, 9, & 10
2005	441017.00	1867786.00	654.00	CELL BOUNDARY FOR CELLS 9 & 10 – LIMIT OF CELLS 7 & 8 OVERBUILD
2006	440953.00	1867786.00	653.04	GRADE BREAK TIE IN – LIMIT OF CELL 8 OVERBUILD
2007	440524.91	1867786.00	653.04	TOE OF SLOPE TIE IN – LIMIT OF CELL 8 OVERBUILD
2008	440289.10	1867754.00	731.64	CELL BOUNDARY FOR CELLS 8 & 10
2009	440289.10	1867786.00	731.64	SLOPE CREST TIE IN – LIMIT OF CELL 8 OVERBUILD
2010*	440104.32	1867605.44	727.95	GRADE BREAK
2011*	440072.43	1867754.00	727.31	GRADE BREAK
2012	440063.66	1868304.00	726.15	GRADE BREAK
2013	440053.71	1868340.68	724.00	GRADE BREAK
2014	440289.10	1868254.00	731.64	SLOPE CREST – CELL BOUNDARY
2015	440289.10	1868286.00	731.64	SLOPE CREST – LIMIT OF CELL 10 OVERBUILD
2016	440289.10	1868304.00	731.64	SLOPE CREST – GRADE BREAK
2017	440315.01	1868418.42	723.01	SLOPE CREST – GRADE BREAK
2018	440318.03	1868542.36	722.00	SLOPE CREST – GRADE BREAK
2019	440522.03	1868254.00	654.00	TOE OF SLOPE – CELL BOUNDARY
2020	440525.02	1868286.00	653.04	TOE OF SLOPE – LIMIT OF CELL 10 OVERBUILD
2021	440535.22	1868400.56	649.60	TOE OF SLOPE – EDGE OF CELL 10 EXCAVATION
2022	440606.37	1868400.56	649.60	TOE OF SLOPE – EDGE OF CELL 10 EXCAVATION
2023	440627.57	1868361.45	650.78	BASE OF CONSTRUCTION ACCESS RAMP BERM
2024	440634.52	1868358.52	653.29	BASE OF CONSTRUCTION ACCESS RAMP BERM
2025	440631.61	1868354.00	651.00	BASE OF CONSTRUCTION ACCESS RAMP BERM
2026	440817.00	1868354.00	651.00	TOE OF SLOPE – EDGE OF CELL 10 EXCAVATION
2027	440953.00	1868286.00	653.04	GRADE BREAK – LIMIT OF CELL 10 OVERBUILD

SUBGRADE DESIGN CONTROL POINTS COORDINATES (WASHINGTON STATE PLANE, FT)

POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION
2028	441017.00	1868254.02	654.00	GRADE BREAK – CELL BOUNDARY FOR CELLS 9 & 10
2029	441017.00	1868286.00	654.00	GRADE BREAK – LIMIT OF CELLS 9 & 10 OVERBUILD
2030	441017.00	1868360.00	654.00	CELL BOUNDARY – TOE OF SLOPE
2031	441081.00	1868286.00	653.04	GRADE BREAK – LIMIT OF CELL 9 OVERBUILD
2032	441217.00	1868354.00	651.00	TOE OF SLOPE – EDGE OF CELL 9 EXCAVATION
2033	441511.97	1868254.00	654.00	TOE OF SLOPE – CELL BOUNDARY
2034	441509.09	1868286.00	653.04	TOE OF SLOPE – LIMIT OF CELL 9 OVERBUILD
2035	441502.97	1868354.00	651.00	TOE OF SLOPE – LIMIT OF CELL 9 EXCAVATION
2036	441744.90	1868254.00	731.64	SLOPE CREST – CELL BOUNDARY
2037	441744.90	1868354.00	731.64	SLOPE CREST – GRADE BREAK
2038	441709.97	1868508.26	720.00	GRADE BREAK
2039	441481.72	1868499.90	720.00	TOP OF CONSTRUCTION RAMP
2040	441475.00	1868541.36	720.00	TOP OF CONSTRUCTION RAMP
2041	441499.67	1868545.36	722.00	GRADE BREAK
2042	441506.39	1868503.90	722.00	GRADE BREAK
2043	441895.90	1868486.77	718.00	GRADE BREAK
2044	441862.00	1868354.00	729.30	GRADE BREAK
2045*	441862.00	1867849.00	729.30	GRADE BREAK
2046*	441865.90	1867870.31	728.00	TOP OF HAUL ROAD
2047*	441915.08	1867861.31	728.00	TOP OF HAUL ROAD
2048*	441895.90	1868034.26	718.00	BASE OF HAUL ROAD
2049*	441945.08	1868025.26	718.00	BASE OF HAUL ROAD
CELL BERM				
2050*	440025.00	1867653.80	718.19	CELL TOE ROAD CL (WEST LIMITS OF CELL 8)
2051	440025.00	1867950.00	719.97	CELL TOE ROAD CL (WEST LIMITS OF CELL 10)
2052	440025.00	1868354.93	722.00	CELL TOE ROAD CL
2053	440025.00	1868450.00	722.47	CELL TOE ROAD CL (EAST LIMITS)

NOTE:
* DENOTES TIE IN FROM PREVIOUS CONSTRUCTION OF CELLS 7 & 8

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15850 SHT01	600G	0111

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7–10
SUBGRADE SURVEY CONTROL – CELLS 9 & 10

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0270.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0270	0

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0271	0

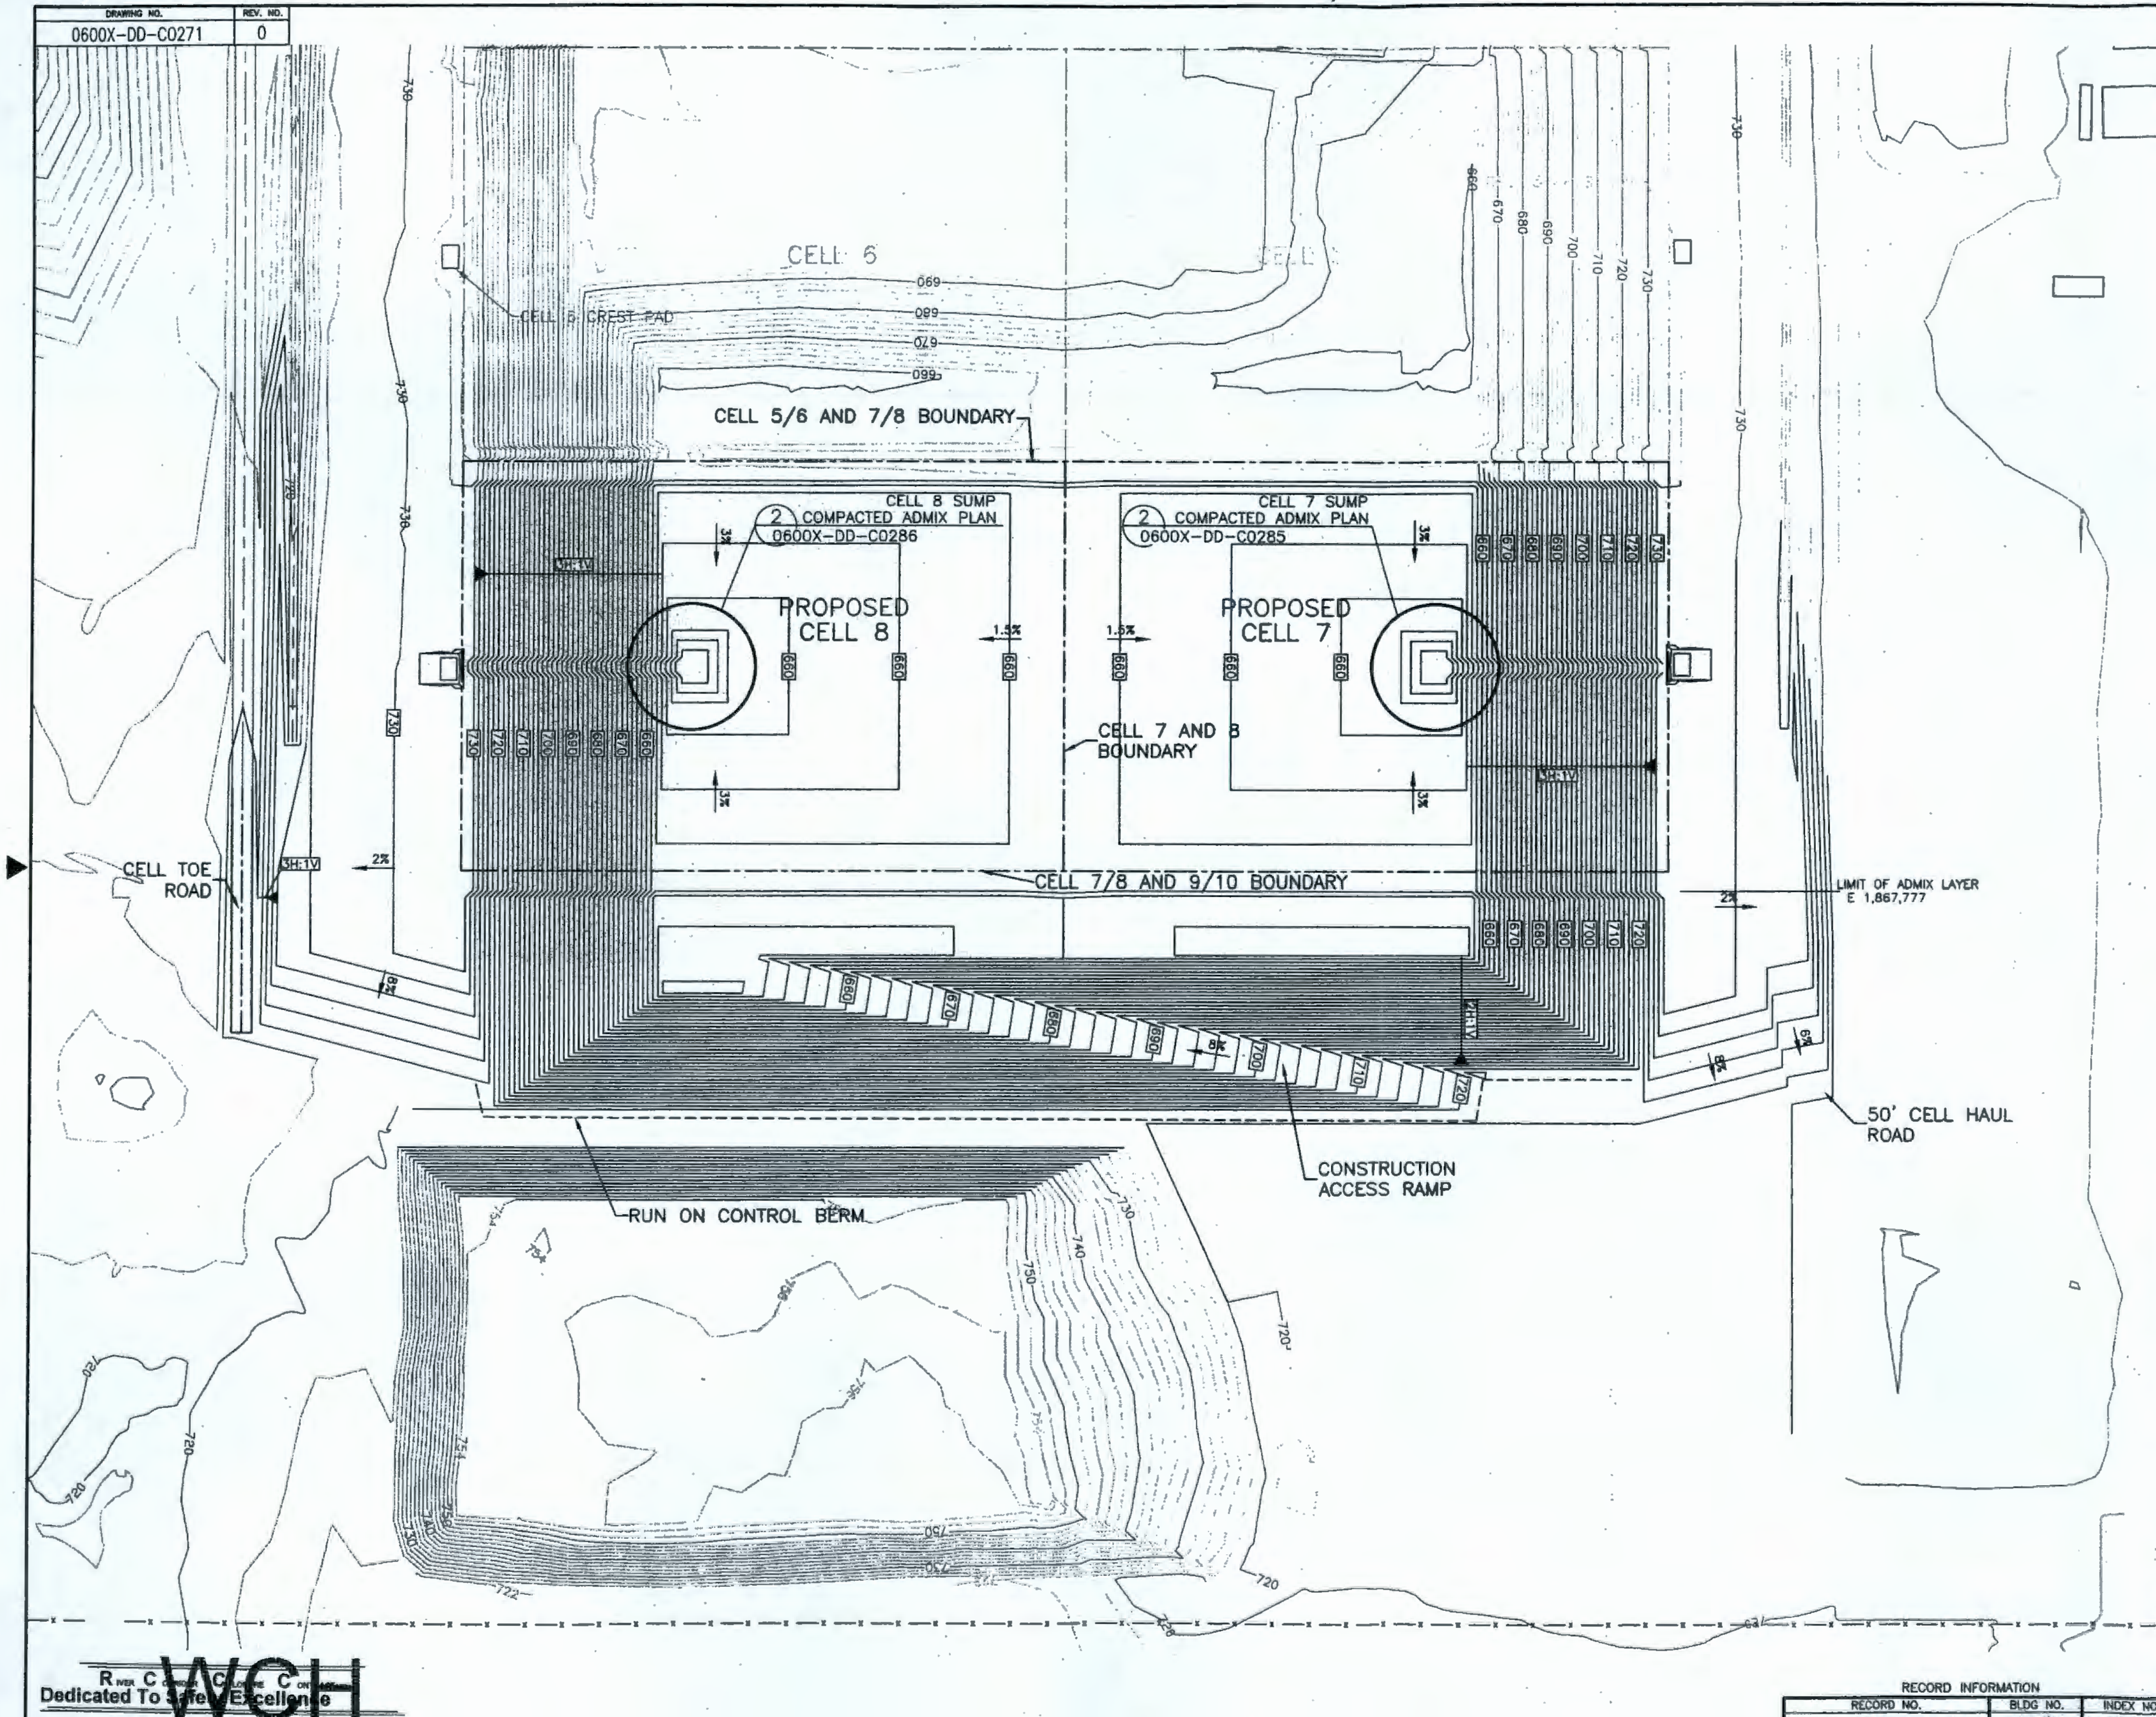

RIVER CORRIDOR CLOSURE CONTRACT
WCH
Dedicated To Safety Excellence

NOTES

1. GRADING TOLERANCES SHOWN ON DWG. NO. 0600-DD-C0281.
2. LIMIT OF LINER COMPONENT CONSTRUCTION INDICATES EXTENT OF FULL-DEPTH CONSTRUCTION.
3. EXISTING CONTOURS FROM FIELD SURVEY PREPARED BY ROGERS SURVEYING, INC., DATED JULY, 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCONTRACTOR SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
4. SURVEY DATUM:
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)

Best Available Copy

DOCUMENT CONTROL mec 10/11/07

0 50' 100' 200'

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. ☑ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borlaug 10/9/07
0600X-SC-G0524 05-19 018
S00X524A00

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIEST — STATE OF WASHINGTON — 42158 REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJW	CJB	Sam	AH	N/A	JCB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
ADMIX LAYER CONTOURS - CELLS 7 & 8

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0271.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0271	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15851 SHT01	600G	0111

DRAWING NO.	REV. NO.
0600X-DD-C0272	0

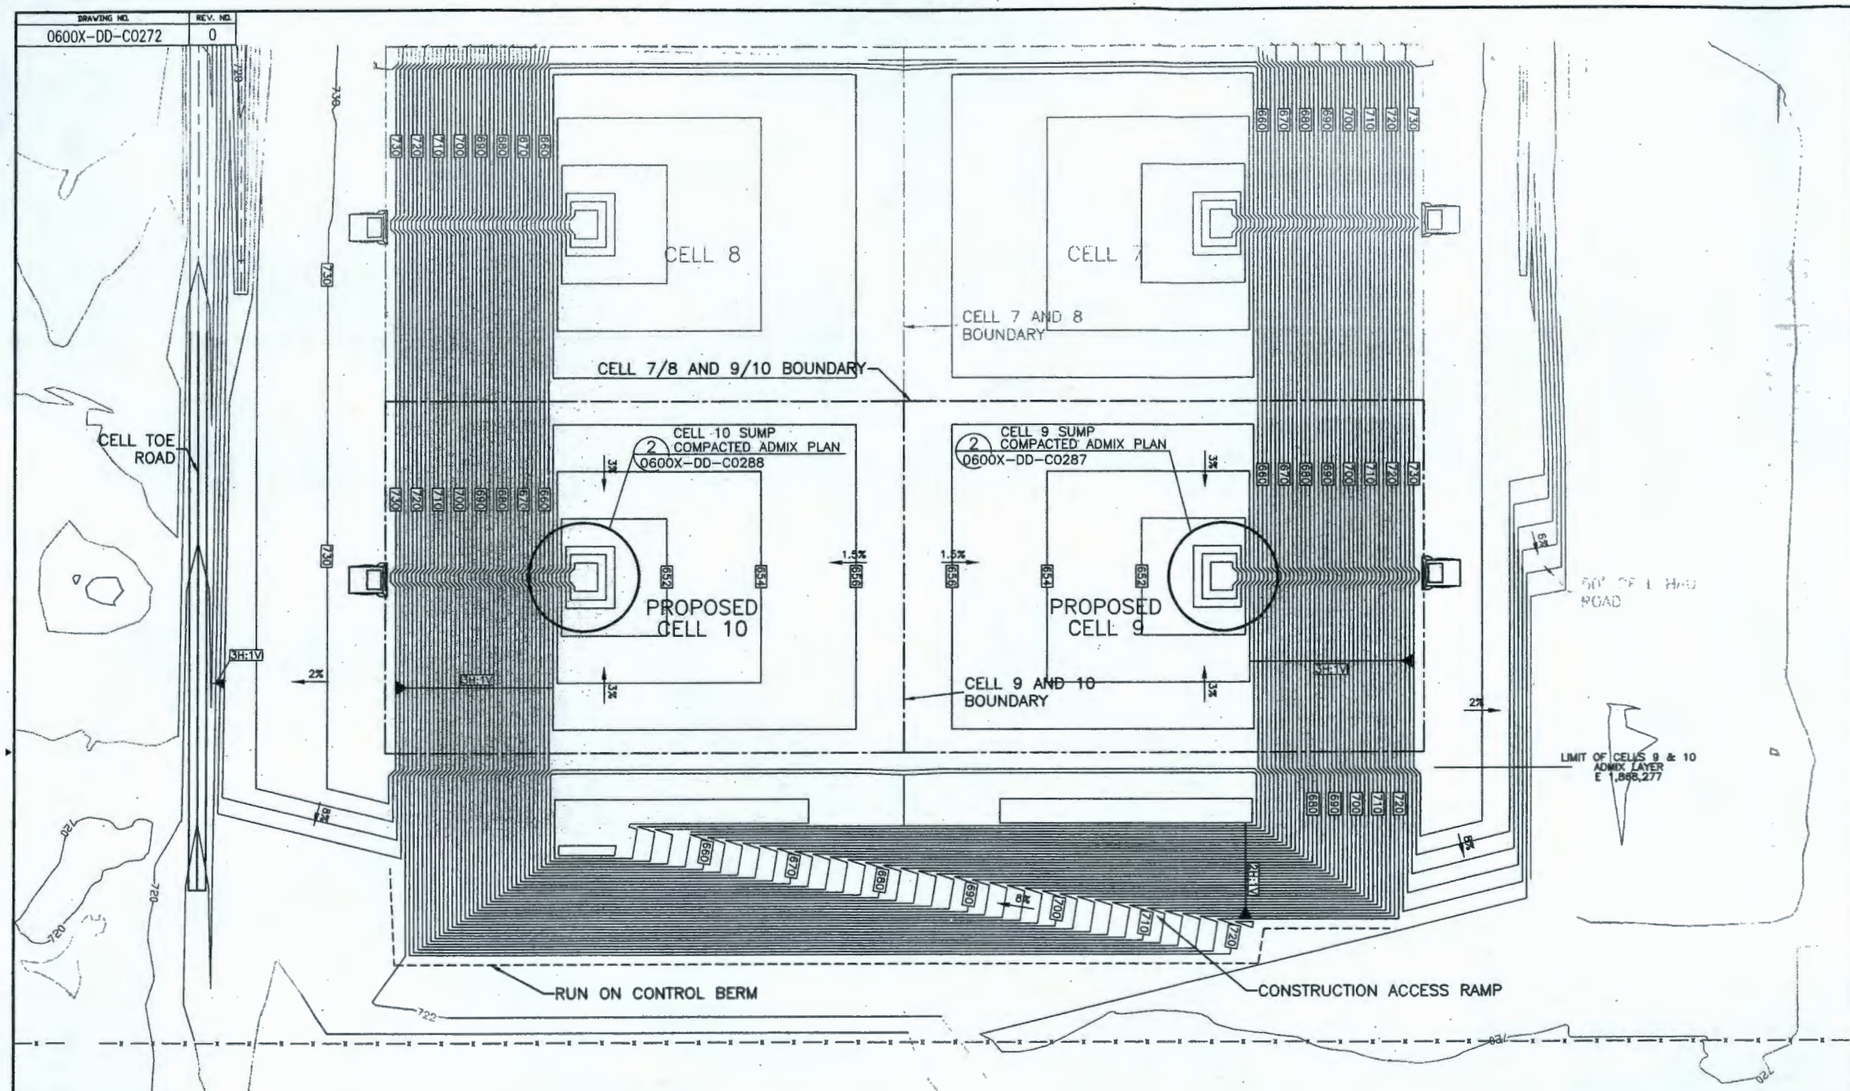

NOTES

1. GRADING TOLERANCES SHOWN ON DWG. NO. 0600-DD-C0281.
2. LIMIT OF LINER COMPONENT CONSTRUCTION INDICATES EXTENT OF FULL-DEPTH CONSTRCUTION.
3. EXISTING CONTOURS FROM FIELD SURVEY PREPARED BY ROGERS SURVEYING, INC., DATED JULY, 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCONTRACTOR SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
4. SURVEY DATUM:
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)

0 50' 100' 200'

DOCUMENT CONTROL mlc 10/11/07

Best Available Copy

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRANDT — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	DESIG/ ENG'R	ENG'R CHK	SYS. ENG'R	PROJ. ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION.	JJ	CJB	[illegible]	[illegible]	NA	RB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
ADMIX LAYER CONTOURS – CELLS 9 & 10

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0272.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0272	0

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

STATUS STAMP																							
REVIEWED BY																							
REVIEWED BY																							

Bill Boesley 10/9/07
Reviewer/Date

DOCUMENT ID NUMBER
0600X-C-60584 05-19 019
SCHD. NO. GRID ITEM SUBMITTAL

S00X524A00

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15852 SHT01	600G	0111

River Corridor Closure Contract — Dedicated To Safety Excellence — WCH

ERA_VCP-SUBMS 11/00

DRAWING NO.	REV. NO.
0600X-DD-C0273	0

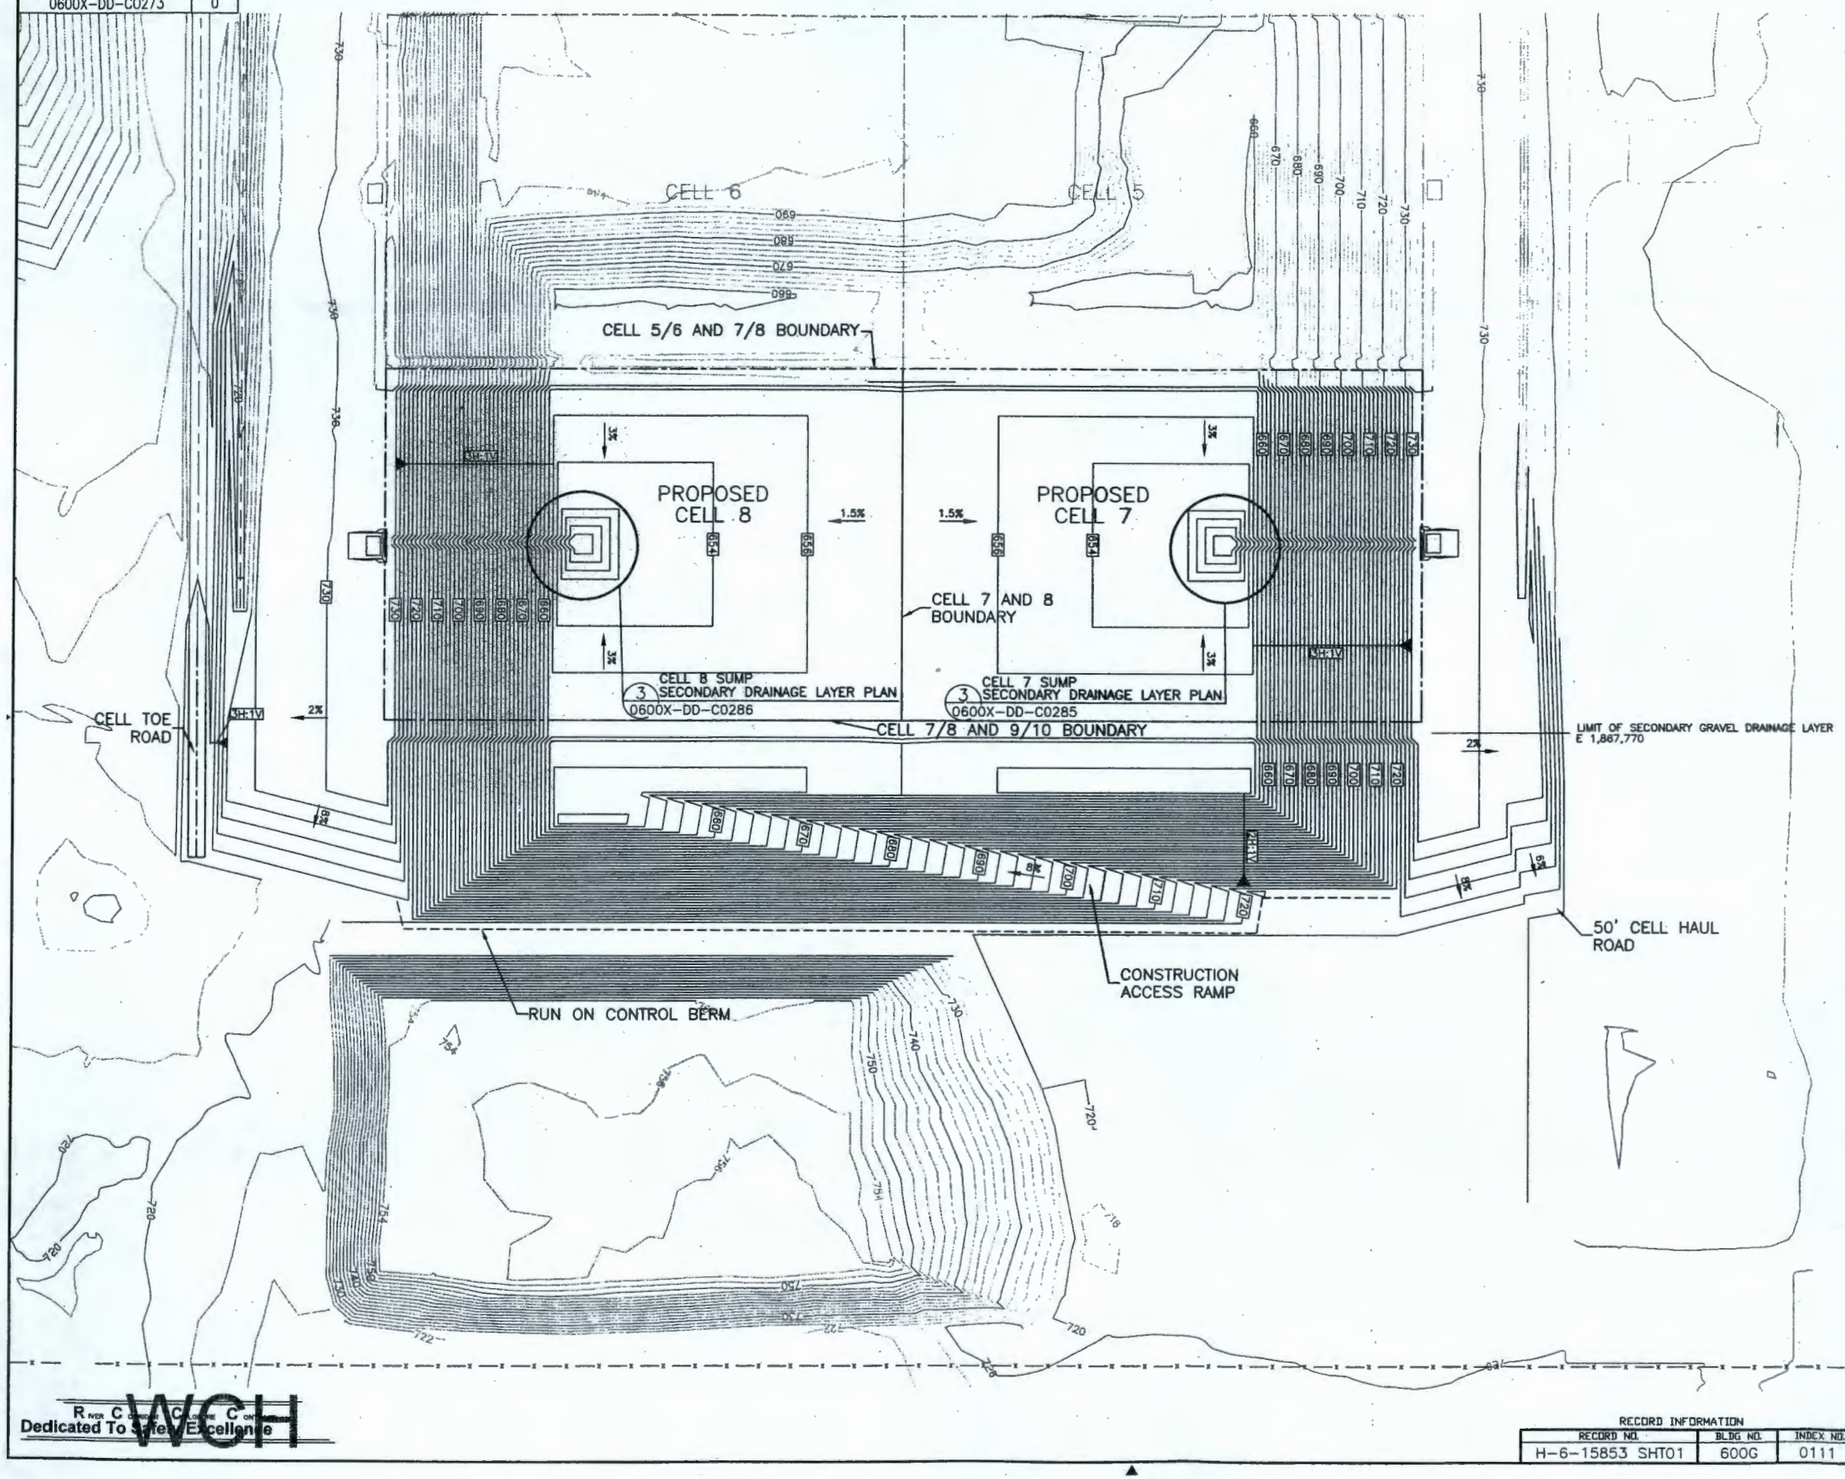

NOTES

1. GRADING TOLERANCES SHOWN ON DWG. NO. 0600-DD-C0281.
2. LIMIT OF CONSTRUCTION INDICATES EXTENT OF FULL-DEPTH CONSTRUCTION.
3. EXISTING CONTOURS FROM FIELD SURVEY PREPARED BY ROGERS SURVEYING, INC., DATED JULY, 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCONTRACTOR SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
4. SURVEY DATUM:
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)

DOCUMENT CONTROL mkc 10/11/07

Best Available Copy

0 50' 100' 200'

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. (X) Work may proceed.
2. ( ) Revise and resubmit. Work may proceed prior to resubmittal.
3. ( ) Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ( ) Revise and resubmit. Work may not proceed.
5. ( ) Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on this contract.

DISPOSITION													
1													
2													
3													
4													
5													
6													
7													
8													
9													
10													
11													
12													
13													
14													
15													
16													
17													
18													
19													
20													
21													
22													
23													
24													
25													
26													
27													
28													
29													
30													
31													
32													
33													
34													
35													
36													
37													
38													
39													
40													
41													
42													
43													
44													
45													
46													
47													
48													
49													
50													
51													
52													
53													
54													
55													
56													
57													
58													
59													
60													
61													
62													
63													
64													
65													
66													
67													
68													
69													
70													
71													
72													
73													
74													
75													
76													
77													
78													
79													
80													
81													
82													
83													
84													
85													
86													
87													
88													
89													
90													
91													
92													
93													
94													
95													
96													
97													
98													
99													
100													

Bill Dobelaer 10/9/07
06001-SC-G0824 05-19 020
500X524A00

RECEIVED
OCT 08 2007
CH - DOCUMENT CONTROL

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRUST — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	DESIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JDW	CJB	Sm	BH	N/A	RB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SECONDARY DRAINAGE LAYER CONTOURS – CELLS 7 & 8

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0273.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0273	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15853 SHT01	600G	0111

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0274	0

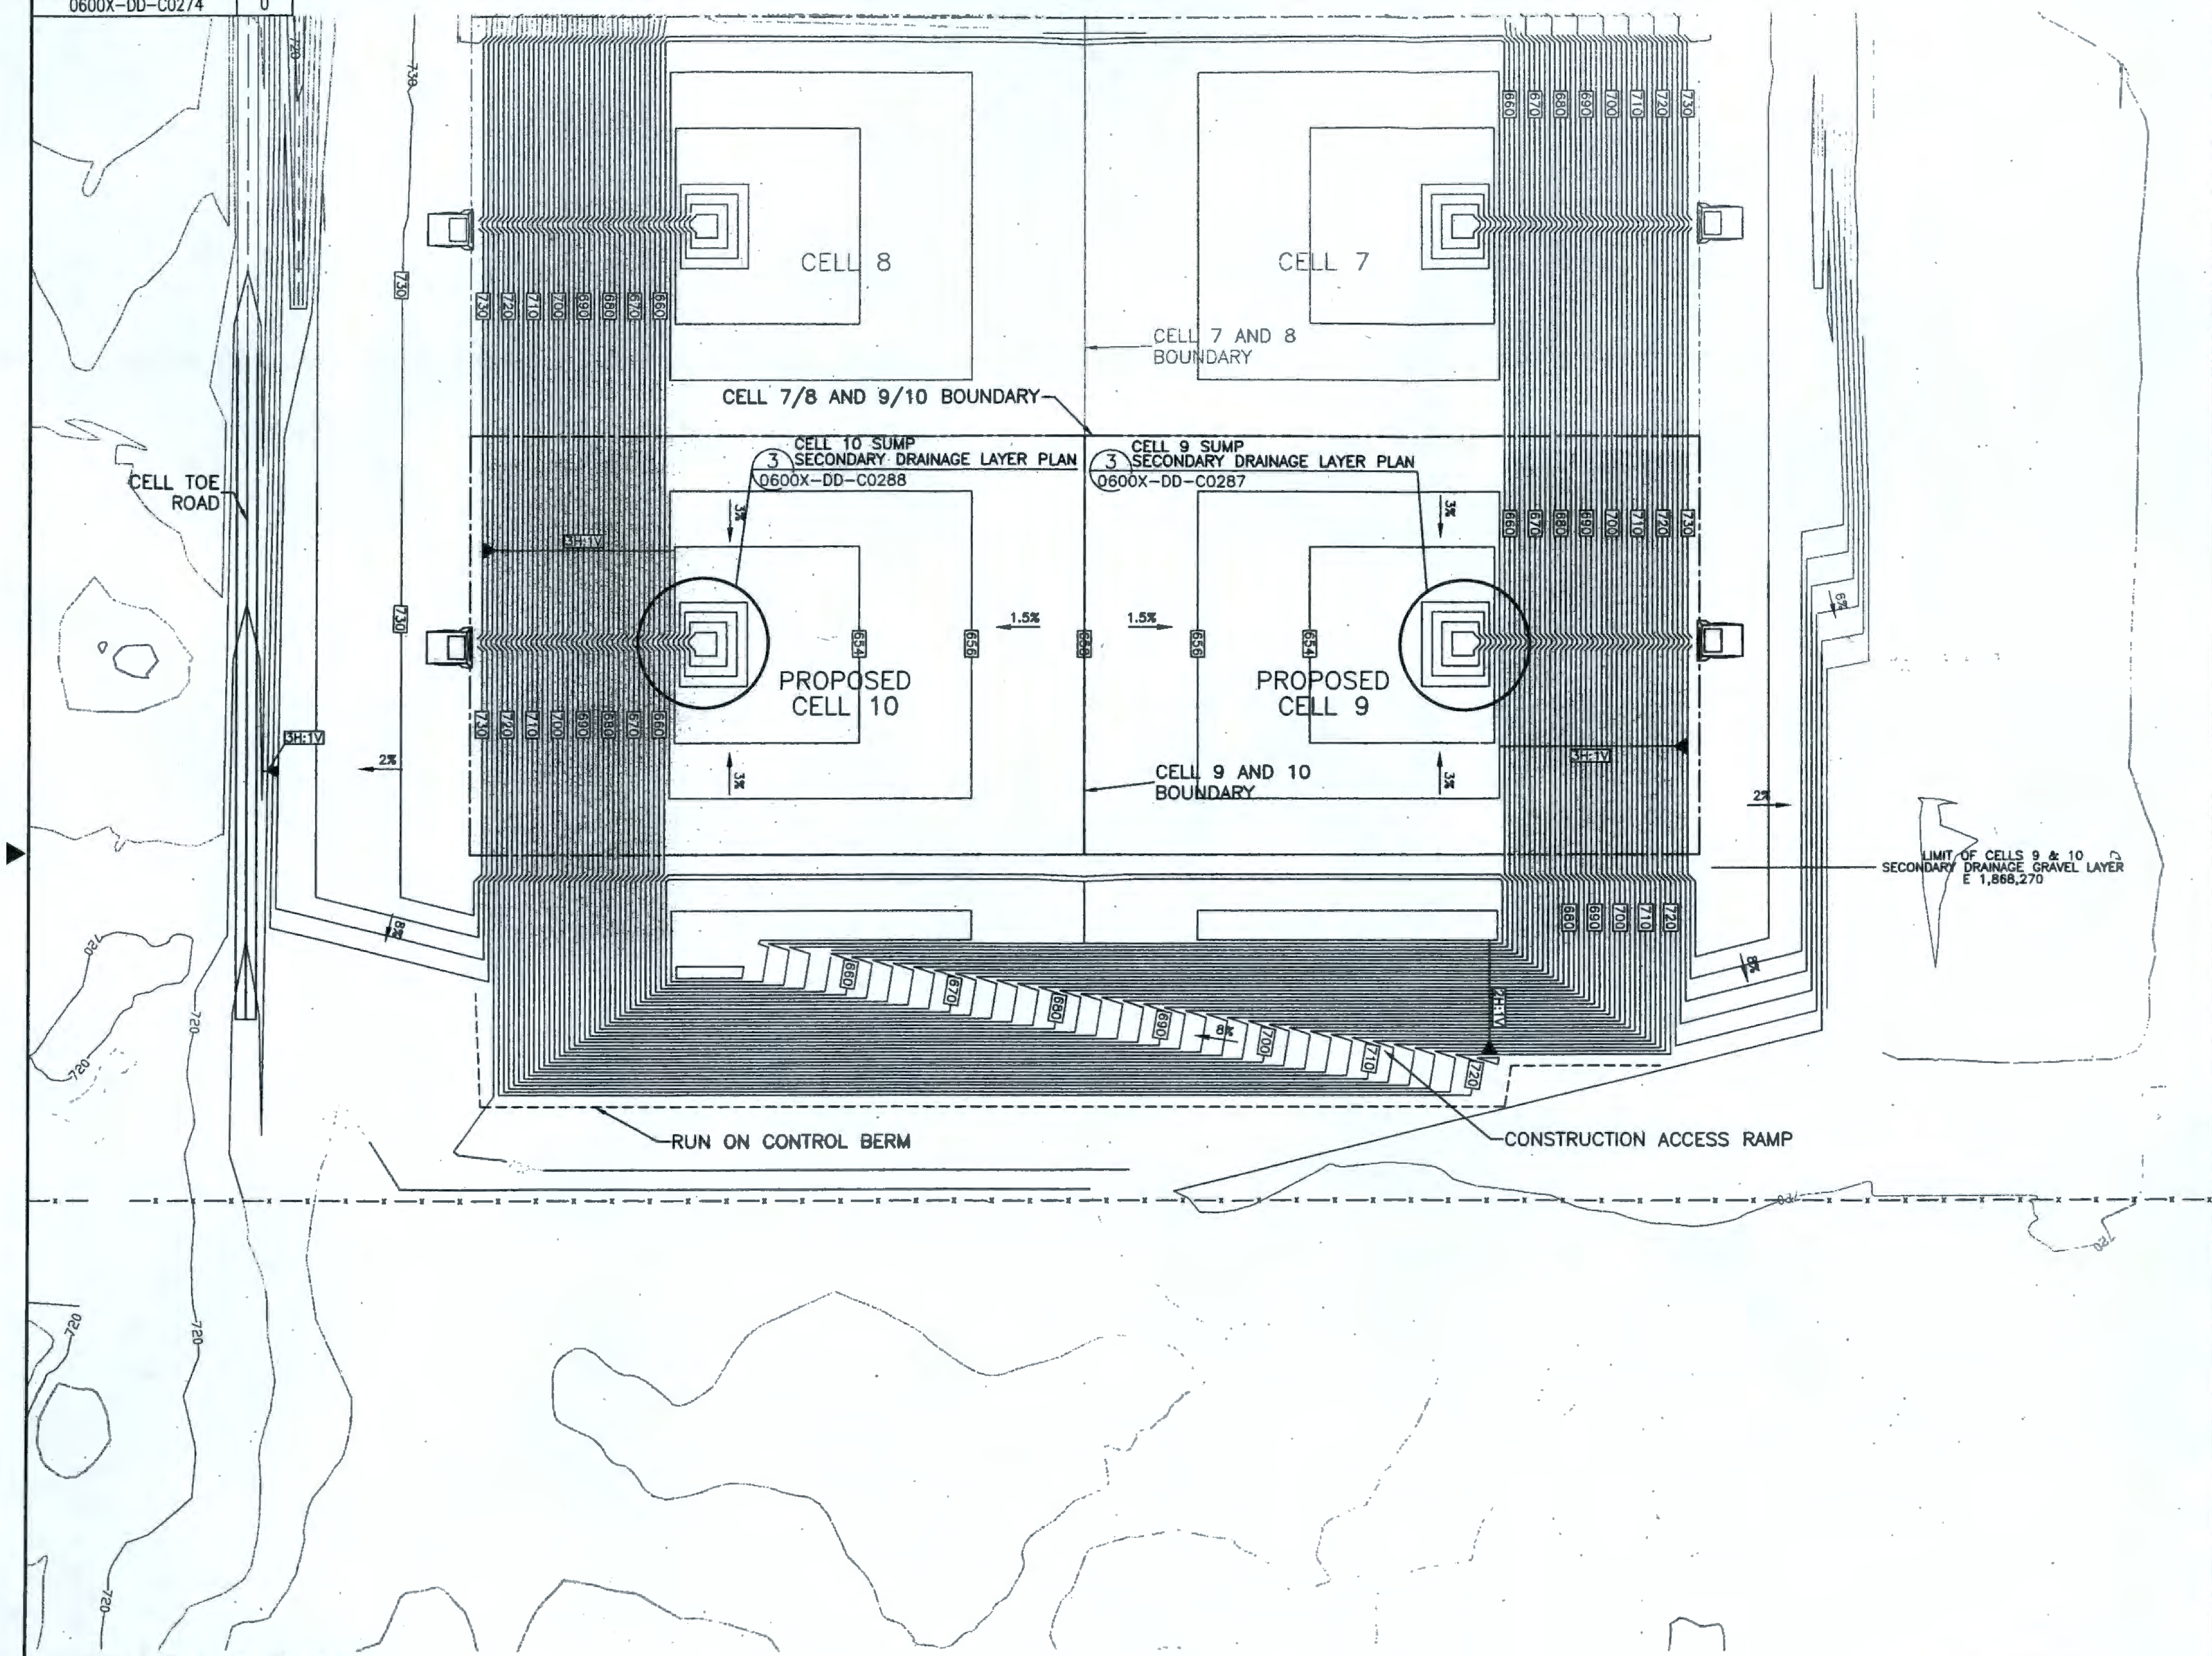

NOTES

1. GRADING TOLERANCES SHOWN ON DWG. NO. 0600-DD-C0281.
2. LIMIT OF LINER COMPONENT CONSTRUCTION INDICATES EXTENT OF FULL-DEPTH CONSTRUCTION.
3. EXISTING CONTOURS FROM FIELD SURVEY PREPARED BY ROGERS SURVEYING, INC., DATED JULY, 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCONTRACTOR SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
4. SURVEY DATUM:
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)

DOCUMENT CONTROL mec 10/11/07

Best Available Copy

N

0 50' 100' 200'

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borlaug 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G0524 05-19 021
S00X524 A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIEST — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ENGR	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJW	CB	Simon	BJH	N/A	DR

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SECONDARY DRAINAGE LAYER CONTOURS - CELLS 9 & 10

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0274.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0274	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15854 SHT01	600G	0111

River Corridor Closure Contract
Dedicated To Safety/Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0275	0

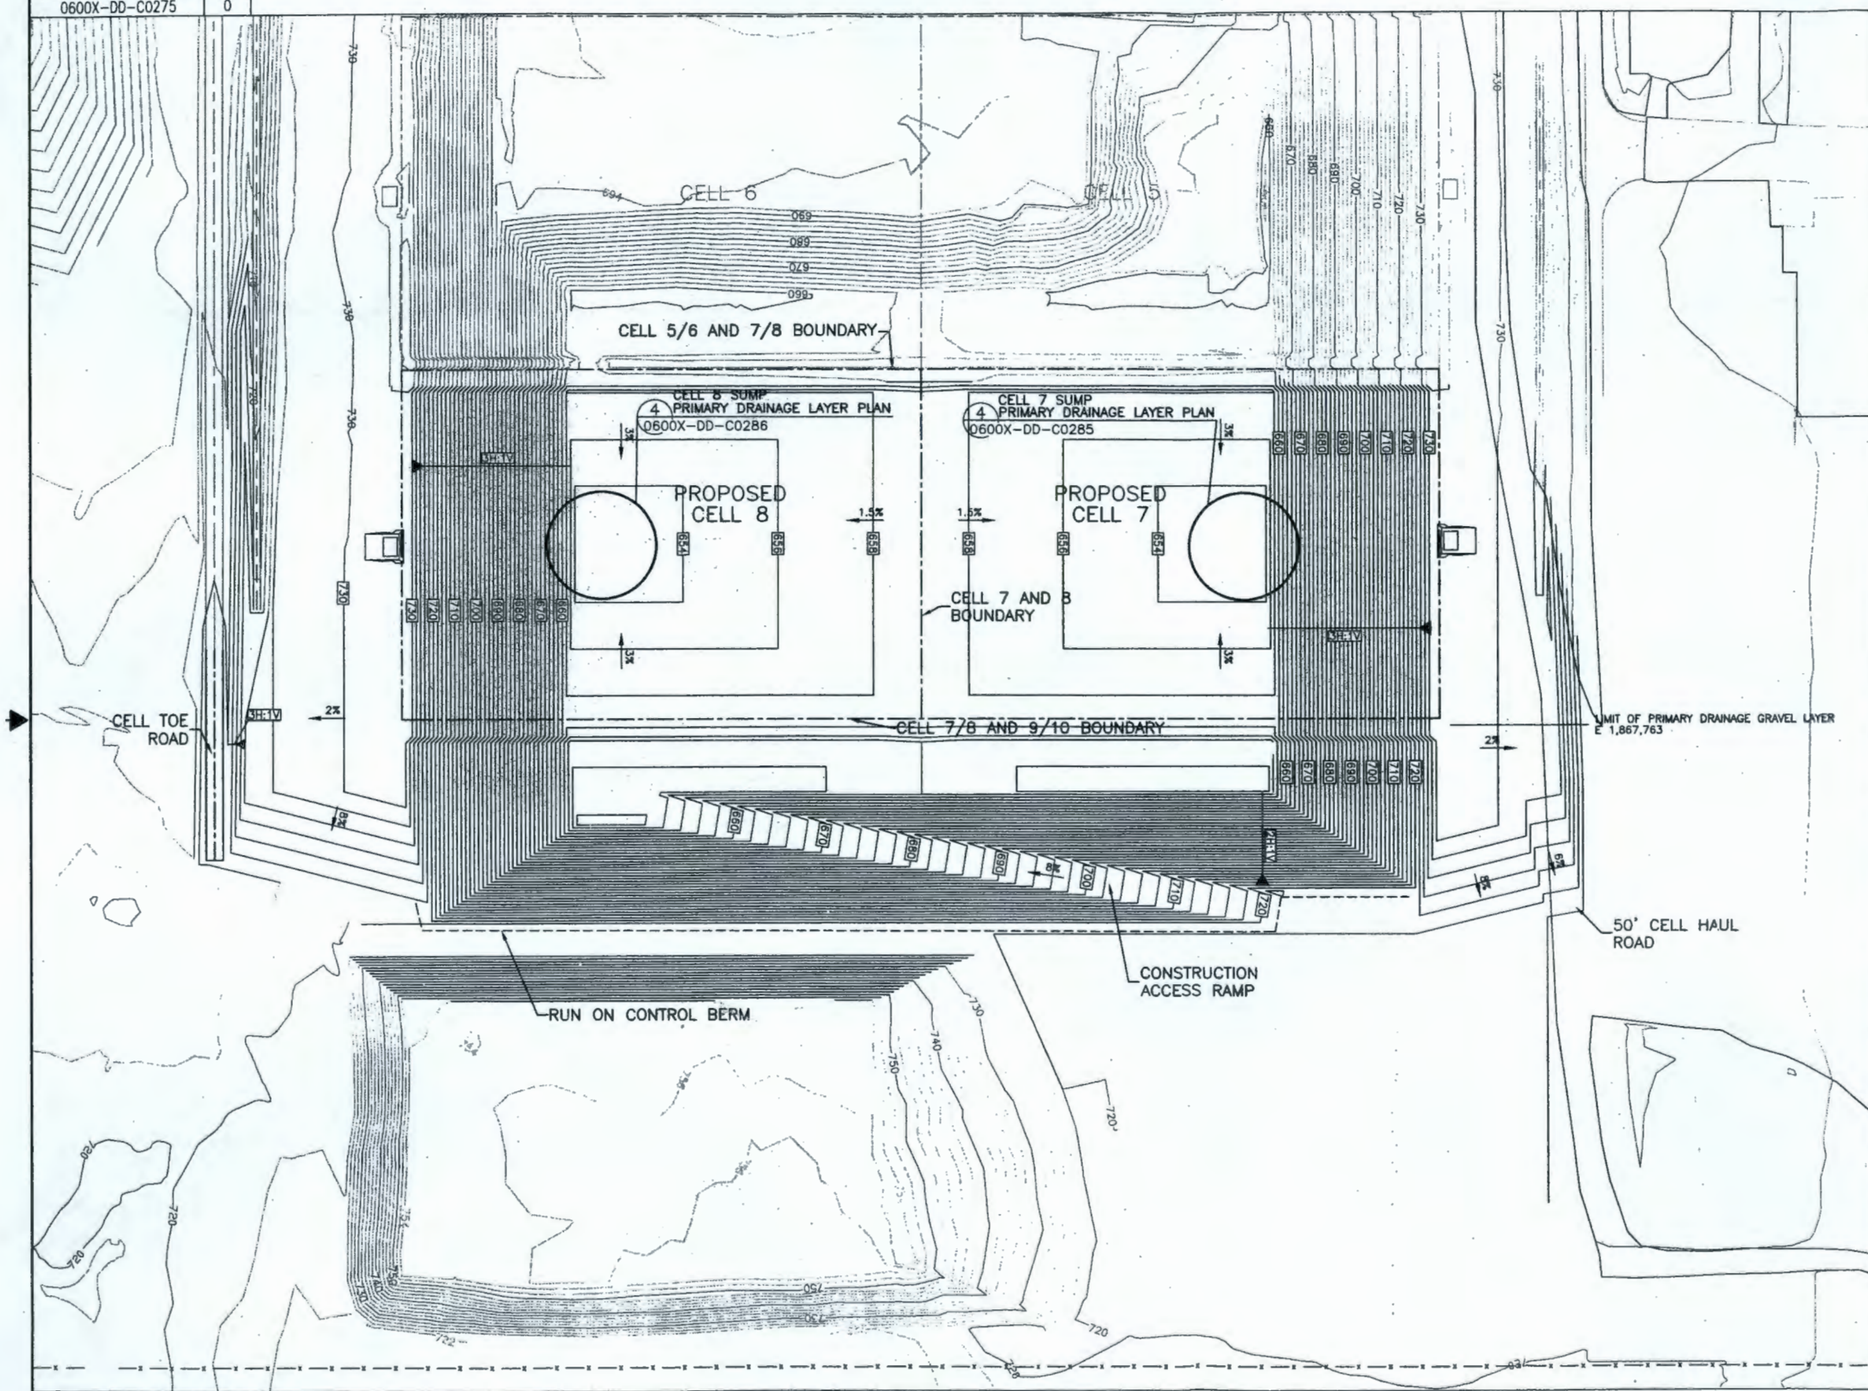

NOTES

1. GRADING TOLERANCES SHOWN ON DWG. NO. 0600-DD-C0281.
2. LIMIT OF LINER COMPONENT CONSTRUCTION INDICATES EXTENT OF FULL-DEPTH CONSTRUCTION.
3. EXISTING CONTOURS FROM FIELD SURVEY PREPARED BY ROGERS SURVEYING, INC., DATED JULY, 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCONTRACTOR SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
4. SURVEY DATUM:
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)

DOCUMENT CONTROL 10/11/07

Best Available Copy

0 50' 100' 200'

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Borlaug 10/9/07
0600X-C-C0341 05-19 022
SCOXG34H00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIERLY — STATE OF WASHINGTON — 9/28/07 — 42158 — REGISTERED PROFESSIONAL ENGINEER

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ENGG/ ENGR	ENGR CHK	SYS ENGR	PROJ ENGR
0	9/28/07	ISSUED FOR CONSTRUCTION	JSW	CJB	[illegible]	RH	NA	JRB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.	WEAVER BOOS CONSULTANTS, LLC
RICHLAND, WASHINGTON	DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
PRIMARY DRAINAGE LAYER CONTOURS - CELLS 7 & 8

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0275.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0275	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15855 SHT01	600G	0111

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0276	0

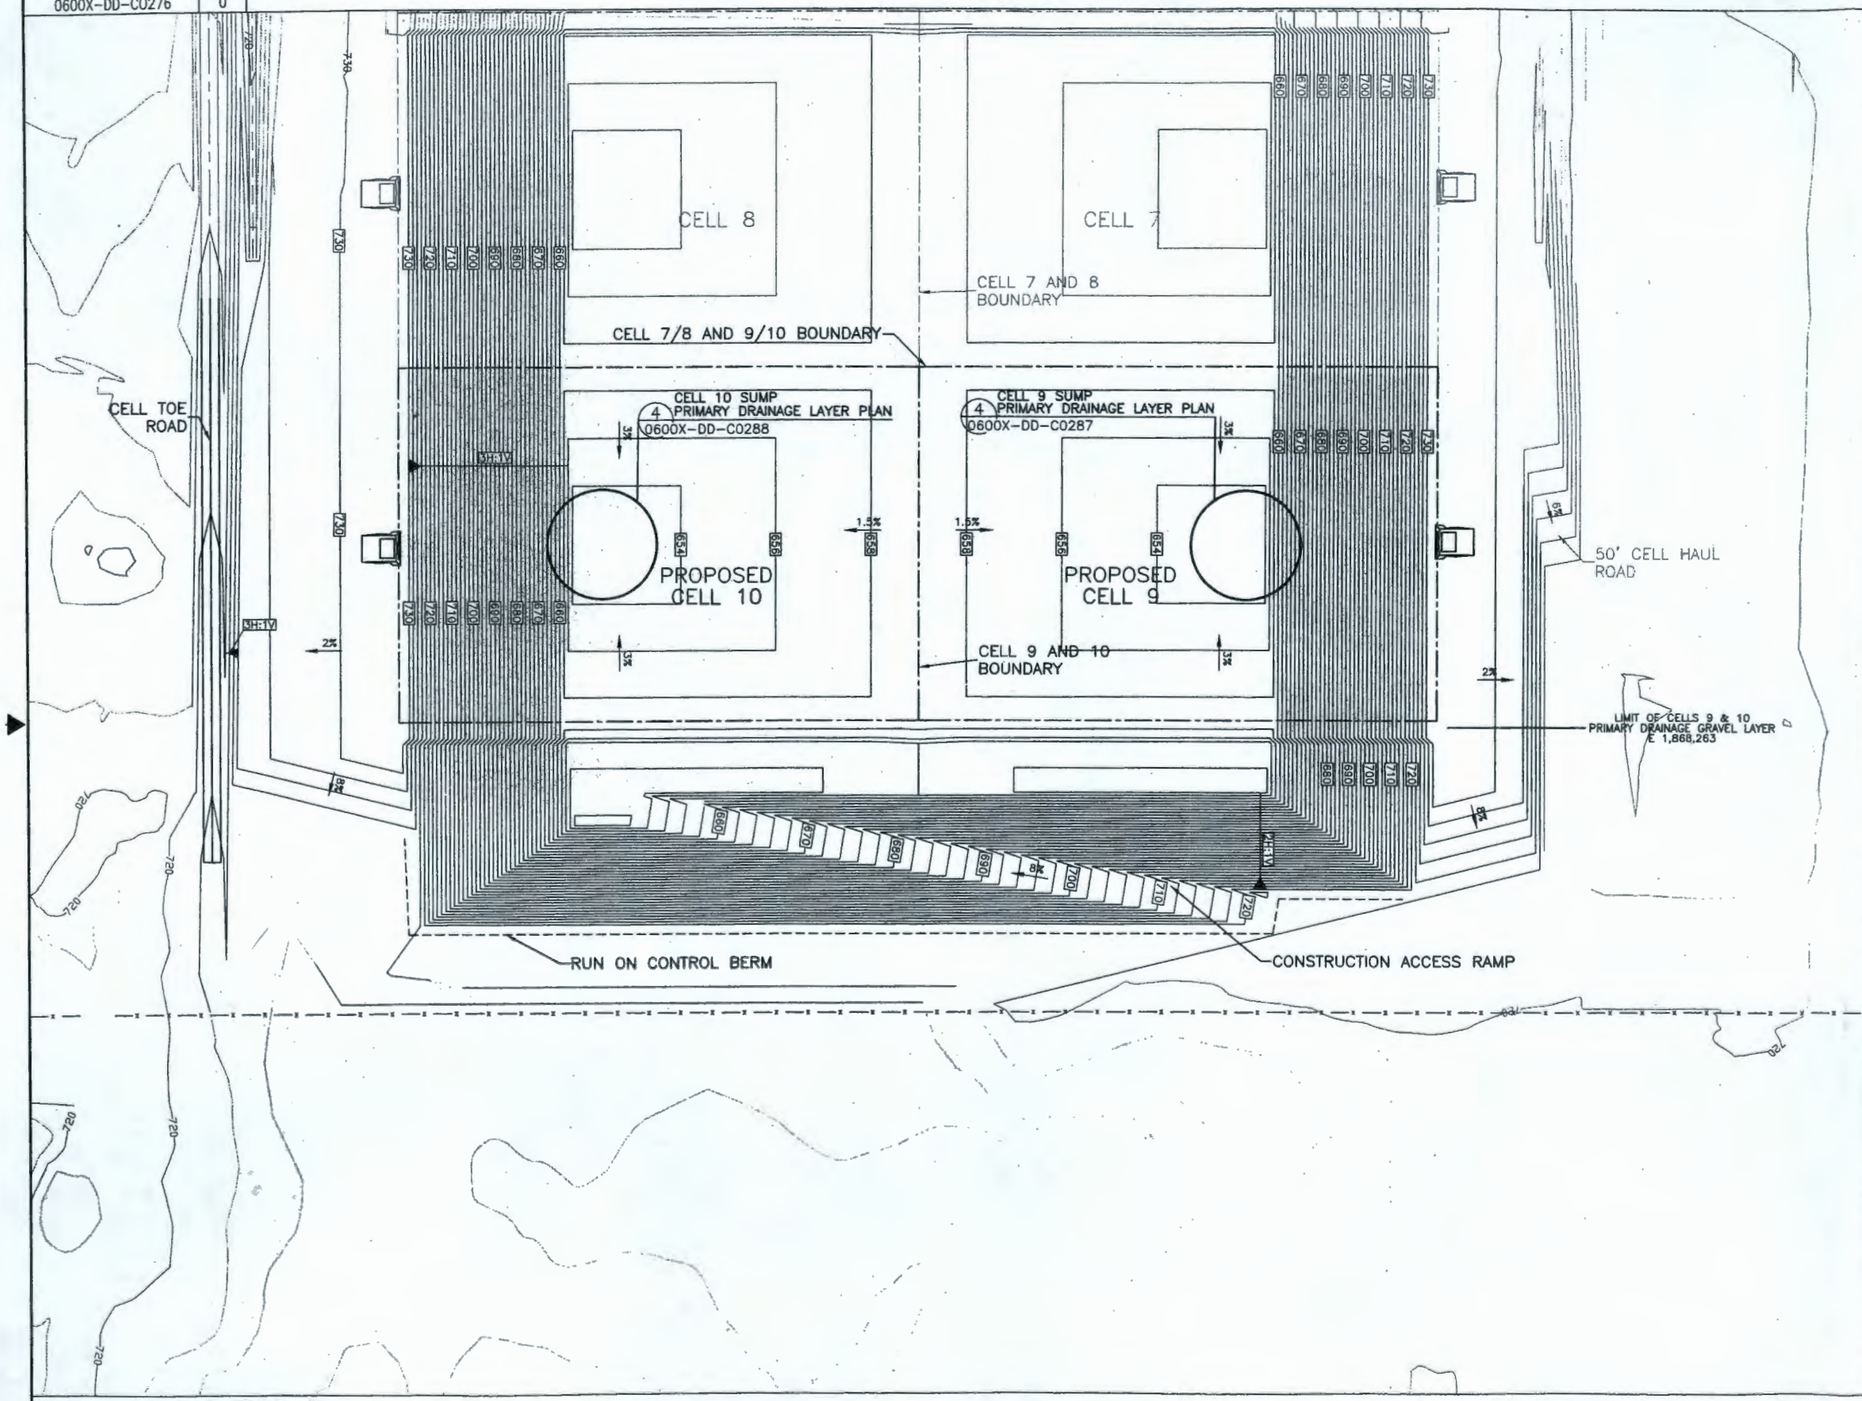

NOTES

1. GRADING TOLERANCES SHOWN ON DWG. NO. 0600-DD-C0281.
2. LIMIT OF LINER COMPONENT CONSTRUCTION INDICATES EXTENT OF FULL-DEPTH CONSTRUCTION.
3. EXISTING CONTOURS FROM FIELD SURVEY PREPARED BY ROGERS SURVEYING, INC., DATED JULY, 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCONTRACTOR SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
4. SURVEY DATUM:
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)

DOCUMENT CONTROL mlc 10/11/07

Best Available Copy

0 50' 100' 200'

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1 ☑ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3 ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Furnished to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Boerlauty 10/9/07
DOCUMENT ID NUMBER: 0600XEC-00524 05-19 023
500X524R00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGHT — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENGR	CHK'R CHK	SYS ENGR	PROJ ENGR
0	9/28/07	ISSUED FOR CONSTRUCTION	JW	CJB		RH	NA	

SCALE AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
PRIMARY DRAINAGE LAYER CONTOURS – CELLS 9 & 10

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0276.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0276	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15856 SHT01	600G	0111

River Corridor Closure Contract
WCH
Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0277	0

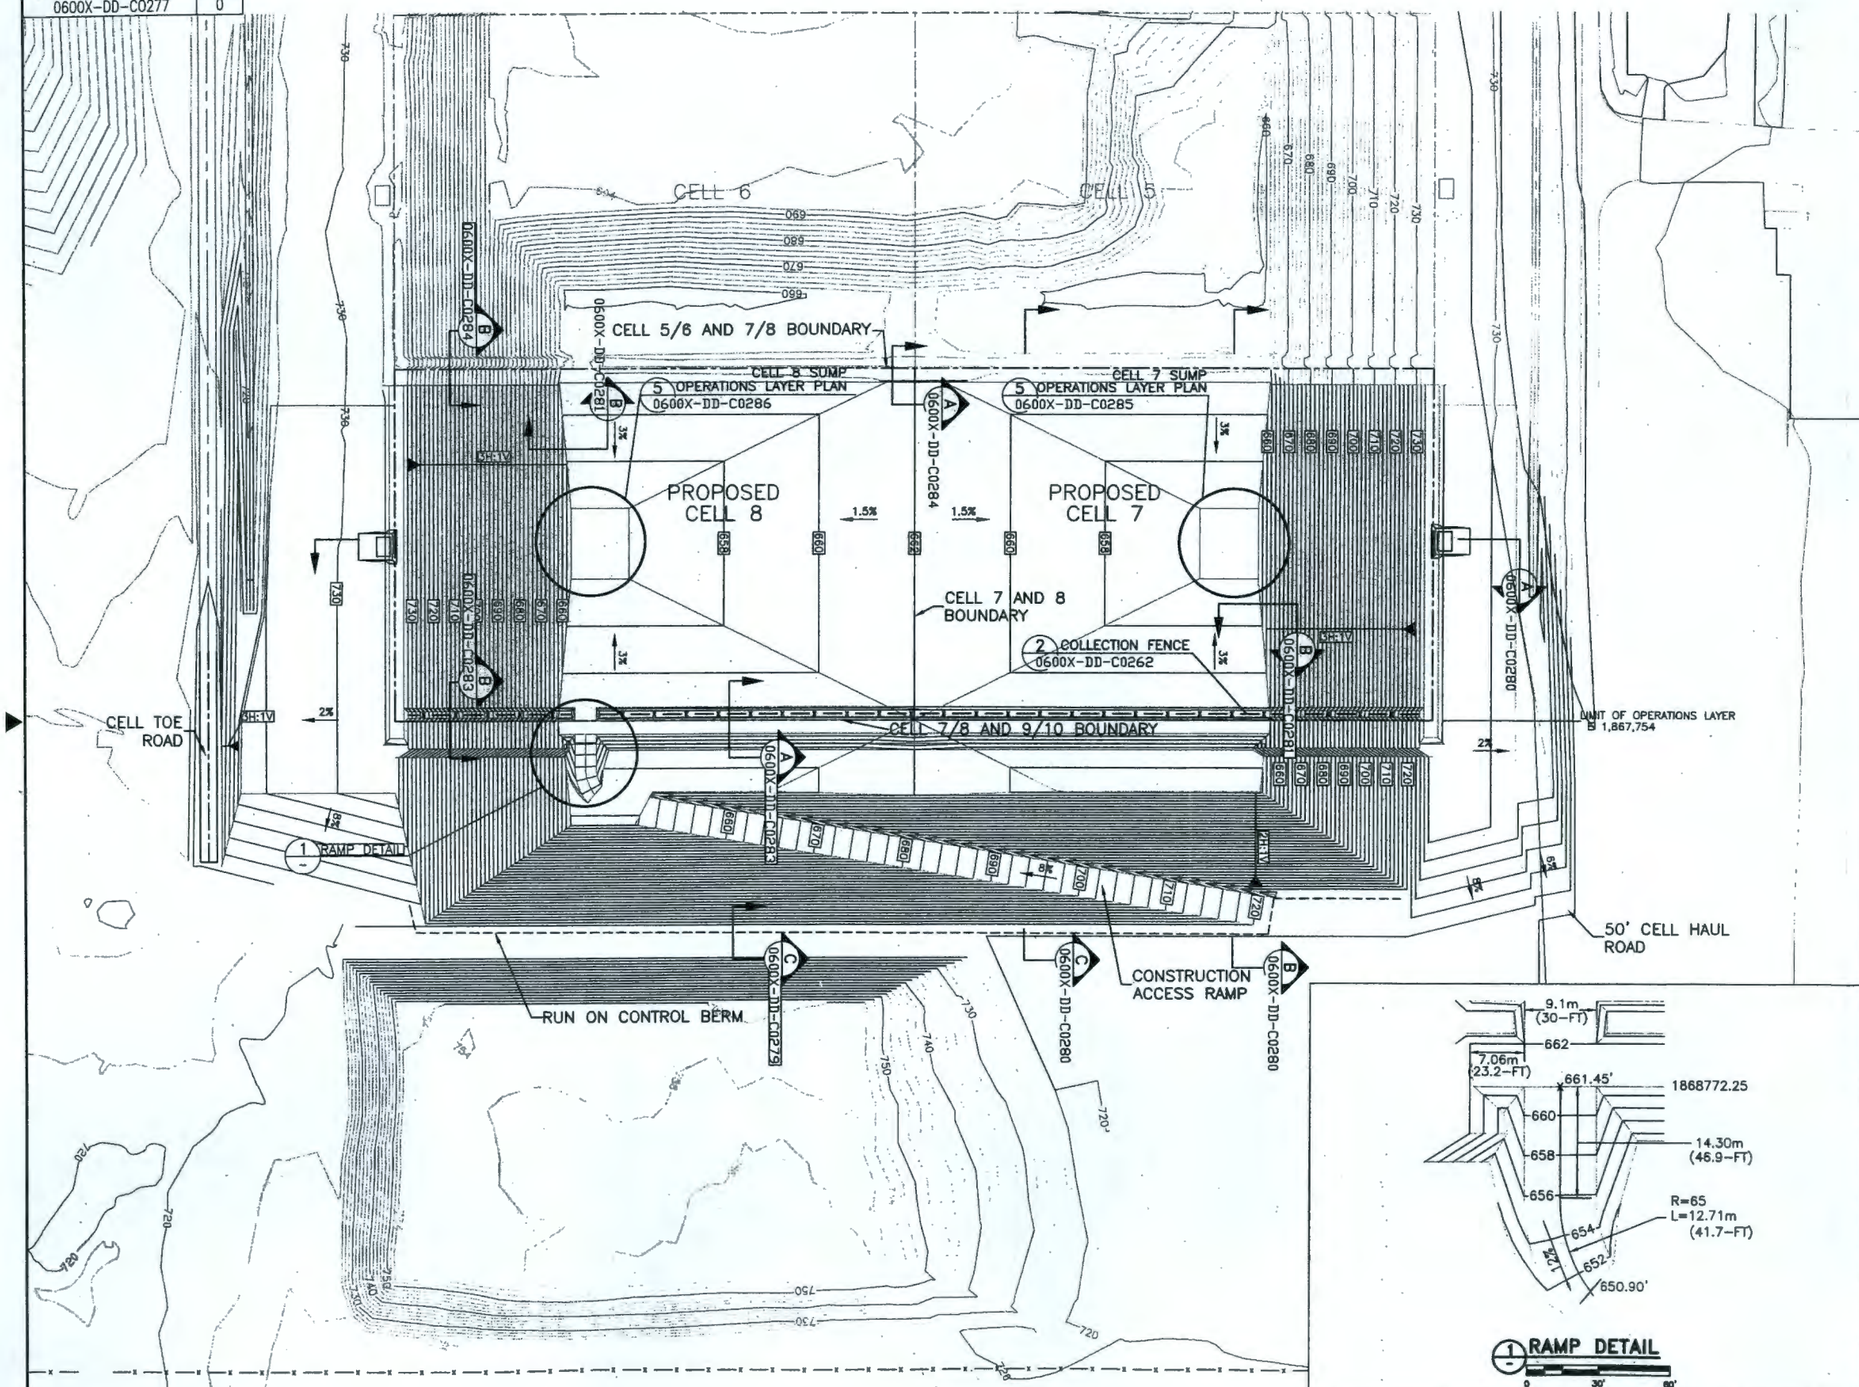

NOTES

1. GRADING TOLERANCES SHOWN ON DWG. NO. 0600-DD-C0281.
2. LIMIT OF LINER COMPONENT CONSTRUCTION INDICATES EXTENT OF FULL-DEPTH CONSTRUCTION.
3. EXISTING CONTOURS FROM FIELD SURVEY PREPARED BY ROGERS SURVEYING, INC., DATED JULY, 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCONTRACTOR SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
4. SURVEY DATUM:
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)

DOCUMENT CONTROL mac 10/11/07

Best Available Copy

N

0 50' 100' 200'

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1 ☒ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3 ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

DISCIPLINE	DATE	INITIAL
ENGINEERING		
CONSTRUCTION		
QA		
SAFETY		
RADIOLOGICAL CONTROL		
PROJECT MANAGEMENT		
PROCUREMENT		
SUBCONTRACTOR		

Bill Bellamy 10/9/07
SUPPLIER/SUBCONTRACTOR REPRESENTATIVE DATE

DOCUMENT ID NUMBER: 0600X-SC-60524 05-19 024
SCOPE NO. | ASBS ITEM | SUBMITTAL

S00X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGGS — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	DESIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JW	CJB	[illegible]	[illegible]	N/A	RB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
OPERATIONS LAYER CONTOURS - CELLS 7 & 8

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0277.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0277	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15857 SHT01	600G	0111

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0278	0

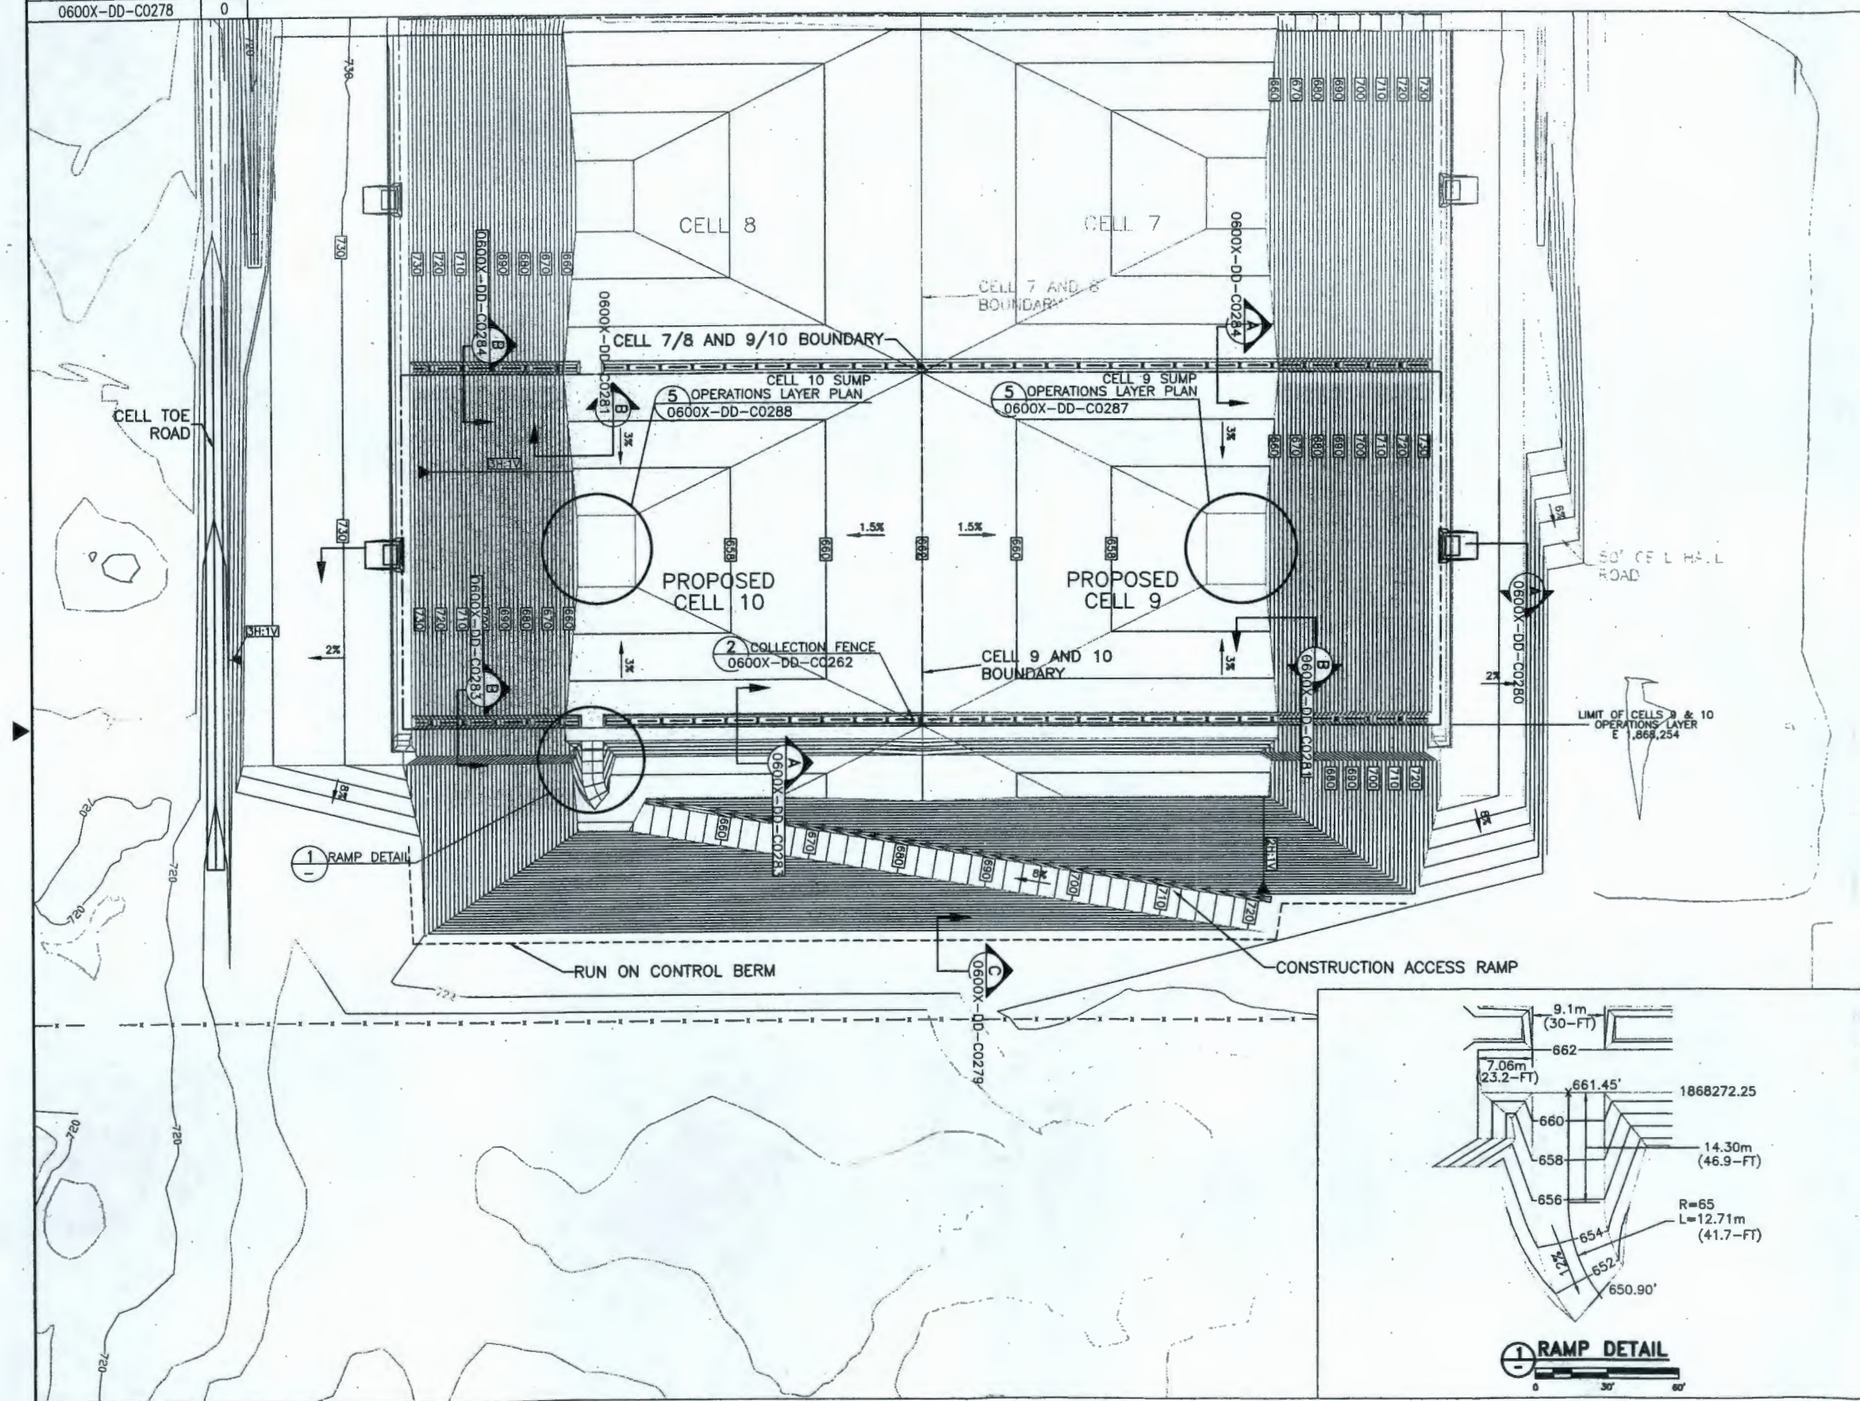

NOTES

1. GRADING TOLERANCES SHOWN ON DWG. NO. 0600-DD-C0281.
2. LIMIT OF LINER COMPONENT CONSTRUCTION INDICATES EXTENT OF FULL-DEPTH CONSTRUCTION.
3. EXISTING CONTOURS FROM FIELD SURVEY PREPARED BY ROGERS SURVEYING, INC., DATED JULY, 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCONTRACTOR SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
4. SURVEY DATUM:
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)

0 50' 100' 200'
CONTOUR INTERVAL: 2 FT

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Boreland 10/8/07
DOCUMENT ID NUMBER
0600X-SC-60584 05-19 025
SCO.D. No. | SUBMITTAL ITEM | SUBMITTAL
SCOX524ACO

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

Best Available Copy

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIENT — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DWFT CHK	ORIG/ ENG'R	ENG'R CHK	CIS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJV	CJB	Sam	JH	N/A	SR

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
7-10
OPERATIONS LAYER CONTOURS – CELLS 9 & 10

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0278.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0278	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15858 SHT01	600G	0111

RIVER CORRIDOR CLOSURE CONTRACT
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0279	0

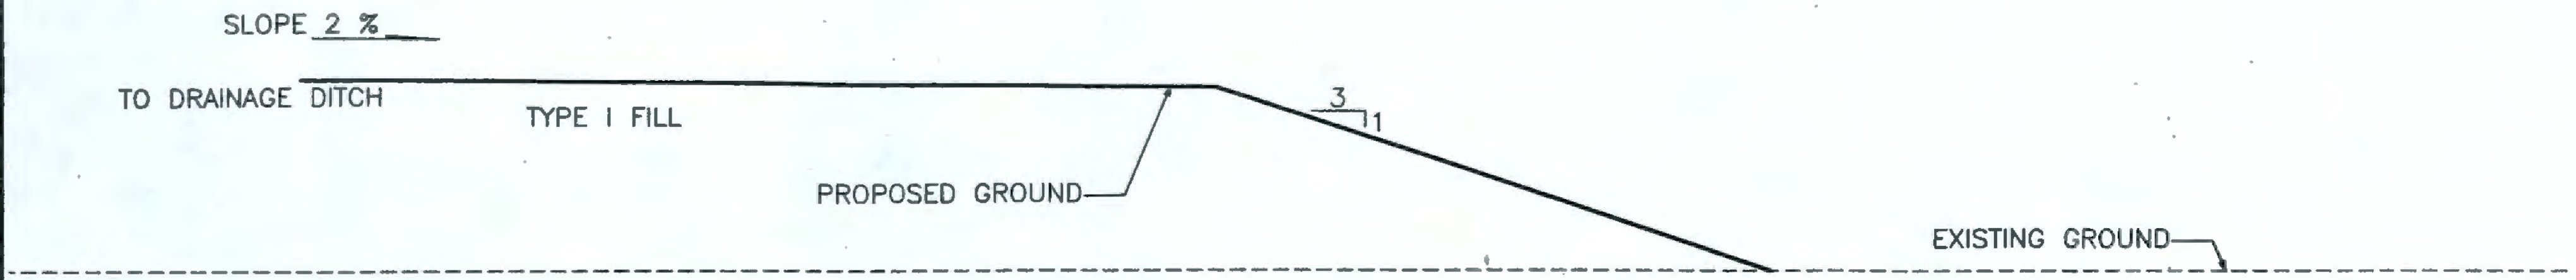

A TYPICAL TRENCH BERM SECTION (NORTH)

0600X-DD-C0267

SCALE 0 8 16 feet

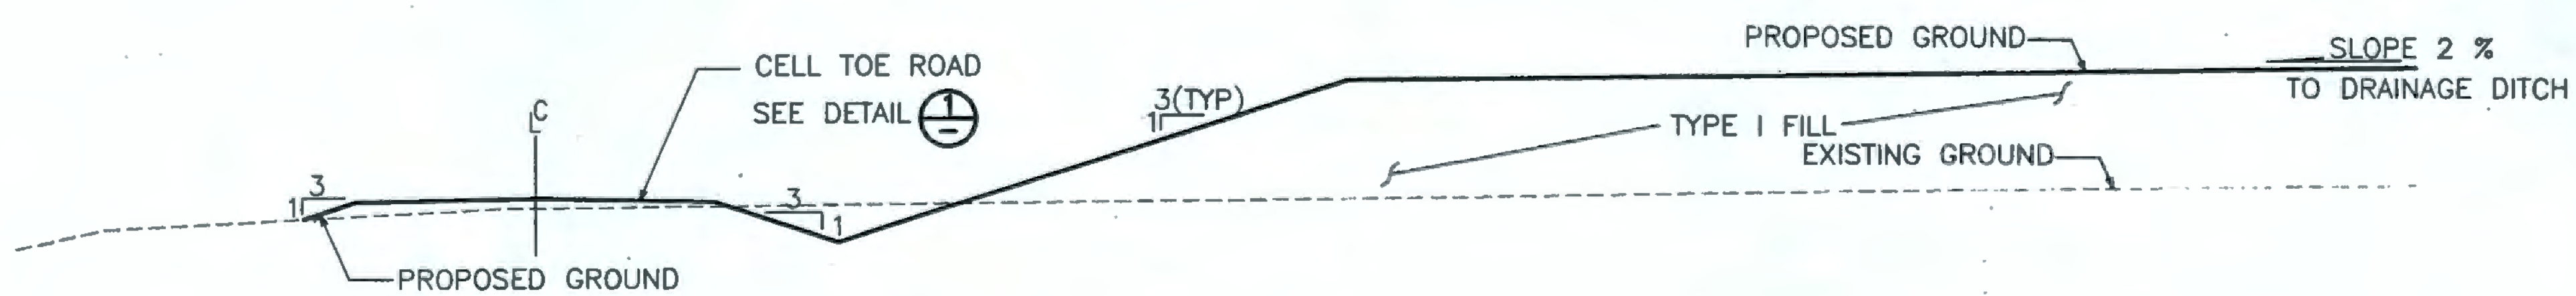

B TYPICAL TRENCH BERM SECTION (SOUTH)

0600X-DD-C0267,C0268

SCALE 0 8 16 feet

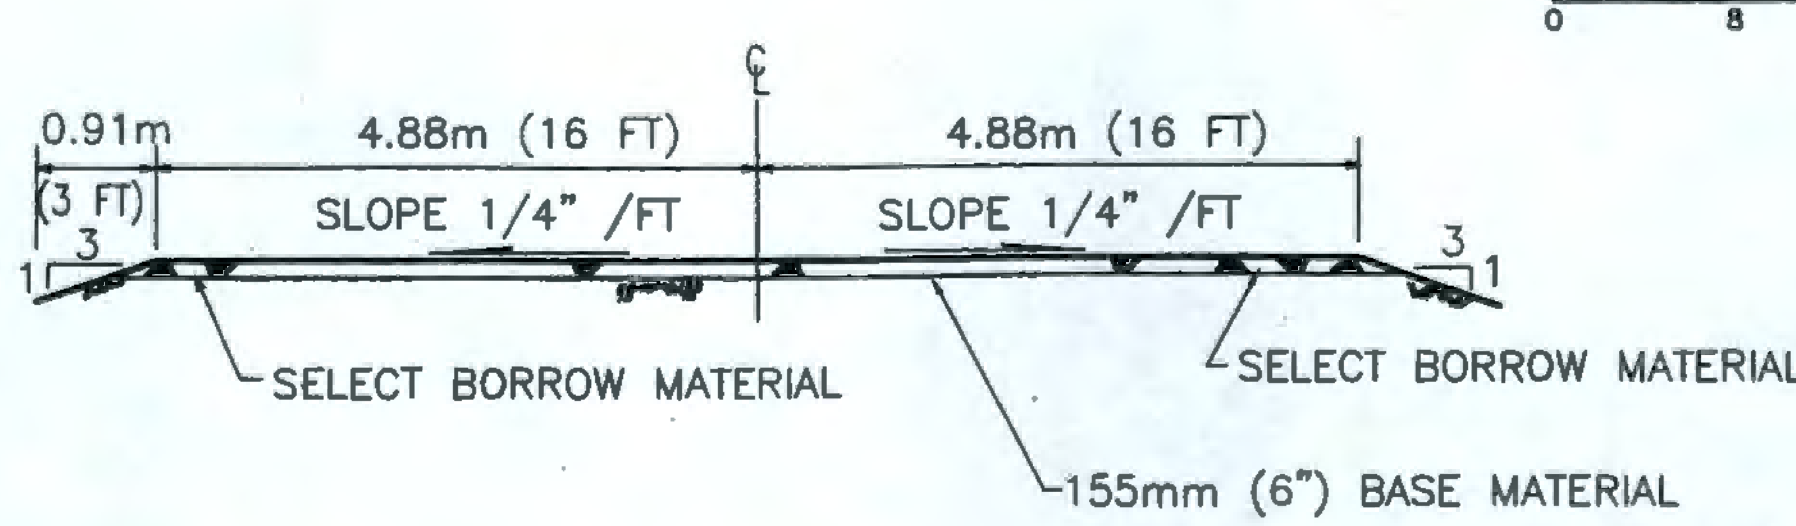

1 CELL TOE ROAD SECTION

SCALE 0 4 8 feet

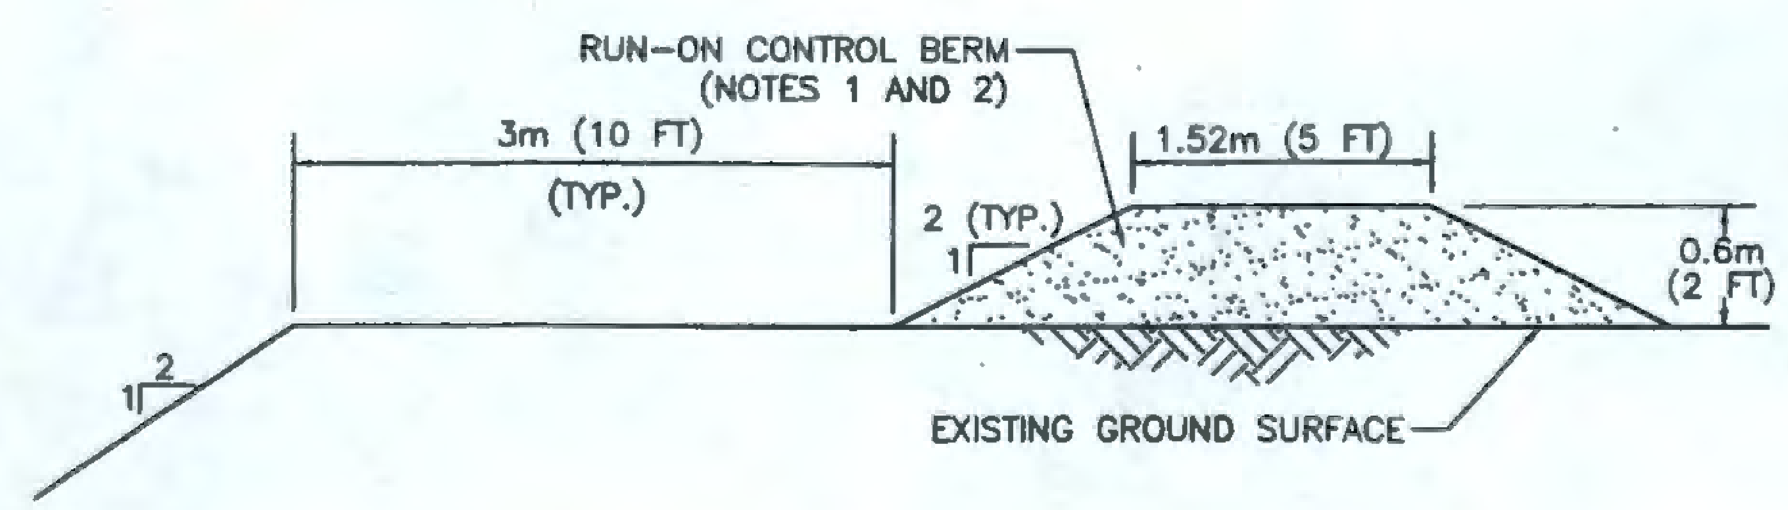

C RUN-ON CONTROL BERM SECTION

0600X-DD-C0264,C0277,C0278,C0280

SCALE 0 3 6 feet

NOTES

1. CONSTRUCT RUN-ON CONTROL BERM FROM TYPE I FILL.
2. FLATTEN RUN-ON CONTROL BERM SLOPES AT ENTRANCE TO CONSTRUCTION ACCESS RAMP AS REQUIRED FOR VEHICLE ACCESS. SLOPE AWAY FROM CELLS.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Review and resubmit. Work may proceed prior to resubmission.
3. ☐ Review and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Review and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borlaug 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G0524 05-19 026
SCR/O. No. / SSRS ITEM / SUBMITTAL
S00X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mec 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIEST — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JW	CJB	[illegible]	JH	N/A	JCB

SCALE AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
CIVIL SECTIONS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0279.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0279	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15859 SHT01	600G	0111

River Corridor Closure Contract
WCH
Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0280	0

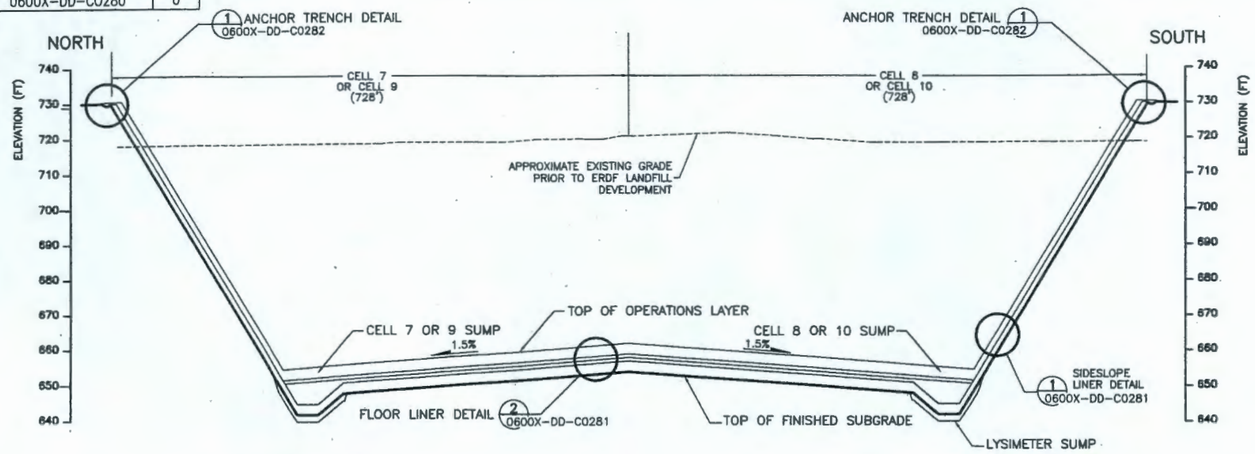

A NORTH–SOUTH SECTION FOR CELLS 7 & 8 AND 9 & 10

0600X-DD-C0277,C0278

SCALE 0 100 200 feet

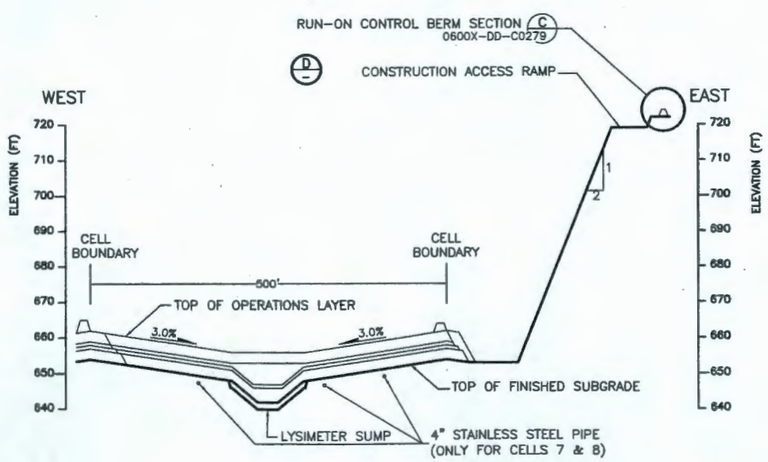

B E–W SECTION

0600X-DD-C0277

SCALE 0 100 200 feet

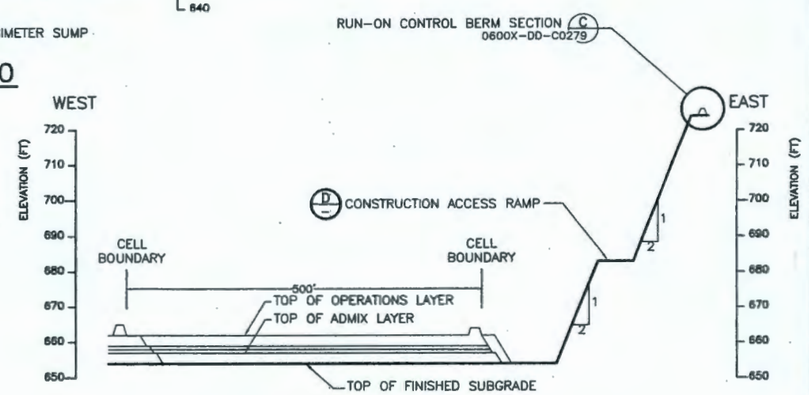

C E–W SECTION

0600X-DD-C0277

SCALE 0 100 200 feet

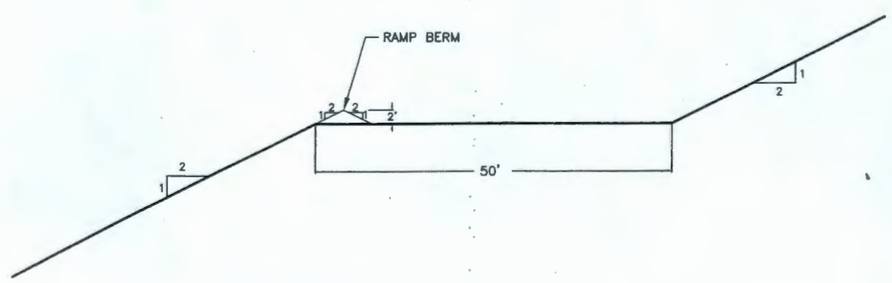

D CONSTRUCTION ACCESS RAMP

0600X-DD-C0267,C0268

SCALE 0 20 40 feet

RECORD INFORMATION		
RECORD NO.	BLDG NO.	INDEX NO.
H-6-15860 SHT01	600G	0111

NOTES

WASHINGTON CLOSURE HANFORD	JOB NO. 14655
SUPPLEMENTAL CONSTRUCTION DOCUMENT STATUS STAMP	

1. ☒ Work may proceed.
2. ☐ Review and resubmit. Work may proceed prior to resubmittal.
3. ☐ Review and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Review and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

DISCIPLINE											
ENGINEERING											
CONSTRUCTION											
SAFETY											
ENVIRONMENTAL											
SECURITY											
SUPPORT											
CONTROLS											
MANAGEMENT											

Bill Dorlaug 10/9/07
SIGNATURE DATE
0600X-SC-60524 05-19 027
DOC'T NO. DOCUMENT ID NUMBER SERIES ITEM SUBMITTAL

500X5211A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRAUST — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DWG'T CH'K	ORIG/ ENG'R	ENG'R CH'K	STS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JSV	CJB	[illegible]	BH	NA	SCB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7–10
GENERAL CROSS SECTIONS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0280.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0280	0

Washington Closure Hanford

RIVER CORRIDOR CLOSURE CONTRACT
Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0281	0

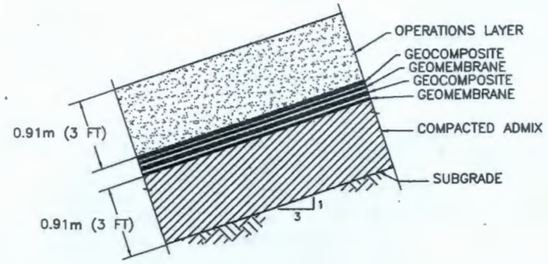

1 SIDESLOPE LINER DETAIL

0600X-DD-C0280,C0299

SCALE 0 3 6 feet

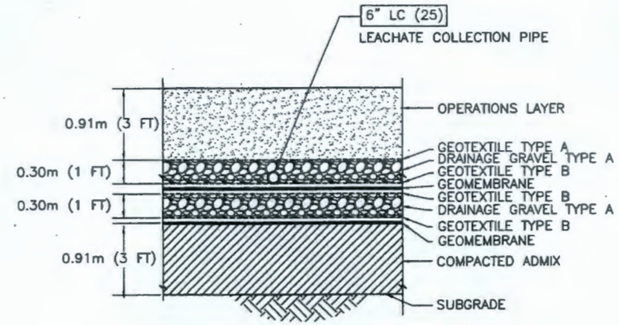

2 FLOOR LINER DETAIL

0600X-DD-C0280,C0289,C0290,C0299

SCALE 0 3 6 feet

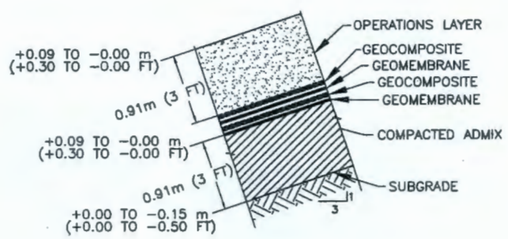

SIDESLOPE LINER
(SEE NOTES 3 AND 4)

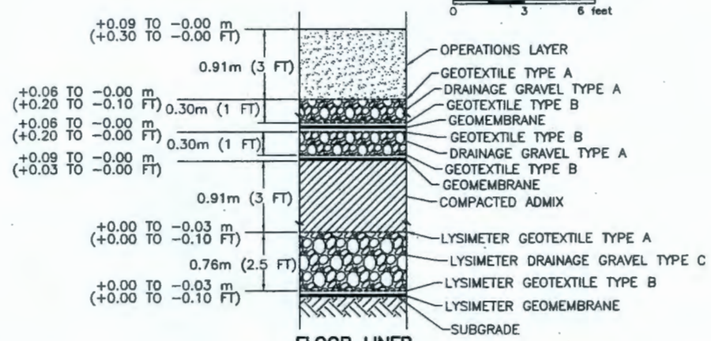

FLOOR LINER
(SEE NOTES 3 AND 4)

3 LINER GRADING TOLERANCES

SCALE 0 3 6 feet

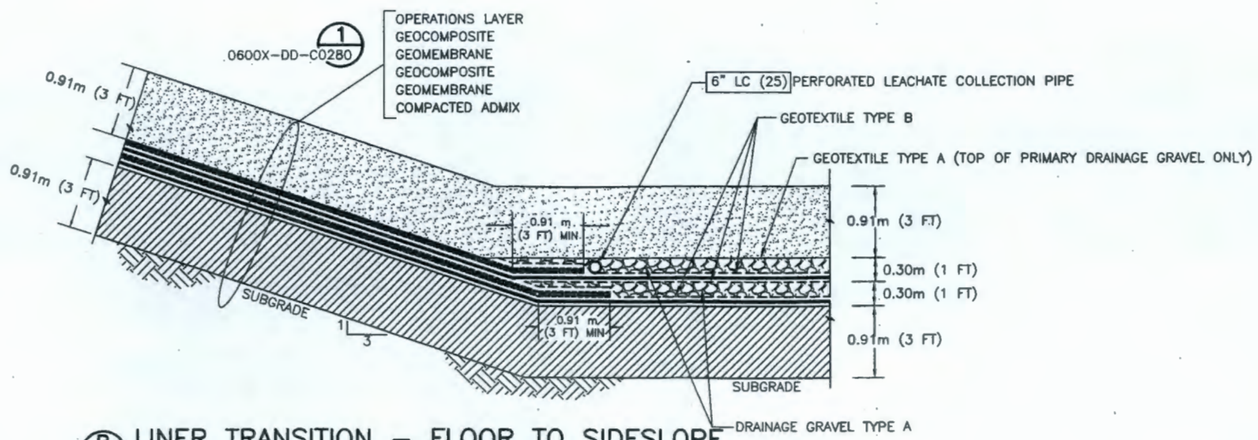

B LINER TRANSITION – FLOOR TO SIDESLOPE

0600X-DD-C0277,C0278

SCALE 0 3 6 feet

NOTES

1. LINER SYSTEM COMPONENT THICKNESSES EXAGGERATED FOR CLARITY.
2. REFER TO TECHNICAL SPECIFICATIONS FOR CELL CONSTRUCTION FOR MATERIAL, HANDLING, AND INSTALLATION REQUIREMENTS.
3. GRADING TOLERANCES DO NOT RELIEVE CONTRACTOR FROM LINER SYSTEM THICKNESS REQUIREMENTS. LINER SYSTEM THICKNESSES REPRESENT THE MINIMUM ALLOWABLE. AREAS FOUND TO BE LESS THAN THE REQUIRED THICKNESS (EVEN BY MINOR AMOUNTS) WILL REQUIRE RECONSTRUCTION.
4. GRADING TOLERANCES DO NOT RELIEVE CONTRACTOR FROM THE MINIMUM PIPE SLOPE REQUIREMENTS. ALL 6" LC(25) PERFORATED LEACHATE COLLECTION PIPE MUST BE INSTALLED AT A 1% MINIMUM SLOPE.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☐ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borlaug 10/8/07
DOCUMENT ID NUMBER 0600X-SR-G0529 05-19 028
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mjc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGGS — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JSV	CSB	[illegible]	BHH	N/A	RB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. — RICHLAND, WASHINGTON
WEAVER BOOS CONSULTANTS, LLC — DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
LINER SYSTEM DETAILS-1

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0281.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0281	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15861 SHT01	600G	0111

WCH Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0282	0

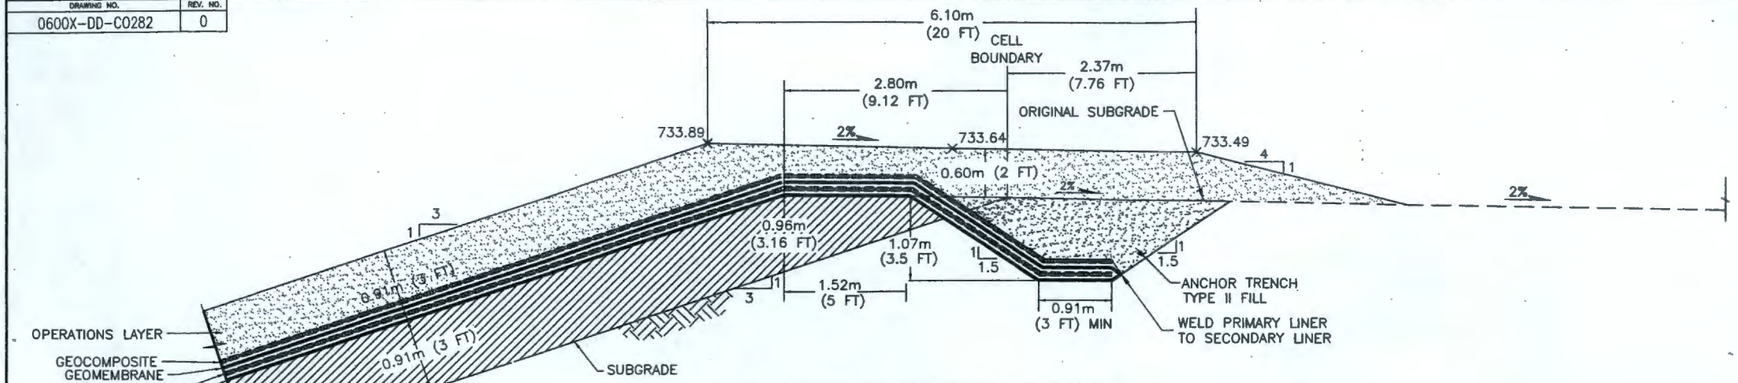

1 ANCHOR TRENCH DETAIL

0600X-DD-C0280,C0299

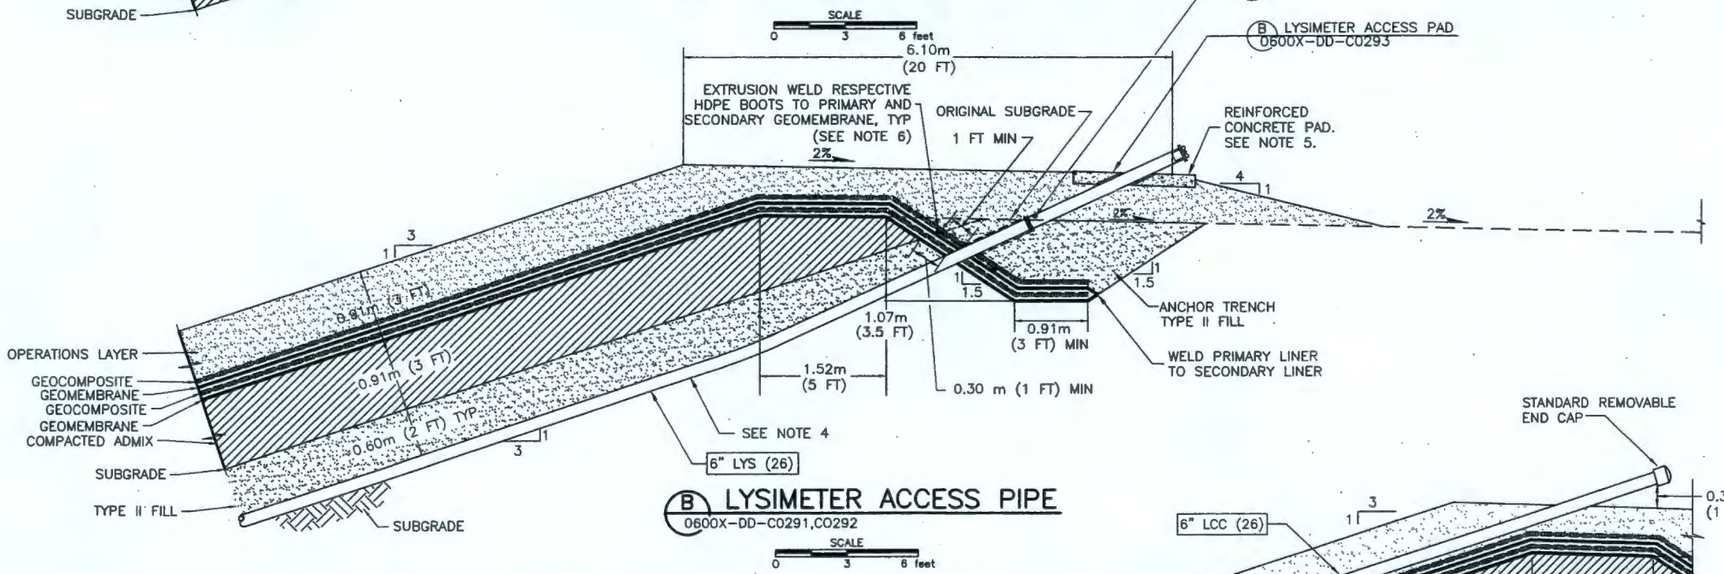

B LYSIMETER ACCESS PIPE

0600X-DD-C0291,C0292

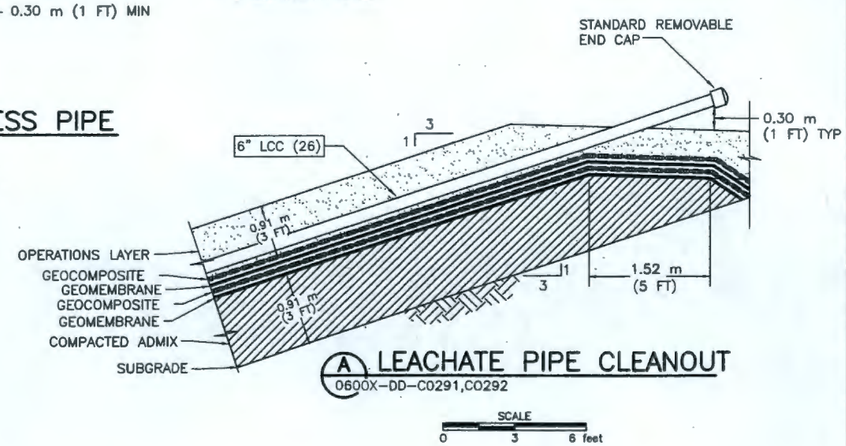

A LEACHATE PIPE CLEANOUT

0600X-DD-C0291,C0292

SCALE
0 3 6 feet

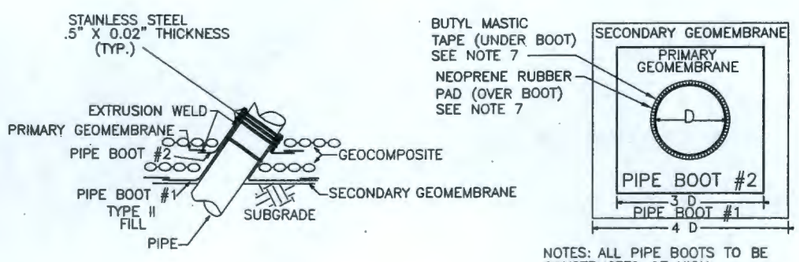

NOTES: ALL PIPE BOOTS TO BE CONSTRUCTED OF HIGH DENSITY POLYETHYLENE (HDPE)

2 PIPE BOOT DETAIL

NOTES

1. LINER SYSTEM COMPONENT THICKNESS' EXAGGERATED FOR CLARITY.
2. REFER TO TECHNICAL SPECIFICATIONS FOR CELL CONSTRUCTION FOR MATERIAL, HANDLING, AND INSTALLATION REQUIREMENTS.
3. REFER TO TECHNICAL SPECIFICATION 0600X-SP-C0072 FOR SITE WORK FOR TYPE I FILL AND TYPE II FILL REQUIREMENTS.
4. GENTLY SLOPE LYSIMETER PIPE AND TRENCH SUBGRADE TO ENSURE THAT LYSIMETER PIPE PENETRATES LINERS AS SHOWN. MAINTAIN 1 FT COVER (MIN) BETWEEN LYSIMETER PIPE AND COMPACTED ADMIX LAYER. PIPE SHALL REMAIN IN CONTINUOUS CONTACT WITH TRENCH BOTTOM ALONG ENTIRE PIPE LENGTH.
5. BOLLARDS NOT SHOWN
6. REMOVE GEOCOMPOSITE AS NECESSARY FOR BOOT INSTALLATION TO SECONDARY AND PRIMARY GEOMEMBRANE. FORM BOOT WITH SUFFICIENT MATERIAL TO PREVENT OVERSTRESSING DURING BACKFILLING, BUT WITHOUT FOLDS OR WRINKLES.
7. BUTYL MASTIC TAPE AND NEOPRENE RUBBER PAD APPLIED CONTINUOUSLY AROUND PIPE.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

DATE RECEIVED							
DATE RETURNED		✓					
DISPOSITION		2					

Bill Boblauff 10/9/07
DOCUMENT SUBMITTED: 0600X-SC-G0534 05-19 029
SUBCO NO. — SUBCO ITEM — SUBMITTAL
SUBCONTRACTOR: S00X624A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGHT — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JW	GB	Sam	JH	N/A	SDB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 – 10
LINER SYSTEM DETAILS – 2

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0282.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0282	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15862 SHT01	600G	0111

River Corridor Closure Contract — Dedicated To Safety Excellence — WCH

DRAWING NO.	REV. NO.
0600X-DD-C0283	0

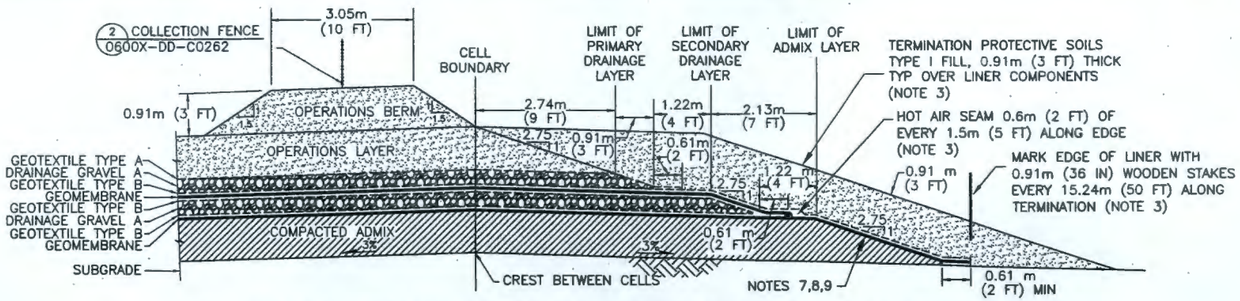

A FLOOR LINER TERMINATION SECTION @ EAST CELL BOUNDARY

0600X-DD-C0277,C0278

SCALE 0 4 8 feet

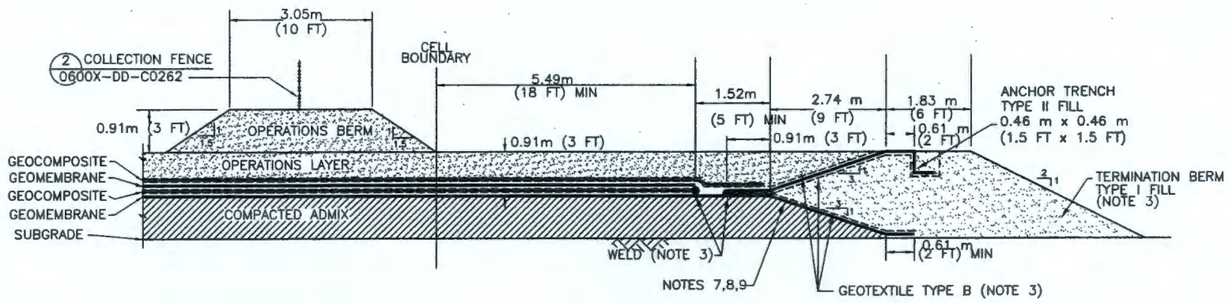

B SIDESLOPE LINER TERMINATION SECTION @ EAST CELL BOUNDARY

0600X-DD-C0277,C0278

SCALE 0 4 8 feet

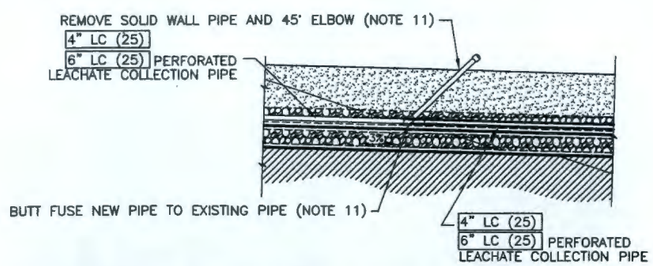

C TYPICAL LEACHATE PIPING TIE-IN SECTION

0600X-DD-C0291,C0292

SCALE 0 4 8 feet

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☐ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Barclay 10/9/07
DOCUMENT ID NUMBER: X000L-SC-00529 05-19 030
SCPO No. / SERIES ITEM / SUBMITTAL
500X524-A00

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15863 SHT01	600G	0111

NOTES

1. LINER SYSTEM COMPONENT THICKNESS' EXAGGERATED FOR CLARITY.
2. REFER TO TECHNICAL SPECIFICATIONS FOR CELL CONSTRUCTION FOR MATERIAL, HANDLING, AND INSTALLATION REQUIREMENTS.
3. TEMPORARY FEATURES IN THE TERMINATION SECTIONS ARE INDICATED BY A REFERENCE TO NOTE 3. ALL TEMPORARY FEATURES ARE TO BE CONSTRUCTED AS PART OF THE TERMINATION SECTION AND REMOVED FOR FUTURE LINER SYSTEM TIE-IN.
4. FOR LINER TIE-IN, REMOVE ALL DAMAGED, DETERIORATED, OR OTHERWISE UNSATISFACTORY EXISTING GEOSYNTHETIC MATERIALS TO THE SATISFACTION OF THE CONTRACTOR.
5. JOIN GEOSYNTHETIC MATERIALS BETWEEN EXISTING AND NEW LINER SECTIONS USING STANDARD METHODS DESCRIBED IN TECHNICAL SPECIFICATIONS, EXCEPT AS NOTED.
6. EXTRUSION WELDING SHALL NOT BE USED TO JOIN NEW AND EXISTING GEOMEMBRANES.
7. FOR LINER TIE-IN, REMOVE ANY CRACKED OR OTHERWISE UNSUITABLE EXISTING ADMIX TO THE SATISFACTION OF THE CONTRACTOR.
8. SEAM BETWEEN NEW AND EXISTING ADMIX SHALL BE 3H:1V (TYP) AND NO STEEPER THAN 2.75H:1V.
9. KNEAD NEW ADMIX THOROUGHLY INTO EXISTING ADMIX.
10. ALL LAYERS OF NEW LINER SYSTEM SHALL BE CONTINUOUS WITH CORRESPONDING LAYERS IN EXISTING LINER.
11. 4" LC (25) PERFORATED LEACHATE COLLECTION PIPES IN CURRENT CELL SHALL TERMINATE 10 FT WEST OF CELL BOUNDARY AND PIPES IN FUTURE CELL SHALL BE INSTALLED IN THEIR ENTIRETY DURING FUTURE CELL CONSTRUCTION.

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIEST — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAF'T CH'K	DSG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJW	CJB	[illegible]	[illegible]	N/A	PB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
LINER TERMINATION DETAILS-1

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0283.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0283	0

Washington Closure Hanford

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0284	0

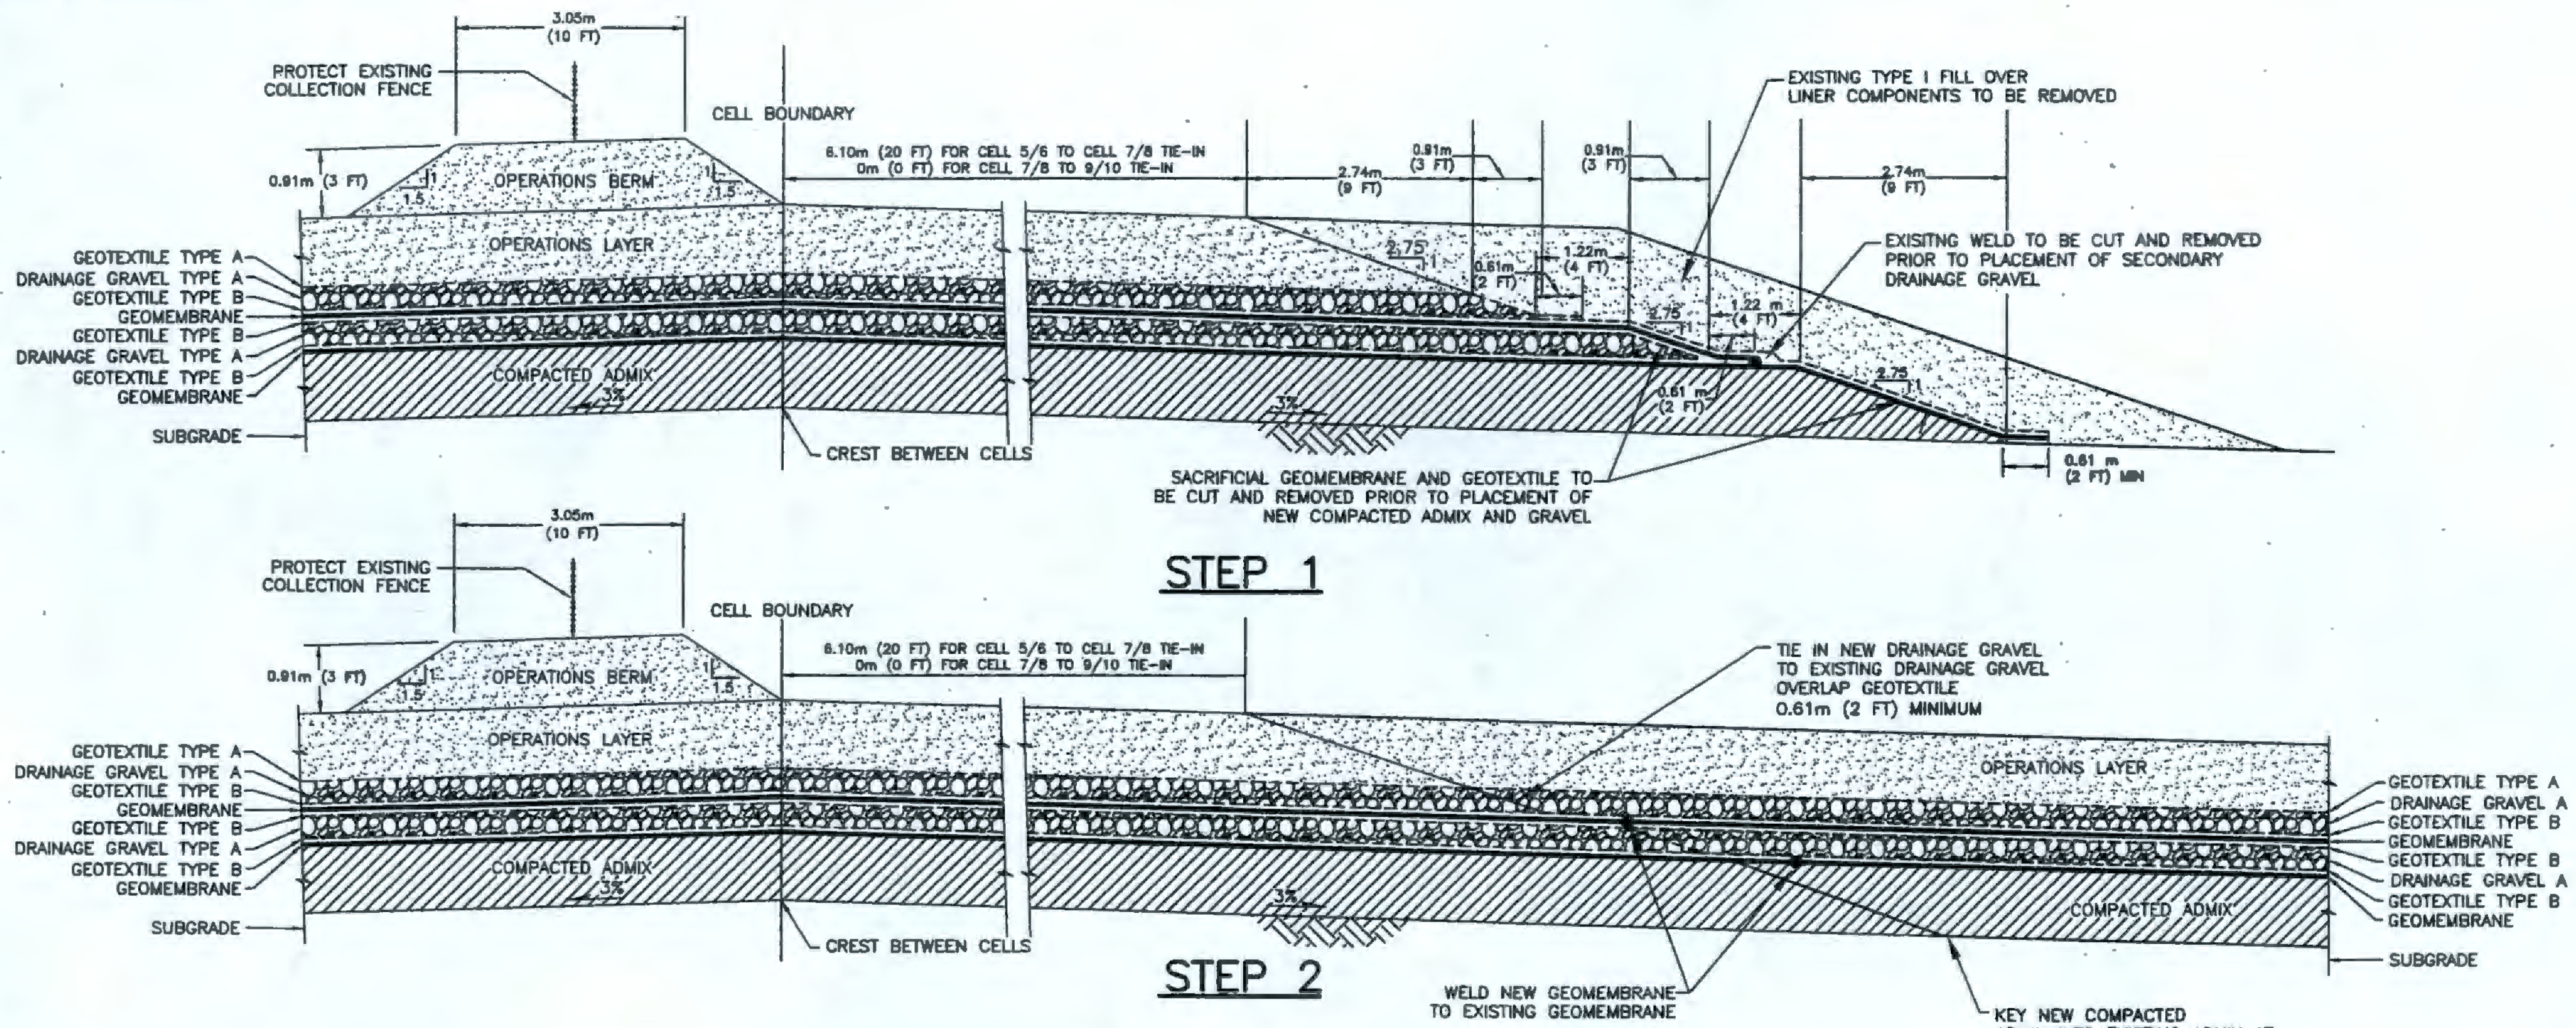

A FLOOR LINER TIE-IN SECTION
0600X-DD-C0277,C0278

SCALE 0 5 10 feet

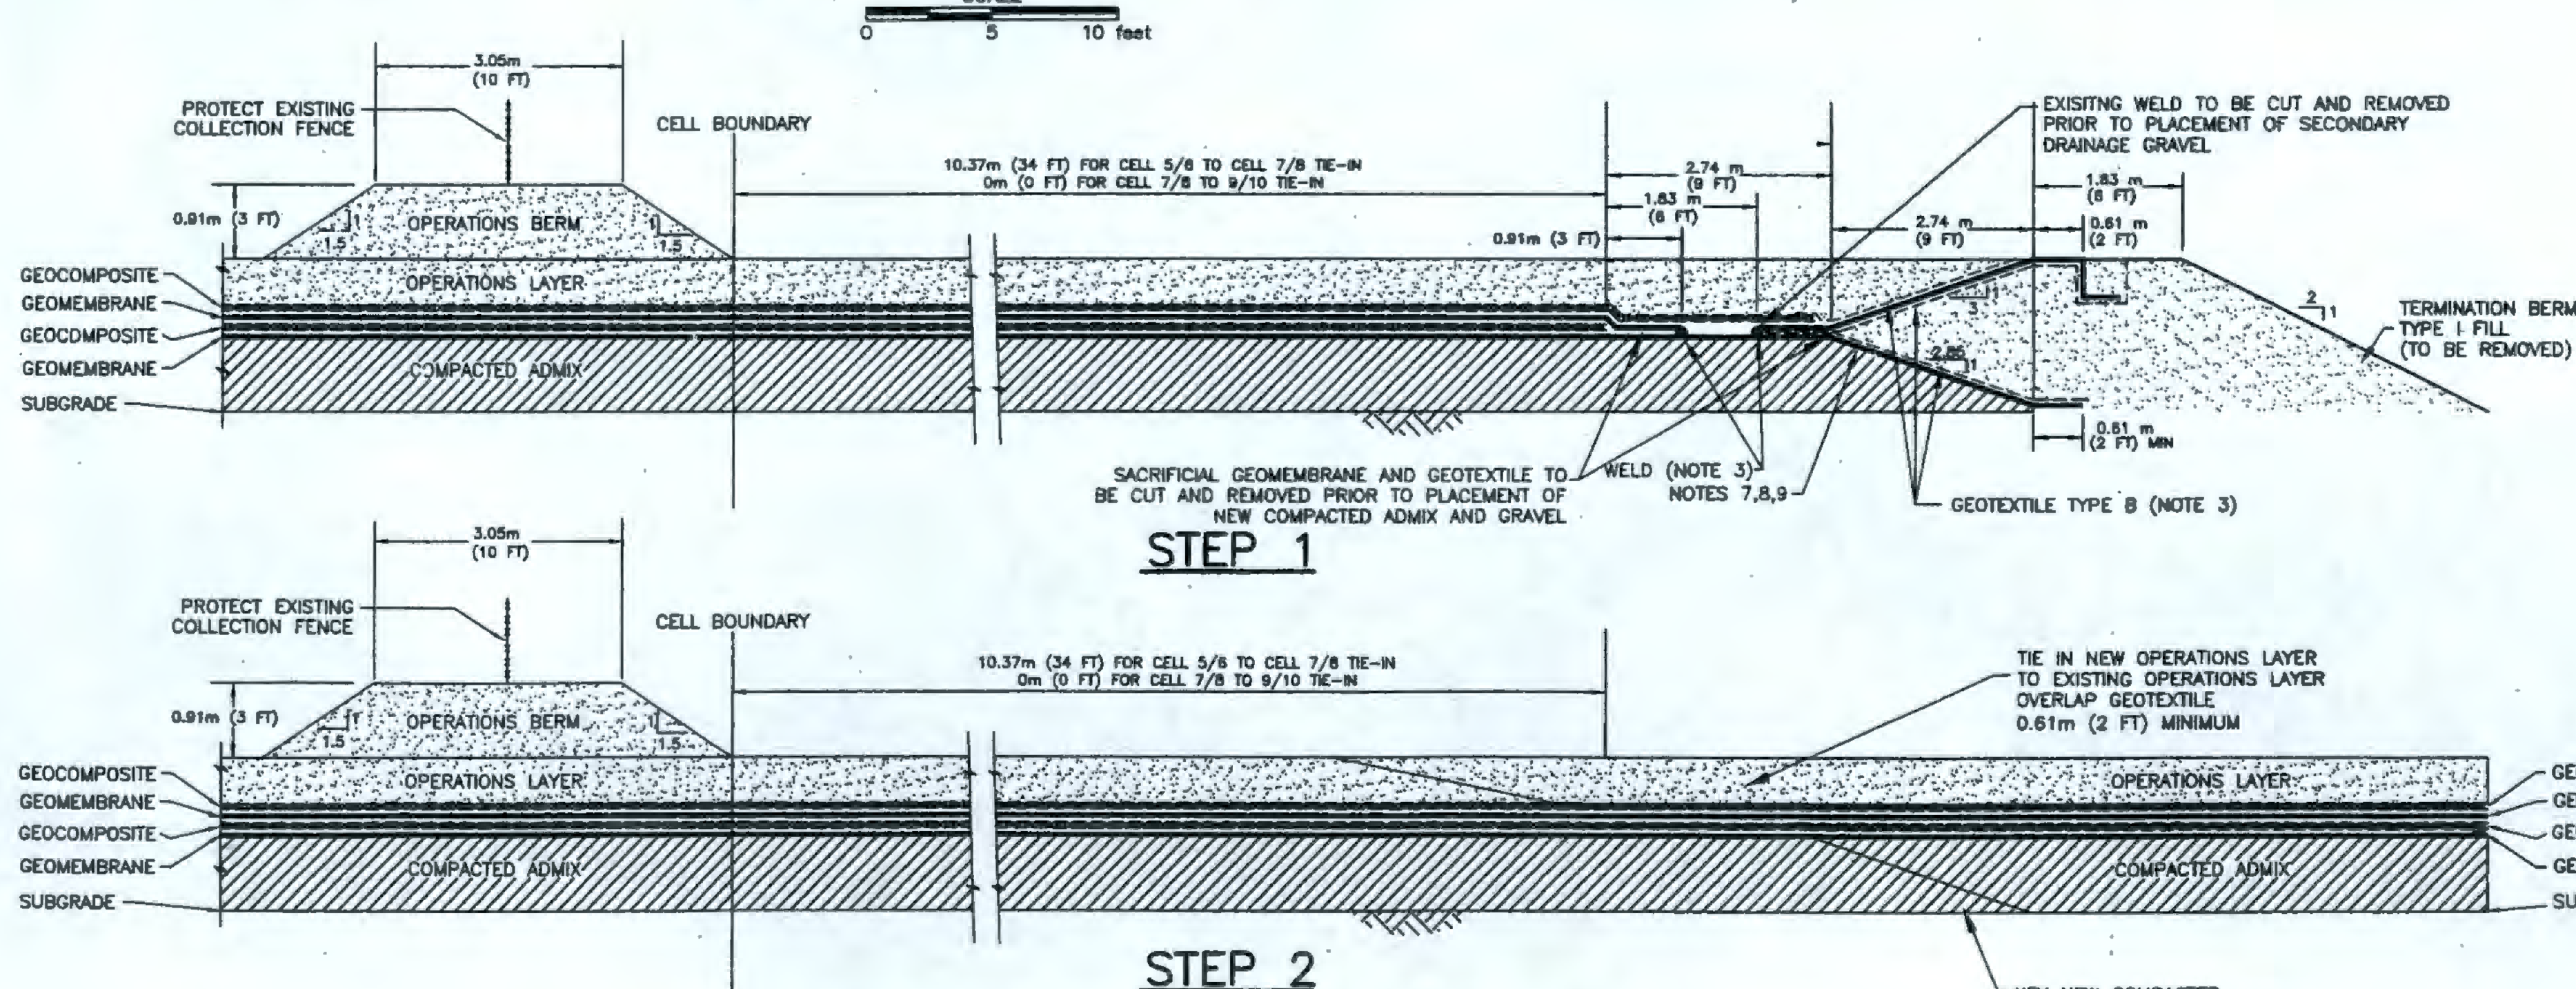

B SIDESLOPE LINER TIE-IN SECTION
0600X-DD-C0277,C0278

SCALE 0 5 10 feet

NOTES

1. LINER SYSTEM COMPONENT THICKNESS' EXAGGERATED FOR CLARITY.
2. REFER TO TECHNICAL SPECIFICATIONS FOR CELL CONSTRUCTION FOR MATERIAL, HANDLING, AND INSTALLATION REQUIREMENTS.
3. REMOVE FOR LINER SYSTEM TIE-IN.
4. FOR LINER TIE-IN, REMOVE ALL DAMAGED, DETERIORATED, OR OTHERWISE UNSATISFACTORY EXISTING GEOSYNTHETIC MATERIALS TO THE SATISFACTION OF THE CONTRACTOR.
5. JOIN GEOSYNTHETIC MATERIALS BETWEEN EXISTING AND NEW LINER SECTIONS USING STANDARD METHODS DESCRIBED IN TECHNICAL SPECIFICATIONS, EXCEPT AS NOTED.
6. EXTRUSION WELDING SHALL NOT BE USED TO JOIN NEW AND EXISTING GEOMEMBRANES.
7. FOR LINER TIE-IN, REMOVE ANY CRACKED OR OTHERWISE UNSUITABLE EXISTING ADMIX TO THE SATISFACTION OF THE CONTRACTOR.
8. SEAM BETWEEN NEW AND EXISTING ADMIX SHALL BE 3H:1V (TYPICAL) AND NO STEEPER THAN 2.75H:1V.
9. KNEAD NEW ADMIX THOROUGHLY INTO EXISTING ADMIX.
10. ALL LAYERS OF NEW LINER SYSTEM SHALL BE CONTINUOUS WITH CORRESPONDING LAYERS IN EXISTING LINER.
11. REMOVE PIPING INCLUDING 45° FITTING, AND BUTT FUSE COLLECTION PIPE FOR 7 AND 8 TO EXISTING 5 AND 6 COLLECTION PIPES.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☑ Work may proceed.
Bill Borlaug 10/9/07
0600X-SC-G0524 05-19 031
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIESE — STATE OF WASHINGTON — 42158 REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JW	CJB	Sm	BH	N/A	JB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
LINER TERMINATION DETAILS - 2

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0284.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0284	0

DOCUMENT CONTROL mec 10/11/07

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15864 SHT1	600G	0111

River Corridor Closure Contract WCH Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0285	0

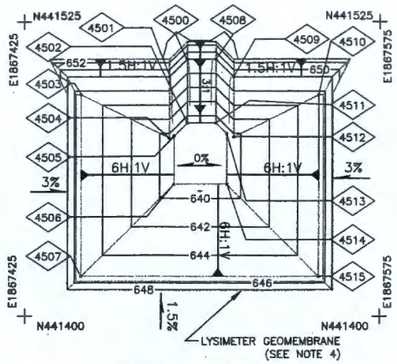

CELL 7 SUMP
6 LYSIMETER SUMP PLAN

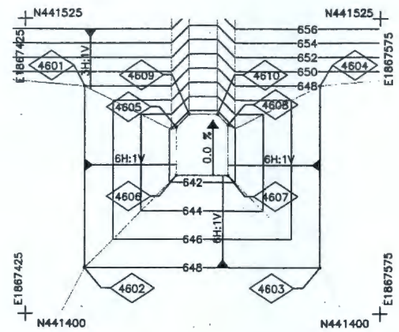

CELL 7 SUMP
1 SUBGRADE CONTROL
0600X-DD-C0267,C0269

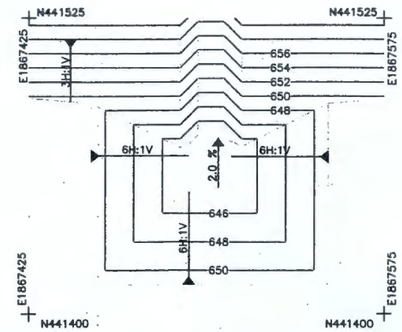

CELL 7 SUMP
2 COMPACTED ADMIX LAYER
0600X-DD-C0271

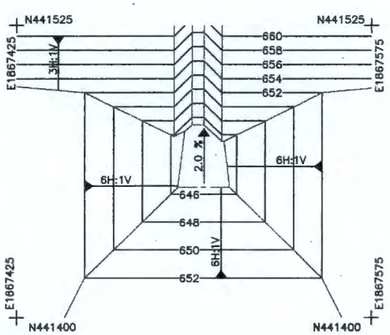

CELL 7 SUMP
3 SECONDARY DRAINAGE LAYER
0600X-DD-C0273

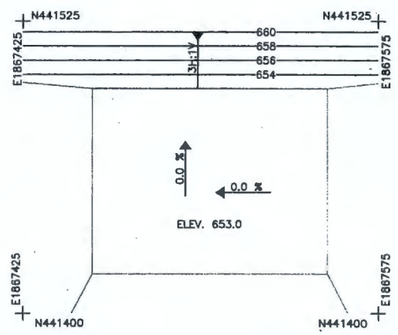

CELL 7 SUMP
4 PRIMARY DRAINAGE LAYER
0600X-DD-C0275

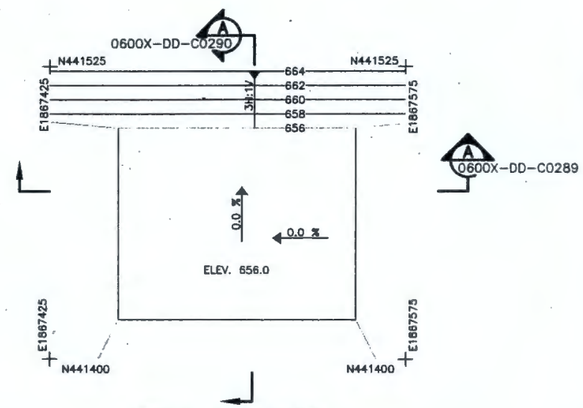

CELL 7 SUMP
5 OPERATIONS LAYER
0600X-DD-C0277

SUBGRADE CONTROL POINTS COORDINATES (WASHINGTON STATE PLANE, FT)

POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION	POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION	POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION
4500	441508.97	1867498.51	648.00	LYS-RISER TRENCH	4513	441477.46	1867515.00	639.00	LYS-FLR OF SUMP					
4501	441501.47	1867491.01	648.00	LYS-RISER TRENCH	4514	441456.00	1867515.00	639.00	LYS-FLR OF SUMP					
4502	441481.97	1867498.51	639.00	LYS-FLR OF SUMP	4515	441417.00	1867554.00	645.50	LYS-TOP OF SUMP					
4503	441493.97	1867454.00	645.50	LYS-TOP OF SUMP	4601	441493.97	1867454.00	648.00	SG-TOP OF SUMP					
4504	441475.47	1867491.01	639.33	LYS-SLOPE BRK	4602	441417.00	1867454.00	648.00	SG-TOP OF SUMP					
4505	441476.46	1867493.00	639.00	LYS-FLR OF SUMP	4603	441417.00	1867554.00	648.00	SG-TOP OF SUMP					
4506	441456.00	1867493.00	639.00	LYS-FLR OF SUMP	4604	441493.97	1867554.00	648.00	SG-TOP OF SUMP					
4507	441417.00	1867454.00	645.50	LYS-TOP OF SUMP	4605	441476.46	1867493.00	641.50	SG-FLOOR OF SUMP					
4508	441508.97	1867510.49	649.00	LYS-RISER TRENCH	4606	441456.00	1867493.00	641.50	SG-FLOOR OF SUMP					
4509	441501.47	1867517.99	648.00	LYS-RISER TRENCH	4607	441456.00	1867515.00	641.50	SG-FLOOR OF SUMP					
4510	441493.97	1867554.00	645.50	LYS-TOP OF SUMP	4608	441477.46	1867515.00	641.50	SG-FLOOR OF SUMP					
4511	441481.97	1867510.49	639.00	LYS-FLR OF SUMP	4609	441481.97	1867498.51	641.50	SG-RISER TRENCH					
4512	441475.97	1867517.99	639.50	LYS-SLOPE BRK	4610	441481.97	1867510.49	641.50	SG-RISER TRENCH					

SCALE
0 30 FT 60 FT

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15865 SHT01	600G	0111

Dedicated To Safety Excellence

NOTES

1. ELEVATIONS SHOWN ARE NOMINAL. ACTUAL ELEVATIONS SHALL BE DETERMINED BY MINIMUM REQUIRED COMPONENT THICKNESS PER GRADING TOLERANCE ON DWG NO. 0600X-DD-C0281.
2. SURVEY DATUM
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)
3. LYSIMETER SUMP LOCATED BELOW SUBGRADE LEVEL. SUBGRADE FOR LYSIMETER ACCESS PIPE NOT SHOWN IN ENTIRETY. SUBGRADE BREAK LINES SHOWN FOR REFERENCE.
4. SEE 0600X-DD-C0289 AND 0600X-DD-C0290 FOR EXTENT OF LYSIMETER GEOMEMBRANE LIMITS.

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1 ☒ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3 ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on this contract.
STATUS STAMP
REVIEWED BY
Bill Borlaug 10/9/07
DOCUMENT ID NUMBER
0600X-SC-60524 05-19 038
SCHED. PA. SUBC ITEM SUBMITTAL
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BREAT
STATE OF WASHINGTON
42158
REGISTERED
PROFESSIONAL ENGINEER
9/28/07
EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJW	CJB	[illegible]	BJH	N/A	RB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC.
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SUMP LAYOUT PLAN - CELL 7

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0285.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0285	0

DRAWING NO.	REV. NO.
0600X-DD-C0286	0

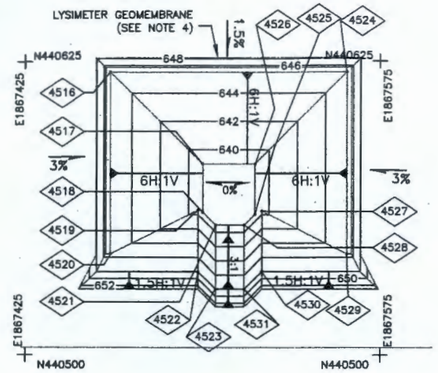

CELL 8 SUMP
6 LYSIMETER SUMP PLAN

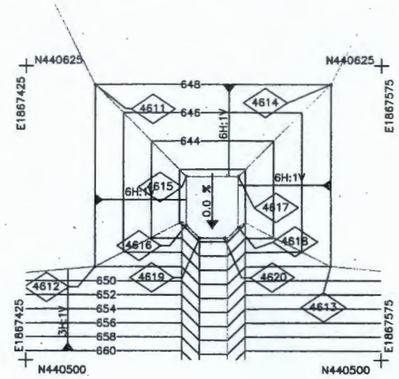

CELL 8 SUMP
1 SUBGRADE CONTROL
0600X-DD-C0267,269

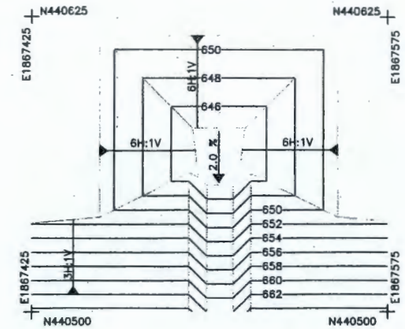

CELL 8 SUMP
2 COMPACTED ADMIX LAYER
0600X-DD-C0271

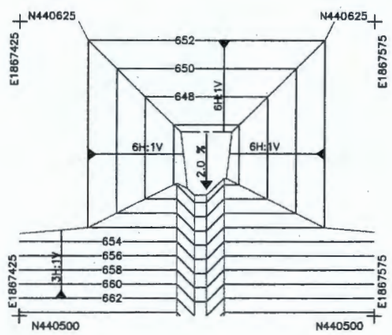

CELL 8 SUMP
3 SECONDARY DRAINAGE LAYER
0600X-DD-C0273

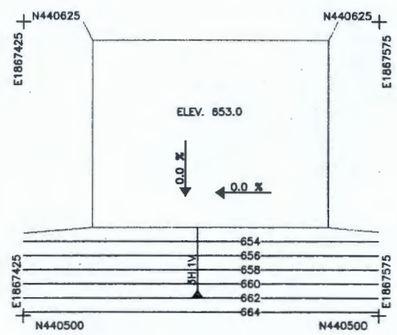

CELL 8 SUMP
4 PRIMARY DRAINAGE LAYER
0600X-DD-C0275

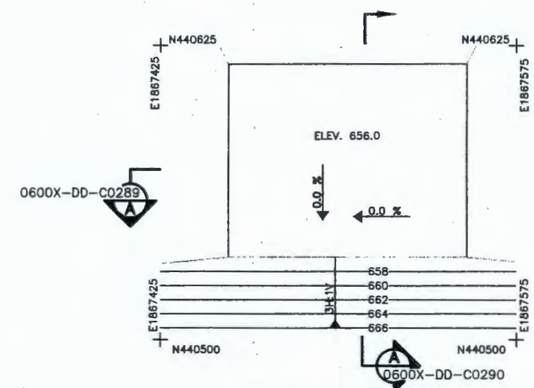

CELL 8 SUMP
5 OPERATIONS LAYER
0600X-DD-C0277

SUBGRADE CONTROL POINTS COORDINATES (WASHINGTON STATE PLANE, FT)

POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION	POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION	POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION
4516	440617.00	1867454.00	645.50	LYS-TOP OF SUMP	4529	440540.03	1867554.00	645.50	LYS-TOP OF SUMP					
4517	440578.00	1867493.00	639.00	LYS-FLR OF SUMP	4530	440532.53	1867517.99	648.00	LYS-RISER TRENCH					
4518	440557.54	1867493.00	639.00	LYS-FLR OF SUMP	4531	440525.03	1867510.49	648.00	LYS-RISER TRENCH					
4519	440558.53	1867491.01	639.33	LYS-SLOPE BRK	4611	440617.00	1867454.00	648.00	SG-TOP OF SUMP					
4520	440540.03	1867454.00	645.50	LYS-TOP OF SUMP	4612	440540.03	1867454.00	648.00	SG-TOP OF SUMP					
4521	440552.03	1867498.51	639.00	LYS-TOP OF SUMP	4613	440540.03	1867554.00	648.00	SG-TOP OF SUMP					
4522	440532.53	1867491.01	648.00	LYS-RISER TRENCH	4614	440617.00	1867554.00	648.00	SG-TOP OF SUMP					
4523	440525.03	1867498.51	648.00	LYS-RISER TRENCH	4615	440578.00	1867493.00	641.50	SG-FLR OF SUMP					
4524	440617.00	1867554.00	645.50	LYS-TOP OF SUMP	4616	440557.54	1867493.00	641.50	SG-FLR OF SUMP					
4525	440578.00	1867515.00	639.00	LYS-FLR OF SUMP	4617	440578.00	1867515.00	641.50	SG-FLR OF SUMP					
4526	440556.54	1867515.00	639.00	LYS-FLR OF SUMP	4618	440556.54	1867515.00	641.50	SG-FLR OF SUMP					
4527	440558.03	1867517.99	639.50	LYS-SLOPE BRK	4619	440552.03	1867498.51	641.50	SG-RISER TRENCH					
4528	440552.03	1867510.49	639.00	LYS-FLR OF SUMP	4620	440552.03	1867509.16	641.50	SG-RISER TRENCH					

SCALE
0 30 FT 60 FT

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15866 SHT01	600G	0111

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

NOTES

1. ELEVATIONS SHOWN ARE NOMINAL. ACTUAL ELEVATIONS SHALL BE DETERMINED BY MINIMUM REQUIRED COMPONENT THICKNESS PER GRADING TOLERANCE ON DWG NO. 0600X-DD-C0281.
2. SURVEY DATUM
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)
3. LYSIMETER SUMP LOCATED BELOW SUBGRADE LEVEL. SUBGRADE FOR LYSIMETER ACCESS PIPE NOT SHOWN IN ENTIRETY. SUBGRADE BREAK LINES SHOWN FOR REFERENCE.
4. SEE 0600X-DD-C0289 AND 0600X-DD-C0290 FOR EXTENT OF LYSIMETER GEOMEMBRANE LIMITS.

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. (X) Work may proceed.
2. ( ) Revise and resubmit. Work may proceed prior to resubmission.
3. ( ) Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ( ) Revise and resubmit. Work may not proceed.
5. ( ) Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Barkalow 10/9/07
DOCUMENT ID NO. 0600X-SC-G0524 05-14 033
SCOPE NO. 5C0X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mse 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

KEVIN CARL BRIEST
STATE OF WASHINGTON
42158
REGISTERED PROFESSIONAL ENGINEER
9/28/07
EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	DSG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJW	CJB	Sm	DHH	N/A	KRB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC.
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SUMP LAYOUT PLAN – CELL 8

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0286.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0286	0

DRAWING NO.	REV. NO.
0600X-DD-C0287	0

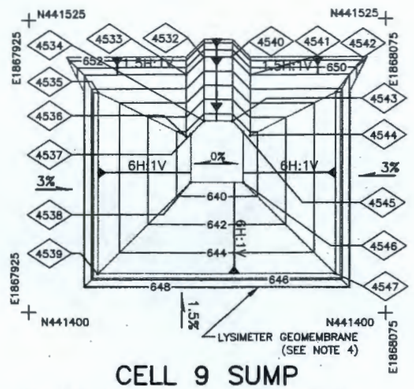

CELL 9 SUMP
6 LYSIMETER SUMP PLAN

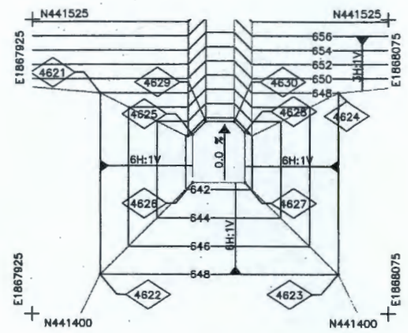

CELL 9 SUMP
1 SUBGRADE CONTROL
0600X-DD-C0268

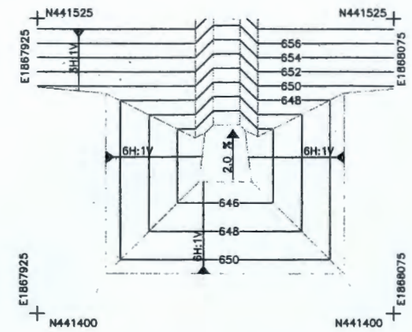

CELL 9 SUMP
2 COMPACTED ADMIX LAYER
0600X-DD-C0272

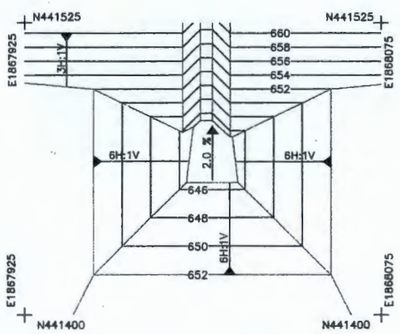

CELL 9 SUMP
3 SECONDARY DRAINAGE LAYER
0600X-DD-C0274

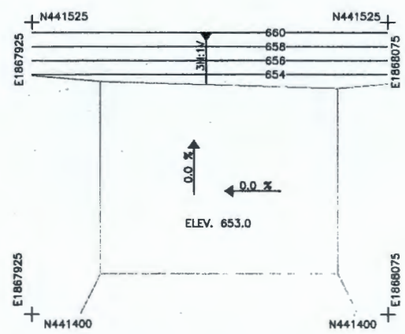

CELL 9 SUMP
4 PRIMARY DRAINAGE LAYER
0600X-DD-C0276

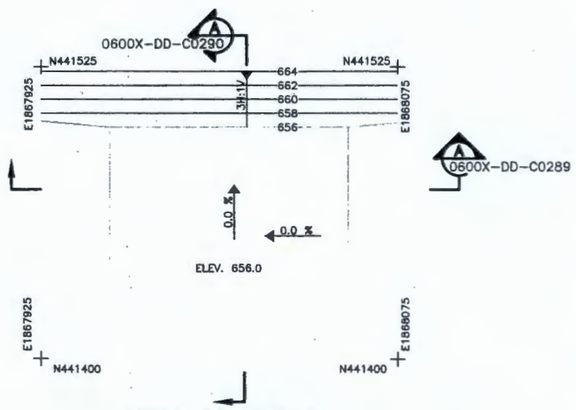

CELL 9 SUMP
5 OPERATIONS LAYER
0600X-DD-C0278

SUBGRADE CONTROL POINTS COORDINATES (WASHINGTON STATE PLANE, FT)

POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION	POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION	POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION
4532	441508.97	1867998.51	648.00	LYS-RISER TRENCH	4545	441477.46	1868015.00	639.00	LYS-FLR OF SUMP					
4533	441501.47	1867991.01	648.00	LYS-RISER TRENCH	4546	441456.00	1868015.00	639.00	LYS-FLR OF SUMP					
4534	441481.97	1867998.51	639.00	LYS-FLR OF SUMP	4547	441417.00	1868054.00	645.50	LYS-TOP OF SUMP					
4535	441493.97	1867954.00	645.50	LYS-TOP OF SUMP	4621	441493.97	1867954.00	648.00	SG-TOP OF SUMP					
4536	441475.47	1867991.01	639.33	LYS-SLOPE BRK	4622	441417.00	1867954.00	648.00	SG-TOP OF SUMP					
4537	441476.46	1867993.00	639.00	LYS-FLR OF SUMP	4623	441417.00	1868054.00	648.00	SG-TOP OF SUMP					
4538	441456.00	1867993.00	639.00	LYS-FLR OF SUMP	4624	441493.97	1868054.00	648.00	SG-TOP OF SUMP					
4539	441417.00	1867954.00	645.50	LYS-TOP OF SUMP	4625	441476.46	1867993.00	641.50	SG-FLOOR OF SUMP					
4540	441508.97	1868010.49	648.00	LYS-RISER TRENCH	4626	441456.00	1867993.00	641.50	SG-FLOOR OF SUMP					
4541	441501.47	1868017.99	648.00	LYS-RISER TRENCH	4627	441456.00	1868015.00	641.50	SG-FLOOR OF SUMP					
4542	441493.97	1868054.00	645.50	LYS-TOP OF SUMP	4628	441477.46	1868015.00	641.50	SG-FLOOR OF SUMP					
4543	441481.97	1868010.49	639.00	LYS-FLR OF SUMP	4629	441481.97	1867998.51	641.50	SG-RISER TRENCH					
4544	441475.97	1868017.99	639.50	LYS-SLOPE BRK	4630	441481.97	1868010.49	641.50	SG-RISER TRENCH					

SCALE
0 30 FT 60 FT

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15867 SHT01	600G	0111

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

NOTES

1. ELEVATIONS SHOWN ARE NOMINAL. ACTUAL ELEVATIONS SHALL BE DETERMINED BY MINIMUM REQUIRED COMPONENT THICKNESS PER GRADING TOLERANCE ON DWG NO. 0600X-DD-C0281.
2. SURVEY DATUM
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)
3. LYSIMETER SUMP LOCATED BELOW SUBGRADE LEVEL. SUBGRADE FOR LYSIMETER ACCESS PIPE NOT SHOWN IN ENTIRETY. SUBGRADE BREAK LINES SHOWN FOR REFERENCE.
4. SEE 0600X-DD-C0289 AND 0600X-DD-C0290 FOR EXTENT OF LYSIMETER GEOMEMBRANE LIMITS.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated components.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
REVIEWED BY: Bill Richling 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G0534 — 05-19 — 034
500X524 A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL 10/11/07

Best Available Copy

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIEN — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07
EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JW	CJB	[illegible]	BH	N/A	JB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC.
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SUMP LAYOUT PLAN - 9

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0287.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0287	0

DRAWING NO.	REV. NO.
0600X-DD-C0288	0

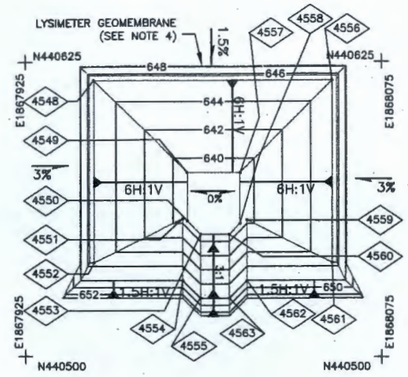

CELL 10 SUMP
6 LYSIMETER SUMP PLAN

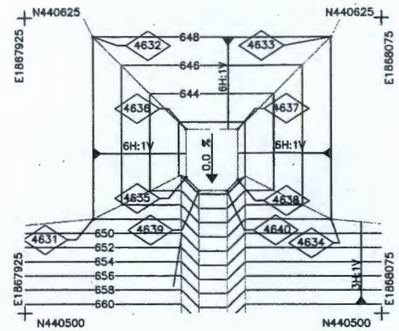

CELL 10 SUMP
1 SUBGRADE CONTROL
0600X-DD-C0268

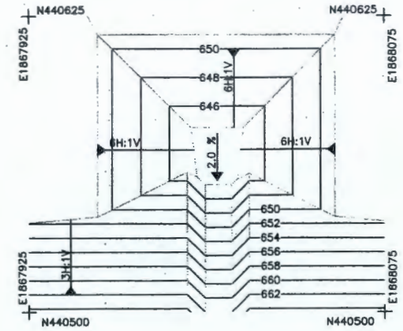

CELL 10 SUMP
2 COMPACTED ADMIX LAYER
0600X-DD-C0272

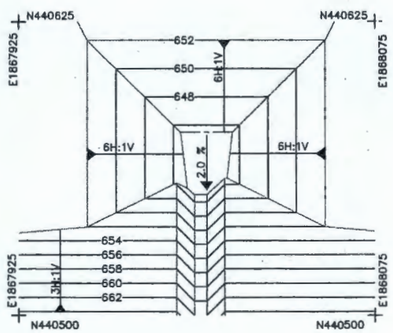

CELL 10 SUMP
3 SECONDARY DRAINAGE LAYER
0600X-DD-C0274

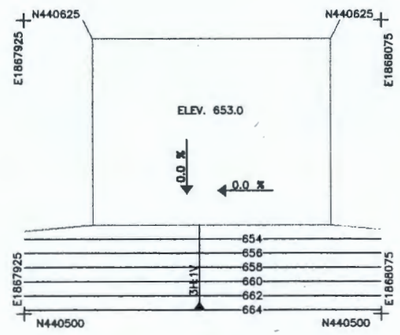

CELL 10 SUMP
4 PRIMARY DRAINAGE LAYER
0600X-DD-C0276

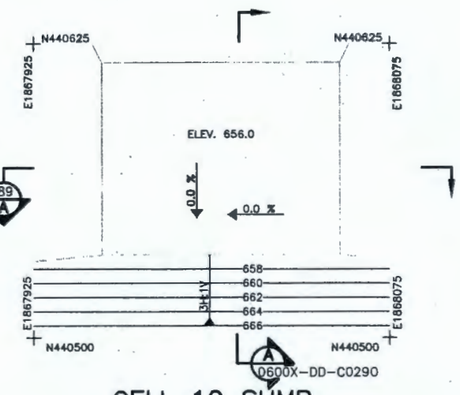

CELL 10 SUMP
5 OPERATIONS LAYER
0600X-DD-C0278

SUBGRADE CONTROL POINTS COORDINATES (WASHINGTON STATE PLANE, FT)

POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION	POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION	POINT #	NORTHING	EASTING	ELEVATION	DESCRIPTION
4548	440617.00	1867954.00	645.50	LYS-TOP OF SUMP	4561	440540.03	1868054.00	645.50	LYS-TOP OF SUMP					
4549	440578.00	1867993.00	639.00	LYS-FLR OF SUMP	4562	440532.53	1868017.99	648.00	LYS-RISER TRENCH					
4550	440557.54	1867993.00	639.00	LYS-SLOPE BRK	4563	440525.03	1868010.49	648.00	LYS-RISER TRENCH					
4551	440558.53	1867991.01	639.33	LYS-TOP OF SUMP	4631	440540.03	1867954.00	648.00	SG-TOP OF SUMP					
4552	440540.03	1867954.00	645.50	LYS-FLR OF SUMP	4632	440617.00	1867954.00	648.00	SG-TOP OF SUMP					
4553	440552.03	1867998.51	639.00	LYS-FLR OF SUMP	4633	440617.00	1868054.00	648.00	SG-TOP OF SUMP					
4554	440532.53	1867991.01	648.00	LYS-RISER TRENCH	4634	440540.03	1868054.00	648.00	SG-TOP OF SUMP					
4555	440525.03	1867998.51	648.00	LYS-RISER TRENCH	4635	440557.54	1867993.00	641.50	SG-FLOOR OF SUMP					
4556	440617.00	1868054.00	645.50	LYS-TOP OF SUMP	4636	440578.00	1867993.00	641.50	SG-FLOOR OF SUMP					
4557	440578.00	1868015.00	639.00	LYS-FLR OF SUMP	4637	440578.00	1868015.00	641.50	SG-FLOOR OF SUMP					
4558	440556.54	1868015.00	639.00	LYS-FLR OF SUMP	4638	440556.54	1868015.00	641.50	SG-FLOOR OF SUMP					
4559	440558.03	1868017.99	639.50	LYS-SLOPE BRK	4639	440552.03	1867998.51	641.50	SG-RISER TRENCH					
4560	440552.03	1868010.49	639.00	LYS-FLR OF SUMP	4640	440552.03	1868010.49	641.50	SG-RISER TRENCH					

SCALE
0 30 FT 60 FT

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15868 SHT01	600G	0111

NOTES

1. ELEVATIONS SHOWN ARE NOMINAL. ACTUAL ELEVATIONS SHALL BE DETERMINED BY MINIMUM REQUIRED COMPONENT THICKNESS PER GRADING TOLERANCE ON DWG NO. 0600X-DD-C0281.
2. SURVEY DATUM
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)
3. LYSIMETER SUMP LOCATED BELOW SUBGRADE LEVEL. SUBGRADE FOR LYSIMETER ACCESS PIPE NOT SHOWN IN ENTIRETY. SUBGRADE BREAK LINES SHOWN FOR REFERENCE.
4. SEE 0600X-DD-C0289 AND 0600X-DD-C0290 FOR EXTENT OF LYSIMETER GEOMEMBRANE LIMITS.

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on this contract.
Bill Borlaug 10/9/07
DOCUMENT ID NUMBER 0600X-SC-G00524 05-19 035
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL Rec 10/11/07

Best Available Copy

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIXEY — STATE OF WASHINGTON — 4215B — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	DSG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JSW	CSB	Sam	BJH	NA	RB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON | WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SUMP LAYOUT PLAN - CELL 10

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0288.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0288	0

River Corridor Closure Contract
Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0289	0

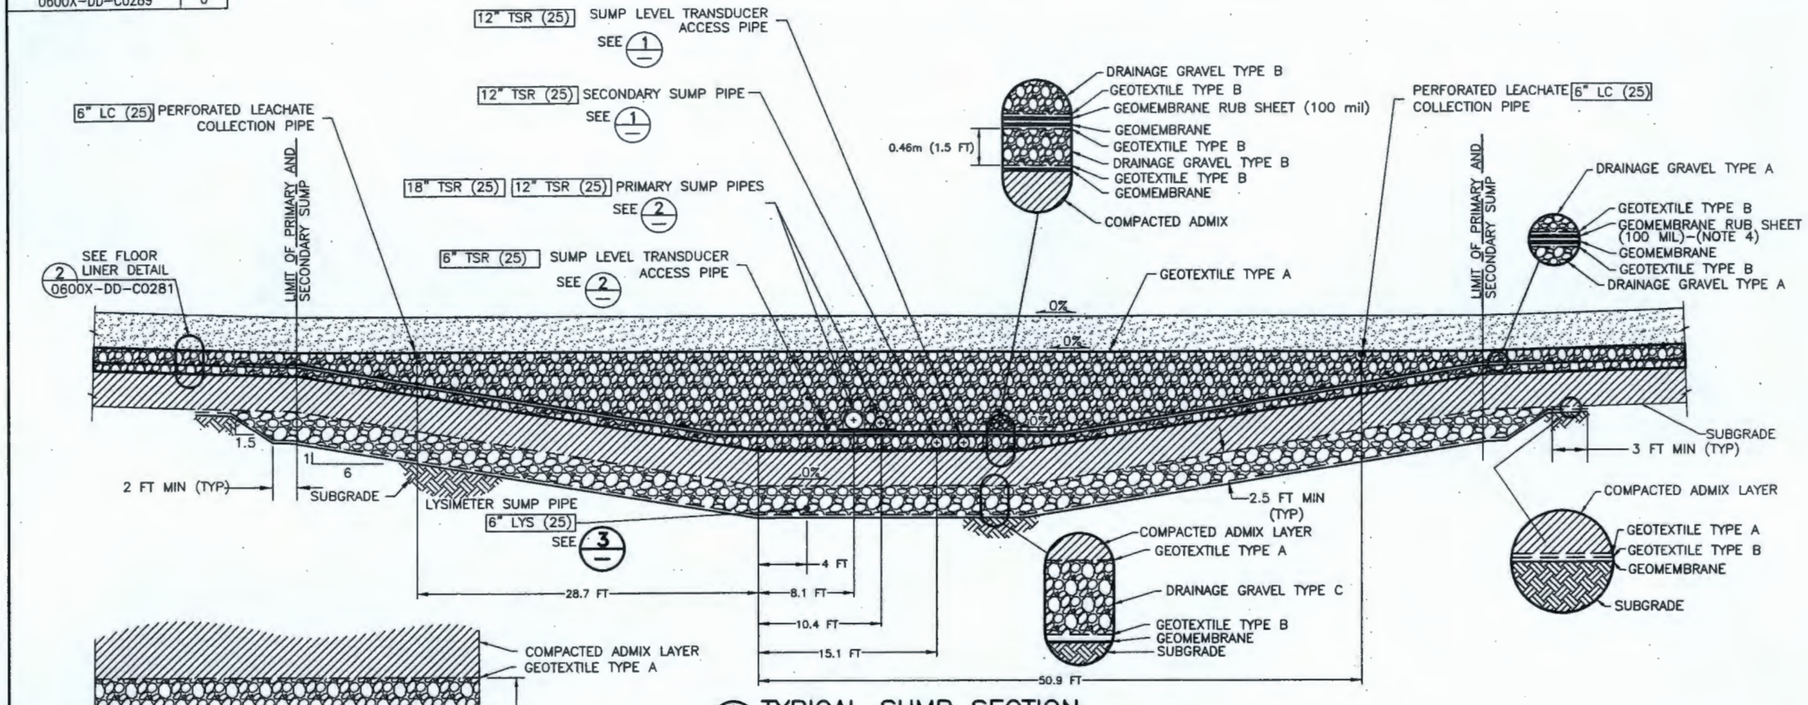

A TYPICAL SUMP SECTION
0600X-DD-C0285,C0286,C0287,C0288

SCALE
0 6 12 feet

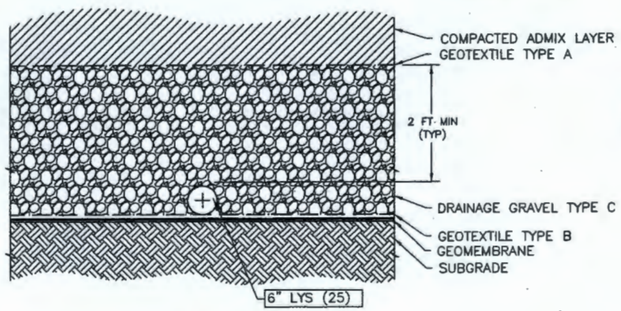

3 LYSIMETER SUMP PIPE
NTS

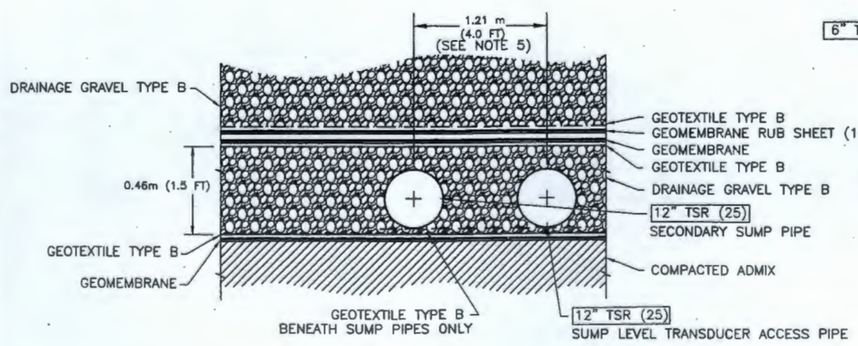

1 SECONDARY SUMP PIPE
NTS

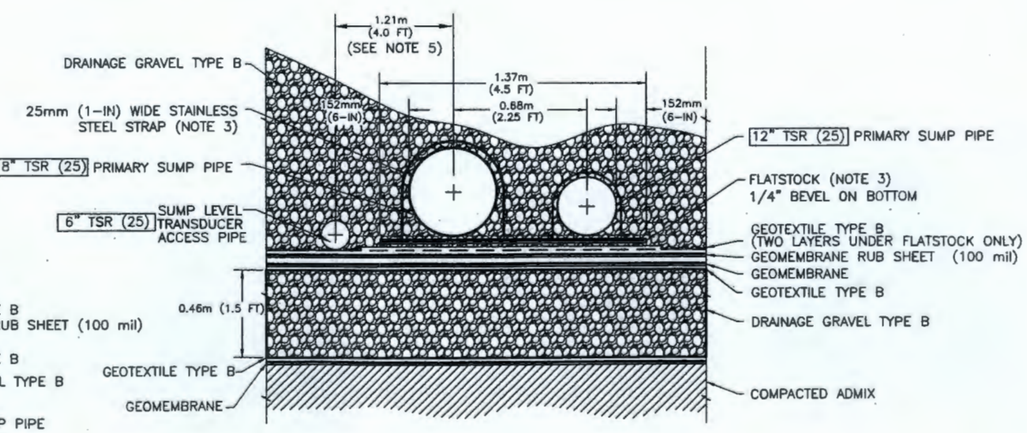

2 PRIMARY SUMP PIPES
NTS

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15869 SHT01	600G	0111

NOTES

1. LINER SYSTEM COMPONENT THICKNESS' EXAGGERATED FOR CLARITY.
2. REFER TO TECHNICAL SPECIFICATIONS FOR CELL CONSTRUCTION FOR MATERIAL, HANDLING, AND INSTALLATION REQUIREMENTS.
3. FLAT STOCK SHALL EXTEND UNDER ENTIRE LENGTH OF PIPES AND 152mm (6-IN) MIN BEYOND PIPE END. ANCHOR PIPES TO FLAT STOCK WITH 25 mm (1-IN) WIDE SS STRAPS AT 1.52m (5 FT) INTERVALS. ATTACH STRAPS TO FLAT STOCK USING STAINLESS STEEL BOLTS AND WASHERS OR SCREWS. FASTENERS SHALL NOT PROTRUDE BEYOND BOTTOM OF FLATS. REFER TO TECHNICAL SPECIFICATIONS FOR PIPING, VALVES, AND SPECIALS REQUIREMENTS.
4. GEOMEMBRANE RUB SHEET (100mil) SHALL EXTEND 1.52m (5 FT) MIN ALONG SLOPE BEYOND LIMITS OF SUMP ALL AROUND. REFER TO TECHNICAL SPECIFICATIONS FOR CELL CONSTRUCTION GEOSYNTHETICS FOR MATERIAL HANDLING AND INSTALLATION REQUIREMENTS.
5. SUMP LEVEL TRANSDUCER PIPES IN BOTH SUMPS HAVE A 4-FT SEPERATION FROM THE SUMP PIPES WITHIN THE SUMP AND TRANSITION TO 2.25-FT ON THE SIDESLOPE.

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1 ☒ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3 ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Boehling 10/9/07
0600X-SC-G0524 05-19 036
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGHT — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJU	CJB	[illegible]	BJH	N/A	RCB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON | WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SUMP DETAILS - 1

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0289.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0289	0

Washington Closure Hanford

RIVER CORRIDOR CLOSURE CONTRACT
Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0290	0

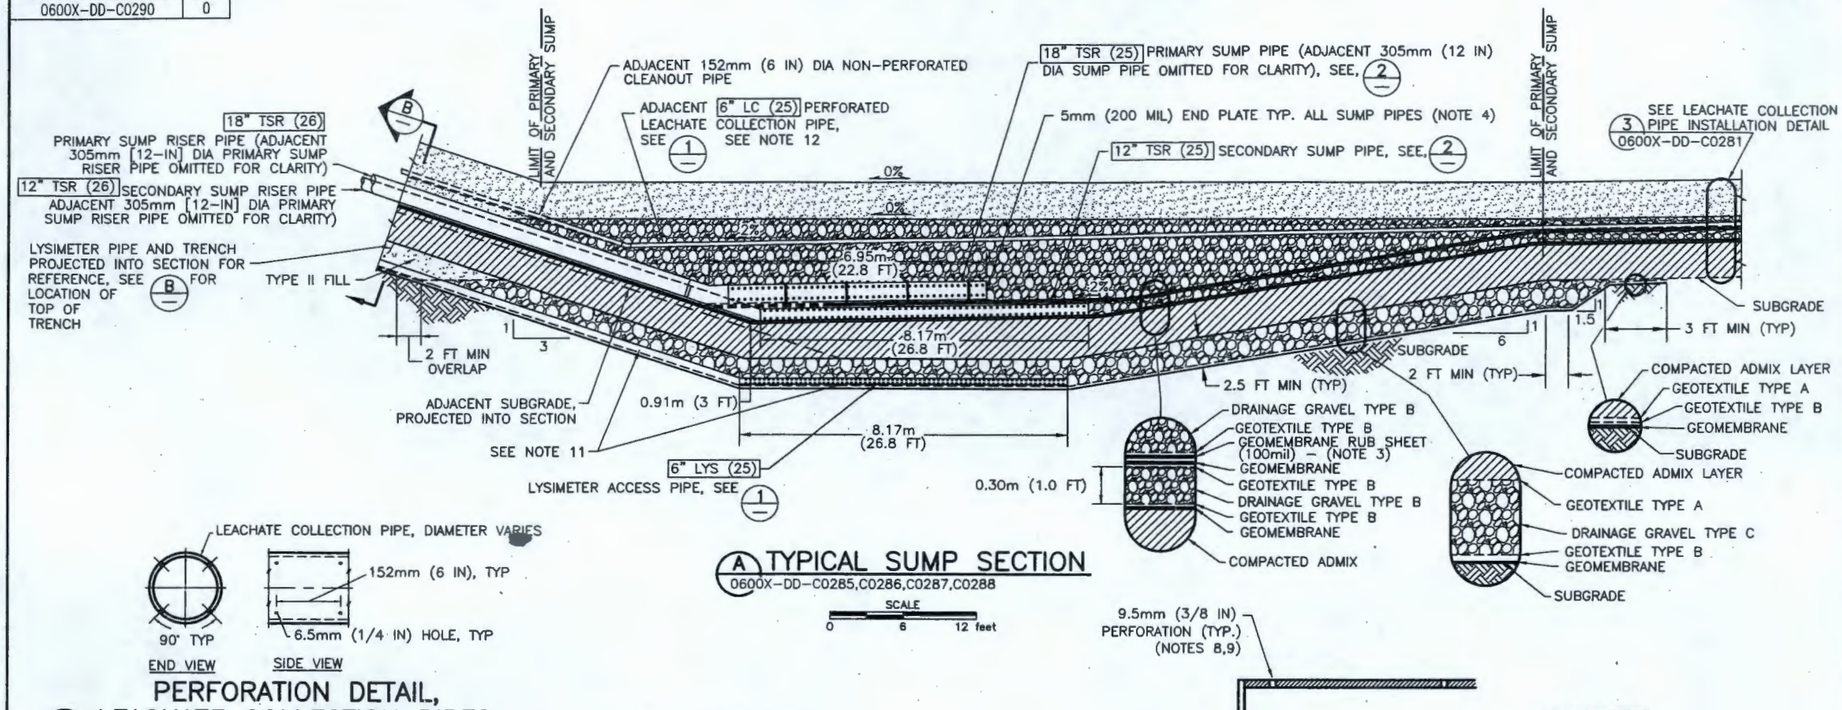

A TYPICAL SUMP SECTION

0600X-DD-C0285,C0286,C0287,C0288

SCALE 0 6 12 feet

1 PERFORATION DETAIL, LEACHATE COLLECTION PIPES

NTS

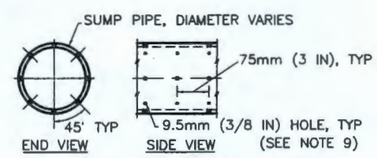

2 PERFORATION DETAIL, SUMP PIPES

NTS

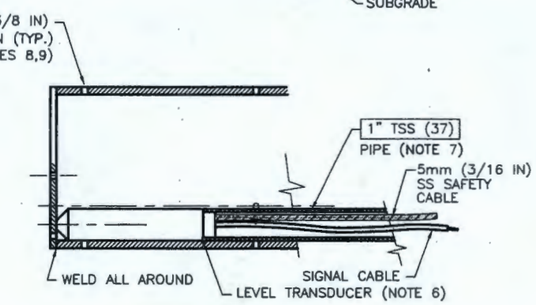

3 SUMP LEVEL TRANDUCER INSTALLATION

NTS

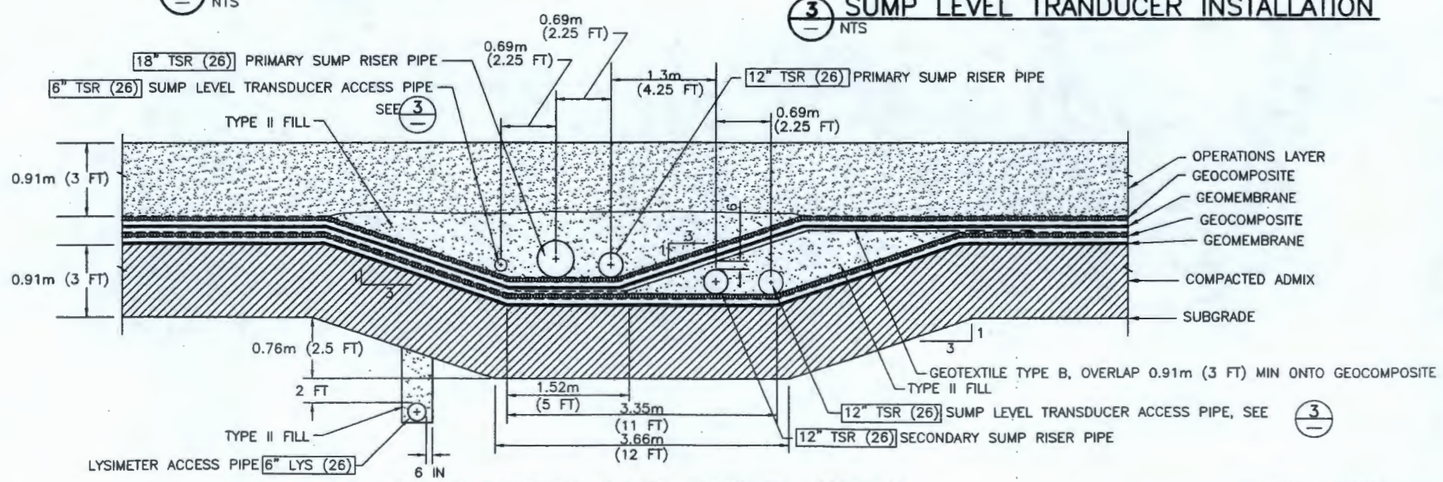

B SIDESLOPE RISER TRENCH SECTION

NTS

NOTES

1. LINER SYSTEM COMPONENT THICKNESSES EXAGGERATED FOR CLARITY.
2. REFER TO TECHNICAL SPECIFICATIONS FOR MATERIAL, HANDLING, AND INSTALLATION REQUIREMENTS.
3. RUB SHEET TO EXTEND 1.5m (5 FT) MIN ALONG SLOPE BEYOND LIMITS OF SUMP ALL AROUND.
4. WELD END PLATE TO SUMP PIPE ALL AROUND. ALTERNATIVELY, BOLT PLATE TO SUMP PIPE USING 8 BOLTS MINIMUM IN RADIAL PATTERN WITH WASHERS. BOLTS AND WASHERS SHALL BE STAINLESS STEEL.
5. LEACHATE REMOVAL PUMPS TO BE PLACED WITHIN PERFORATED SECTION OF SUMP PIPE AT LOWEST ELEVATION.
6. SENSOR AND CABLES NOT SHOWN IN SECTION.
7. JOINTS SHALL BE SOLVENT WELDED OR THREADED.
8. TRANSDUCER PIPE PERFORATION PATTERN IS IDENTICAL TO SUMP PIPE PERFORATION PATTERN.
9. PIPE ON FLOOR OF SUMP SHALL BE PERFORATED.
10. END OF PRIMARY SUMP LEVEL TRANSDUCER PIPE TO BE 3.0m (10 FT) FROM END OF ASSOCIATED SUMP PIPE. END OF SECONDARY SUMP LEVEL TRANSDUCER PIPE SHALL MATCH END OF SECONDARY SUMP PIPE.
11. FITTINGS SHALL NOT BE USED TO TRANSITION SIDE SLOPE LYSIMETER PIPE TO PERFORATED LYSIMETER PIPE IN SUMP. LYSIMETER PIPE BENDS SHALL BE MINIMUM NECESSARY FOR ALIGNMENT AND WITHIN MANUFACTURERS RECOMMENDATIONS.
12. TRANSITION FROM SOLID PIPE TO PERFORATED AT TOE OF SIDESLOPE.
13. SUMP LEVEL TRANSDUCER PIPES IN BOTH SUMPS HAVE A 4-FT SEPERATION FROM THE SUMP PIPES WITHIN THE SUMP AND, TRANSITION TO 2.25-FT ON THE SIDESLOPE.

DOCUMENT CONTROL mlc 10/14/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGGS STATE OF WASHINGTON 42158 REGISTERED PROFESSIONAL ENGINEER 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CK'K	ORIG/ ENG'R	ENG'R CK'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JSW	CJB	[illegible]	[illegible]	N/A	CJB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SUMP DETAILS - 2

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0290.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0290	0

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15870 SHT01	600G	0111

WASHINGTON CLOSURE HANFORD JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Borbylo 10/9/07
DOCUMENT ID NUMBER 0600X-SC-60524 05-19 037
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

RIVER CORRIDOR CLOSURE CONTRACT
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0291	0

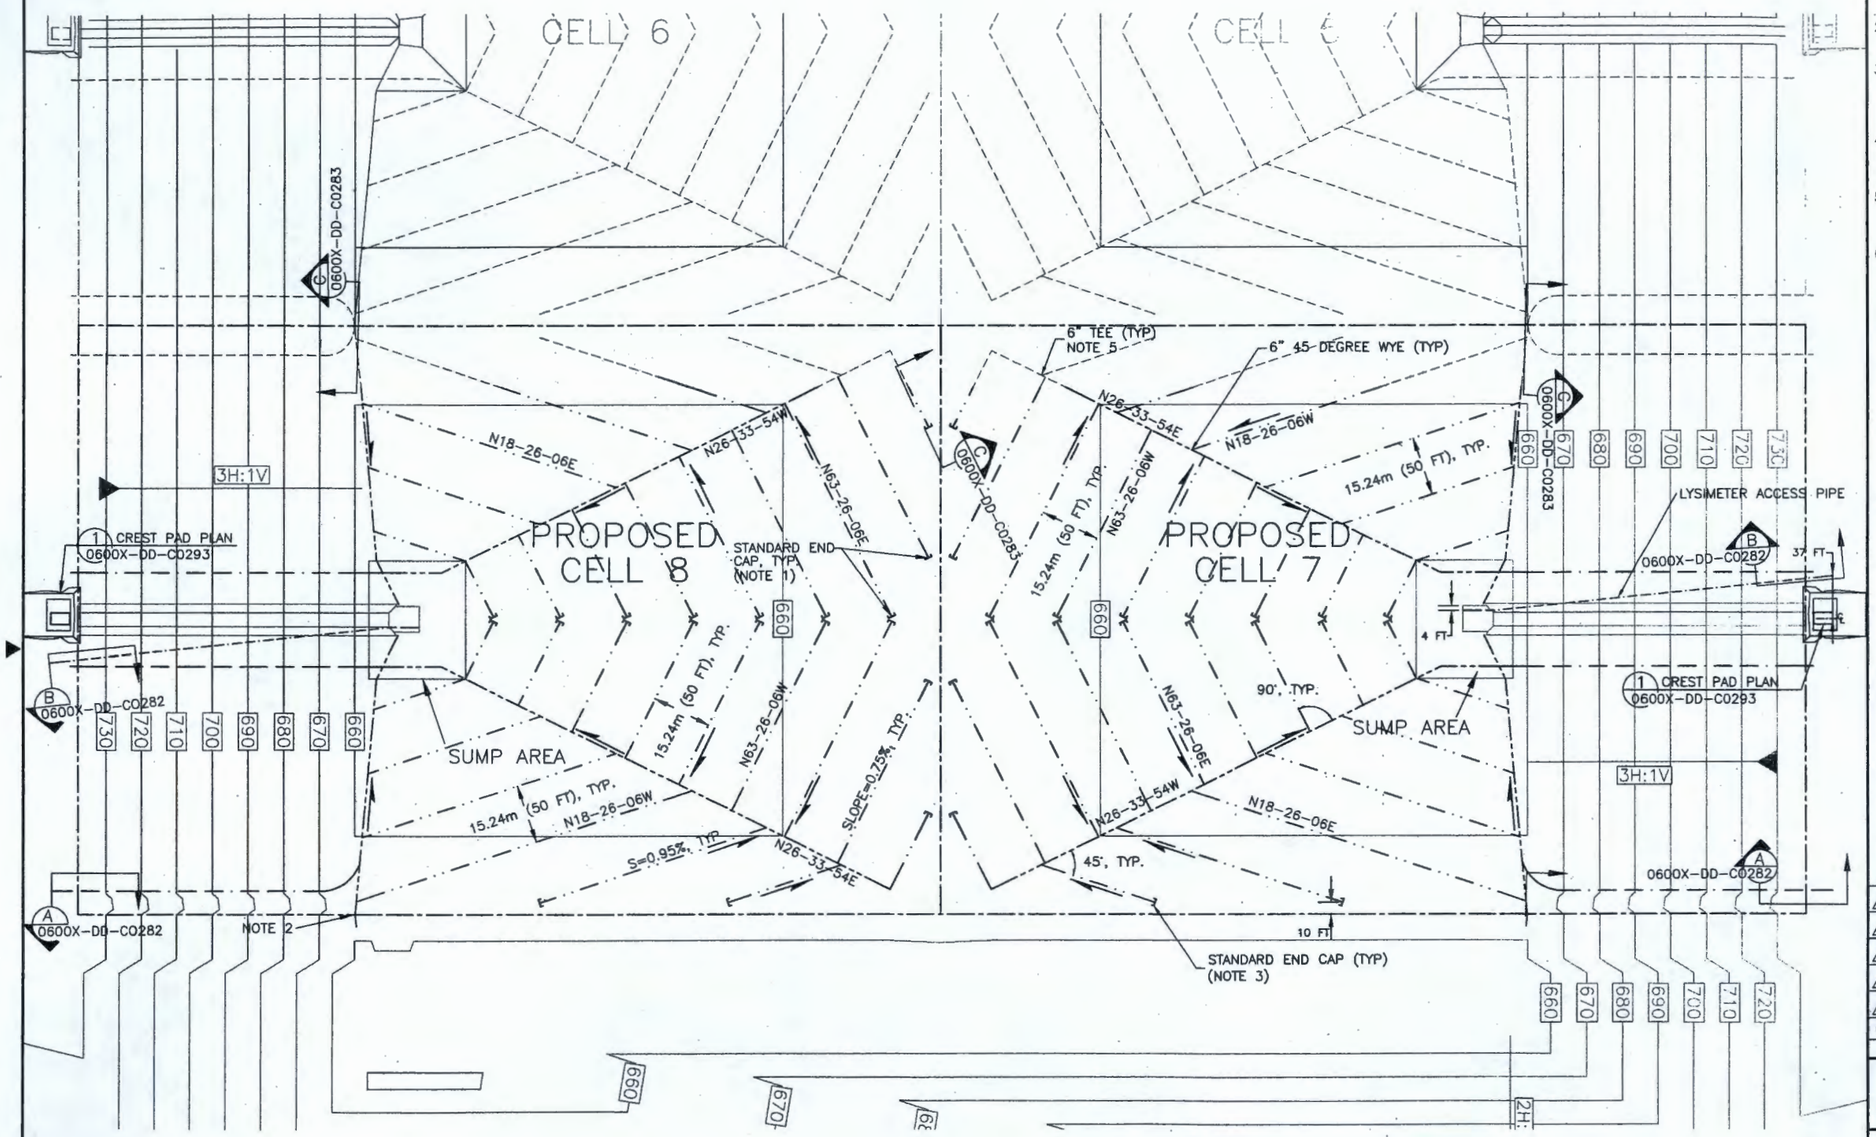

NOTES

1. ALL 102 mm (4-IN) PERF PIPE SHALL BE CONNECTED AT BOTH ENDS TO 152 mm (6-IN) PERF PIPE ONLY, WHERE POSSIBLE. OTHERWISE CLOSE WITH STANDARD END CAP.
2. CLEANOUT PIPES SHALL CROSS OVER EACH OTHER AND SHALL NOT BE INTERCONNECTED.
3. TERMINATE AND CAP ALL 102 mm (4-IN) LEACHATE COLLECTION PIPES 3.05 m (10 FT) FROM BOUNDARIES BETWEEN CELLS. TERMINATE AND CAP 152 mm (6-IN) PIPES WHERE SHOWN.
4. FOR CLARITY, SUMP RISER PIPES, SUMP LEVEL TRANSDUCER ACCESS PIPES, AND VADOSE ZONE MONITORING PIPES ARE NOT SHOWN.
5. PIPE CONNECTIONS SHALL BE 6" TEES WITH 6"X4" REDUCERS, OR 6" FABRICATED 45 DEGREE WYE THREE SEGMENT WITH 6"X4" REDUCER.
6. IN-CELL LEACHATE PIPING INSTALLED IN PRIMARY DRAINAGE LAYER ONLY.

LEGEND:

- CONTOUR OR GRADE BREAK
- 4" LC (25) PERFORATED LEACHATE COLLECTION PIPE
- 6" LC (25) PERFORATED LEACHATE COLLECTION PIPE
- 6" LCC (26) CLEANOUT RISER
- 6" LYS (25)(26) LYSIMETER ACCESS PIPE
- N18-26-06W BEARING OF PIPE
- EXISTING LEACHATE COLLECTION PIPE

DOCUMENT CONTROL nlc 10/11/07

Best Available Copy

0 30' 60' 120'

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIANT, STATE OF WASHINGTON, 42158, REGISTERED PROFESSIONAL ENGINEER, 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CK'R	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJU	CJB	Smm	JJH	NA	JCB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
IN-CELL LEACHATE PIPING PLAN – CELLS 7 & 8

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0291.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0291	0

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. [X] Work may proceed.
2. [ ] Revise and resubmit. Work may proceed prior to resubmittal.
3. [ ] Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. [ ] Revise and resubmit. Work may not proceed.
5. [ ] Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Boeland 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G0524 05-19 038
ROFO NO. | ERS ITEM | SUBMITTAL
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15871 SHT01	600G	0111

River Corridor Closure Contract
WCH
Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0292	0

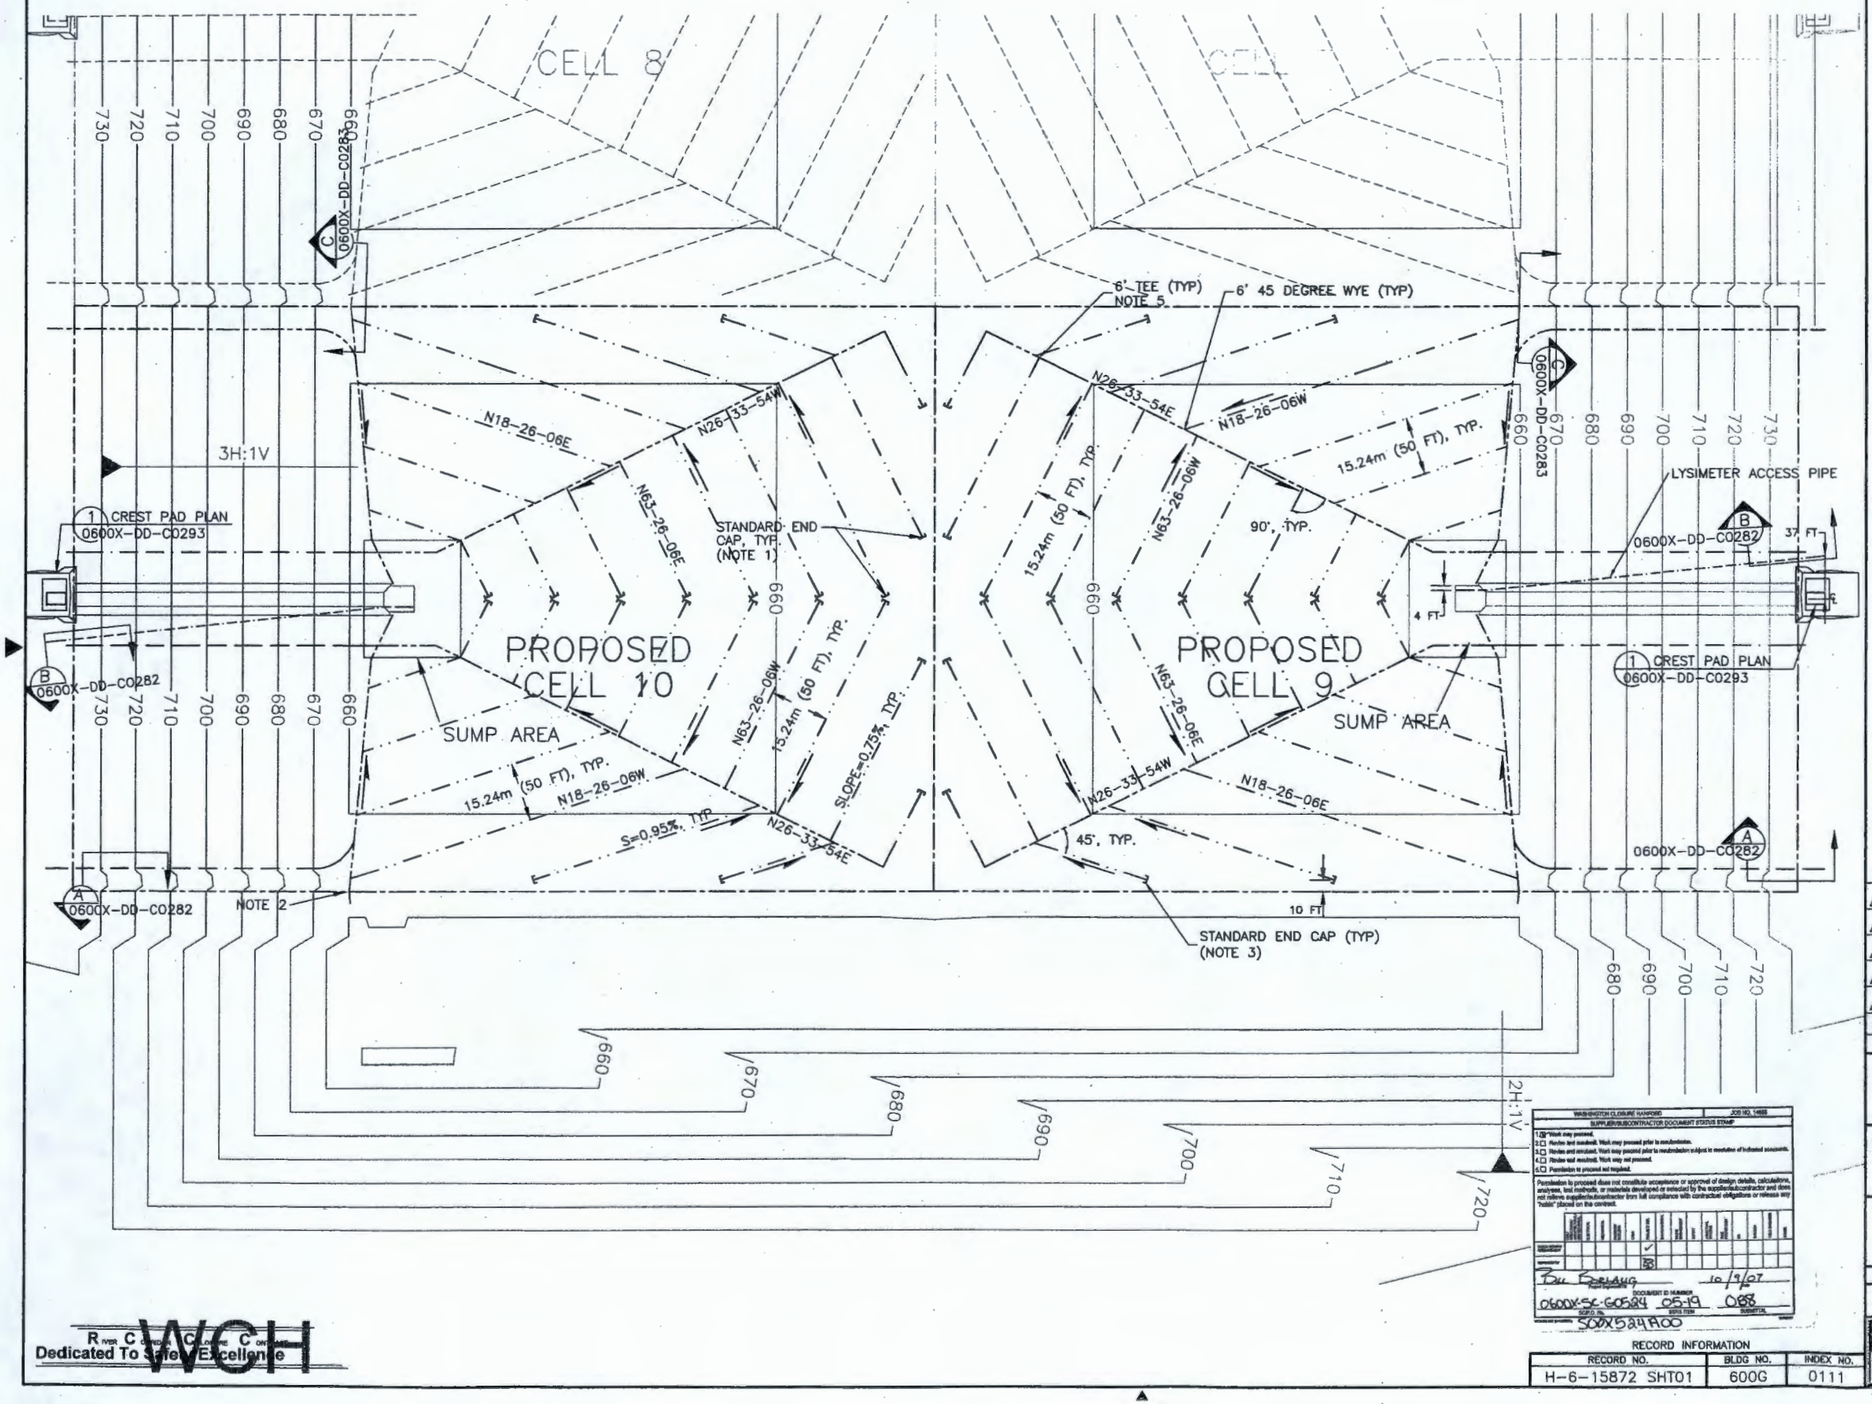

NOTES

1. ALL 102 mm (4-IN) PERF PIPE SHALL BE CONNECTED AT BOTH ENDS TO 152 mm (6-IN) PERF PIPE ONLY, WHERE POSSIBLE. OTHERWISE CLOSE WITH STANDARD END CAP.
2. CLEANOUT PIPES SHALL CROSS OVER EACH OTHER AND SHALL NOT BE INTERCONNECTED.
3. TERMINATE AND CAP ALL 102 mm (4-IN) LEACHATE COLLECTION PIPES 3.05 m (10 FT) FROM BOUNDARIES BETWEEN CELLS. TERMINATE AND CAP 152 mm (6-IN) PIPES WHERE SHOWN.
4. FOR CLARITY, SUMP RISER PIPES, SUMP LEVEL TRANSDUCER ACCESS PIPES, AND VADOSE ZONE MONITORING PIPES ARE NOT SHOWN.
5. PIPE CONNECTIONS SHALL BE 6" TEES WITH 6"X4" REDUCERS, OR 6" FABRICATED 45 DEGREE WYE THREE SEGMENT WITH 6"X4" REDUCER.
6. IN-CELL LEACHATE PIPING INSTALLED IN PRIMARY DRAINAGE LAYER ONLY.

LEGEND:

- CONTOUR OR GRADE BREAK
- 4" LC (25) PERFORATED LEACHATE COLLECTION PIPE
- 6" LC (25) PERFORATED LEACHATE COLLECTION PIPE
- 6" LCC (26) CLEANOUT RISER
- 6" LYS (25)(26) LYSIMETER ACCESS PIPE
- N18-26-06W BEARING OF PIPE
- EXISTING LEACHATE COLLECTION PIPE

0 30' 60' 120'

DOCUMENT CONTROL 10/11/07

Best Available Copy

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRENT, STATE OF WASHINGTON, 42158, REGISTERED PROFESSIONAL ENGINEER, 4/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJV	CJB	[illegible]	BJH	N/A	BJR

SCALE: AS SHOWN

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. [X] Work may proceed.
2. [ ] Revise and resubmit. Work may proceed prior to resubmittal.
3. [ ] Review and envision. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. [ ] Review and resubmit. Work may not proceed.
5. [ ] Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Doc Control 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G0584 05-19 088
500X5214.100

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15872 SHT01	600G	0111

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
IN-CELL LEACHATE PIPING PLAN - CELLS 9 & 10

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0292.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0292	0

River Corridor Closure Contract
WCH
Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0293	0

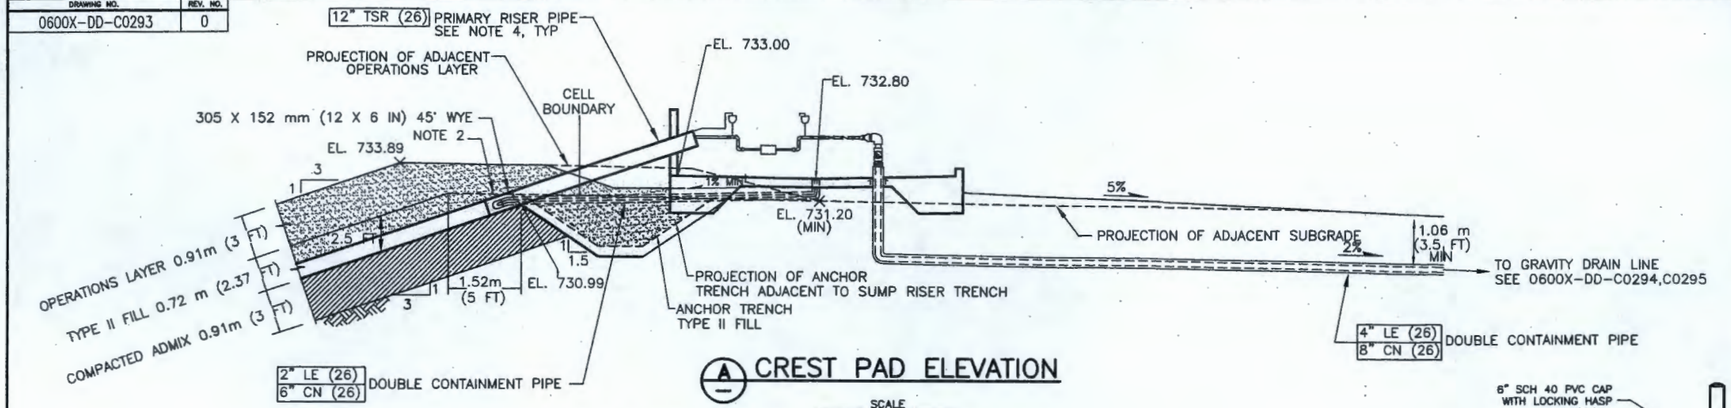

A CREST PAD ELEVATION

SCALE 0 5 10 feet

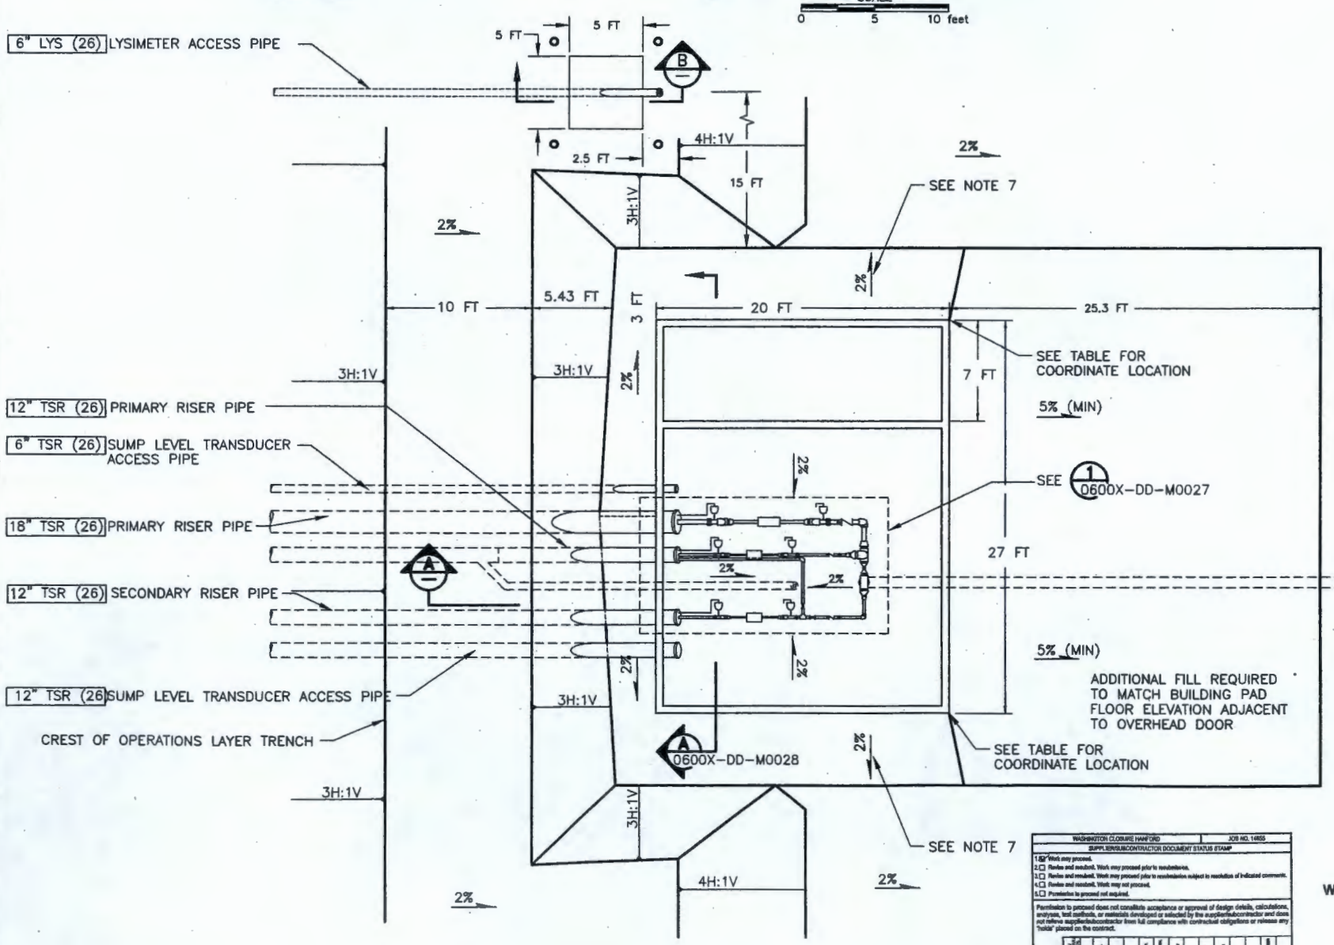

1 CREST PAD PLAN

0600X-DD-C0291, C0292

SCALE 0 5 10 feet

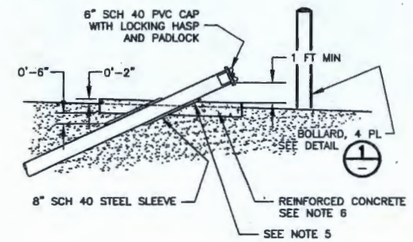

B LYSIMETER ACCESS PAD

0600X-DD-C0282, C0291, C0292 NTS

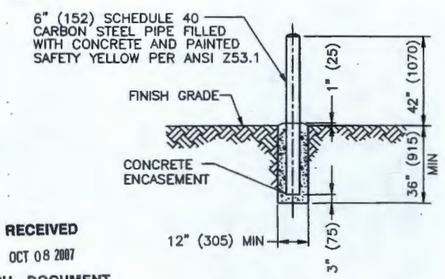

C BOLLARD DETAIL

0600X-DD-C0293, C0300 NTS

NOTES

1. CREST PAD BUILDING, PIPE SUPPORTS, AND JUNCTION BOXES NOT SHOWN.
2. WELD PRIMARY GEOMEMBRANE TO SECONDARY RISER PIPES ALL AROUND AT PENETRATION. BOOT MAY BE USED SUBJECT TO APPROVAL BY CONTRACTOR.
3. CREST PAD PLAN IS TYPICAL FOR CELLS 7, 8, 9 AND 10.
4. HDPE FUSION BUTT WELD JOINTS SHALL NOT BE MADE ABOVE NON-LINED AREA AT CREST PAD BUILDING TRANSITIONS.
5. FILL ANNULAR SPACE BETWEEN HDPE PIPE AND SLEEVE WITH FLEXIBLE SILICONE SEALANT.
6. 5-FOOT X 5-FOOT-6" THK REINFORCED CONCRETE SLAB ON GRADE W/ #5 REINFORCING BARS AT 12" OC EW. CENTER REINFORCING IN SLAB.
7. SLOPE 2% TO BLEND BACK INTO SURROUNDING GRADE.
8. CLEAN OUT RISERS ARE OUTSIDE THE VIEW OF THE CREST PAD PLAN.

CREST PAD BUILDING COORDINATE TABLE	
CELL 7 BUILDING	
NW CORNER	NE CORNER
N 441771.09	N 441771.09
E 1867487.0	E 1867514.0
CELL 8 BUILDING	
SW CORNER	SE CORNER
N 440262.91	N 440262.91
E 1867494.0	E 1867521.0
CELL 9 BUILDING	
NW CORNER	NE CORNER
N 441771.09	N 441771.09
E 1867987.0	E 1868014.0
CELL 10 BUILDING	
SW CORNER	SE CORNER
N 440262.91	N 440262.91
E 1867994.0	E 1868021.0

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGHT — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JW	CJB	Sum	BJH	N/A	CJB

SCALE: AS SHOWN

RECEIVED OCT 08 2007 WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mjc 10/11/07

RECORD INFORMATION		
RECORD NO.	BLDG NO.	INDEX NO.
H-6-15873 SHT01	600G	0105

WASHINGTON CLOSURE HANFORD — SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP — JOB NO. 14655

1 ☒ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3 ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

DISCIPLINE	STAMP	DATE
ENGINEERING		
CONSTRUCTION		
ENVIRONMENTAL	✓	
SAFETY	RG	

Bill Bergmann 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G0524 05-14 030
REPO YR. SERIAL ITEM SUBMITTAL
500X524A00

RIVER CORRIDOR CLOSURE CONTRACT — WCH — Dedicated To Safety Excellence

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
CREST PAD PLAN AND ELEVATION

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0293.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0293	0

DRAWING NO.	REV. NO.
0600X-DD-C0294	0

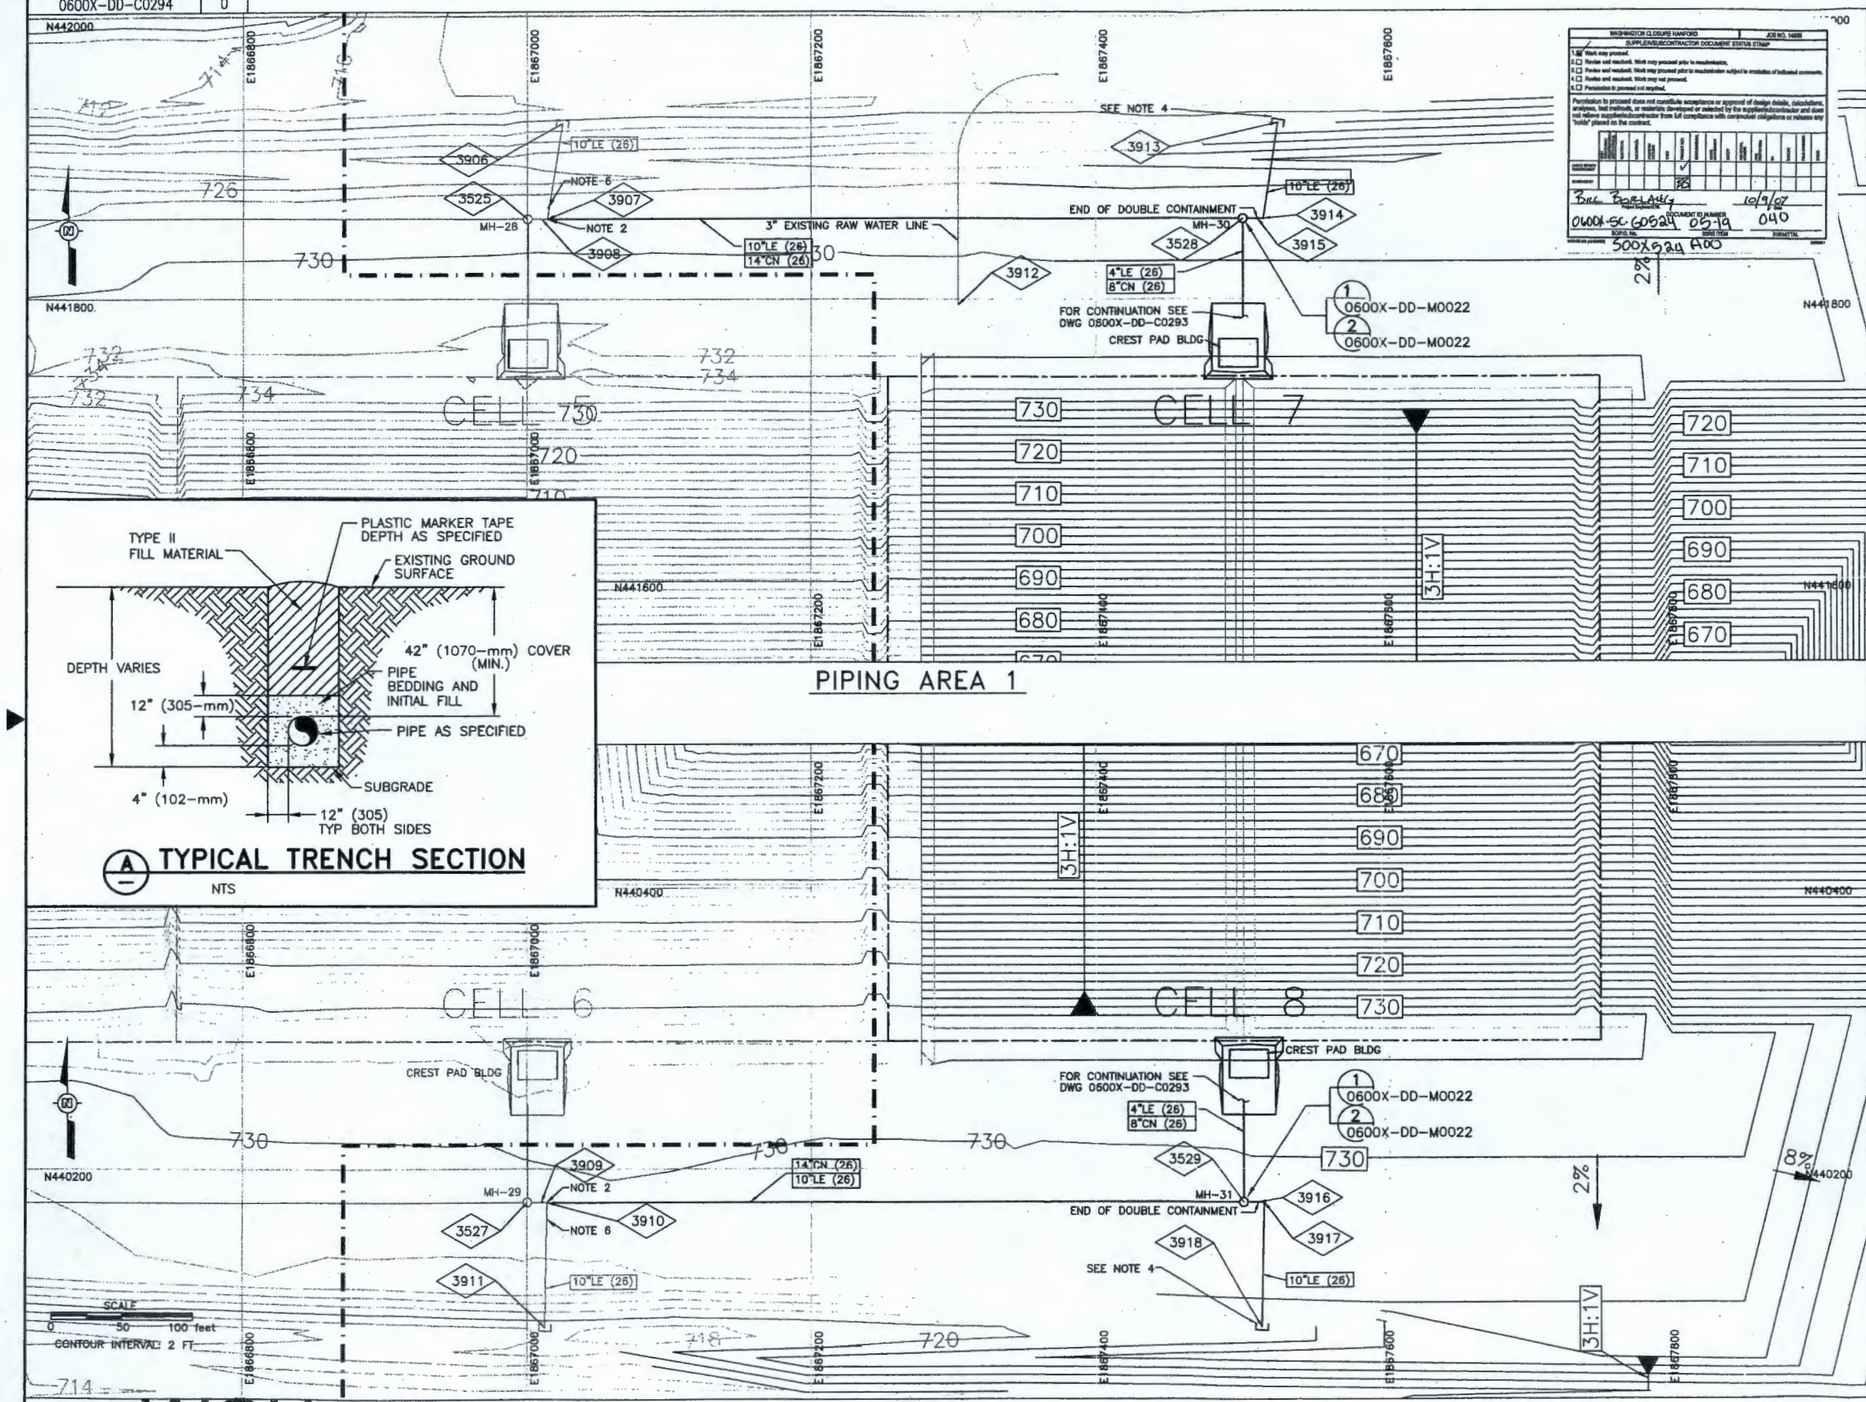

A TYPICAL TRENCH SECTION
NTS

NOTES

1. SURVEY DATUM:
   VERTICAL NAVD 88
   HORIZONTAL NAD 83 (91)
2. REMOVE EXISTING 90° ELL AND FUSION WELD NEW DOUBLE CONTAINMENT PIPE TO EXISTING. TIE-IN WORK IS CONSIDERED HAZARDOUS AND SHALL COMPLY WITH FEDERAL REGULATIONS AND WCH WORK PRACTICES FOR RADIOLOGICAL AND HAZARDOUS WORK.
3. SEE DRAWING 0600X-DD-M0023 FOR PIPING MATERIAL DESIGNATION.
4. CAPPED PIPE SHALL EXTEND 305mm(12") OUT FROM THE GROUND SURFACE.
5. SEE DRAWING 0600X-DD-C0261 FOR COORDINATE INFORMATION.
6. ABANDON EXISTING SINGLE CONTAINMENT "CLEAN" LEACHATE COLLECTION PIPE IN PLACE. REMOVE PORTION(S) OF PIPE AS NECESSARY FOR INSTALLATION OF NEW DOUBLE CONTAINMENT PIPE.

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

0600X-SC-G0524-05-19-040
S00X524 A00



KEY PLAN

DOCUMENT CONTROL 10/11/07

Best Available Copy

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BREWER, STATE OF WASHINGTON, 42158, REGISTERED PROFESSIONAL ENGINEER, 4/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JSW	CJB	Sm	BJB	NIA	CJB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
YARD PIPING PLAN - CELLS 7 & 8

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0294.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0294	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15874 SHT 01	600G	0105

RIVER CORRIDOR CLOSURE CONTRACT
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0295	0

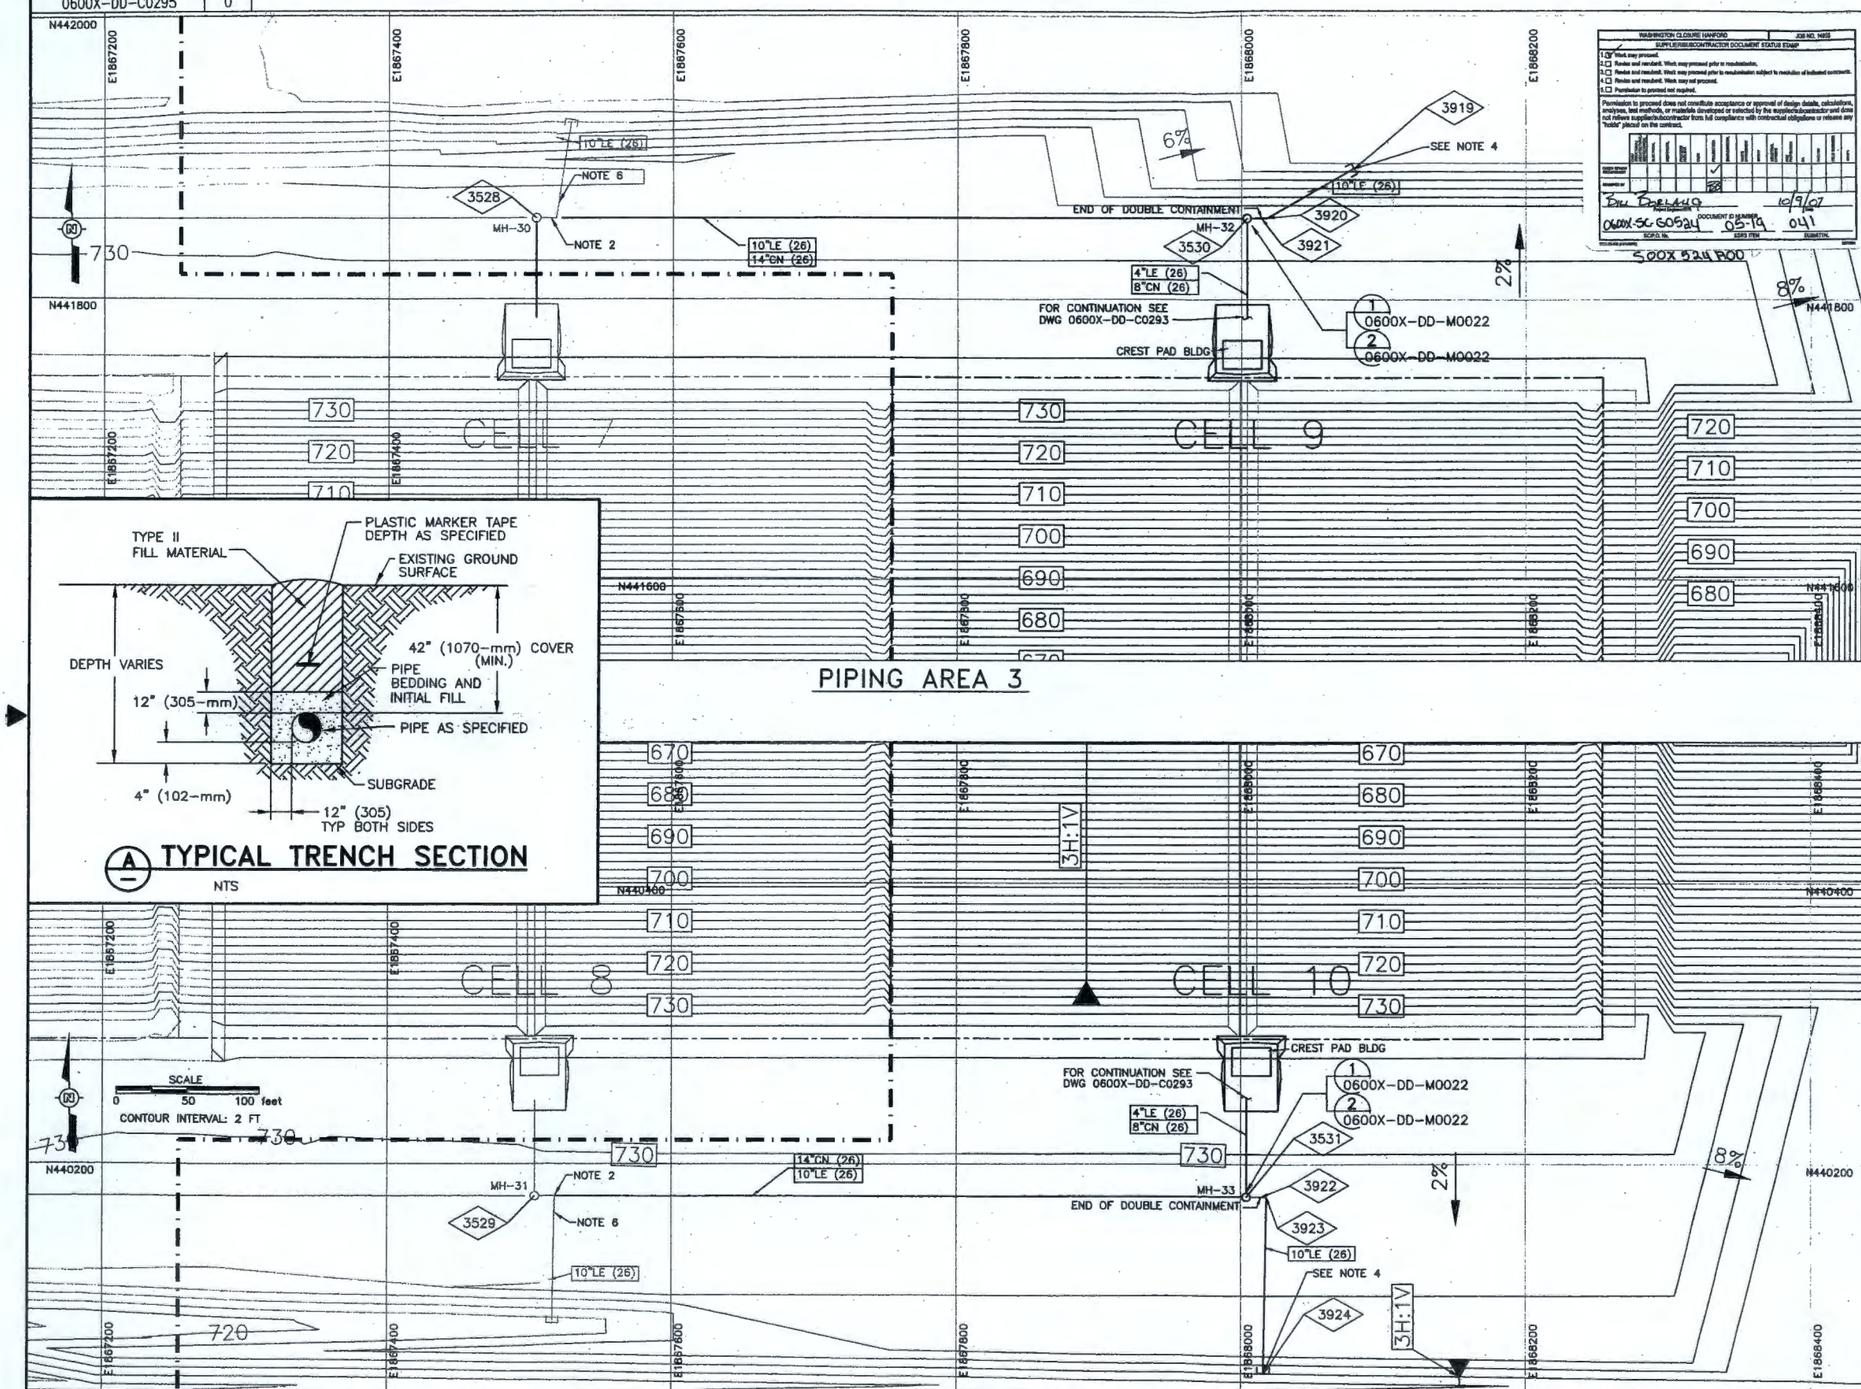

TYPICAL TRENCH SECTION

NTS

WASHINGTON CLOSURE HANFORD — JOB NO. 14655

SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal, subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

DISCIPLINE	DATE	DISCIPLINE	DATE	DISCIPLINE	DATE	DISCIPLINE	DATE	DISCIPLINE	DATE	DISCIPLINE	DATE

REMARKS or COMMENTS: 2B

Bill Bielaud — 10/9/07

0600X-SC-G0524 — 05-19 — 041 — 500X524 R00

NOTES

1. SURVEY DATUM:
   VERTICAL NAVD 88
   HORIZONTAL NAD 83 (91)
2. REMOVE EXISTING 90° ELL AND FUSION WELD NEW DOUBLE CONTAINMENT PIPE TO EXISTING. TIE-IN WORK IS CONSIDERED HAZARDOUS AND SHALL COMPLY WITH FEDERAL REGULATIONS AND WCH WORK PRACTICES FOR RADIOLOGICAL AND HAZARDOUS WORK.
3. SEE DRAWING 0600X-DD-M0023 FOR PIPING MATERIAL DESIGNATION.
4. CAPPED PIPE SHALL EXTEND 305mm(12") OUT FROM THE GROUND SURFACE.
5. SEE DRAWING 0600X-DD-C0261 FOR COORDINATE INFORMATION.
6. ABANDON EXISTING SINGLE CONTAINMENT "CLEAN" LEACHATE COLLECTION PIPE IN PLACE. REMOVE PORTION(S) OF PIPE AS NECESSARY FOR INSTALLATION OF NEW DOUBLE CONTAINMENT PIPE.
7. TERMINATION LOCATED BY CONTRACTOR.

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

0600X-SC-G0524-05-19-041
500X524 R00



KEY PLAN

DOCUMENT CONTROL mjc 10/11/07

Best Available Copy

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRAUER — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG ENGR	ENGR CHK	DES ENGR	PROJ ENGR
0	9/28/07	ISSUED FOR CONSTRUCTION	JW	CB	[illegible]	AH	NA	[illegible]

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
YARD PIPING PLAN - CELLS 9 &10

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0295.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0295	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15875 SHT 01	600G	0105

RIVER CORRIDOR CLOSURE CONTRACT
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0297	0

STOCKPILE AREA CONTROL POINT COORDINATES (WASHINGTON STATE PLANE, FT)

POINT #	NORTHING	EASTING	DESCRIPTION
100	439939.09	1866525.00	CELLS 7 & 8 STOCKPILE BOUNDARY
101	439301.90	1866525.00	CELLS 7 & 8 STOCKPILE BOUNDARY
102	439502.58	1867755.10	CELLS 7 & 8 STOCKPILE BOUNDARY
103	439245.71	1867755.10	CELLS 7 & 8 STOCKPILE BOUNDARY
104	439245.71	1868641.15	CELLS 7 & 8 STOCKPILE BOUNDARY
105	439939.09	1868641.15	CELLS 7 & 8 STOCKPILE BOUNDARY

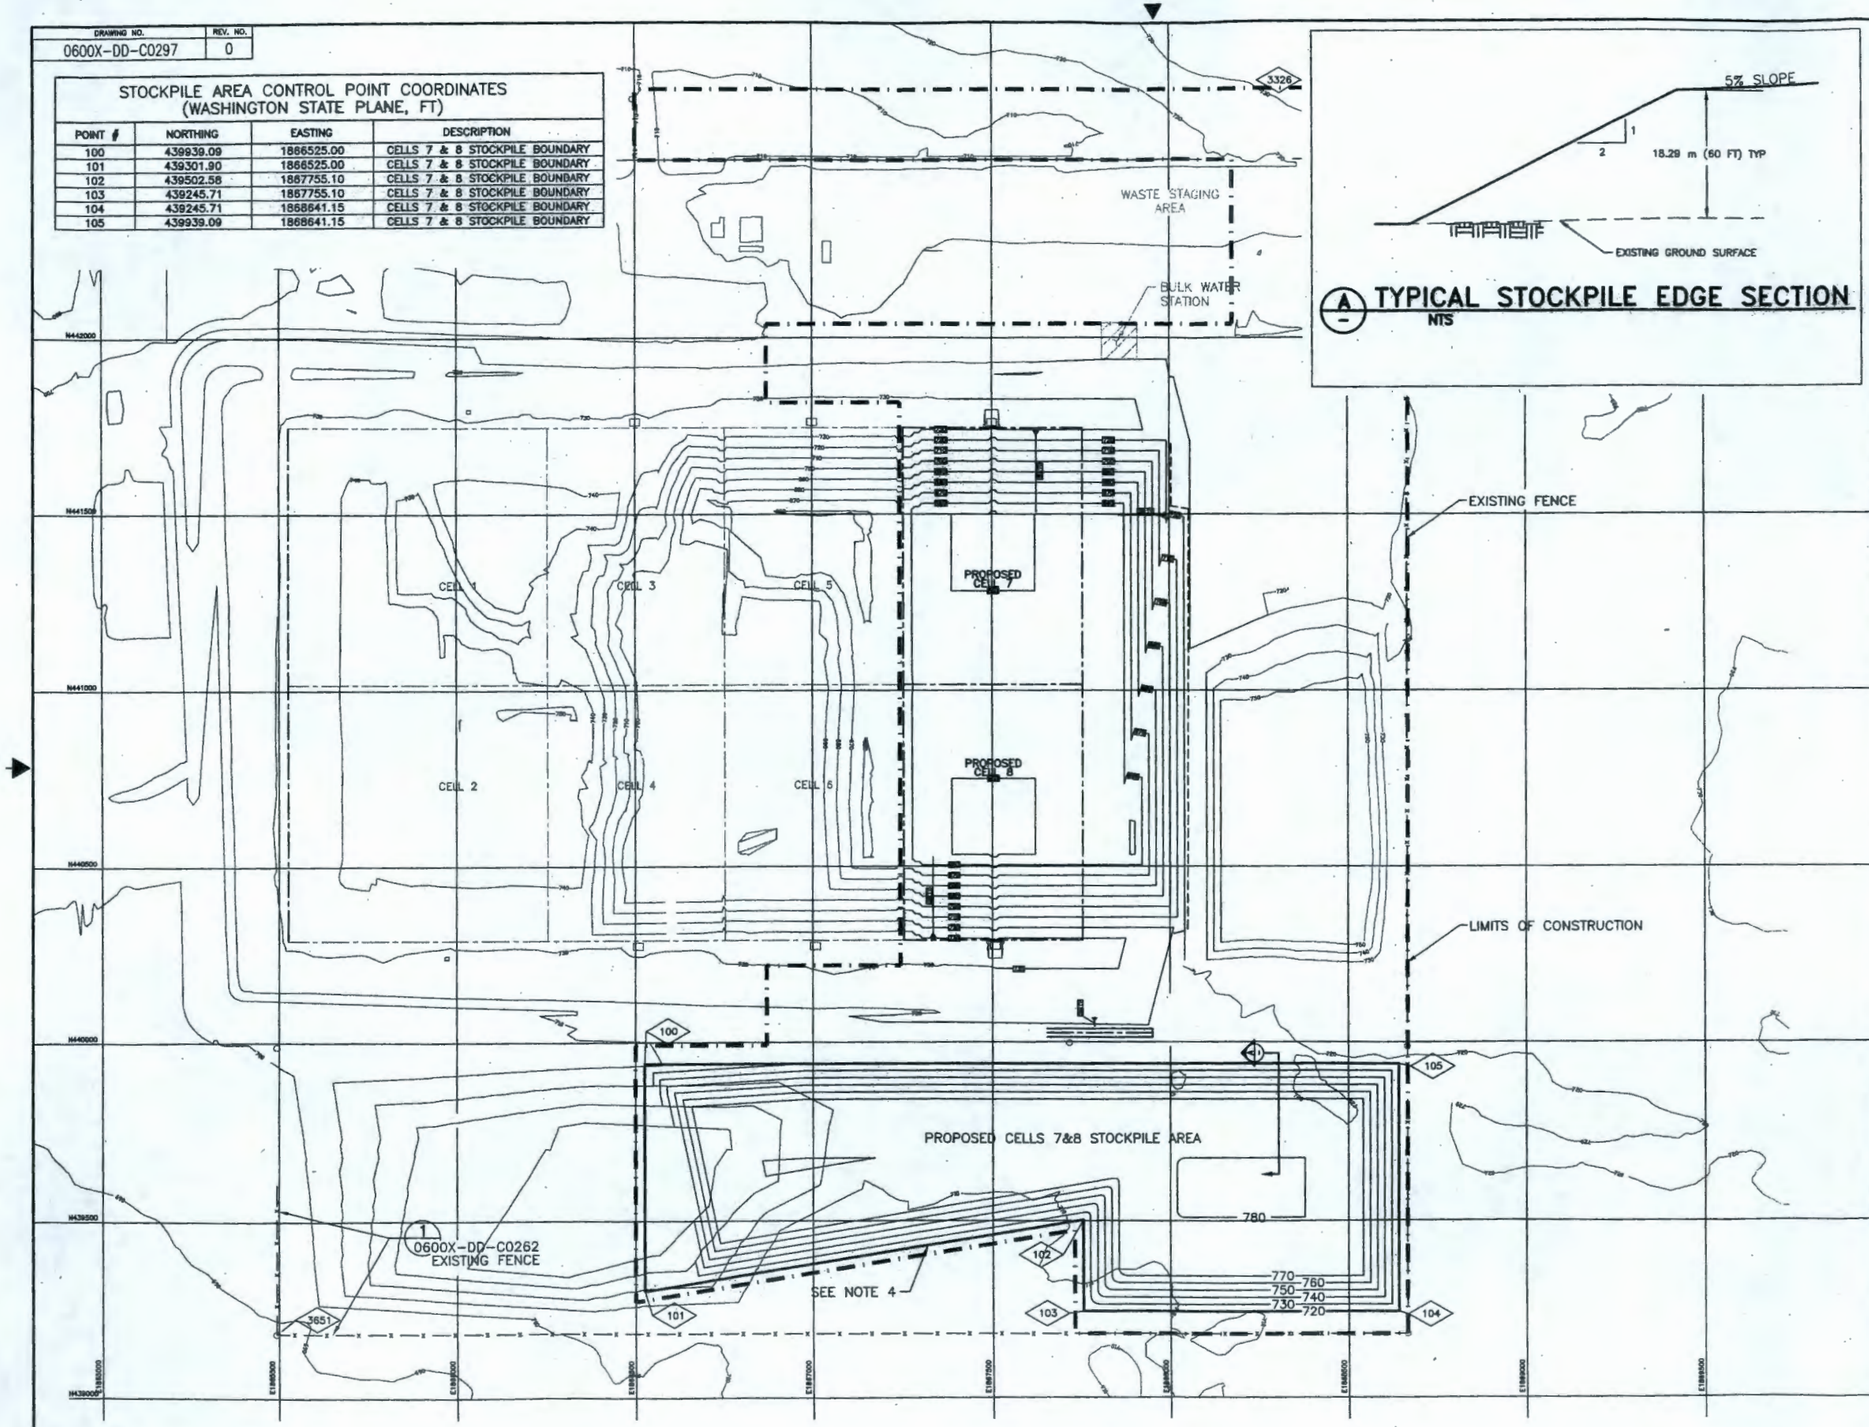

NOTES

1. STORE EXCAVATED MATERIALS IN STOCKPILE AREA.
2. EXISTING CONTOURS FROM FIELD SURVEY PREPARED BY ROGERS SURVEYING, INC., DATED JULY, 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCONTRACTOR SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
3. SURVEY DATUM:
   VERTICAL NAVD 88
   HORIZONTAL NAD 83 (91)
4. MAINTAIN 25' MINIMUM BUFFER AROUND EXISTING FRENCH DRAIN WASTE SITES (SHOWN ON DRAWING 0600X-DD-C0259).

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Resubmittal is not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

SUPPLIER														
WCH														
REVIEWER														

Bill Doblang 10/9/07
DOCUMENT CONTROL — DOCUMENT IS MARKED
0600X-SC-G0594 — SERIAL NO. — 05-19 — SERIE ITEM — 049 — SUBMITTAL
500X534 A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mjc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRYANT — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	CHKD/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JW	CJB	[illegible]	[illegible]	N/A	[illegible]

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
STOCKPILE PLAN - CELLS 7 & 8

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0297.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0297	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15877 SHT01	600G	0110

River Corridor Closure Contractor — WCH — Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0298	0

STOCKPILE AREA CONTROL POINT COORDINATES
(WASHINGTON STATE PLANE, FT)

POINT #	NORTHING	EASTING	DESCRIPTION
104	439245.71	1868641.15	CELLS 7,8,9&10 STOCKPILE BOUNDARY
105	439939.09	1868641.15	CELLS 7,8,9&10 STOCKPILE BOUNDARY
106	439939.09	1869725.00	CELLS 9 & 10 STOCKPILE BOUNDARY
107	439245.71	1869725.00	CELLS 9 & 10 STOCKPILE BOUNDARY

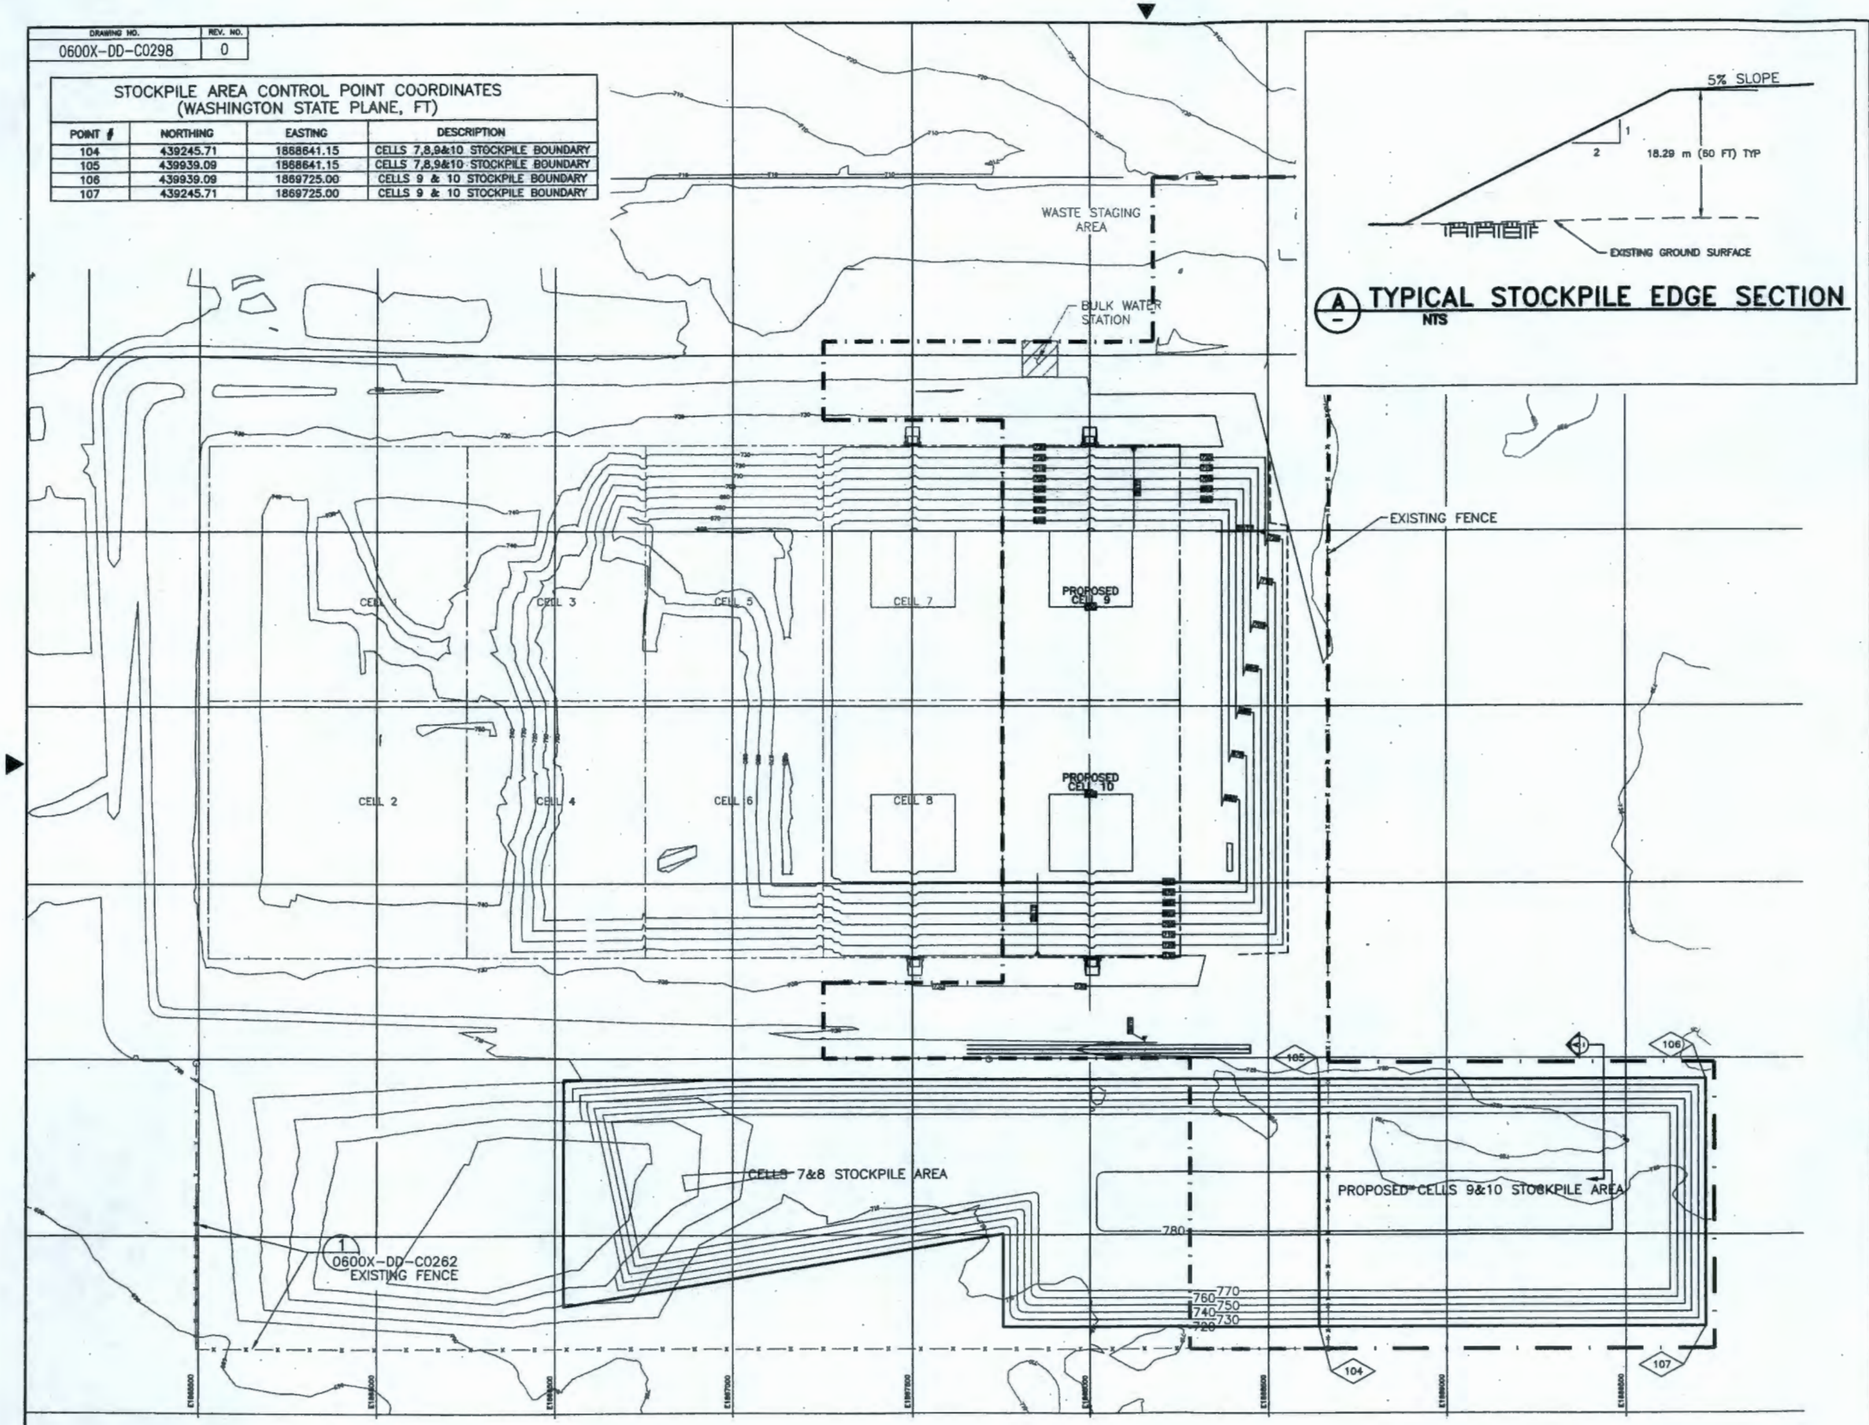

A TYPICAL STOCKPILE EDGE SECTION
NTS

NOTES

1. STORE EXCAVATED MATERIALS IN STOCKPILE AREA.
2. EXISTING CONTOURS FROM FIELD MAPPING PREPARED BY WALKER AND ASSOCIATES, PHOTOGRAMMETRY DATED JULY, 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCONTRACTOR SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
3. SURVEY DATUM:
   VERTICAL NAVD 88
   HORIZONTAL NAD 83 (91)

N

0 100' 200' 400'

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/CONTRACTOR DOCUMENT STATUS STAMP

1 ☒ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3 ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

DISPOSITION							✓										
INITIALS							RB										

Bill Borlaug 10/9/07
DISPOSITION BY — DATE
DOCUMENT NUMBER: 0600X-SC-G0584 05-19 043
SCP.S. No. — SYSTEM — SUBMITTAL
500X5844A00

DOCUMENT CONTROL mke 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGHT — STATE OF WASHINGTON — 9/28/07 — 42158 — REGISTERED PROFESSIONAL ENGINEER

EXPIRES: 5/28/08

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

REV.	DATE	DESCRIPTION	DRAWN BY	TRNFT CHK	DSN/ ENG'R	ENGR CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJV	CSB	[illegible]	BJH	N/A	DB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC.
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
STOCKPILE PLAN - CELLS 9 & 10

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0298.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0298	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15878 SHT01	600G	0110

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0299	0

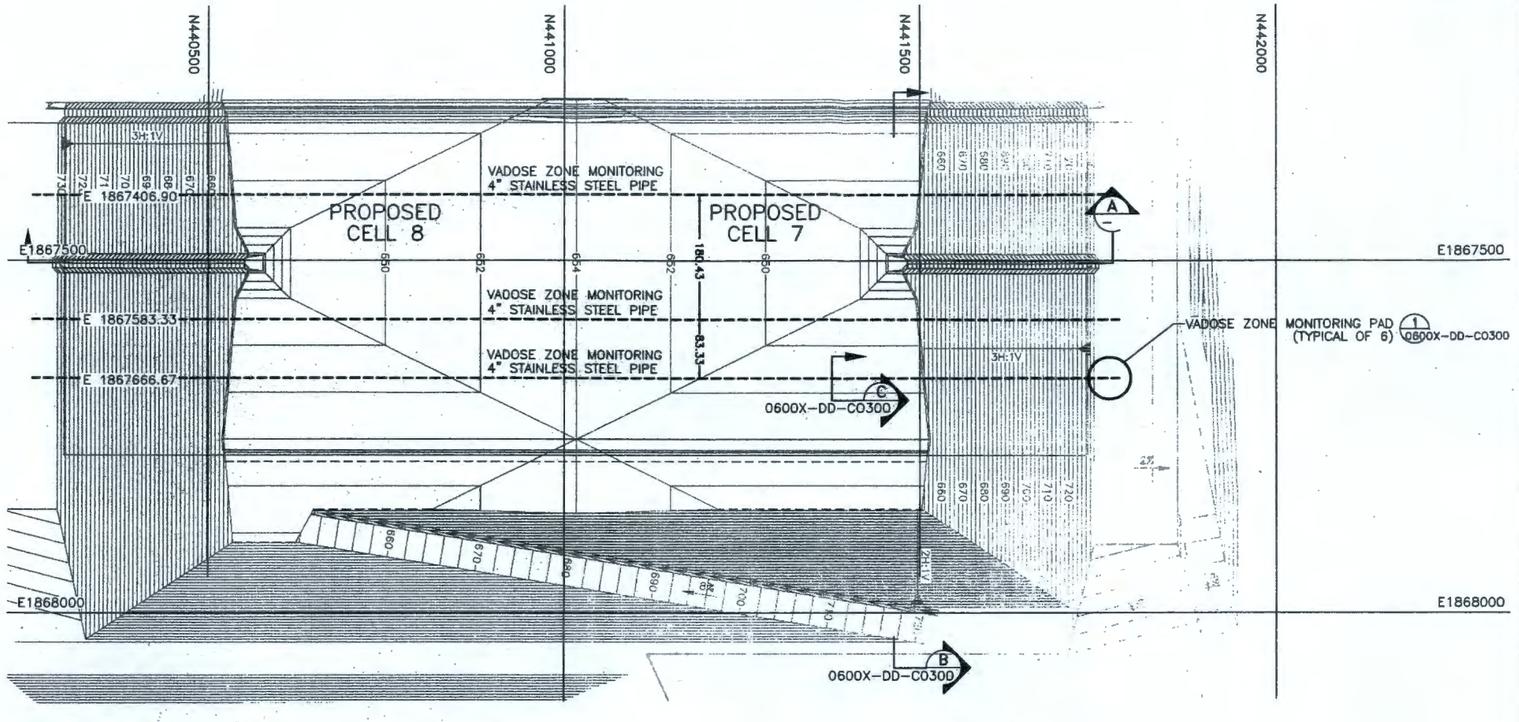

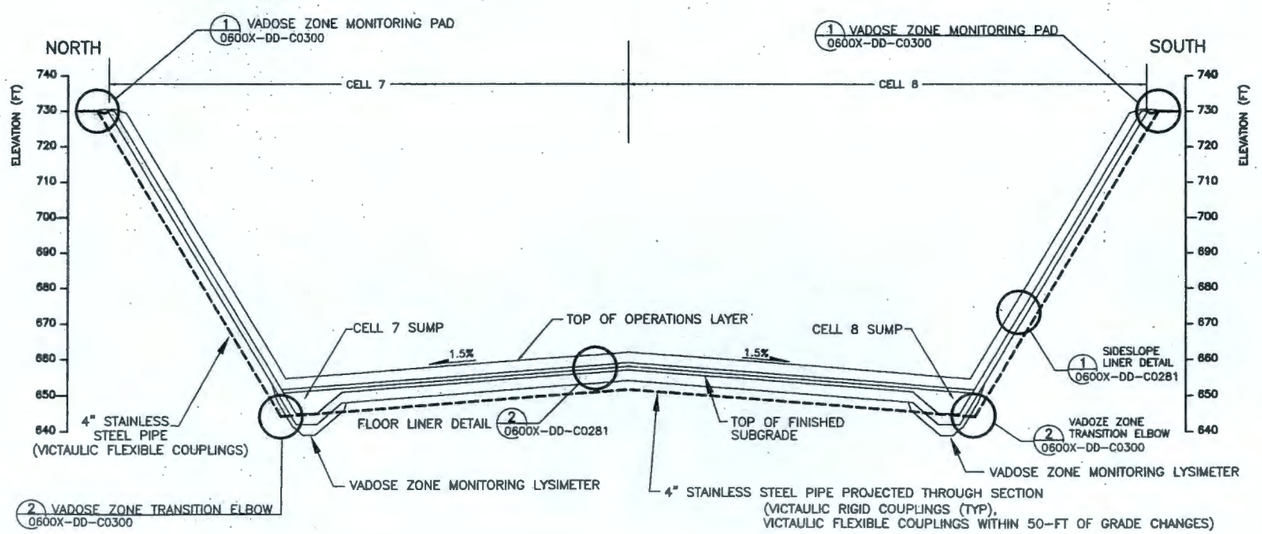

A N-S SECTION

NOTES

1. GRADING TOLERANCES SHOWN ON DWG. NO. 0600-DD-C0281.
2. EXISTING CONTOURS FROM FIELD SURVEY PREPARED BY ROGERS SURVEYING INC. DATED JULY, 2006. TOPOGRAPHY DOES NOT REFLECT CHANGES FROM OPERATIONS SINCE JULY 2006. SUBCONTRACTOR SHALL CONSTRUCT FACILITIES TO THE FINISHED ELEVATIONS SHOWN.
3. SURVEY DATUM:
   VERTICAL NAVD: 88
   HORIZONTAL NAD: 83 (91)
4. MINIMIZE NUMBER OF VICTAULIC COUPLINGS ON VADOSE ZONE MONITORING PIPE.

N

0 50' 100' 200'

DOCUMENT CONTROL mlc 10/11/07

Best Available Copy

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BREST, STATE OF WASHINGTON, 42158, REGISTERED PROFESSIONAL ENGINEER, 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JV	CJB	[illegible]	DJH	N/A	[illegible]

SCALE: AS SHOWN

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Boelang — 10/9/07
500X524A00

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15879 SHT 01	600G	0110

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
VADOSE ZONE MONITORING SYSTEM

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0299.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0299	0

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0300	0

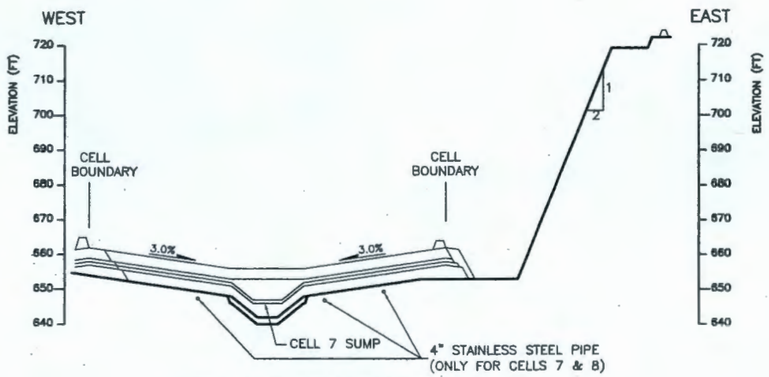

B W-E SECTION
0060X-DD-C0299 SCALE 1"=100'(H) 1"=20'(V)

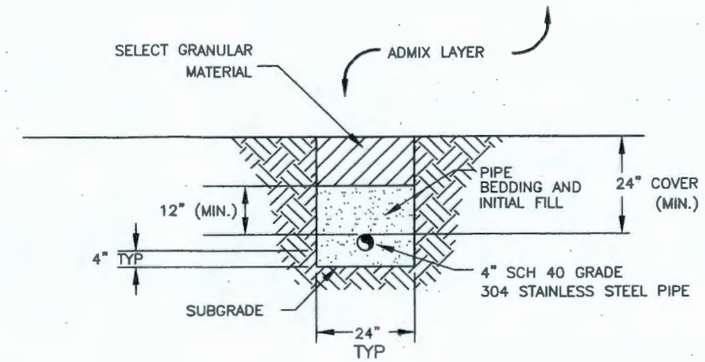

C TYPICAL TRENCH SECTION
0060X-DD-C0299 NTS

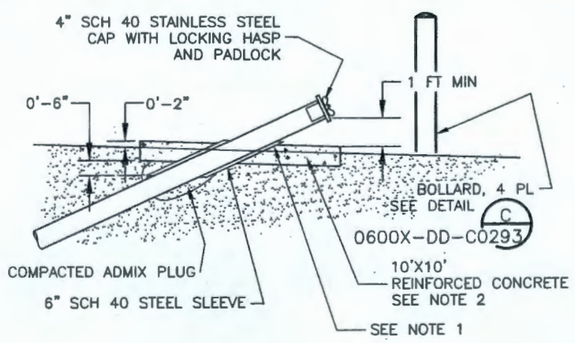

1 VADOSE ZONE MONITORING PAD
0060X-DD-C0299 NTS

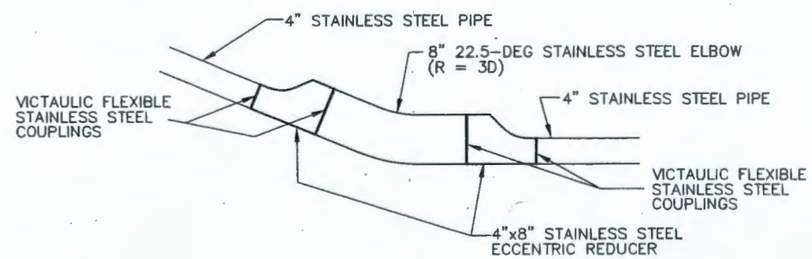

2 VADOSE ZONE TRANSITION ELBOW DETAIL
0060X-DD-C0299 NTS

NOTES

1. FILL ANNULAR SPACE BETWEEN PIPE AND SLEEVE WITH FLEXIBLE SILICONE SEALANT.
2. 5-FOOT X 5-FOOT-6" THK REINFORCED CONCRETE SLAB ON GRADE W/ #5 REINFORCING BARS AT 12" OC EW. CENTER REINFORCING IN SLAB.
3. MINIMIZE NUMBER OF VICTAULIC COUPLINGS ON VADOSE ZONE MONITORING PIPE.

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Eric Borlaug 10/9/07
0600X-SC-C0520 05-19 045
500X 624 A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGGS — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/24/07	ISSUED FOR CONSTRUCTION	JW	CTB	[illegible]	[illegible]	N/A	[illegible]

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC.
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
VADOSE ZONE MONITORING SYSTEM DETAILS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0300.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0300	0

RIVER CORRIDOR CLOSURE CONTRACT
Dedicated To Safety Excellence

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15880 SHT01	600G	0110

DRAWING NO.	REV. NO.
0600X-DD-C0301	0

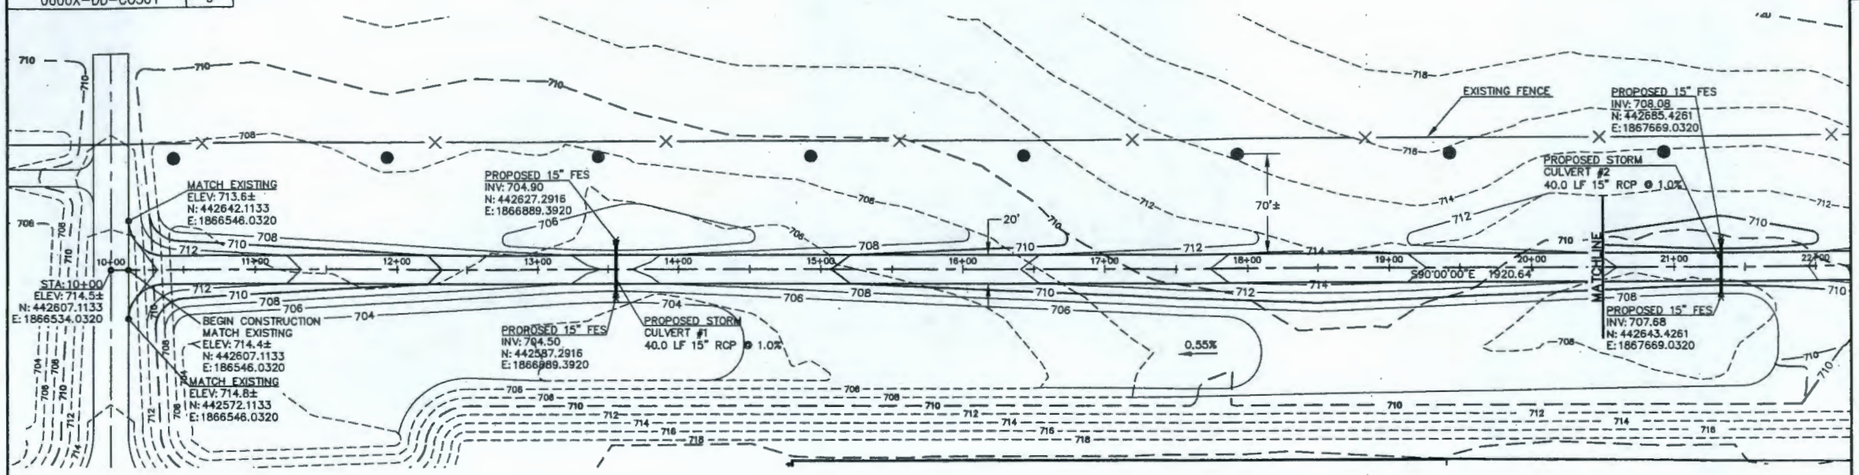

ACCESS ROAD

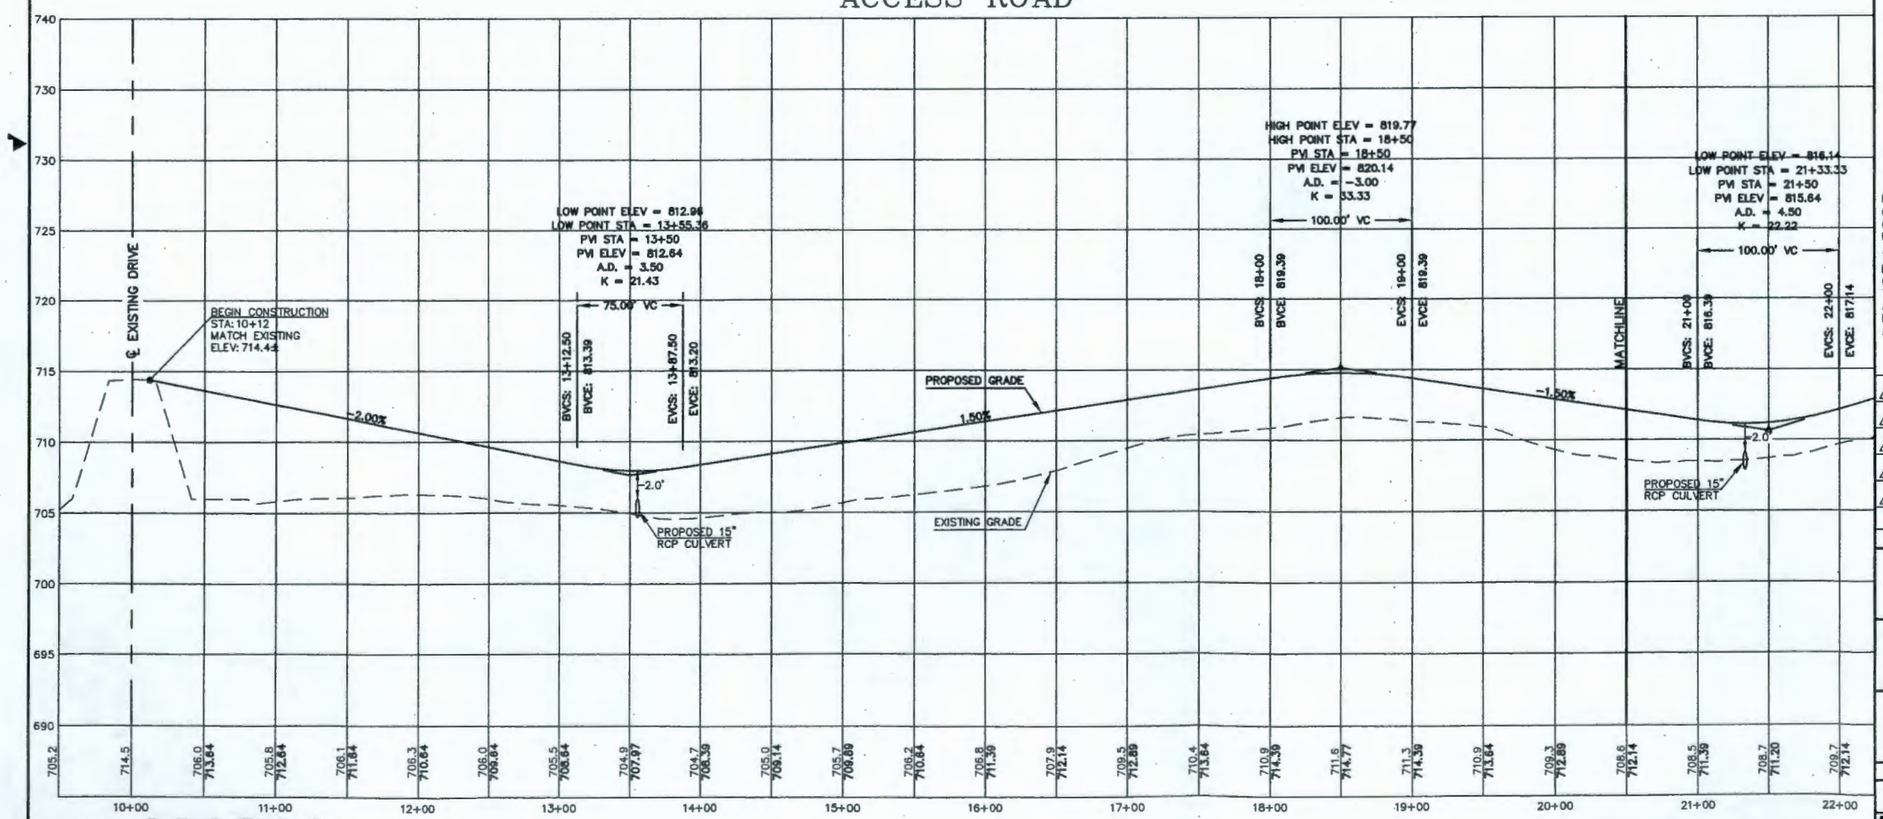

Dedicated To Safety Excellence

RECORD INFORMATION		
RECORD NO.	BLDG NO.	INDEX NO.
H-6-15881 SHT01	600G	0109

NOTES

EARTHWORK SUMMARY
CUT: 5,430 CU.YDS.
FILL: 8,180 CU. YDS.
NET: 2,750 CU. YDS. FILL

N
0' 25' 50' 100'

DOCUMENT CONTROL 10/11/07

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1 ☒ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3 ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the control.
Bill Borlaug 10/9/07
Review Signature
DOCUMENT ID NUMBER
0600X-SC-G0524 05-19 046
SUPP. No. SUBS. ITEM SUBMITTAL
500X524RAD

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIENT
STATE OF WASHINGTON
42158
REGISTERED
PROFESSIONAL ENGINEER
9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	CP	CJB	EWB	N/A	SPB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
ACCESS ROAD PLAN AND PROFILE

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0301.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0301	0

DRAWING NO.	REV. NO.
0600X-DD-C0302	0

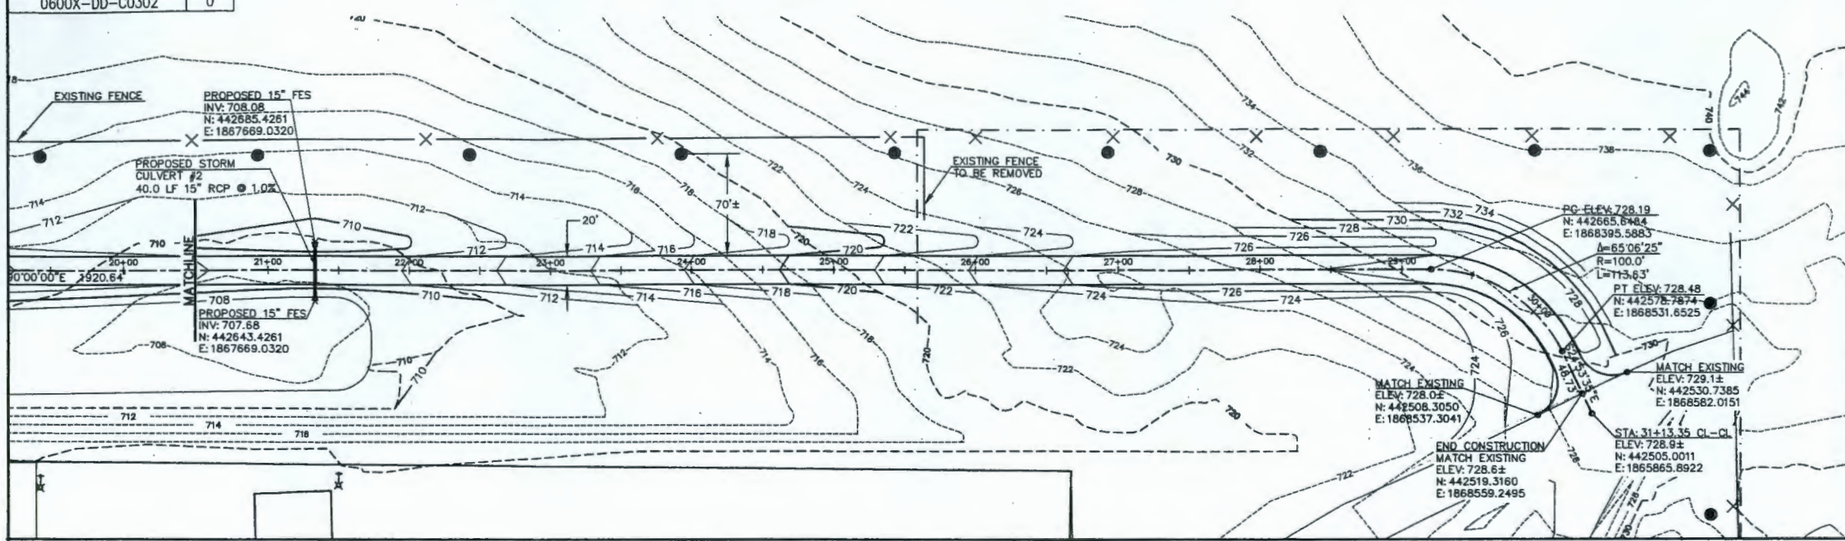

ACCESS ROAD

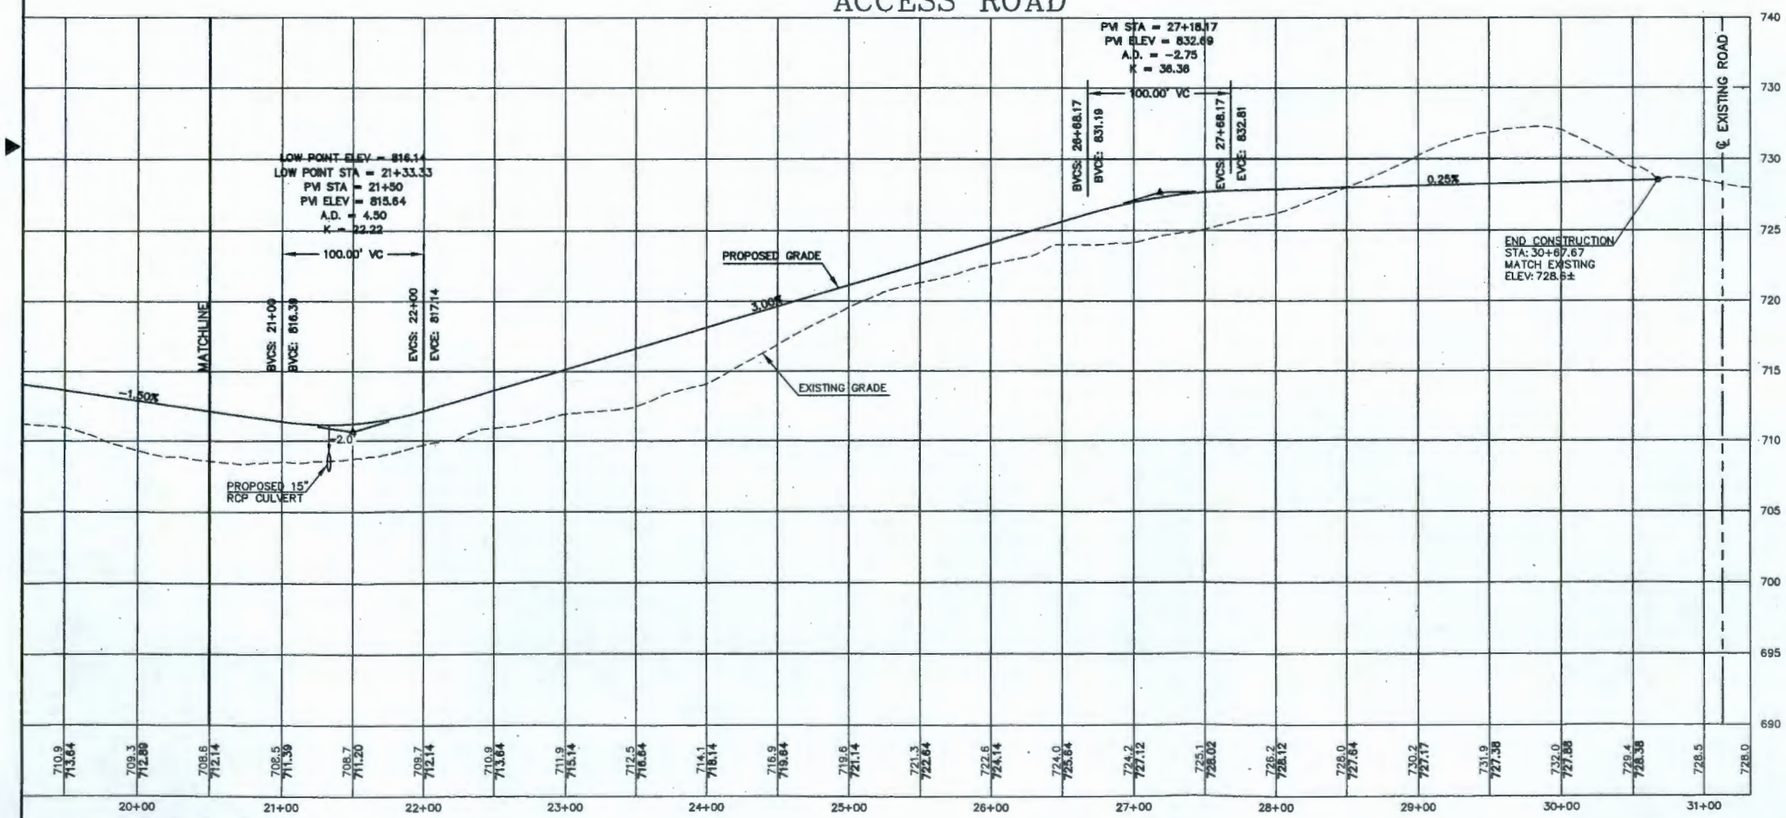

River Corridor Closure Contract
Dedicated To Safety Excellence

RECORD INFORMATION

RECORD NO.	BLDG. NO.	INDEX NO.
H-6-15882 SHT01	600G	0109

NOTES

EARTHWORK SUMMARY
CUT: 5,430 CU.YDS.
FILL: 8,180 CU. YDS.
NET: 2,750 CU. YDS. FILL

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1 ☒ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmission.
3 ☐ Revise and resubmit. Work may proceed prior to resolution subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Provisions to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Boehling 10/9/07
0600X-SC-G059 05-19 047
SCOPE No. — DOCUMENT ELEMENTS NUMBER — SUBMITTAL
S00X524 A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mjc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BERGET — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS. ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	CP	GJB	EN		N/A	BB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
ACCESS ROAD PLAN AND PROFILE

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0302.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0302	0

PIPE ARCH DIMENSION (INCHES)		THICKNESS (INCHES)		DIMENSIONS (INCHES)						SKIRT	END SECTION SLOPE (H:V)
				A	B	H	L	W	T		
				TOL. ± 1"	MAX.	TOL. ± 1"	TOL. ± 1 1/2"	TOL. ± 2"	TOL. ± 2"		
SPAN	RISE	STEEL	ALUM.								
17	13	0.064	0.060	7	9	6	19	30	40	1 PC.	2 1/2 : 1
21	15	0.064	0.060	7	10	6	23	36	46	1 PC.	2 1/2 : 1
24	18	0.064	0.060	8	12	6	28	42	52	1 PC.	2 1/2 : 1
28	20	0.064	0.075	9	14	6	32	48	58	1 PC.	2 1/2 : 1
35	24	0.079	0.075	10	16	6	39	60	70	1 PC.	2 1/2 : 1
42	29	0.079	0.105	12	18	8	46	75	85	2 PC.	2 1/2 : 1
49	33	0.109	0.105	13	21	9	53	85	103	2 PC.	2 1/2 : 1
57	38	0.109 0.138	0.105	18	26	12	63	90	114	3 PC.	2 1/2 : 1
64	43	0.109 0.138	0.105	18	30	12	70	102	130	3 PC.	2 1/2 : 1
71	47	0.109 0.138	0.135	18	33	12	77	114	146	3 PC.	2 1/2 : 1
77	52	0.109 0.138	------	18	36	12	77	128	152	3 PC.	1 3/4 : 1
83	57	0.109 0.138	------	18	39	12	77	138	158	3 PC.	1 1/2 : 1

PIPE DIAM. (INCHES)	THICKNESS (INCHES)		DIMENSIONS (INCHES)						SKIRT	END SECTION SLOPE (H:V)
			A	B	H	L	W	T		
	STEEL	ALUM.	TOL. ± 1"	MAX.	TOL. ± 1"	TOL. ± 1 1/2"	TOL. ± 2"	TOL. ± 2"		
12	0.064	0.060	6	6	6	21	24	34	1 PC.	2 1/2 : 1
15	0.064	0.060	7	8	6	26	30	40	1 PC.	2 1/2 : 1
18	0.064	0.060	8	10	6	31	36	46	1 PC.	2 1/2 : 1
21	0.064	0.060	9	12	6	36	42	52	1 PC.	2 1/2 : 1
24	0.064	0.075	10	13	6	41	48	58	1 PC.	2 1/2 : 1
30	0.079	0.075	12	16	8	51	60	70	2 PC.	2 1/2 : 1
36	0.079	0.105	14	19	9	60	72	94	2 PC.	2 1/2 : 1
42	0.109	0.105	16	22	11	69	84	108	2 PC.	2 1/2 : 1
48	0.109	0.105	18	27	12	78	90	112	2 PC.	2 1/2 : 1
54	0.109	------	18	30	12	84	102	122	2 PC.	2 1/2 : 1
60	0.109 0.138	------	18	33	12	87	114	134	3 PC.	1 3/4 : 1
66	0.109 0.138	------	18	36	12	87	120	142	3 PC.	1 1/2 : 1
72	0.109 0.138	------	18	39	12	87	126	148	3 PC.	1 1/3 : 1
78	0.109 0.138	------	18	42	12	87	132	152	3 PC.	1 1/4 : 1
84	0.109 0.138	------	18	45	12	87	138	158	3 PC.	1 1/8 : 1

1. THE DIAMETER OF THE END SECTION OF DESIGN B SHALL MATCH THE INSIDE DIAMETER OF THE CONCRETE PIPE.
2. SKIRT SECTIONS SHALL BE MADE IN ONE PIECE FOR ROUND PIPE WITH A DIAMETER OF 12" TO 24" INCLUSIVE AND FOR PIPE ARCHES WITH A RISE OF 13" TO 20" INCLUSIVE. SKIRT SECTIONS FOR LARGER SIZES OF PIPES MAY BE MULTIPLE PIECES IN CONFORMANCE WITH THE TABULATED VALUES SHOWN.
3. DESIGN A END SECTIONS FOR 42" THRU 84" DIAMETER AND 49" X 33" THRU 83" X 57" ARCH WITH ANNULAR CORRUGATIONS AND ALL HELICALLY CORRUGATED PIPE ARCH INCLUDE ONE FOOT OF PIPE LENGTH AS A CONNECTOR SECTION. THE CONNECTOR SECTION SHALL BE ATTACHED TO THE END SECTION BY WELDS, RIVETS OR BOLTS AND SHALL BE THE SAME THICKNESS AS THE END SECTION.
4. DESIGN C MAY BE USED IN LIEU OF DESIGN A FOR ALL METAL PIPE SIZES EXCEPT AS NOTED. COUPLING BANDS MAY BE ANY ACCEPTABLE TYPE FOR THE PIPE SPECIFIED.
5. MULTIPLE PANEL SKIRTS SHALL HAVE 2" LAP SEAMS TIGHTLY JOINED BY 3/8" STAINLESS STEEL RIVETS OR GALVANIZED BOLTS ON 6" MAX. CENTERS.
6. THE REINFORCED EDGES OF THE FOLLOWING SIZE END SECTIONS SHALL BE SUPPLEMENTED WITH GALVANIZED STEEL STIFFENER ANGLES:

   60" THRU 72" DIAMETER PIPE .... 2" X 2" X 1/4" ANGLE

   78" AND 84" DIAMETER PIPE, AND
   77" X 52" & 83" X 57" PIPE ARCH .... 2 1/2" X 2 1/2" X 1/4" ANGLE

   THE ABOVE GALVANIZED ANGLES SHALL BE ATTACHED BY 3/8" GALVANIZED NUTS AND BOLTS.
7. GALVANIZED STEEL ANGLE REINFORCEMENT WILL BE PLACED UNDER THE CENTER PANEL SEAMS ON THE 72" THRU 84" DIAM. PIPE AND 77" X 52" & 83" X 57" PIPE ARCH END SECTIONS.
8. AS AN ALTERNATIVE TO THE CONNECTOR LUG AND THREADED ROD USED ON 12" THRU 24" CULVERT PIPE, THE ATTACHMENT MAY BE MADE WITH A 1" WIDE STRAP, 16 GAGE GALVANIZED STEEL FASTENED WITH A 1/2" DIAM., 6" LONG GALVANIZED BOLT AND ONE SQUAREHEAD NUT.

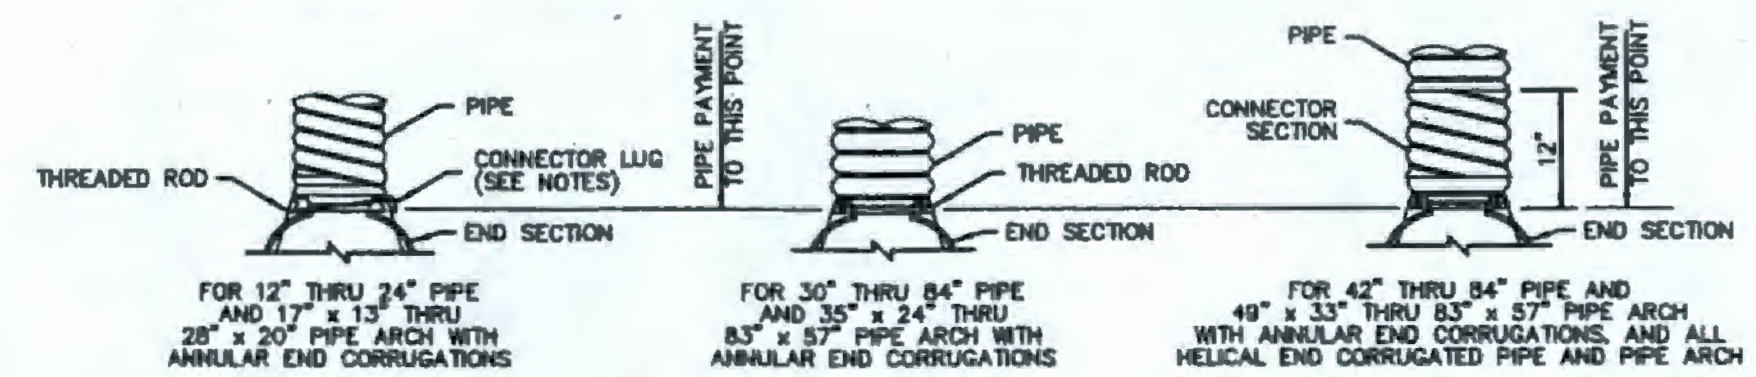

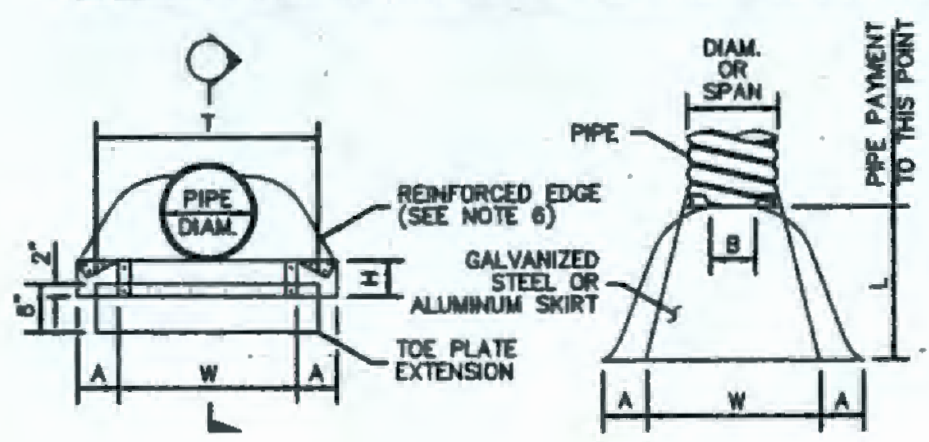

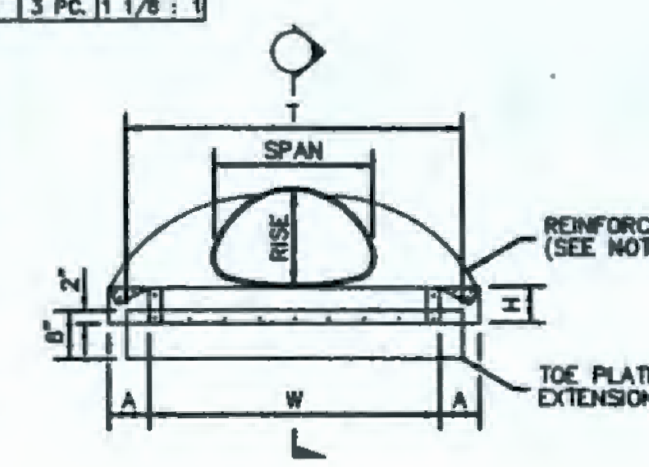

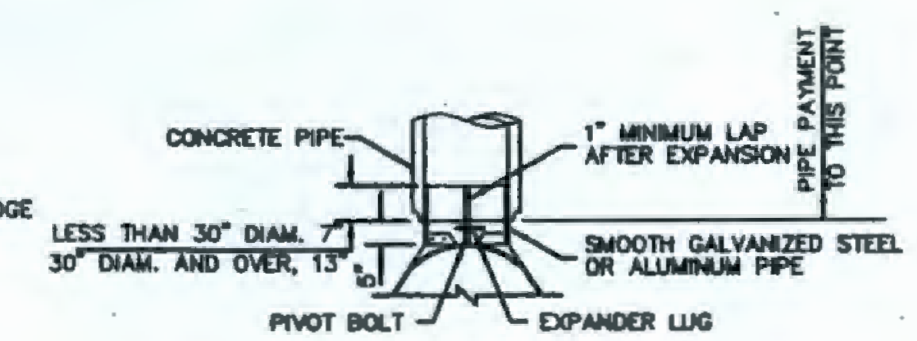

PER WASHINGTON STATE
DEPARTMENT OF TRANSPORTATION
STANDARD PLAN B-70.60-00

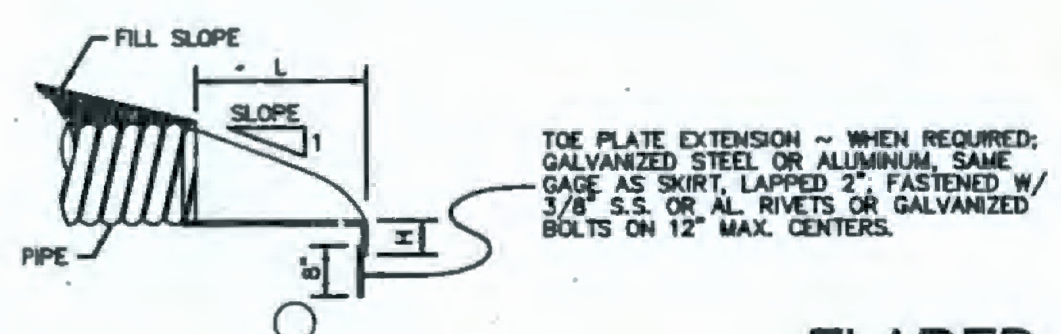

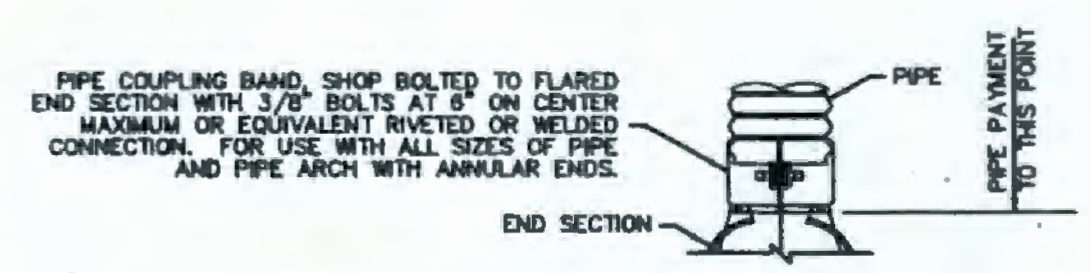

FLARED END SECTION
(1) TYPICAL DETAIL
NTS

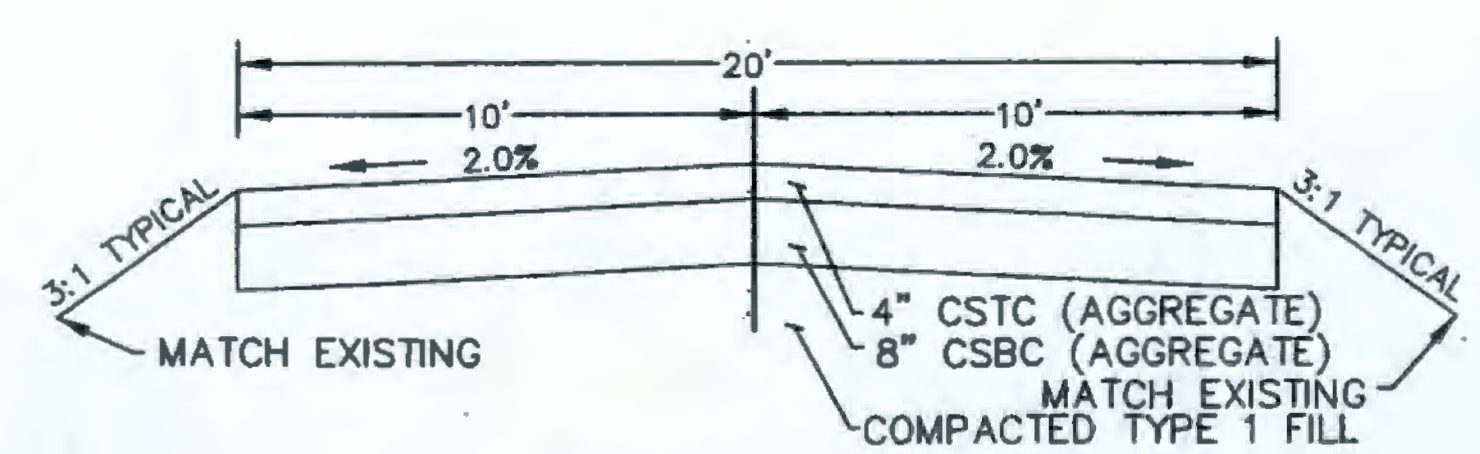

ACCESS ROAD
(3) TYPICAL SECTION
NTS

NOTES

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1.☑ Work may proceed.
2.☐ Revise and resubmit. Work may proceed prior to resubmission.
3.☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4.☐ Revise and resubmit. Work may not proceed.
5.☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Borlaug 10/9/07
0600X-SC-G0524 05-19 048
S00X524A00

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIEST, STATE OF WASHINGTON, 42158 REGISTERED PROFESSIONAL ENGINEER, 9/28/07
EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS. ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	CD	CJB	CW	[illegible]	N/A	JCB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC
DENVER, COLORADO

ENVIRONMENTAL RETORATION DISPOSAL FACILITY
CELLS 7. - 10
ACCESS ROAD DETAILS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0304.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0304	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15884 SHT01	600G	0109

DRAWING NO.	REV. NO.
0600X-DD-C0304	0

River Corridor Closure Contract WCH Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0308	0

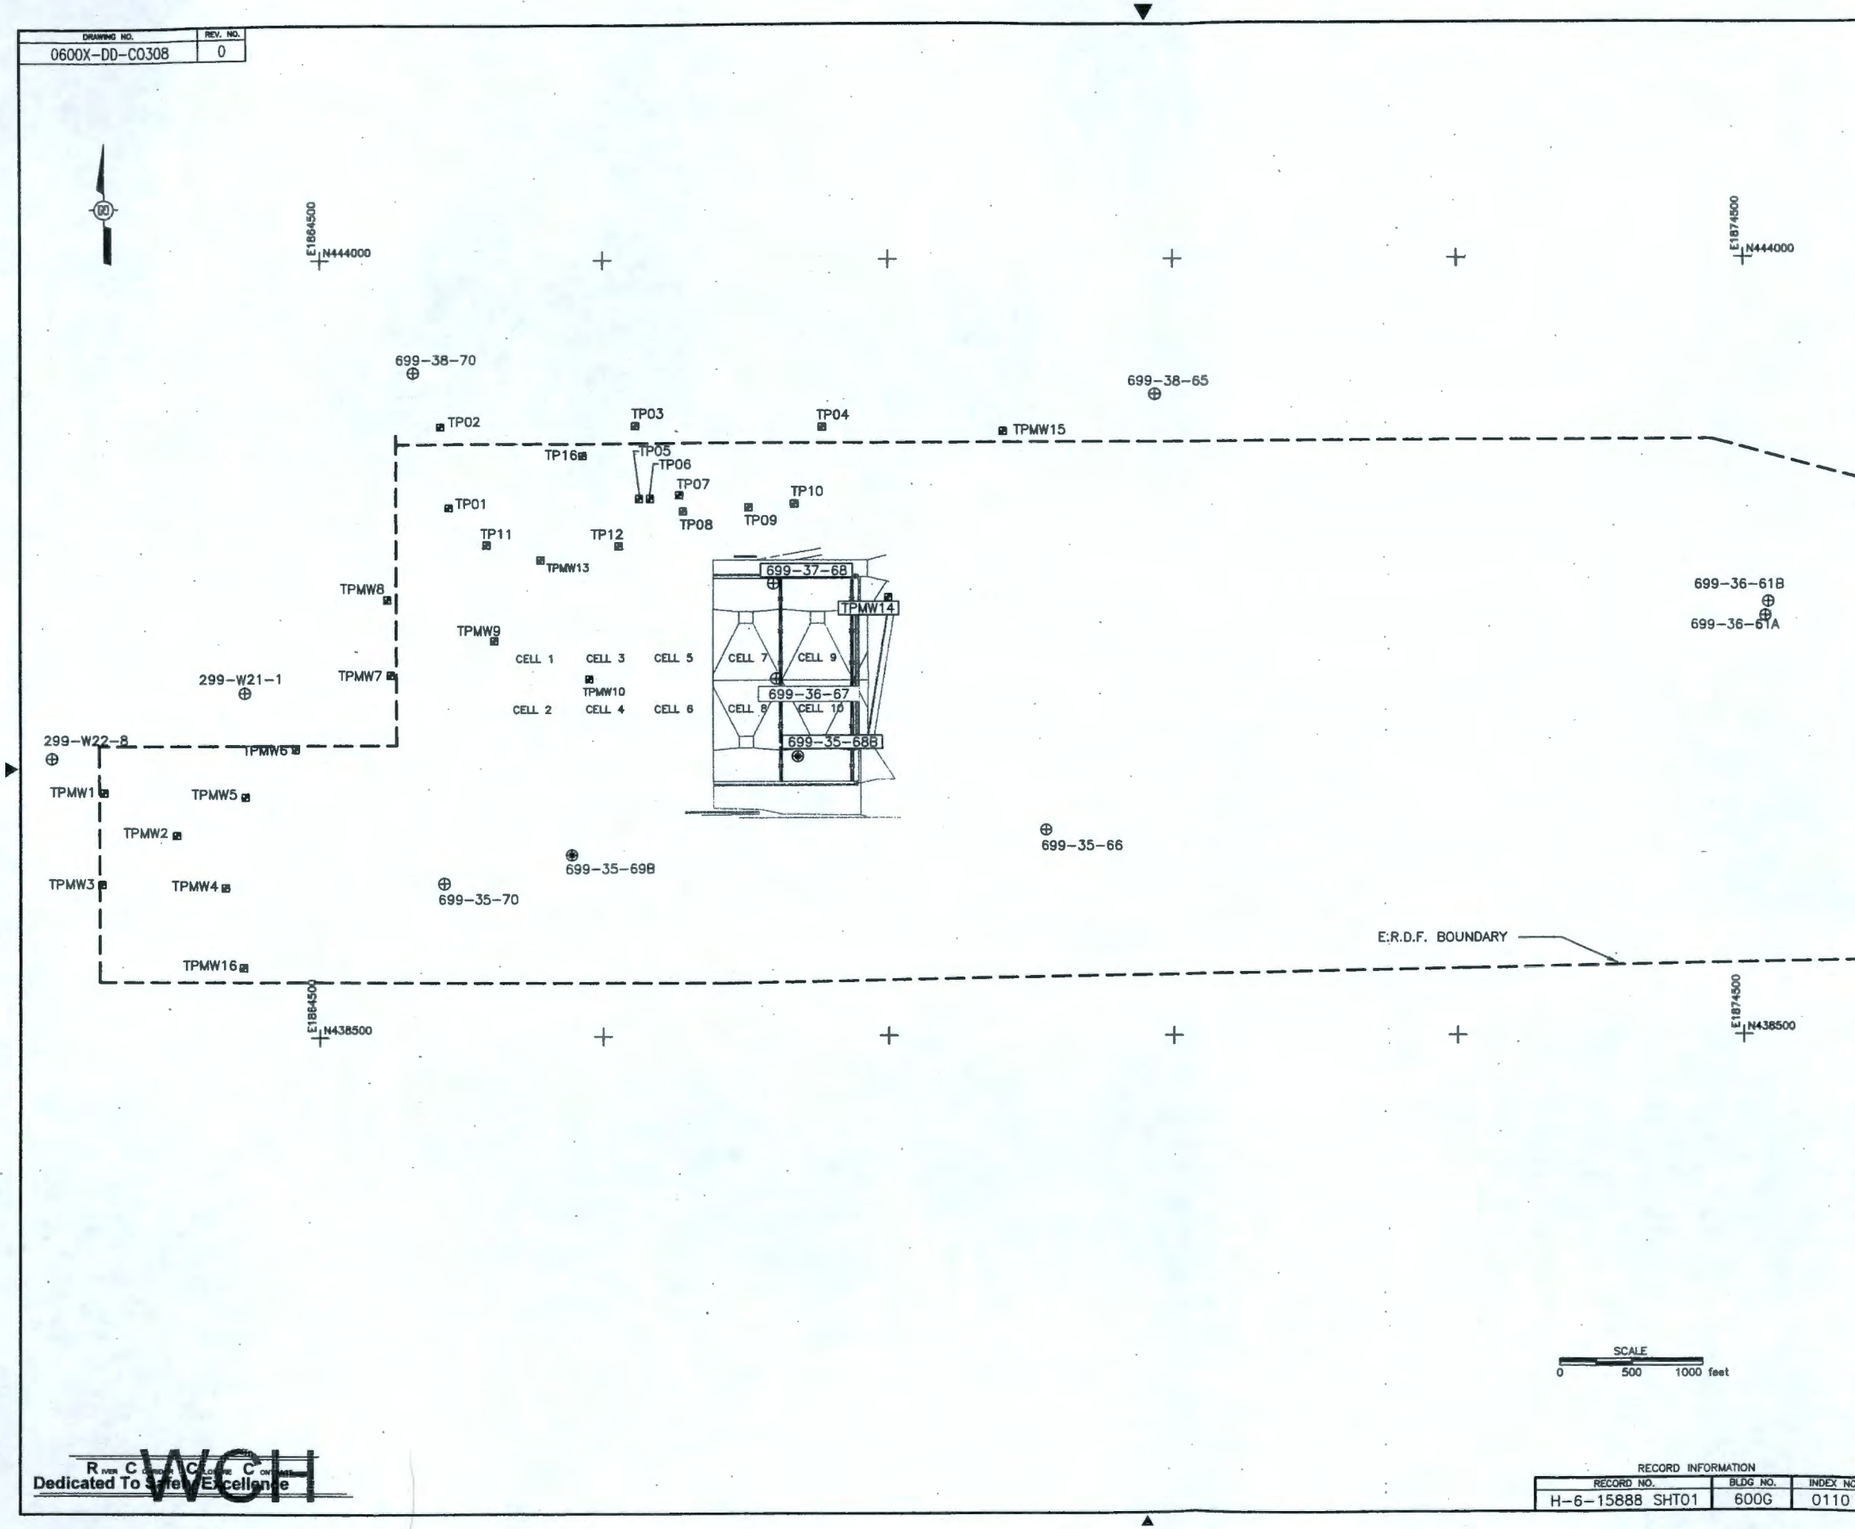

NOTES

LEGEND:

- BORING LOCATION
- TEST PIT LOCATION
- EXISTING WELL LOCATION

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/CONTRACTOR DOCUMENT STATUS STAMP

- [x] Work may proceed.
- [ ] Revise and resubmit. Work may proceed prior to resubmittal.
- [ ] Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
- [ ] Revise and resubmit. Work may not proceed.
- [ ] Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/contractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Discipline	Cognizant Engineer	Cognizant Manager	Quality Assurance	Safety	Safeguards & Security	Independent Review	Project Engineer	Project Manager	Subcontract Administrator	Other	Other	Other	Other
Signature/Date						✓							

Bill Bellamy — 10/9/07
Name/Signature — Date
0600X-SC-G0534 — 08-19 — 049
SGW-5214 A00
BCPO No. — SUBS ITEM — SUBMITTAL

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mle 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL FRIEST — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS. ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JW	CJB	[illegible]	BAB	WA	JOB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
TEST PITS AND BORING LOCATIONS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0308.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0308	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15888 SHT01	600G	0110

River Corridor Closure Contract — WCH — Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0309	0

BOREHOLE LOG

PROJECT: ERDF
BORING NO. 299-W22-9
SHEET 1 OF 2
BORING LOCATION NORTH 35408.00 EAST -72710.00
GROUND ELEVATION: 682.00 FEET
BORING DATE:
DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: ROW/RICHARDS
LOGGED:
CHECKED:
DATE:

DEPTH (FT)	DESCRIPTION
	SANDY SILT
	SILTY SAND

BOREHOLE LOG

PROJECT: ERDF
BORING NO. 299-W21-1
SHEET 1 OF 2
BORING LOCATION NORTH 35888.00 EAST -71382.00
GROUND ELEVATION: 697.90 FEET
BORING DATE:
DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: HATCH/RICHARDS
LOGGED:
CHECKED:
DATE:

DEPTH (FT)	DESCRIPTION
	SILTY SAND
	GRAVELLY SAND
	SAND
	SILTY SAND
	GRAVELLY SILTY SAND

BOREHOLE LOG

PROJECT: ERDF
BORING NO. 699-35-79
SHEET 1 OF 2
BORING LOCATION NORTH 38142.00 EAST -70228.00
GROUND ELEVATION: 708.87 FEET
BORING DATE:
DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: SWAIN
LOGGED:
CHECKED:
DATE:

DEPTH (FT)	DESCRIPTION
	SAND (EOLIAN SAND?)
	GRAVEL
	GRAVELLY SILTY SAND
	SILTY SAND
	SANDY SILT
	SILTY SAND: SAND-SILT
	SANDY SILT
	GRAVELLY SILTY SAND
	SILTY SAND
	GRAVELLY SAND
	SAND

BOREHOLE LOG

PROJECT: ERDF
BORING NO. 299-W22-9
SHEET 2 OF 2
BORING LOCATION NORTH 35408.00 EAST -72710.00
GROUND ELEVATION: 682.00
BORING DATE:
DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: ROW/RICHARDS
LOGGED:
CHECKED:
DATE:

DEPTH (FT)	DESCRIPTION
	SILTY SAND
140	BOREHOLE CONTINUES TO 286 FEET. PLEASE REFER TO WHC-SD-EN-AP-128, Rev. 1 FOR COMPLETE LOG.
	SANDY SILT

BOREHOLE LOG

PROJECT: ERDF
BORING NO. 299-W21-1
SHEET 2 OF 2
BORING LOCATION NORTH 35888.00 EAST -71382.00
GROUND ELEVATION: 697.90
BORING DATE:
DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: HATCH/RICHARDS
LOGGED:
CHECKED:
DATE:

DEPTH (FT)	DESCRIPTION
	SILTY SAND
	SILTY SAND
145	BOREHOLE CONTINUES TO 352 FEET. PLEASE REFER TO WHC-SD-EN-AP-128, Rev. 1 FOR COMPLETE LOG.

BOREHOLE LOG

PROJECT: ERDF
BORING NO. 699-35-79
SHEET 2 OF 2
BORING LOCATION NORTH 38142.00 EAST -70228.00
GROUND ELEVATION: 708.87
BORING DATE:
DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: SWAIN
LOGGED:
CHECKED:
DATE:

DEPTH (FT)	DESCRIPTION
	SILTY SAND
145	BOREHOLE CONTINUES TO 413 FEET. PLEASE REFER TO WHC-SD-EN-AP-128, Rev. 1 FOR COMPLETE LOG.

RIVER CORRIDOR CLOSURE CONTRACT
Dedicated To Safety Excellence

NOTES

1. BORINGS 699-35-69B AND 669-35-68B TRANSCRIBED FROM BORING LOGS SUPPLIED BY WHC GEOTECHNICAL DEPARTMENT. REMAINDER OF BORING LOGS TRANSCRIBED FROM WHC-SD-AP-128 REV.1. "SITE CHARACTERIZATION PLAN FOR THE ENVIRONMENTAL RESTORATION DISPOSAL FACILITY".
2. FOR LOCATIONS OF SOIL BORINGS, SOIL TEST PITS, AND EXISTING WELLS, SEE DRAWING NO. 0600X-DD-C0308.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Berlanga 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G0528 05-19 050
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGHT — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07
EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS. ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JW	CJB	Sm	JB	NA	PB

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. — RICHLAND, WASHINGTON
WEAVER BOOS CONSULTANTS, LLC — DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SOIL BORING LOGS-1

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0309.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0309	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15889 SHT01	600G	0501

DRAWING NO.	REV. NO.
0600X-DD-C0310	0

BOREHOLE LOG

PROJECT: ERDF
BORING NO. 699-35-79
SHEET 1 OF 3
BORING LOCATION NORTH 34523.00 EAST -89988.00
GROUND ELEVATION: 692.10 FEET
BORING DATE:
DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: GOEBLE/ROW
LOGGED:
CHECKED:
DATE:

DEPTH (FT)	DESCRIPTION	NUMBER	TYPE	BLOWS	N	RECOVERY	WATER CONTENT, PERCENT	WATER LEVEL
	TOPSOIL – (EOLIAN SAND?)							
5	SAND							
10								
15								
20								
25	GRAVELLY SAND							
30								
35	SILTY SAND							
40								
45								
50								
55	SAND							
60								
65	SILTY SAND							
70								

BOREHOLE LOG

PROJECT: ERDF
BORING NO. 699-35-79
SHEET 2 OF 3
BORING LOCATION NORTH 34523.00 EAST -89988.00
GROUND ELEVATION: 692.10
BORING DATE:
DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: GOEBLE/ROW
LOGGED:
CHECKED:
DATE:

DEPTH (FT)	DESCRIPTION	NUMBER	TYPE	BLOWS	N	RECOVERY	WATER CONTENT, PERCENT	WATER LEVEL
80	SILTY SAND							
85								
90								
95								
100								
105								
110								
115								
120								
125								
130								
135								
140								
145	BOREHOLE CONTINUES TO 326 FEET. PLEASE REFER TO WHC-SD-EN-AP-128, Rev. 1 FOR COMPLETE LOG							

BOREHOLE LOG

PROJECT: ERDF
BORING NO. 699-35-69
SHEET 1 OF 3
BORING LOCATION NORTH 34860.00 EAST -65758.00
GROUND ELEVATION: 723.47 FEET
BORING DATE:
DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: HATCH
LOGGED:
CHECKED:
DATE:

DEPTH (FT)	DESCRIPTION	NUMBER	TYPE	BLOWS	N	RECOVERY	WATER CONTENT, PERCENT	WATER LEVEL
	SAND – (EOLIAN SAND?)							
5								
10	GRAVELLY SAND							
15								
20	GRAVEL							
25								
30	SANDY GRAVEL							
35	SILTY SAND							
40								
45								
50								
55								
60								
65								
70								

BOREHOLE LOG

PROJECT: ERDF
BORING NO. 699-35-69
SHEET 2 OF 3
BORING LOCATION NORTH 34860.00 EAST -65758.00
GROUND ELEVATION: 723.47
BORING DATE:
DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: HATCH
LOGGED:
CHECKED:
DATE:

DEPTH (FT)	DESCRIPTION	NUMBER	TYPE	BLOWS	N	RECOVERY	WATER CONTENT, PERCENT	WATER LEVEL
	SILTY SAND							
80								
85								
90								
95								
100								
105								
110								
115								
120								
125								
130								
135								
140								
145	BOREHOLE CONTINUES TO 452 FEET. PLEASE REFER TO WHC-SD-EN-AP-128, Rev. 1 FOR COMPLETE LOG							

BOREHOLE LOG

PROJECT: ERDF
BORING NO. 699-35-68B
SHEET 1 OF 1
BORING LOCATION NORTH 35399 EAST -87486
GROUND ELEVATION: 713.9 FEET
BORING DATE: 4/26/94
DRILLING METHOD AND EQUIPMENT: HOLLOW STEM AUGER, B-57 DRILL
LOGGED: E.A. JOHNSON
DRILLING CONTRACTOR:
CHECKED: EDWARD C. RAFUSE
DRILLER: D. ROSSMAN
DATE: 4/27/94

DEPTH (FT)	DESCRIPTION	NUMBER	TYPE	BLOWS (140 Pound Hammer 30 In. Drop)	N	RECOVERY	WATER CONTENT, PERCENT	WATER LEVEL
5	Yellowish Brown, Slightly Moist, Fine to Medium SAND with Some Coarse Sand							
10	Compact, Dark Olive Gray, Moist, Medium to Coarse SAND, Trace Silt		SS SS	22/6" 22/12"	34			33 43
20	Dense to Very Dense, Light Yellowish Brown, Fine to Medium SAND		SS SS	25/12" 25/12"	50/4"			55
30	Very Dense, Light Brownish Gray, Dry, Medium to Coarse SAND		SS SS	37/12" 37/12"	50/4"			57 88
40	Very Dense, Pale Brown, Dry, Fine to Medium SAND, Trace Silt		SS	51/10"	50/4"			109
50	Very Dense, Pale Yellow, Medium to Coarse SAND		SS SS SS SS	26/6" 28/6" 28/6" 70/6"	50/4"			56 125
55	BOTTOM OF BOREHOLE AT 52.4 FEET							

BOREHOLE LOG

PROJECT: ERDF
BORING NO. 699-35-68B
SHEET 1 OF 1
BORING LOCATION NORTH 34717 WEST -89980
GROUND ELEVATION: 701.45 FEET
BORING DATE: 4/22/94
DRILLING METHOD AND EQUIPMENT: HOLLOW STEM AUGER, B-57 DRILL
LOGGED: MONTY MEHLHORN
DRILLING CONTRACTOR:
CHECKED: EDWARD E. RAFUSE
DRILLER: D. ROSSMAN
DATE: 4/25/94

DEPTH (FT)	DESCRIPTION	NUMBER	TYPE	BLOWS (140 Pound Hammer 30 In. Drop)	N	RECOVERY	WATER CONTENT, PERCENT	WATER LEVEL
5	Yellowish Brown, Dry, Fine to Medium SAND, with Some Coarse Sand							
10	Compact to Very Dense, (COLDR), Dry, Medium to Coarse SAND, Little Gravel			28/10" 28/2"	50/4"		18	130
20	Dense to Very Dense, (COLDR) Dry Fine to Medium SAND			27/12" 41/12"	50/4"		18	81
30				31/12" 50/12"	75/4"			81 90
40				49/12" 78/12" 50/6" 100/6"	50 50/4"		18 18	126 140
50	Pebble Layer			26/6" 31/6" 44/6" 36/6" 33/6" 36/6" 34/6" 128/6" 50/2" 34/6" 44/6" 75/6" 125/6"	50 50/4" 50/4" 50/4"			67 110 81 310 480 78 291
60	BOTTOM OF BOREHOLE AT 57.8 FEET							
65								
70								

NOTES

1. BORINGS 699-35-69B AND 669-35-68B TRANSCRIBED FROM BORING LOGS SUPPLIED BY WHC GEOTECHNICAL DEPARTMENT. REMAINDER OF BORING LOGS TRANSCRIBED FROM WHC-SD-AP-128 REV.1. "SITE CHARACTERIZATION PLAN FOR THE ENVIRONMENTAL RESTORATION DISPOSAL FACILITY".
2. FOR LOCATIONS OF SOIL BORINGS, SOIL TEST PITS, AND EXISTING WELLS, SEE DRAWING NO. 0600X-DD-C0308.

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☑ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Berlauz 10/9/07
DOCUMENT CLEARANCE
06001-SC-G0524 05-19 051
SCOPE NO. SERIES NO. SERIES ITEM SUBNITTAL

500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL MSC 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIGHT, STATE OF WASHINGTON, 42158, REGISTERED PROFESSIONAL ENGINEER, 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	DISC/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJW	CJB	[illegible]	BJH	N/A	[illegible]

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SOIL BORING LOGS-2

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0310.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0310	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15890 SHT01	600G	0501

Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0311	0

BOREHOLE LOG

PROJECT: ERDF — BORING NO. 699-38-65 — SHEET 1 OF 2

BORING LOCATION NORTH 37965.00 EAST -84978.00 — GROUND ELEVATION: 751.03 FEET — BORING DATE:

DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: M. DAWSON/C. BACH
LOGGED:
CHECKED:
DATE:

SOIL PROFILE			SAMPLES					PENETRATION RESISTANCE BLOWS/FT. 0 10 20 30 40 50 / WATER CONTENT, PERCENT	PIEZOMETER GRAPHIC / WATER LEVEL
DEPTH (FT)	DESCRIPTION	GRAPHIC LOG	NUMBER	TYPE	BLOWS	N	RECOVERY		
0–10	GRAVELLY SAND								
10–25	SANDY SILT								
25–34	NOT LOGGED								
34–74	SANDY SILT								

BOREHOLE LOG

PROJECT: ERDF — BORING NO. 699-36-61A — SHEET 1 OF 2

BORING LOCATION NORTH 36365.00 EAST -80704.00 — GROUND ELEVATION: 746.52 FEET — BORING DATE:

DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: ROW
LOGGED:
CHECKED:
DATE:

SOIL PROFILE			SAMPLES					PENETRATION RESISTANCE BLOWS/FT. 0 10 20 30 40 50 / WATER CONTENT, PERCENT	PIEZOMETER GRAPHIC / WATER LEVEL
DEPTH (FT)	DESCRIPTION	GRAPHIC LOG	NUMBER	TYPE	BLOWS	N	RECOVERY		
0–5	SAND – (EOLIAN SAND?)								
5–24	GRAVELLY SAND								
24–31	SILTY SANDY GRAVEL								
31–74	SILTY SAND								

BOREHOLE LOG

PROJECT: ERDF — BORING NO. 699-36-61B — SHEET 1 OF 2

BORING LOCATION NORTH 36463.00 EAST -80685.00 — GROUND ELEVATION: 746.46 FEET — BORING DATE:

DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: C.BACH
LOGGED:
CHECKED:
DATE:

SOIL PROFILE			SAMPLES					PENETRATION RESISTANCE BLOWS/FT. 0 10 20 30 40 50 / WATER CONTENT, PERCENT	PIEZOMETER GRAPHIC / WATER LEVEL
DEPTH (FT)	DESCRIPTION	GRAPHIC LOG	NUMBER	TYPE	BLOWS	N	RECOVERY		
0–10	SAND – (EOLIAN SAND?)								
10–35	GRAVEL								
35–40	SILTY GRAVEL								
40–74	SAND								

BOREHOLE LOG

PROJECT: ERDF — BORING NO. 699-38-65 — SHEET 2 OF 2

BORING LOCATION NORTH 37965.00 EAST -84978.00 — GROUND ELEVATION: 751.03 — BORING DATE:

DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: M. DAWSON/C. BACH
LOGGED:
CHECKED:
DATE:

SOIL PROFILE			SAMPLES					PENETRATION RESISTANCE BLOWS/FT. 0 10 20 30 40 50 / WATER CONTENT, PERCENT	PIEZOMETER GRAPHIC / WATER LEVEL
DEPTH (FT)	DESCRIPTION	GRAPHIC LOG	NUMBER	TYPE	BLOWS	N	RECOVERY		
74–84	SANDY SILT								
84–115	SILTY SAND								
115–135	SANDY SILT								
135–149	SILTY SAND								
145	BOREHOLE CONTINUES TO 536 FEET. PLEASE REFER TO WHC-SD-EN-AP-128, Rev. 1 FOR COMPLETE LOG								

BOREHOLE LOG

PROJECT: ERDF — BORING NO. 699-36-61A — SHEET 2 OF 2

BORING LOCATION NORTH 36365.00 EAST -80704.00 — GROUND ELEVATION: 746.52 — BORING DATE:

DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: ROW
LOGGED:
CHECKED:
DATE:

SOIL PROFILE			SAMPLES					PENETRATION RESISTANCE BLOWS/FT. 0 10 20 30 40 50 / WATER CONTENT, PERCENT	PIEZOMETER GRAPHIC / WATER LEVEL
DEPTH (FT)	DESCRIPTION	GRAPHIC LOG	NUMBER	TYPE	BLOWS	N	RECOVERY		
74–149	SILTY SAND								
145	BOREHOLE CONTINUES TO 390 FEET. PLEASE REFER TO WHC-SD-EN-AP-128, Rev. 1 FOR COMPLETE LOG								

BOREHOLE LOG

PROJECT: ERDF — BORING NO. 699-36-61B — SHEET 2 OF 2

BORING LOCATION NORTH 36463.00 EAST -80685.00 — GROUND ELEVATION: 746.46 — BORING DATE:

DRILLING METHOD AND EQUIPMENT: CABLE TOOL
DRILLING CONTRACTOR: NOT DOCUMENTED
DRILLER: C. BACH
LOGGED:
CHECKED:
DATE:

SOIL PROFILE			SAMPLES					PENETRATION RESISTANCE BLOWS/FT. 0 10 20 30 40 50 / WATER CONTENT, PERCENT	PIEZOMETER GRAPHIC / WATER LEVEL
DEPTH (FT)	DESCRIPTION	GRAPHIC LOG	NUMBER	TYPE	BLOWS	N	RECOVERY		
74–95	SAND								
95–105	SILTY SAND								
105–125	NOT LOGGED								
125–149	SAND								
145	BOREHOLE CONTINUES TO 568 FEET. PLEASE REFER TO WHC-SD-EN-AP-128, Rev. 1 FOR COMPLETE LOG								

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

NOTES

1. BORINGS 699-35-69B AND 669-35-68B TRANSCRIBED FROM BORING LOGS SUPPLIED BY WHC GEOTECHNICAL DEPARTMENT. REMAINDER OF BORING LOGS TRANSCRIBED FROM WHC-SD-AP-128 REV.1. "SITE CHARACTERIZATION PLAN FOR THE ENVIRONMENTAL RESTORATION DISPOSAL FACILITY".
2. FOR LOCATIONS OF SOIL BORINGS, SOIL TEST PITS, AND EXISTING WELLS, SEE DRAWING NO. 0600X-DD-C0308.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☑ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Project Engineer: Dan Borlaug 10/9/07
0600X-SC-G0524 — 05-19 — 052
S00X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIEST — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07
EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJW	CJB	[illegible]	[illegible]	N/A	[illegible]

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SOIL BORING LOGS-3

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0311.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0311	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15891 SHT01	600G	0501

DRAWING NO.	REV. NO.
0600X-DD-C0312	0

FIELD TEST PIT LOG

PROJECT: ERDF — TEST PIT NO. TPWF1 — SHEET 1 OF 1
PIT LOCATION – GROUND ELEVATION: – TEST PIT DATE: 5/31/94
TRENCHING METHOD AND EQUIPMENT: CASE 580 TURBO — LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION — CHECKED: RICHARD LUARK
OPERATOR: D. CADIEU — DATE: 5/31/94

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–2		S1	3.3	COMPACT, MODERATE YELLOWISH BROWN, SILTY FINE TO COARSE SAND (SM), (EOLIAN DEPOSIT)
3				COMPACT, OLIVE BLACK, COARSE TO FINE SAND (SP), (HANFORD FORMATION)
4–12		S2	2.9	NOTE: 1 INCH CALICHE LAYER AT 4 FEET COMPACT, OLIVE BLACK, LAMINATED COARSE TO FINE SAND, TRACE SILT, LITTLE GRAVEL (SP), (HANFORD FORMATION)
13–14				TOTAL DEPTH = 12.5 FEET

FIELD TEST PIT LOG

PROJECT: ERDF — TEST PIT NO. TPWF2 — SHEET 1 OF 1
PIT LOCATION – GROUND ELEVATION: – TEST PIT DATE: 5/31/94
TRENCHING METHOD AND EQUIPMENT: CASE 580 TURBO — LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION — CHECKED: RICHARD LUARK
OPERATOR: D. CADIEU — DATE: 5/31/94

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–6		S1	3.1	COMPACT, MODERATE YELLOWISH BROWN SILTY FINE TO COARSE SAND (SM), (EOLIAN DEPOSIT)
7–8		S2	2.4	COMPACT, OLIVE GRAY, COARSE TO FINE SAND, TRACE FINE GRAVEL (SP), (HANFORD FORMATION)
9–14				TOTAL DEPTH = 8.7 FEET

FIELD TEST PIT LOG

PROJECT: ERDF — TEST PIT NO. TPWF3 — SHEET 1 OF 1
PIT LOCATION – GROUND ELEVATION: – TEST PIT DATE: 5/31/94
TRENCHING METHOD AND EQUIPMENT: CASE 580 EXTENDAHOE — LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION — CHECKED: RICHARD LUARK
OPERATOR: D. CADIEU — DATE: 5/31/94

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–2		S1	3.7	COMPACT, MODERATE YELLOWISH BROWN, SILTY, FINE TO COARSE SAND (SM), (EOLIAN DEPOSIT)
3–4				COMPACT, OLIVE GRAY, COARSE TO FINE SAND, LITTLE GRAVEL (SP), (HANFORD FORMATION)
5–12		S2	2.7	CALCIUM CEMENTED SAND LAYER ~1 INCH COMPACT TO DENSE, OLIVE GRAY, LAMINATED COARSE TO FINE SAND, LITTLE GRAVEL (SP), (HANFORD FORMATION)
13–14				TOTAL DEPTH = 13.7 FEET

FIELD TEST PIT LOG

PROJECT: ERDF — TEST PIT NO. TPWF4 — SHEET 1 OF 1
PIT LOCATION – GROUND ELEVATION: – TEST PIT DATE: 5/31/94
TRENCHING METHOD AND EQUIPMENT: CASE 580 EXTENDAHOE — LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION — CHECKED: RICHARD LUARK
OPERATOR: D. CADIEU — DATE: 5/31/94

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–2				COMPACT, MODERATE YELLOWISH BROWN, SILTY FINE TO COARSE SAND (SM), (EOLIAN DEPOSIT)
3–7				CALCIUM CEMENTED COARSE SAND LAYER ~2" COMPACT, OLIVE GRAY, COARSE TO FINE SAND, LITTLE GRAVEL (SP), (HANFORD FORMATION)
8–14				TOTAL DEPTH = 8 FEET

RIVER CORRIDOR CLOSURE CONTRACT
WCH
Dedicated To Safety Excellence

NOTES

1. FOR LOCATIONS OF SOIL BORINGS, SOIL TEST PITS, AND EXISTING WELLS, SEE DRAWING NO. 0600X-DD-C0308.

WASHINGTON CLOSURE HANFORD — JOB NO 14652
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Review and resubmit. Work may proceed prior to resubmittal.
3. ☐ Review and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Review and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or submitted by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Belanger 10/9/07
DOCUMENT REVIEW 0600X-SC-G0540 05-TQ 053
SCPO No. SUBMITTAL NO. SUBMITTAL
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIEN — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS. ENG'R	PROJ. ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJJ	CSB	[illegible]	JH	NIA	BK

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7–10
SOIL TEST PIT LOGS–1

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0312.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0312	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15892 SHT01	600G	0501

DRAWING NO.	REV. NO.
0600X-DD-C0313	0

FIELD TEST PIT LOG

PROJECT: ERDF — TEST PIT NO. TPW05 — SHEET 1 OF 1
PIT LOCATION – GROUND ELEVATION: – TEST PIT DATE: 6/1/94
TRENCHING METHOD AND EQUIPMENT: CASE 580 EXTENDAHOE — LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION — CHECKED: RICHARD LUARK
OPERATOR: D. CADIEU — DATE: 5/31/94

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–4		S1	2.9	COMPACT, MODERATE YELLOWISH BROWN, SILTY FINE TO COARSE SAND (SM), (EOLIAN DEPOSIT)
5–8		S2	3.5	COMPACT TO DENSE, PALE YELLOWISH BROWN, CALCIUM CEMENTED COARSE SAND, LITTLE TO TRACE FINE GRAVEL (SP), (HANFORD FORMATION)
8–9				COMPACT, OLIVE BLACK, COARSE TO FINE SAND, TRACE GRAVEL (SP), (HANFORD FORMATION)
9				TOTAL DEPTH = 9 FEET

FIELD TEST PIT LOG

PROJECT: ERDF — TEST PIT NO. TPW06 — SHEET 1 OF 1
PIT LOCATION – GROUND ELEVATION: – TEST PIT DATE: 6/1/94
TRENCHING METHOD AND EQUIPMENT: CASE 580 EXTENDAHOE — LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION — CHECKED: RICHARD LUARK
OPERATOR: D. CADIEU — DATE: 5/31/94

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–5		S1	4.5	COMPACT, PALE YELLOWISH BROWN, SILTY FINE TO COARSE SAND (SM), (EOLIAN DEPOSIT)
6–8		S2	2.3	COMPACT, OLIVE BLACK, COARSE TO FINE SAND TO SAND AND GRAVEL, LITTLE SILT (SW-GW), (HANFORD FORMATION)
9				TOTAL DEPTH = 9 FEET

FIELD TEST PIT LOG

PROJECT: ERDF — TEST PIT NO. TPW07 — SHEET 1 OF 1
PIT LOCATION – GROUND ELEVATION: – TEST PIT DATE: 6/1/94
TRENCHING METHOD AND EQUIPMENT: CASE 580 EXTENDAHOE — LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION — CHECKED: RICHARD LUARK
OPERATOR: D. CADIEU — DATE: 5/31/94

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–6				COMPACT, PALE YELLOWISH BROWN, SILTY FINE TO COARSE SAND (SM)
7				COMPACT, OLIVE BLACK, COARSE TO FINE SAND AND GRAVEL (SP), (HANFORD FORMATION)
8–12		S1	2.6	COMPACT TO DENSE, MODERATE YELLOWISH BROWN, SILTY COARSE TO FINE SAND, LITTLE TO SOME GRAVEL (SM), (HANFORD FORMATION)
13				TOTAL DEPTH = 13 FEET

FIELD TEST PIT LOG

PROJECT: ERDF — TEST PIT NO. TPW08 — SHEET 1 OF 1
PIT LOCATION – GROUND ELEVATION: – TEST PIT DATE: 6/1/94
TRENCHING METHOD AND EQUIPMENT: CASE 580 EXTENDAHOE — LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION — CHECKED: RICHARD LUARK
OPERATOR: D. CADIEU — DATE: 5/31/94

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–4		S1	4.8	COMPACT, MODERATE YELLOWISH BROWN, SILTY FINE TO COARSE SAND (SP-SM), (EOLIAN DEPOSIT)
7–8				COMPACT, OLIVE BLACK, COARSE SANDY GRAVEL (GP), (HANFORD FORMATION)
9–12		S2	3.8	COMPACT TO DENSE, MODERATE YELLOWISH BROWN, SILTY COARSE TO FINE SAND, LITTLE TO SOME GRAVEL (SM), (HANFORD FORMATION)
13				TOTAL DEPTH = 13 FEET

FIELD TEST PIT LOG

PROJECT: ERDF — TEST PIT NO. TPW09 — SHEET 1 OF 1
PIT LOCATION – GROUND ELEVATION: – TEST PIT DATE: 6/1/94
TRENCHING METHOD AND EQUIPMENT: CASE 580 EXTENDAHOE — LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION — CHECKED: RICHARD LUARK
OPERATOR: D. CADIEU — DATE: 5/31/94

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–4				COMPACT, MODERATE YELLOWISH BROWN, SILTY FINE TO MEDIUM SAND (SM), (EOLIAN DEPOSIT)
5–7		S1	2.8	COMPACT, OLIVE BLACK, COARSE TO FINE SAND, SOME GRAVEL (SP), (HANFORD FORMATION)
7–8				COMPACT, MODERATE YELLOWISH BROWN, SILTY, COARSE TO FINE SAND, SOME GRAVEL (SM), (HANFORD FORMATION)
8				TOTAL DEPTH = 8 FEET

FIELD TEST PIT LOG

PROJECT: ERDF — TEST PIT NO. TPW10 — SHEET 1 OF 1
PIT LOCATION – GROUND ELEVATION: – TEST PIT DATE: 6/1/94
TRENCHING METHOD AND EQUIPMENT: CASE 580 EXTENDAHOE — LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION — CHECKED: RICHARD LUARK
OPERATOR: D. CADIEU — DATE: 5/31/94

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–4		S1	6.7	COMPACT, MODERATE YELLOWISH BROWN, SILTY FINE TO COARSE SAND, TRACE GRAVEL (SM), (EOLIAN DEPOSIT)
5–8		S2	2.0	COMPACT, OLIVE BLACK, COARSE TO FINE SAND AND GRAVEL WITH COBBLES TO COARSE TO FINE SAND, SOME GRAVEL WITH COBBLES (SP TO GP), (HANFORD FORMATION)
9				TOTAL DEPTH = 9 FEET

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15893 SHT01	600G	0501

NOTES

1. FOR LOCATIONS OF SOIL BORINGS, SOIL TEST PITS, AND EXISTING WELLS, SEE DRAWING NO. 0600X-DD-C0308.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
☐ Work may proceed.
☐ Revise and resubmit. Work may proceed prior to resubmittal.
☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
☐ Revise and resubmit. Work may not proceed.
☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Bergman 10/9/07
DOCUMENT NUMBER 0600X-SC-60524 0519 — SHEET/PAGE 054 — SUBSECTION
SCOPE NO. 500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mkc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BEAUST — STATE OF WASHINGTON — 42158 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	DSG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JJV	CJB	BH	N/A	SR	

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. — RICHLAND, WASHINGTON
WEAVER BOOS CONSULTANTS, LLC — DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
SOIL TEST PIT LOGS -2

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0313.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0313	0

RIVER CORRIDOR CLOSURE CONTRACT
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-C0315	0

FIELD TEST PIT LOG

PROJECT: ERDF | TEST PIT NO. TP03 | SHEET 1 OF 1
PIT LOCATION – | GROUND ELEVATION: – | TEST PIT DATE: 12/2/94
TRENCHING METHOD AND EQUIPMENT: FORD 555D | LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION | CHECKED: SCOTT STONEMAN
OPERATOR: D. CADIEU | DATE: 1/23/95

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–6		S1, S2		LOOSE TO COMPACT, PALE YELLOWISH BROWN, COARSE TO FINE SAND WITH SOME SILT (SW–SM), (EOLIAN DEPOSIT)
7–10		S3		COMPACT TO DENSE, BROWNISH BLACK, COARSE TO FINE GRAVEL WITH SOME COARSE TO FINE SAND, DRY, CACO3 CEMENTATION AT CONTACT (GW), (HANFORD FORMATION)
11–14				TOTAL DEPTH = 10 FEET

FIELD TEST PIT LOG

PROJECT: ERDF | TEST PIT NO. TP04 | SHEET 1 OF 1
PIT LOCATION – | GROUND ELEVATION: – | TEST PIT DATE: 12/1/94
TRENCHING METHOD AND EQUIPMENT: FORD 555D | LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION | CHECKED: SCOTT STONEMAN
OPERATOR: D. CADIEU | DATE: 1/23/95

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–3		S1		LOOSE, PALE YELLOWISH BROWN, COARSE TO FINE SAND WITH LITTLE SILT (SW–SM), (EOLIAN DEPOSIT)
4–8		S2		COMPACT TO DENSE, GRAY, COARSE TO FINE TO MEDIUM SAND, TRACE SILT (GW). (HANFORD FORMATION)
9–14				TOTAL DEPTH = 8 FEET

FIELD TEST PIT LOG

PROJECT: ERDF | TEST PIT NO. TP05 | SHEET 1 OF 1
PIT LOCATION – | GROUND ELEVATION: – | TEST PIT DATE: 11/31/94
TRENCHING METHOD AND EQUIPMENT: FORD 555D | LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION | CHECKED: SCOTT STONEMAN
OPERATOR: D. CADIEU | DATE: 1/23/95

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–7		S1		PALE YELLOWISH BROWN, COARSE TO FINE SAND LITTLE SILT (SW), (EOLIAN DEPOSIT)
8–12		S2		LIGHT OLIVE BROWN, MEDIUM TO FINE SAND, SOME SILT, TRACE COARSE TO FINE GRAVEL (SM) COMPACT TO DENSE, BROWNISH BLACK, COARSE TO FINE GRAVEL WITH SAND (GW), (HANFORD FORMATION)
13–14				TOTAL DEPTH = 12.5 FEET

FIELD TEST PIT LOG

PROJECT: ERDF | TEST PIT NO. TP06 | SHEET 1 OF 1
PIT LOCATION – | GROUND ELEVATION: – | TEST PIT DATE: 11/30/94
TRENCHING METHOD AND EQUIPMENT: FORD 555D | LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION | CHECKED: SCOTT STONEMAN
OPERATOR: D. CADIEU | DATE: 1/23/95

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–7		S1		LOOSE, PALE YELLOWISH BROWN, COARSE TO FINE SAND, LITTLE SILT (SW–SM), (EOLIAN DEPOSIT)
8–9		S2		COMPACT, VERY DARK GRAY, COARSE TO MEDIUM SAND, SOME COBBLES, SOME COARSE TO FINE GRAVEL, TRACE SILT (SP)
10–14				TOTAL DEPTH = 9.5 FEET

FIELD TEST PIT LOG

PROJECT: ERDF | TEST PIT NO. TP07 | SHEET 1 OF 1
PIT LOCATION – | GROUND ELEVATION: – | TEST PIT DATE: 11/30/94
TRENCHING METHOD AND EQUIPMENT: FORD 555D | LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION | CHECKED: SCOTT STONEMAN
OPERATOR: D. CADIEU | DATE: 1/23/95

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–5		S1		LOOSE, LIGHT BROWNISH GRAY, FINE SAND SOME SILT (SM), (EOLIAN DEPOSIT) CALICHE LAYER~3 INCHES
6–9		S2		LOOSE TO COMPACT, BROWNISH BLACK, COARSE TO FINE GRAVEL, SOME COARSE TO FINE SAND, (HANFORD FORMATION)
10–14				TOTAL DEPTH = 9 FEET

FIELD TEST PIT LOG

PROJECT: ERDF | TEST PIT NO. TP08 | SHEET 1 OF 1
PIT LOCATION – | GROUND ELEVATION: – | TEST PIT DATE: 11/30/94
TRENCHING METHOD AND EQUIPMENT: FORD 555D | LOGGED: MARK ANDERSON
CONTRACTOR: E.P. JOHNSON CONSTRUCTION | CHECKED: SCOTT STONEMAN
OPERATOR: D. CADIEU | DATE: 1/23/95

DEPTH (FT)	GRAPHIC LOG	SAMPLES	MOISTURE CONTENT (%)	SOIL PROFILE DESCRIPTION
1–4		S1		LOOSE, PALE YELLOWISH BROWN, COARSE TO FINE SAND, LITTLE TO SOME SILT (SM), (EOLIAN DEPOSIT) CALICHE LAYER~0.4 FT
5–6				DENSE, COARSE GRAVEL, LTTLE COARSE TO FINE SAND (HANFORD FORMATION)
7–15		S2		COMPACT TO DENSE, PALE OLIVE, LAMINATED, MEDIUM TO FINE SAND, LITTLE SILT (SP–SM), (HANFORD FORMATION)
				TOTAL DEPTH = 15.3 FEET

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15895 SHT01	600G	0501

Dedicated To Safety Excellence

NOTES

1. FOR LOCATIONS OF SOIL BORINGS, SOIL TEST PITS, AND EXISTING WELLS, SEE DRAWING NO. 0600X-DD-C0308.

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borlaug 10/9/07
DOCUMENT CLASSIFICATION
0600X-SC-G06244 05-19 055
SCOPE No. | DISCIPLINE | SUBMITTAL

500X524 A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mjc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

JOHN CARL BRIANT, STATE OF WASHINGTON, 42158, REGISTERED PROFESSIONAL ENGINEER, 9/28/07

EXPIRES: 5/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ MGR
0	9/28/07	ISSUED FOR CONSTRUCTION	JJW	CTB	[illegible]	DJH	NIA	[illegible]

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7–10
SOIL TEST PIT LOGS–3

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0315.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0315	0

DRAWING NO.	REV. NO.
0600X-DD-C0316	0

NOTE: BUILDING ORIENTATION VARIES SEE BELOW

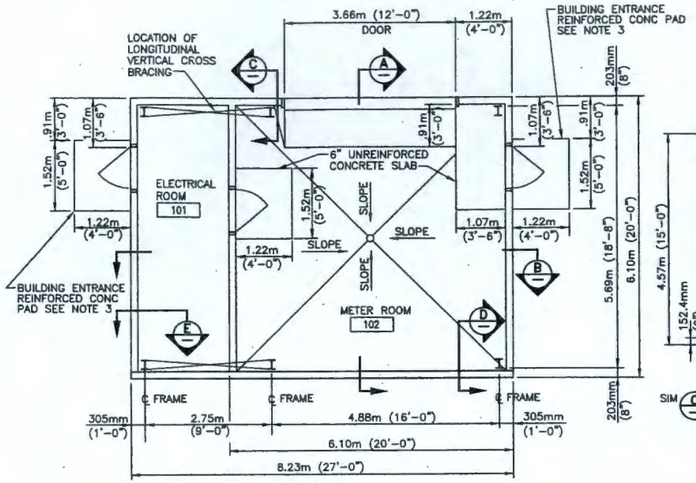

PLAN

SCALE
0 5 10 feet

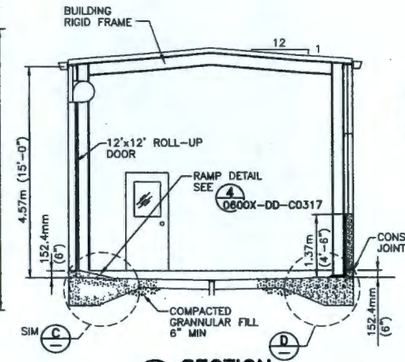

A SECTION

SCALE
0 5 10 feet

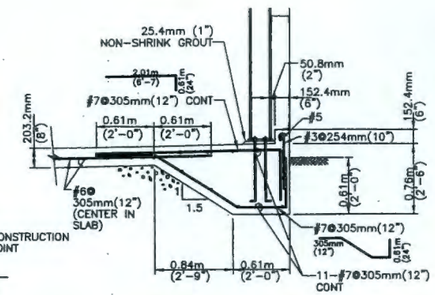

C SECTION

SCALE
0 2.5 5 feet

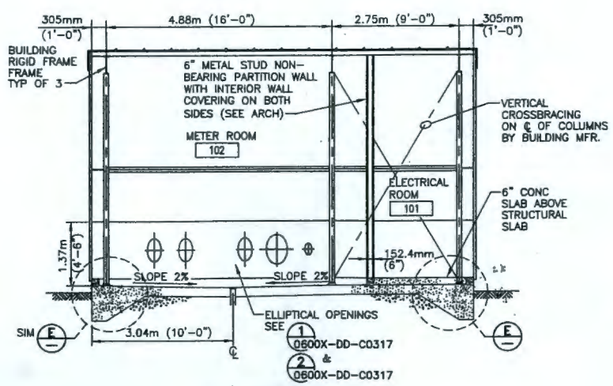

B SECTION

SCALE
0 5 10 feet

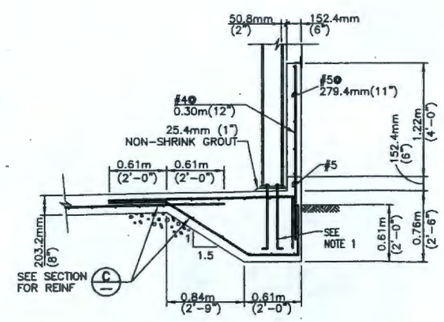

D SECTION

SCALE
0 2.5 5 feet

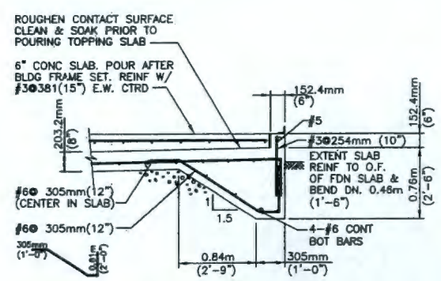

E SECTION

SCALE
0 2.5 5 feet

NOTES

1. BUILDING FRAME ANCHOR BOLTS SHALL BE A MINIMUM OF (4)-3/4" DIA. COORDINATE WITH BUILDING SUPPLIER FOR BOLT NUMBER AND LOCATION.
2. BUILDING TYPICAL (4 PLANS) FOR CELLS 7/8 & 9/10.
3. BOTH OUTSIDE BUILDING ENTRANCE PADS SHALL BE 152.4mm (6") THICKNESS WITH #4@12" EW CENTERED IN SLAB THICKNESS. PADS SHALL BE SEPARATE FROM MAIN FOUNDATION SLAB. SLOPE PADS 1/4"/FT AWAY FROM DOOR OPENINGS.
4. THE INTERIOR CONCRETE SLABS AT DOORWAYS ARE TO BE FINISHED LEVEL, NO SLOPE.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1 ☒ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmission.
3 ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Borlaug 10/8/07
DOCUMENT ID NUMBER: 0600X-SC-G00524 05-19 056
SCPO No. / SRPS ITEM / SUBMITTAL
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mkc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

DAVID E. NIELSEN — STATE OF WASHINGTON — 28592 — REGISTERED PROFESSIONAL ENGINEER — 9/24/07
EXPIRES 9/23/07 08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG ENGR	ENGR CHK	SYS ENGR	PROJ ENGR
0	9/28/07	ISSUED FOR CONSTRUCTION	BR	MF	MF	RW	N/A	

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
CREST PAD BLDG STRUCTURAL PLANS AND SECTIONS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0316.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0316	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15896 SHT01	600G	0901

RIVER CORRIDOR CLOSURE CONTRACT WCH Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-C0317	0

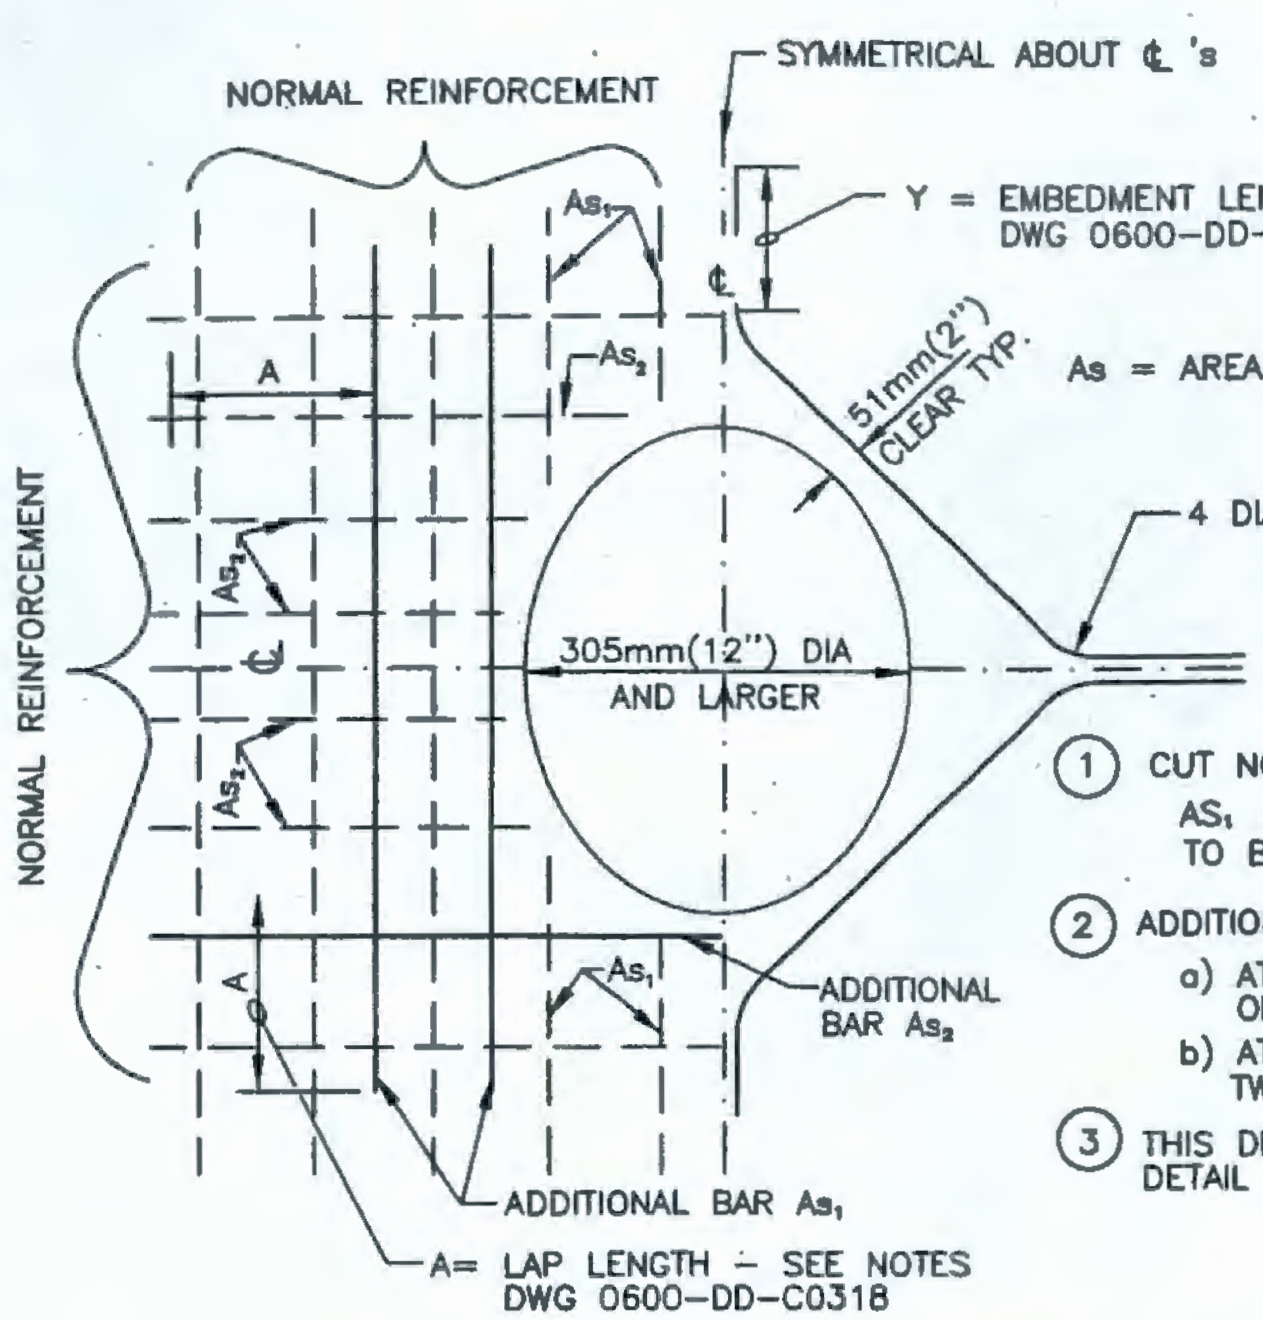

(1) CUT NORMAL REINFORCEMENT AT OPENINGS: AS_1 AND AS_2 =1/2 AREA OF CUT BARS TO BE ON EACH SIDE OF OPENING

(2) ADDITIONAL BARS AS_1 AND AS_2 TO BE PLACED:
- a) AT ℄ OF WALLS OR SLABS WHERE ONE LAYER OF REINFORCEMENT IS PROVIDED
- b) AT EACH FACE OF WALLS OR SLABS WHERE TWO LAYERS OF REINFORCEMENT ARE PROVIDED

(3) THIS DETAIL TO BE USED ONLY WHEN NO OTHER DETAIL IS INDICATED ON THE DRAWINGS

(1) ADDITIONAL REFORCMENT AT ELLIPTICAL OPENINGS DETAIL (305mm(12") DIA OR LARGER)

0600X-DD-C0316
NTS

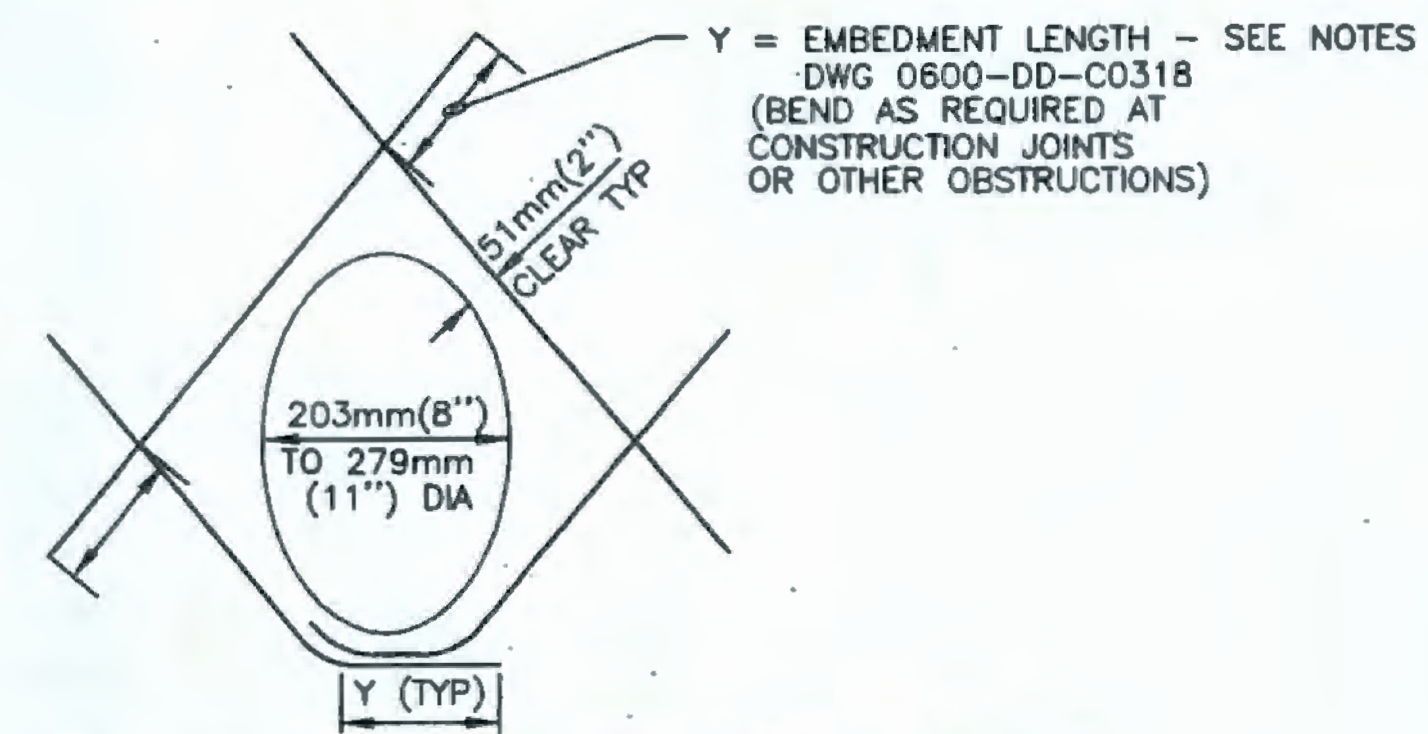

(1) CUT NORMAL REINFORCEMENT CLEAR OF OPENING

(2) DIAGONAL BARS TO BE PLACED;
- A. AT ℄ OF WALL OR SLAB WHERE ONE LAYER OF REINFORCEMENT IS PROVIDED
- B. AT EACH FACE OF WALL OR SLAB WHERE TWO LAYERS OF REINFORCEMENT ARE PROVIDED

(3) UNLESS OTHERWISE NOTED, SIZE OF DIAGONAL BARS SHALL BE THE SIZE OF THE LARGEST NORMAL REINF BAR CUT

(4) THIS DETAIL TO BE USED ONLY WHEN CALLED FOR ON THE DRAWINGS OR WHEN NO OTHER DETAIL IS SPECIFIED

(2) DIAGONAL REFORCEMENT AT ELLIPTICAL OPENINGS DETAIL 203mm(8") -279mm(11") DIA

0600X-DD-C0316
NTS

NOTES

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☑ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borlaug 10/9/07
0600X-SC-G0524 05-19 057
S00X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

Best Available Copy

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

DAVID L NIELSON — STATE OF WASHINGTON — 28592 — REGISTERED PROFESSIONAL ENGINEER — 9/24/07
EXPIRES 9/23/08

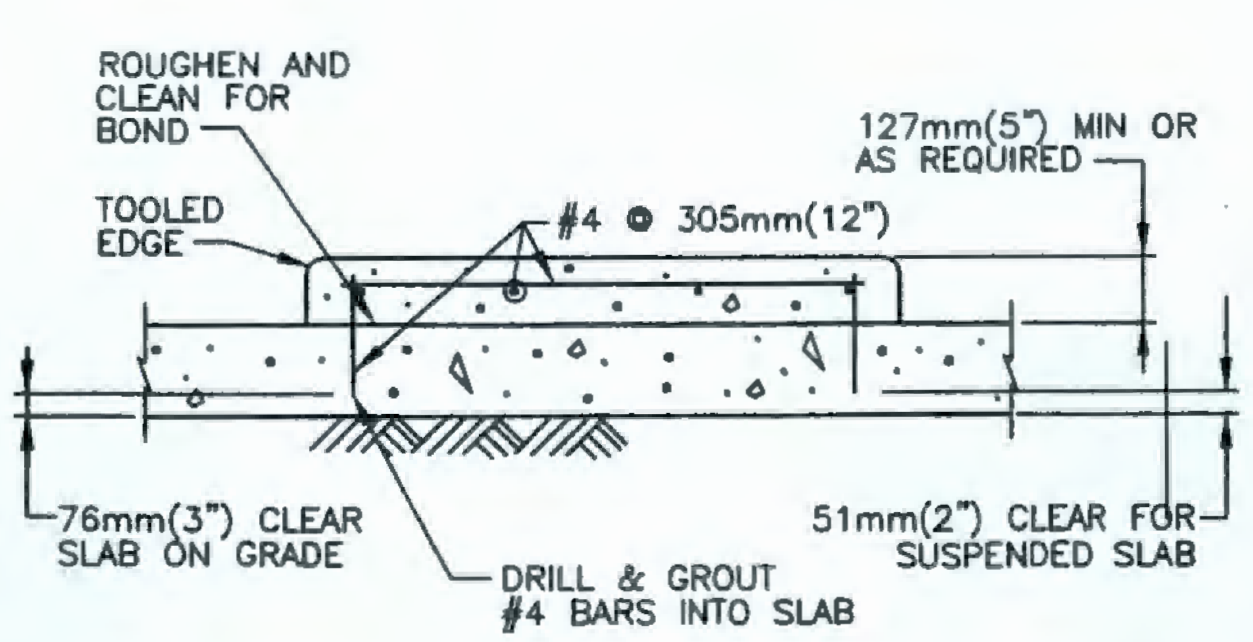

(3) HOUSE KEEPING PAD DETAIL

0600X-DD-E0116
NTS

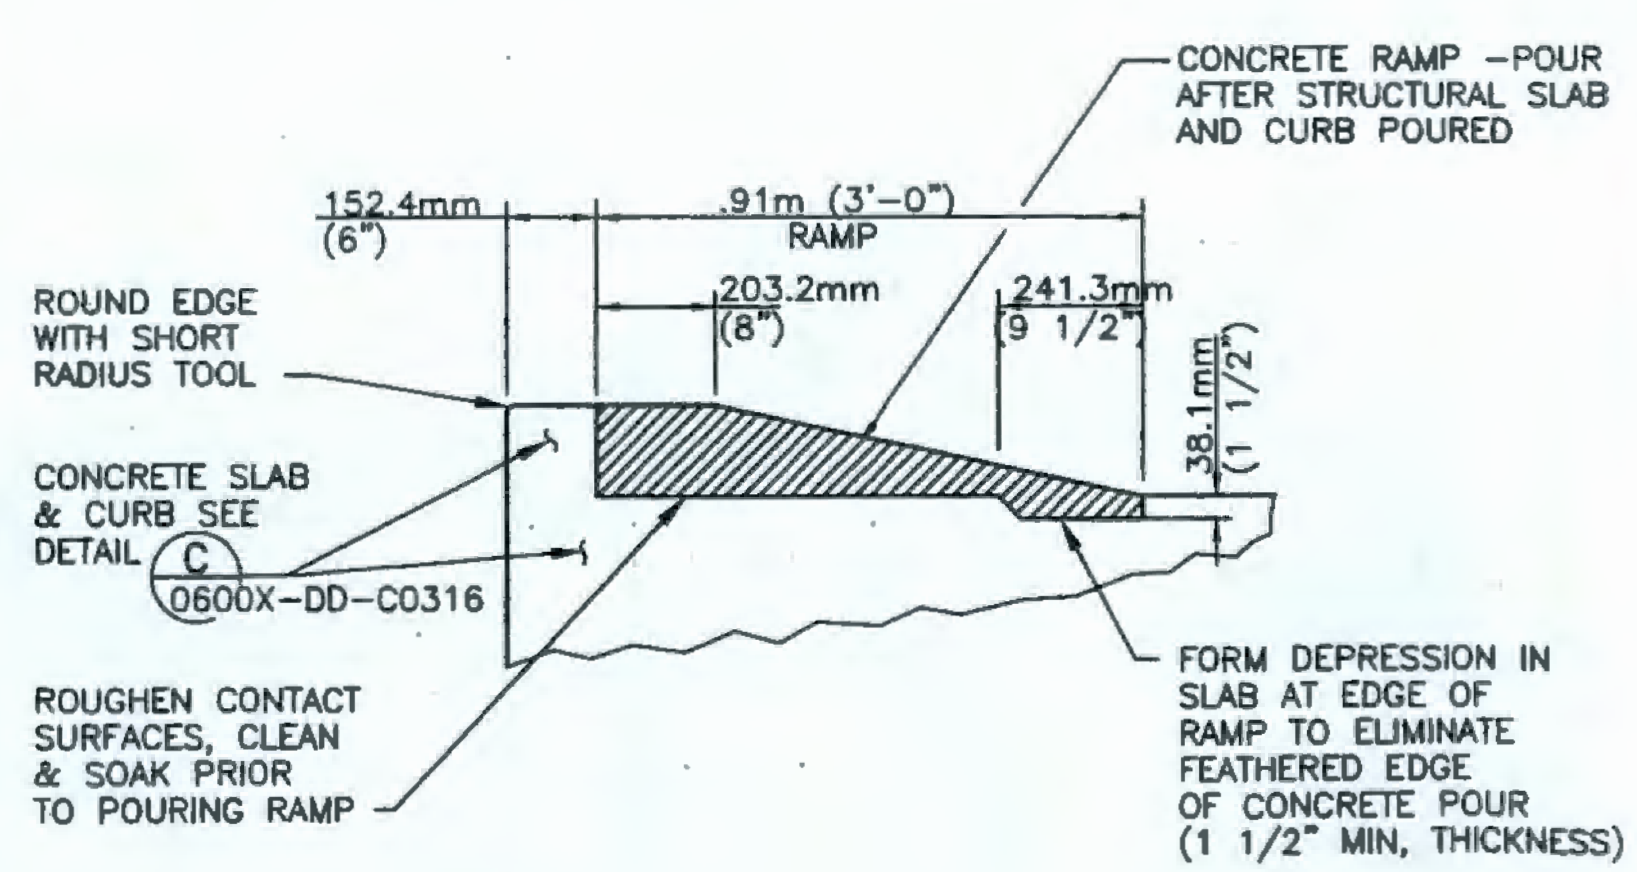

(4) RAMP DETAIL

0600X-DD-C0316
NTS

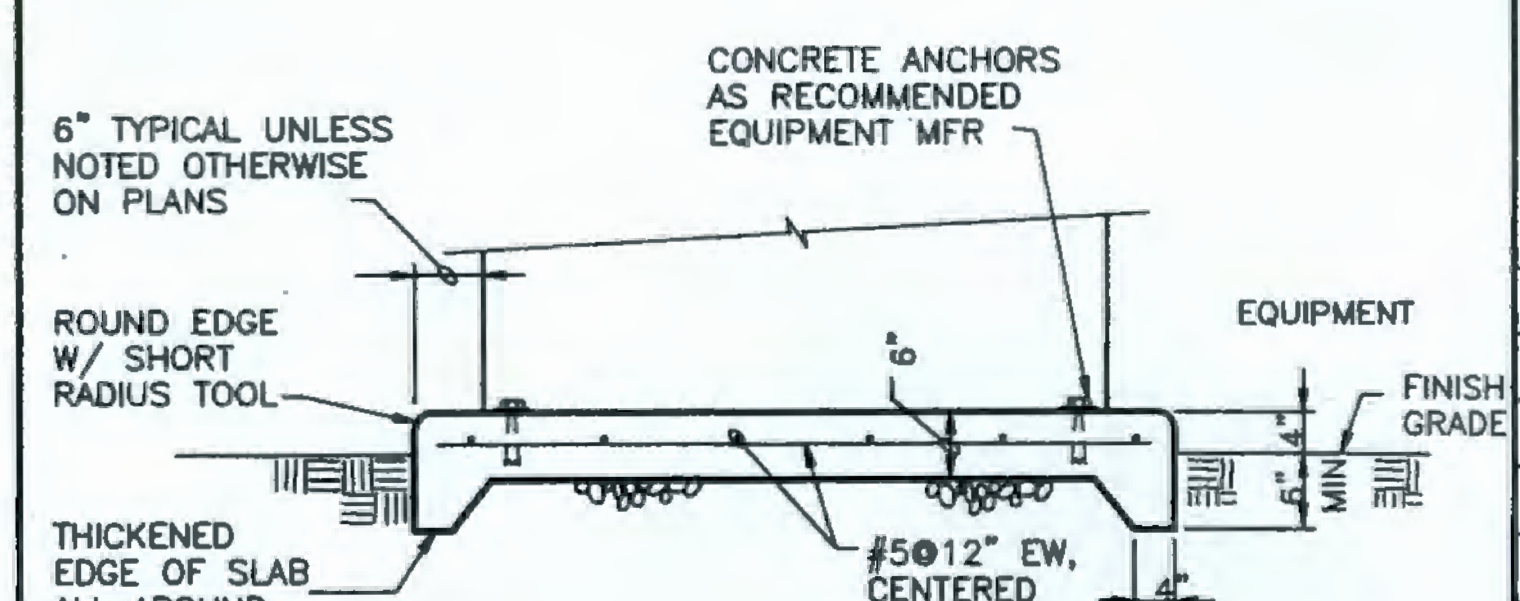

(5) EQUIPMENT PAD DETAIL

0600X-DD-E0107
NTS

WCH River Corridor Closure Contract
Dedicated To Safety Excellence

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15897 SHT01	600G	0901

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	BR	MF	MF	RW	NW	[illegible]

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7–10
STRUCTURAL DETAILS – 1

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0317.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0317	0

DRAWING NO.	REV. NO.
0600X-DD-C0318	0

NOTES:

APPLICABLE CODES: 2006 IBC (INTERNATIONAL BUILDING CODE) AS AMENDED BY THE STATE OF WASHINGTON AND LOCAL AGENCIES.

BUILDING LOADS

FLOOR LOADS:

PUMP ROOM	976 kg/m²	(200 PSF)
ELECTRICAL ROOM	1465kg/m²	(300 PSF)
VEHICLE ACCESS	AASHTO H20	

ROOF LOADS:

97.7 kg/m² (20psf) MINIMUM ROOF LIVE LOAD.
73.2 kg/m² (15psf) GROUND SNOW LOAD (Pg)
97.7 kg/m² (20psf) FLAT-ROOF SNOW LOAD (Pf)
117.2 kg/m² (24psf) ASHFALL LOAD (A_s)
EXPOSURE COEFFICIENT (Ce) = 0.9
IMPORTANCE FACTOR (I) = 1.1
THERMAL FACTOR (Ct) = 1.1

WIND LOAD:

41 m/s (91 mph) WIND SPEED.
EXPOSURE "C".
IMPORTANCE FACTOR (I) : 1.15
INTERNAL PRESSURE COEFFICIENT: ±D.18

SEISMIC LOAD:

SEISMIC IMPORTANCE FACTOR (I) = 1.25
MAPPED SPECTRAL RESPONSE ACCELERATION:
S_s = 0.47 S_1 = 0.14
SITE CLASS: "D"
SPECTRAL RESPONSE COEFFICIENTS:
S_{DS} = 0.44 S_{D1} = 0.20
SEISMIC DESIGN CATEGORY: "C"
SEISMIC FORCE RESISTING SYSTEM:
N-S ORDINARY STEEL MOMENT FRAME
RESPONSE MODIFICATION FACTOR (R) = 3.5
SEISMIC RESPONSE COEFFICIENT (C_s) = 0.161
E-W ORDINARY STEEL CONCENTRICALLY BRACED FRAME
RESPONSE MODIFICATION FACTOR (R) = 3.25
SEISMIC RESPONSE COEFFICIENT (C_s) = 0.173

STRUCTURAL STEEL

1. ALL STRUCTURAL STEEL SHALL CONFORM TO ASTM A36/A36M, A529/A529M, A572, or A992 UNLESS SHOWN OTHERWISE. ALL ROLLED WIDE FLANGE SHAPES SHALL CONFORM TO ASTM A992 GRADE 50. SQUARE OR RECTANGULAR STEEL TUBING SHALL CONFORM TO ASTM TO ASTM A-500, GRADE B. STEEL PIPE SHALL BE A501 OR ASTM A53, GRADE B.
2. ALL STRUCTURAL STEEL SHALL BE FABRICATED AND ERECTED IN CONFORMANCE WITH THE AISC MANUAL OF STEEL CONSTRUCTION, CURRENT EDITION.
3. ALL STRUCTURAL STEEL SHALL BE EMBEDDED IN CONCRETE SHALL BE CLEAN AND FREE OF PAINT, OIL OR DIRT.
4. NO HOLES OTHER THAN THOSE SPECIFICALLY DETAILED SHALL BE ALLOWED THROUGH STRUCTURAL STEEL MEMBER. NO CUTTING OR BURNING OF STRUCTURAL STEEL WILL BE PERMITTED WITHOUT THE APPROVAL OF THE CONTRACTOR.
5. ALL WELDING SHALL BE BY THE SHIELDED ARC METHOD AND SHALL CONFORM TO AWS CODE FOR ARC AND GAS WELDING IN BUILDING CONSTRUCTION. QUALIFICATIONS OF WELDERS SHALL BE IN ACCORDANCE WITH SPECIFICATIONS FOR STANDARD QUALIFICATION PROCEDURE OF THE AWS.

ALUMINIUM

ALUMINUM CONSTRUCTION SHALL BE IN ACCORDANCE WITH AMERICAN SOCIETY OF CIVIL ENGINEERS SPECIFICATIONS FOR STRUCTURES OF ALUMINUM ALLOY 6061-T6. ALUMINUM SURFACES SHALL BE PREVENTED FROM COMING IN DIRECT CONTACT WITH CONCRETE OR WITH METALS NOT COMPATABLE WITH ALUMINUM, USING METHODS DESCRIBED IN THE SPECIFICATIONS.

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

FOUNDATIONS

ALLOWABLE SOILS BEARING PRESSURE (GRAVITY LOADS) DEAD PLUS LIVE LOADS = 95.8 kPa (2000 psf) (INCREASE BEARING VALUE BY 1/3 PERMITTED WHEN USING LOAD COMBINATIONS IN SECTION 1605.3.2 THAT INCLUDE WIND OR SEISMIC).

PROVIDE & PLACE 6" COMPACTED GRANULAR FILL AS SPECIFIED UNDER ALL SLABS AND FOOTINGS TO UNDISTURBED EARTH.

GENERAL

1. STRUCTURAL DIMENSIONS CONTROLLED BY OR RELATED TO MECHANICAL OR ELECTRICAL EQUIPMENT SHALL BE VERIFIED BY THE SUBCONTRACTOR PRIOR TO CONSTRUCTION.
2. MECHANICAL AND ELECTRICAL EQUIPMENT SUPPORTS, ANCHORAGES, OPENINGS, RECESSES AND REVEALS NOT SHOWN ON THE STRUCTURAL DRAWINGS BUT REQUIRED BY OTHER CONTRACT DRAWINGS, SHALL BE PROVIDED FOR PRIOR TO PLACING CONCRETE.
3. STRUCTURAL DRAWINGS SHALL BE USED IN COORDINATION WITH MECHANICAL, ELECTRICAL, ARCHITECTURAL, CIVIL DRAWINGS AND SHOP DRAWINGS PROVIDED BY MANUFACTURERS OF EQUIPMENT.
4. NO STRUCTURAL MEMBERS SHALL BE CUT FOR PIPES, DUCTS, ETC, UNLESS SPECIFICALLY DETAILED OR APPROVED IN WRITING BY THE CONTRACTOR.
5. VISITS TO THE JOB SITE BY THE CONTRACTOR TO OBSERVE THE CONSTRUCTION DOES NOT IN ANY WAY MEAN THAT CONTRACTOR IS GUARANTORS OF THE CONSTRUCTOR'S WORK, NOR RESPONSIBLE FOR THE COMPREHENSIVE OR SPECIAL INSPECTIONS, COORDINATIONS, SUPERVISION, NOR SAFETY AT THE JOB SITE.
6. SPECIAL INSPECTION (CONTRACTOR FURNISHED) IS REQUIRED IN ACCORDANCE WITH IBC SECTIONS 109 AND 1704 ON THE FOLLOWING PORTIONS OF THE WORK.
   - CONCRETE PLACEMENT
   - REINFORCING STEEL PLACEMENT
   - STRUCTURAL WELDING AND FABRICATION
   - ANCHORING, EMBEDS AND BOLTS INSTALLED IN CONCRETE
   - HIGH STRENGTH BOLTS
   - GRADING, EXCAVATION, AND FILLING
7. ALL SPECIFIED CONCRETE TESTING DURING CONSTRUCTION WILL BE FURISHED BY SUBCONTRACTOR. ALL SPECIFIED LABORATORY TEST MIXES SHALL BE THE RESPONSIBLITY OF THE SUBCONTRACTOR.
8. CONSTRUCTION SHORING AND BRACING OR FORMWORK SHALL BE IN ACCORDANCE WITH CHAPTER 2 OF ACI 301 'SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS" AND ACI 347 "RECOMMENDED PRACTICE FOR CONCRETE FORMWORK".
9. THE STRUCTURES SHOWN ON THE DRAWINGS HAVE BEEN DESIGNED FOR STABILITY UNDER FINAL CONDITION ONLY. THESE PLANS DO NOT INCLUDE THE NECESSARY COMPONENTS OR EQUIPMENT FOR THE STRUCTURES DURING CONSTRUCTION. THE SUBCONTRACTOR IS RESPONSIBLE FOR ALL WORK RELATING TO CONSTRUCTION ERECTION METHODS, BRACING, SHORING, RIGGING, GUYS, SCAFFOLDING, FORMWORK AND OTHER WORK AIDS REQUIRED TO SAFELY PERFORM THE WORK SHOWN.

CONCRETE

ALL CAST-IN-PLACE CONCRETE SHALL HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 27.6 MPa (4000psi) EXCEPT WHERE SPECIFICALLY INDICATED OTHERWISE, EXCEPT 20.7 MPa (3000psi) FOR SECONDARY CONCRETE ELEMENTS SUCH AS SIDEWALKS AND PIPE/CONDUIT ENCASEMENT, OR THRUST BLOCKS.

REINFORCING

1. REINFORCING STEEL SHALL BE DEFORMED BARS CONFORMING TO ASTM A615, GRADE 60. REINFORCING TO BE WELDED SHALL CONFORM TO ASTM A706, GRADE 60. FABRICATION AND PLACEMENT OF REINFORCING STEEL SHALL BE IN ACCORDANCE WITH CRSI MSP-1 "MANUAL OF STANDARD PRACTICE" AND ACI 301 "SPECIFICATIONS FOR STRUCTURAL, CONCRETE FOR BUILDING".
2. CLEARANCE FOR REINFORCEMENT BARS, UNLESS SHOWN OTHERWISE, SHALL BE:
   WHEN PLACED ON GROUND:---76.2mm (3")
   ALL OTHER CONCRETE SURFACES:
   #5 BAR OR SMALLER------38.1mm (1 1/2")
   #6 BAR OR LARGER-------50.8mm (2")
3. ALL BENDS, UNLESS OTHERWISE SHOWN, SHALL BE A 90 DEGREE STANDARD BEND AS DEFINED IN LATEST EDITION OF ACI 318.
4. ALL WALL CORNER AND WALL INTERSECTION REINFORCEMENT BARS SHALL BE CONTINUOUS AROUND CORNERS AND THROUGH COLUMNS OR PILASTERS. REINFORCEMENT SHALL BE EXTENDED INTO CONNECTING WALLS AND LAPPED ON THE OPPOSITE FACE OF THE CONNECTING WALLS.
5. VERTICAL WALL BARS SHALL BE LAPPED WITH DOWELS FROM BASE SLABS AND EXTENDED INTO THE TOP FACE OF ROOF SLABS AND LAPPED WITH TOP SLABS REINFORCEMENT. PROVIDE A MINIMUM OF TWO FULL HEIGHT VERTICAL BARS WITH MATCHING DOWELS AT WALL ENDS, CORNERS AND INTERSECTIONS WITH SIZE TO MATCH TYPICAL VERTICAL REINFORCING.
6. UNLESS INDICATED OTHERWISE, SUBCONTRACTOR MAY SPLICE CONTINUOUS SLAB OR LONGITUDINAL BEAM BARS AT LOCATIONS OF HIS CHOOSING, EXCEPT THAT TOP BAR SPLICES SHALL BE LOCATED AT MIDSPAN AND BOTTOM BAR SPLICES SHALL BE LOCATED AT SUPPORTS. ALL REINFORCEMENT BENDS AND LAPS, UNLESS OTHERWISE NOTED, SHALL SATISFY THE FOLLOWING MINIMUM REQUIREMENTS.

CONCRETE DESIGN STRENGTH = 4,000 PSI	GRADE 60 REINFORCING STEEL									
BAR SIZE		#3	#4	#5	#6	#7	#8	#9	#10	#11
LAP SPLICE LENGTH										
SPACING ≤152mm (6")	TOP BAR *	1'-4" .41m	2'-0" .61m	3'-0" .91m	4'-0" 1.22m	5'-10" 1.78m	6'-8" 2.03m	7'-7" 2.31m	8'-6" 2.59m	9'-5" 2.87m
	OTHER BAR	1'-4" .41m	1'-7" .48m	2'-4" .71m	3'-1" .94m	4'-6" 1.37m	5'-2" 1.58m	5'-10" 1.78m	6'-7" 2.01m	7'-3" 2.21m
SPACING ≥152mm (6")	TOP BAR *	1'-4" .41m	1'-8" .51m	2'-0" .61m	2'-5" .74m	3'-6" 1.07m	4'-0" 1.22m	5'-0" 1.52m	6'-2" 1.88m	7'-5" 2.26m
	OTHER BAR	1'-4" .41m	1'-4" .41m	1'-7" .48m	1'-10" .56m	2'-9" .84m	3'-1" .94m	3'-10" 1.17m	4'-9" 1.45m	5'-8" 1.73m
EMBEDMENT LENGTH										
SPACING ≤152mm (6")	TOP BAR *	1'-0" .31m	1'-7" .48m	2'-4" .71m	3'-1" .94m	4'-6" 1.37m	5'-2" 1.58m	5'-10" 1.78m	6'-7" 2.01m	7'-3" 2.21m
	OTHER BAR	1'-0" .31m	1'-3" .38m	1'-9" .53m	2'-5" .74m	3'-6" 1.07m	4'-0" 1.22m	4'-6" 1.37m	5'-1" 1.55m	5'-7" 1.70m
SPACING ≥152mm (6")	TOP BAR *	1'-0" .31m	1'-3" .38m	1'-7" .48m	1'-10" .56m	2'-9" .84m	3'-1" .94m	3'-10" 1.17m	4'-9" 1.45m	5'-8" 1.73m
	OTHER BAR	1'-0" .31m	1'-0" .31m	1'-2" .31m	1'-5" .43m	2'-1" .64m	2'-5" .74m	3'-0" .91m	3'-8" 1.12m	4'-5" 1.35m

* TOP BARS SHALL BE DEFINED AS ANY HORIZONTAL BARS PLACED SUCH THAT MORE THAN 304.8mm (12") OF FRESH CONCRETE IS CAST IN THE MEMBER BELOW THE BAR IN ANY SINGLE POUR. HORIZONTAL WALL BARS ARE CONSIDERED TOP BARS.

7. DOWELS, PIPES, WATERSTOPS AND OTHER INSTALLED MATERIALS AND ACCESSORIES SHALL BE HELD SECURELY IN POSITION WHILE CONCRETE IS BEING PLACED.
8. METAL CLIPS OR SUPPORTS SHALL NOT BE PLACED IN CONTACT WITH THE FORMS OR THE SUBGRADE. CONC. BLOCKS (OR DOBBIES) SUPPORTING BARS ON SUBGRADE SHALL BE IN SUFFICIENT NUMBERS TO SUPPORT THE BARS WITHOUT SETTLEMENT, BUT IN NO CASE SHALL SUPPORT BE CONTINUOUS.
9. DOWELS SHALL BE WIRED OR OTHERWISE HELD IN POSITION. THEY SHALL NOT BE WET SET INTO FRESHLY PLACED CONCRETE.
10. REINFORCING BARS AND ACCESSORIES SHALL NOT BE IN CONTACT WITH ANY PIPE, PIPE FLANGE OR METAL PARTS EMBEDDED IN CONCRETE, A MINIMUM OF 51mm(2 INCHES) CLEARANCE SHALL BE PROVIDED AT ALL TIMES.

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15898 SHT01	600G	0901

NOTES

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☑ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borlaug 10/9/07
0600X-SC-G0524 05-19 05B
S00XS24A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL MLC 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

DAVID L. NIELSON — STATE OF WASHINGTON — 28592 — REGISTERED PROFESSIONAL ENGINEER — 9/26/07
EXPIRES 9/23/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	BR	MF	MF	RW	NW	DM

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
STRUCTURAL DETAILS - 2

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDC0318.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-C0318	0

DRAWING NO.	REV. NO.
0600X-DD-A0014	0

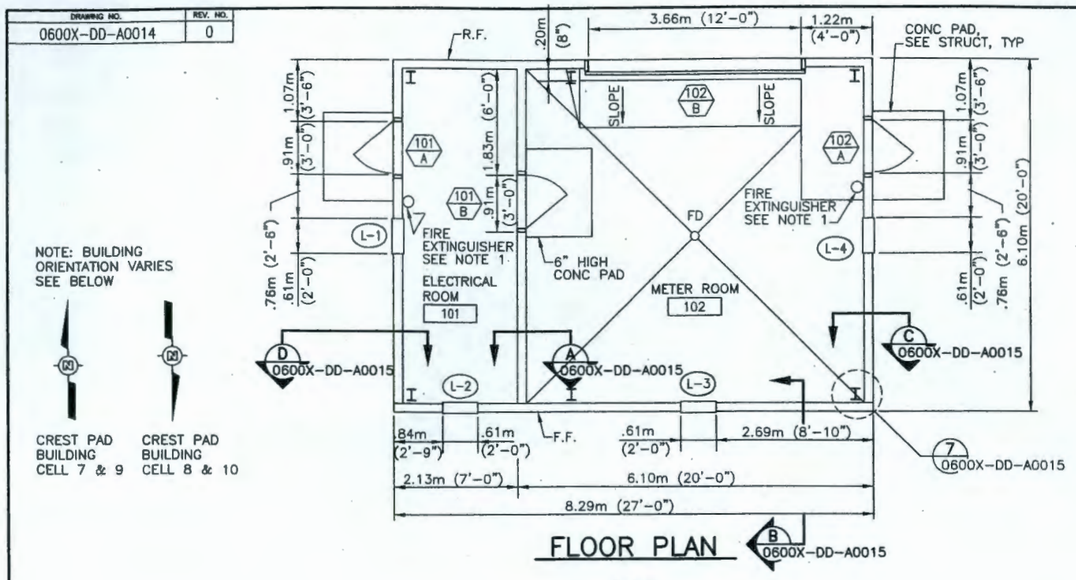

FLOOR PLAN

SCALE 0 5 10 feet

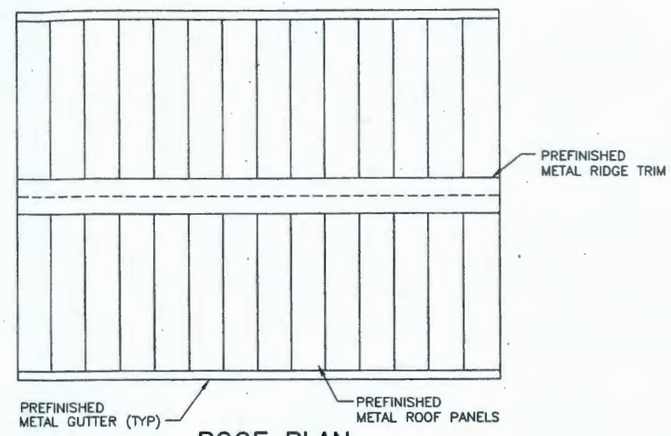

ROOF PLAN

SCALE 0 5 10 feet

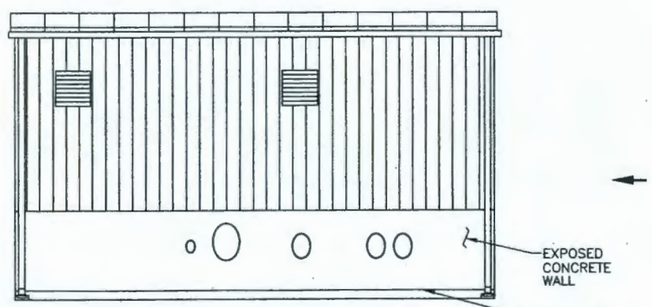

ELEVATION – CELL SIDE

SCALE 0 5 10 feet

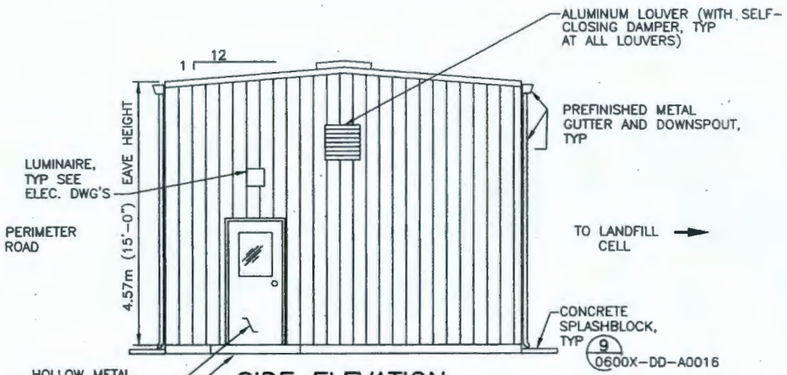

SIDE ELEVATION

SCALE 0 5 10 feet

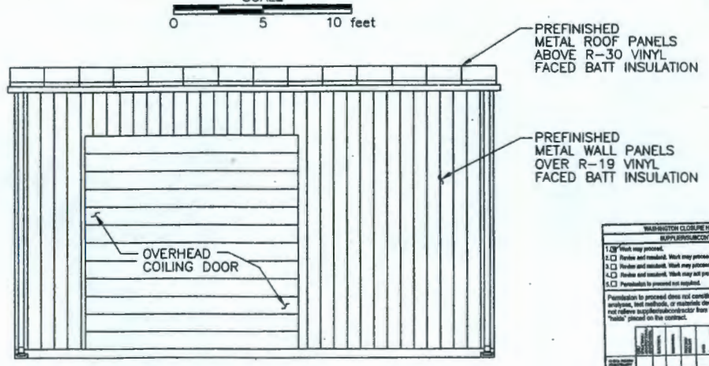

ELEVATION– ROAD SIDE

SCALE 0 5 10 feet

DOCUMENT CONTROL mjc 10/11/07

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
SUPPLIER/SUBCONTRACTOR | DATE
Paul Boeling 10/9/07
DOCUMENT CLEARED
0600X-SC-60580 05-19 059
SUBCONTRACT NO. | REVISION | SUBMITTAL
500X524A00

CODE NOTES (2006 IBC)

OCCUPANCY:	III
CONSTRUCTION TYPE:	V
ALLOWABLE FLOOR AREA:	13,000 S.F.
ACTUAL FLOOR AREA:	540 S.F.
ALLOWABLE HEIGHT:	40 FT.
ALLOWABLE NUMBER OF STORIES:	TWO
ACTUAL NUMBER OF STORIES:	ONE
NUMBER OF OCCUPANTS (CALCULATED):	TWO
ACTUAL NUMBER OF OCCUPANTS:	NOT NORMALLY OCCUPIED

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15900 SHT01	600G	0801

NOTES

1. FIRE EXTINGUISHER SPECIFICATIONS

GENERAL:

CONFORM TO NATIONAL FIRE PROTECTION ASSOCIATION (NFPA): NO. 10 STANDARD FOR PORTABLE FIRE. EXTINGUISHERS.

A. PROVIDE HAND EXTINGUISHER FOR THE ELECTRICAL ROOM THAT MEETS THE FOLLOWING REQUIREMENTS:

1. CARBON DIOXIDE.
2. PRESSURIZED, RED ENAMELED STEEL SHELL CYLINDER.
3. ACTIVATED BY TOP SQUEEZE HANDLE.
4. AGENT PROPELLED THROUGH HOSE AND SPREADER NOZZLE.
5. FOR USE ON B AND C CLASS FIRES.
6. MINIMUM UL RATING: 10B:C, 15–POUND CAPACITY.

B. PROVIDE HAND EXTINGUISHER FOR THE METER ROOM THAT MEETS THE FOLLOWING REQUIREMENTS:

1. TRI–CLASS DRY CHEMICAL EXTINGUISHING AGENT.
2. PRESSURIZED, RED ENAMELED STEEL SHELL CYLINDER.
3. ACTIVATED BY TOP SQUEEZE HANDLE.
4. AGENT PROPELLED THROUGH HOSE AND SPREADER NOZZLE.
5. FOR USE ON A, B, AND C CLASS FIRES.
6. MINIMUM UL RATING: 4A–60B:C, 10–POUND CAPACITY.

FURNISH HEAVY–DUTY BRACKETS WITH CLIP–TOGETHER STRAP FOR WALL MOUNTING.

EXECUTION:

PROVIDE AT LOCATIONS SHOWN OR AS DIRECTED BY CONTRACTOR.

MOUNT HANGERS SECURELY IN POSITION, FOLLOWING MANUFACTURER'S RECOMMENDATIONS.

TOP OF EXTINGUISHER: NO MORE THAN 54–INCHES ABOVE FLOOR.

2. BLDG TYPICAL (4 PLACES) FOR CELLS 7/8 & 9/10.

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

DAVID A. MIELSON — STATE OF WASHINGTON — 36592 — REGISTERED PROFESSIONAL ENGINEER — 9/28/07 — EXPIRES 9/28/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	CHKG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	BR	MF	MF	RW	NKP	

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC.
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7–10
CREST PAD BLDG – PLANS AND ELEVATIONS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDA0014.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-A0014	0

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-A0015	0

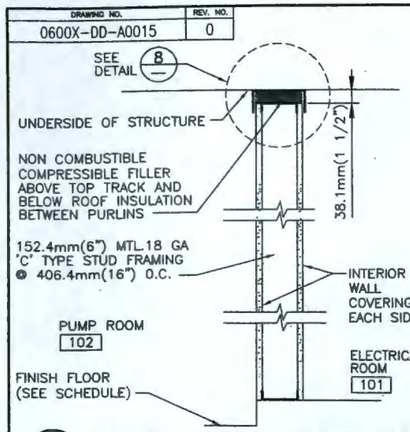

A METAL STUD PARTITION
0600X-DD-A0014
NTS

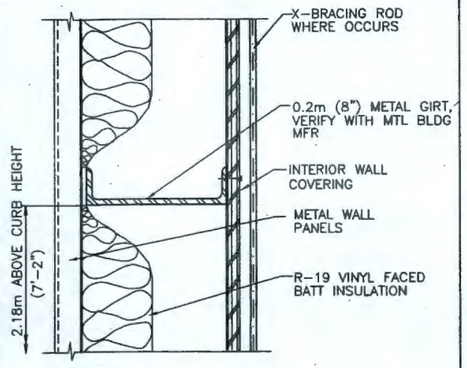

B TYPICAL WALL DETAIL AT WALL COVERING
0600X-DD-A0014
NTS

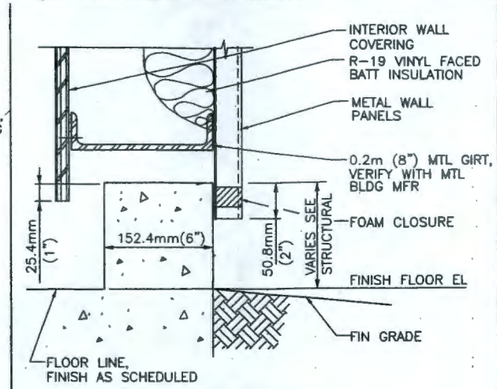

C TYPICAL WALL DETAIL AT METER RM
0600X-DD-A0014
NTS

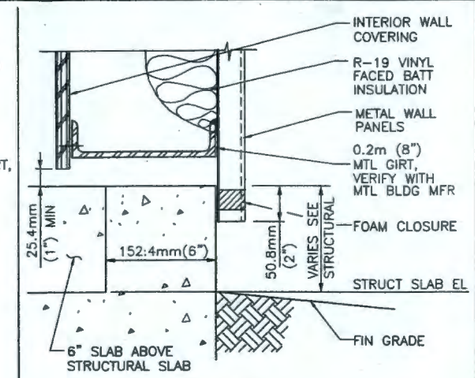

D TYPICAL WALL DETAIL AT ELEC. RM
0600X-DD-A0014
NTS

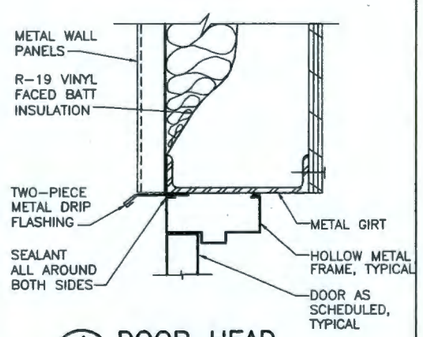

1 DOOR HEAD
0600X-DD-A0017
NTS

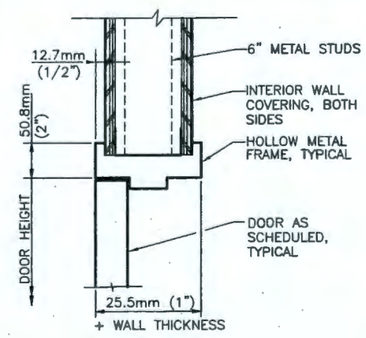

2 DOOR HEAD
0600X-DD-A0017
NTS

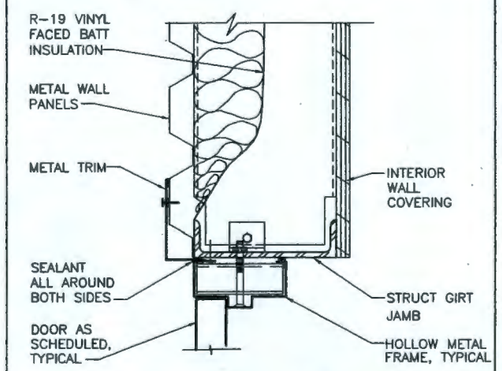

3 DOOR JAMB
0600X-DD-A0017
NTS

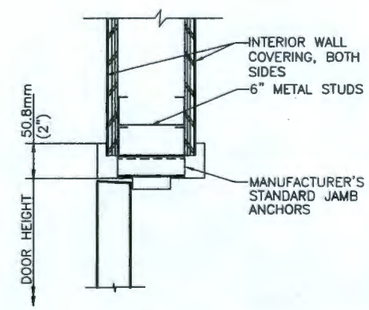

4 DOOR JAMB
0600X-DD-A0017
NTS

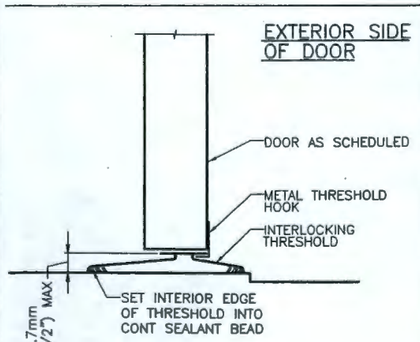

5 DOOR SILL
0600X-DD-A0017
NTS

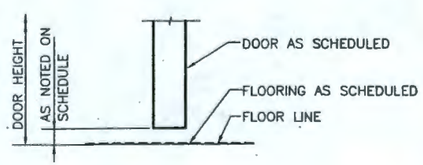

6 DOOR SILL
0600X-DD-A0017
NTS

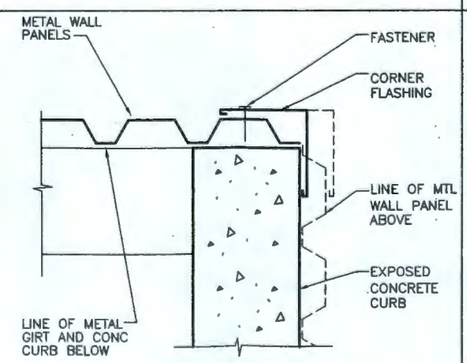

PLAN

7 CORNER DETAIL
0600X-DD-A0017
NTS

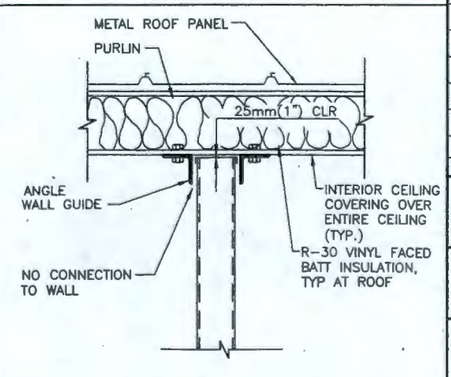

8 DETAIL
0600X-DD-A0017
NTS

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15901 SHT01	600G	0801

NOTES

1. ALL EXTERIOR METAL TRIM AND FLASHING SHALL BE FACTORY FINISHED IN COLOR MATCHING WALL PANELS AND PROVIDED BY METAL BUILDING MANUFACTURER.
2. METAL BUILDING MANUFACTURER SHALL PROVIDE TRIM AND FLASHING IN CONFIGURATIONS THAT ALLOW FOR THERMAL MOVEMENT.

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1 ☒ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3 ☐ Revise and resubmit. Work may proceed prior to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

SUPPLIER/SUBCONTRACTOR																			
WCH ACCEPT						✓													
REVISION NO.						88													

Paul Boelaug 10/9/07
DOCUMENT ID NUMBER
0600X-SC-G05211 09-19 060
SCOPE NO. | WBS ITEM | SUBMITTAL
500X5240A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mke 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

DAVID E. NIELSON — STATE OF WASHINGTON — 28592 — REGISTERED PROFESSIONAL ENGINEER — 10/4/07
EXPIRES 9/23/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	B.R.	MF	MF	RW	NLA	DN

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 -10
ARCHITECTURAL DETAILS - 1

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDA0015.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-A0015	0

RIVER CORRIDOR CLOSURE CONTRACT
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-A0016	0

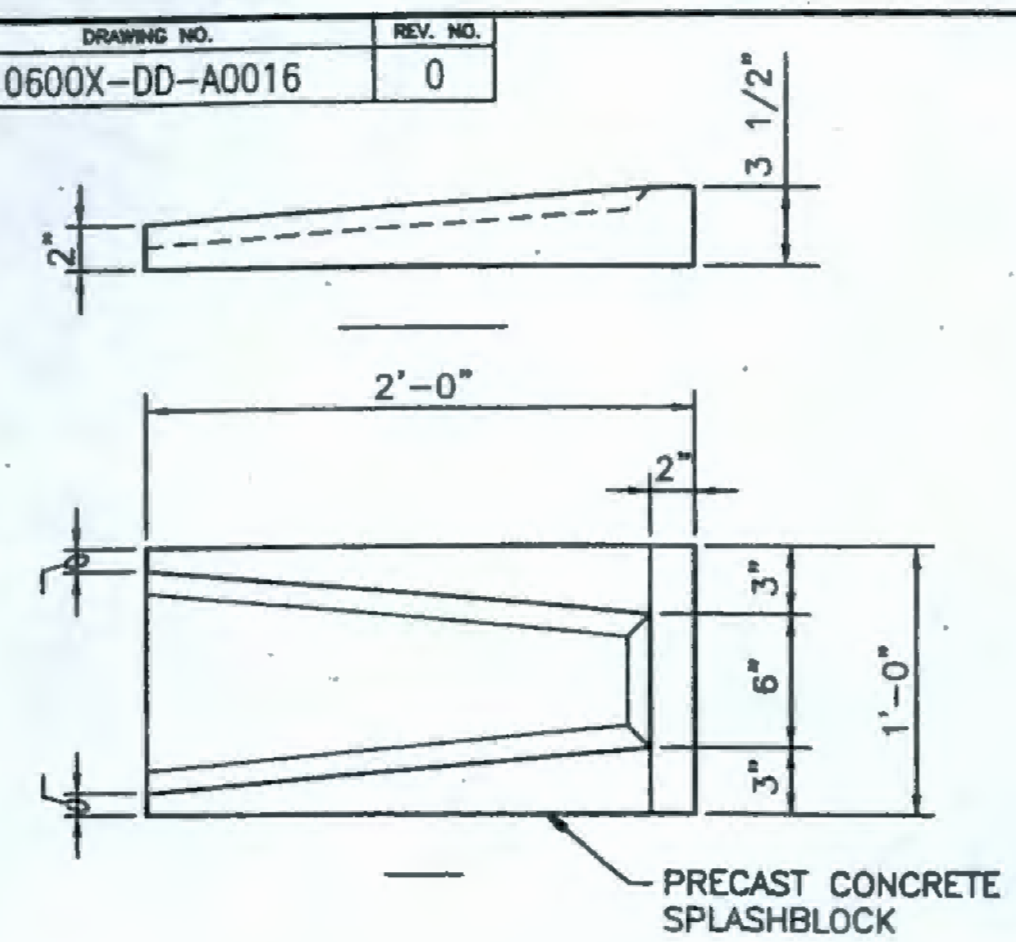

9 SPLASHBLOCK
0600X-DD-A0014
NTS

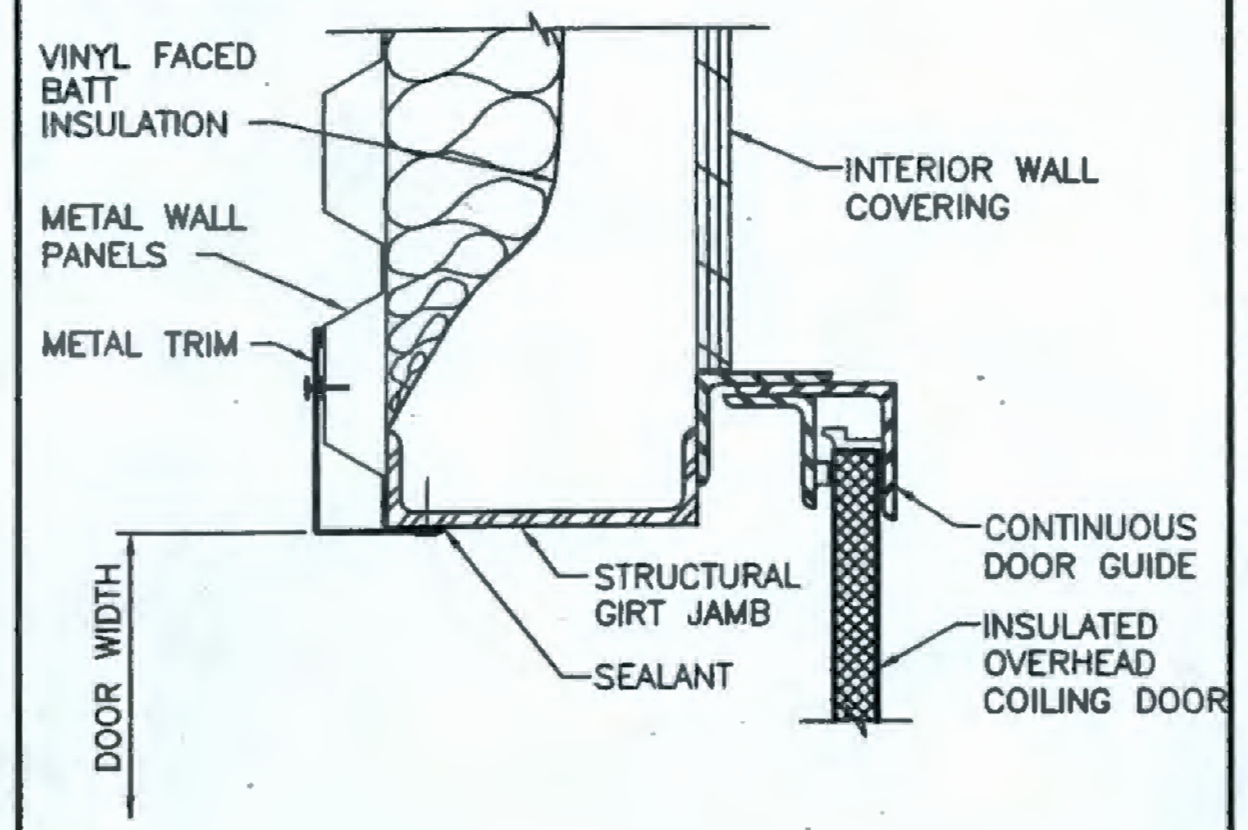

10 OVERHEAD COILING DOOR JAMB
0600X-DD-A0017
NTS

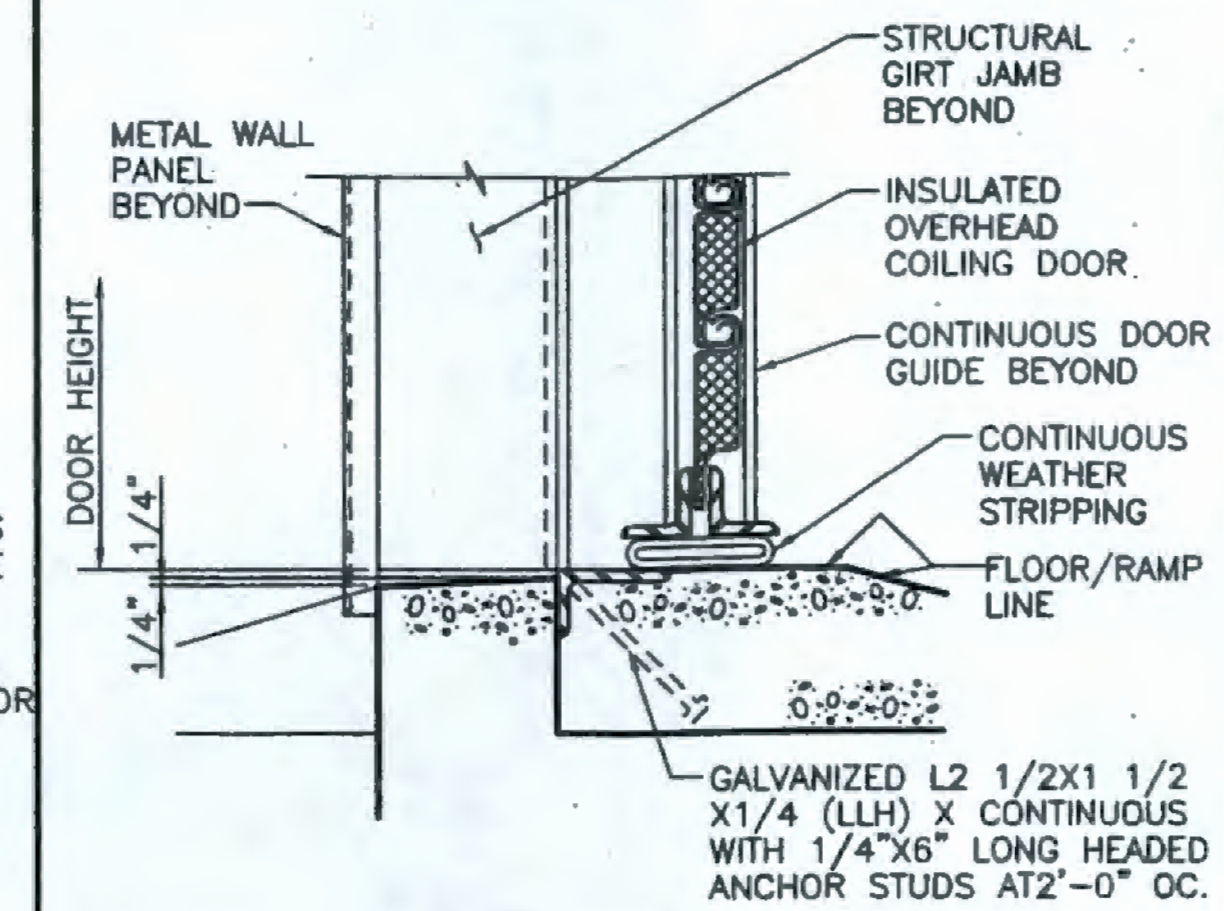

11 OVERHEAD COILING DOOR SILL
0600X-DD-A0017
NTS

NOTES

1. ALL EXTERIOR METAL TRIM AND FLASHING SHALL BE FACTORY FINISHED IN COLOR MATCHING WALL PANELS AND PROVIDED BY METAL BUILDING MANUFACTURER.
2. METAL BUILDING MANUFACTURER SHALL PROVIDE TRIM AND FLASHING IN CONFIGURATIONS THAT ALLOW FOR THERMAL MOVEMENT.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bru Borlaug 10/9/07
0600X-SC-G0524 0579 061
SCP.O. No. — SSRS ITEM — SUBMITTAL

500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

EXPIRES 9/22/08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	BR	MF	MF	RW	NIA	

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON
WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7-10
ARCHITECTURAL DETAILS - 2

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDA0016.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-A0016	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15902 SHT01	600G	0801

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

DRAWING NO.	REV. NO.
0600X-DD-A0017	0

DOOR AND FRAME TYPES

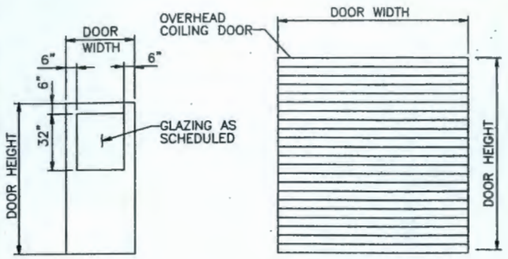

G OCD

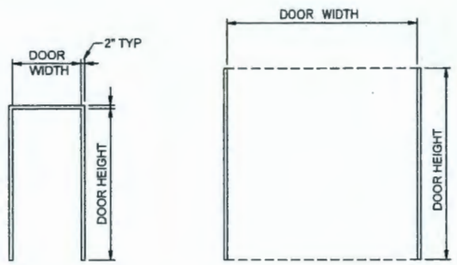

F-1 F-2

INTERIOR FINISH SCHEDULE

ABBREVIATIONS:

AL	ALUMINUM	HGT	HEIGHT
AS	AS SELECTED	INSUL	VINYL FACED BATT INSULATION
CLR	CLEAR	MATL	MATERIAL
COL	COLOR	MET	METAL
CONC	CONCRETE	MSG	MANUFACTURER'S STANDARD
EXP	EXPOSED STRUCTURE	HDNR	CLEAR FLOOR HARDENER
FCTY	FACTORY	WD	WOOD
FNSH	FINISH		

NOTES:

1. NUMBERS IN FINISH COLUMN REFER TO PAINT SYSTEMS IN TECHNICAL SPECIFICATION FOR COATINGS AND FINISHES
2. CODES IN COL COLUMN REFER TO COLOR LIST ON THIS SHEET.
3. FOR EXTERIOR FINISHES AND COLORS, SEE THIS SHEET AND ELEVATION DRAWINGS.
4. REFER TO TECHNICAL SPECIFICATION FOR REINFORCED CONCRETE FOR SCHEDULE OF CONCRETE FINISHES.
5. INTERIOR WALLS AND CEILING SHEATHED FULL HEIGHT WITH INTERIOR WALL AND CEILING COVERING.
6. CONCRETE CURB VARIES IN HEIGHT, SEE STRUCTURAL DRAWINGS.
7. PAINT MISCELLANEOUS METALS WITH PS-5, COLOR P-3.
8. PLYWOOD AT EXTERIOR WALLS TO BE FULL HEIGHT ABOVE CONCRETE CURB ELEV.

SPACE		FLOOR			BASE					TYPICAL WALL			OTHER WALL				CEILING				MISC.
NO.	NAME	SUB FL	FNSH	COL	HGT	MATL	FNSH	COL	WALLS	MATL	FNSH	COL	WALL	MATL	FNSH	COL	HGT	MATL	FNSH	COL	
CREST PAD BUILDING																					
101	ELECTRICAL ROOM	CONC	HDNR	CLR	--	--	--	--	--	NOTE 5	PS-2	P-3	NOTE 5	NOTE 5	PS-2	P-3	VARIES	NOTE 5	PS-2	P-3	NOTE 7 NOTE 8
102	METER ROOM	CONC	PS-6	P-1	NOTE 6	CONC	PS-6	P-3	ALL	NOTE 5	PS-2	P-3	NOTE 5	NOTE 5	PS-2	P-3	VARIES	NOTE 5	PS-6	P-3	NOTE 7 NOTE 8

DOOR AND HARDWARE SCHEDULE

ABBREVIATIONS:

AL	ALUMINUM	HM	HOLLOW METAL
AS	AS SELECTED	MATL	MATERIAL
COL	COLOR	MET	METAL
FCTY	FACTORY	TG	TEMPERED GLASS
FNSH	FINISH		

NOTES:

1. NUMBERS IN "FNSH" COLUMN REFER TO PAINT SYSTEMS IN TECHNICAL SPECIFICATION FOR COATINGS AND FINISHES.
2. CODES ON "COL" COLUMN REFER TO COLOR LIST ON THIS SHEET
3. FOR GLASS TYPES AND HARDWARE SETS REFER TO TECHNICAL SPECIFICATION FOR CREST PAD BUILDING.
4. METAL BUILDING MANUFACTURER'S STANDARD.
5. FOR DOOR DETAILS SEE DRAWING 0600X-DD-A0015 AND 0600X-DD-A0016.
6. PROVIDE NAMEPLATES ON EACH SIDE OF DOOR. MESSAGE TEXT TO MATCH ROOM NAME IN INTERIOR FINISH SCHEDULE. REFER TO TECHNICAL SPECIFICATION FOR CREST PAD BUILDING.

OPENING															HARDWARE SET	FIRE PROTECTION RATING	OTHER REQUIREMENTS
	DOOR SIZE		DOOR					FRAME				DETAILS					
NO.	WIDTH	HEIGHT	CONSTR	TYPE	GLASS	FNSH	COL	MATL	TYPE	FNSH	COL	HEAD	JAMB	SILL	NO.		
CREST PAD BUILDING																	
101A	3'-0"	7'-0"	HM	G	TG	PS-5	P-2	HM	F-1	PS-5	P-2	1	3	5	HDW-1	--	--
101B	3'-0"	7'-0"	HM	G	TG	PS-5	P-2	HM	F-1	PS-5	P-2	2	4	6	HDW-2	--	NOTE 6
102A	3'-0"	7'-0"	HM	G	TG	PS-5	P-2	HM	F-1	PS-5	P-2	1	3	5	HDW-1	--	NOTE 6
102B	12'-0"	12'-0"	MET	OCD	—	PS-5	P-2	MET	F-2	PS-5	P-2	NOTE 4	10	11	HDW-3	--	--

EXTERIOR FINISH SCHEDULE

ITEM / MATERIAL	FINISH	COLOR
PREFINISHED METAL WALL PANEL	FCTY	M-1
PREFINISHED METAL ROOF PANEL	FCTY	M-2
CAST-IN-PLACE CONCRETE	AS SPECIFIED	NATURAL GRAY
PREFINISHED GUTTER AND DOWNSPOUTS	FCTY	M-1

LOUVER SCHEDULE

ABBREVIATIONS:

DB DRAINABLE BLADE

NOTES:

1. METAL BUILDING MANUFACTURER'S STANDARD DETAIL.
2. PROVIDE SELF-CLOSING DAMPER

OPENING			LOUVER				DETAILS			OTHER REQUIREMENTS
NO.	WIDTH	HEIGHT	TYPE	MATL	FNSH	COL	HEAD	JAMB	SILL	
L-1	2'-0"	2'-0"	DB	AL	FCTY	O-1	NOTE 1			SILL AT 10'-6" AFF, NOTE 2
L-2	2'-0"	2'-0"	DB	AL	FCTY	O-1	NOTE 1			SILL AT 10'-6" AFF, NOTE 2
L-3	2'-0"	2'-0"	DB	AL	FCTY	O-1	NOTE 1			SILL AT 10'-6" AFF, NOTE 2
L-4	2'-0"	2'-0"	DB	AL	FCTY	O-1	NOTE 1			SILL AT 10'-6" AFF, NOTE 2

COLOR LIST

NOTES:

1. COLOR SELECTIONS FOR THIS PROJECT MAY BE NOTED IN DOOR AND HARDWARE SCHEDULE, INTERIOR FINISH SCHEDULE, EXTERIOR FINISH SCHEDULE, AND ON THE DRAWINGS, BY THE LETTER-NUMBER COMBINATION IN THE IN THE MARK COLUMN OF THE LIST.
2. SOME COLOR SELECTIONS MAY BE MADE IN VARIOUS SPECIFICATION SECTIONS.
3. USE ONLY THE COLORS NOTED OR SCHEDULED. IF A COLOR SELECTION IS NOT MADE, REQUEST ONE FROM CONTRACTOR.

MARK	ITEM	MANUFACTURER	COLOR	OTHER REQUIREMENTS
P	PAINTING			
P-1	PAINT (FLOOR)	AS SPECIFIED	STANDARD GRAY	MATCH EXISTING CREST PAD BUILDINGS
P-2	PAINT (DOORS AND FRAMES)	AS SPECIFIED	AS SELECTED	
P-3	PAINT	AS SPECIFIED	AS SELECTED	
M	MISCELLANEOUS			
M-1	PREFINISHED METAL WALL PANELS, GUTTERS & DOWNSPOUTS	METAL BUILDING MFR	LIGHT BRONZE	MATCH EXISTING CREST PAD BUILDINGS
M-2	PREFINISHED METAL ROOF PANELS	METAL BUILDING MFR	LIGHT BRONZE	MATCH EXISTING CREST PAD BUILDINGS
M-3	VINYL FACED BATT INSULATION	METAL BUILDING MFR	WHITE	
O	OPENING			
O-1	LOUVER	METAL BUILDING MFR	LIGHT BRONZE	MATCH EXISTING CREST PAD BUILDINGS

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15903 SHT01	600G	0801

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

NOTES

1. ALL SCHEDULES APPLY TO BOTH CREST PAD BUILDINGS.
2. ALL COLOR SELECTIONS SHALL BE VERIFIED BY CONTRACTOR PRIOR TO PURCHASE AND INSTALLATION OR APPLICATION OF MATERIAL.

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1 ☒ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmission.
3 ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Dave Bartholomew 10/9/07
DISPOSITION BY | DATE
0600X-SC-G0529 0519 063
SCPO NO. | SUBS ITEM | SUBMITTAL

SCOPE OF REVIEW | REVISION

5 00X 524 A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

DAVID B. MILLSOP — STATE OF WASHINGTON — 38892 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES 9/23/2008

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	DSG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	BR	MF	MF	RW	NK	

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
FINISH SCHEDULES

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDA0017.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-A0017	0

DRAWING NO.	REV. NO.
0600X-DD-E0104	0

PLAN

- GROUND BUS
- EXPOSED CONDUIT
- CONDUIT CONCEALED ABOVE FLOOR.
- CONDUIT RUN UNDERGROUND OR IN CONCRETE
- EXPOSED CONDUIT RUN BEHIND OBSTRUCTION
- BARE COPPER GROUND TO GROUND WIRE IN SLAB, OR UNDERGROUND GROUND GRID, SIZE AS NOTED.
- UNDERGRDUND TELEMETRY CONDUIT
- LP-T1-1, 3, 5 — HOME RUN TO PANEL "LP-T1", CIRCUITS #1, 3, 5. CONDUCTORS SHALL BE NO. 12 UNLESS OTHERWISE NOTED. CONDUIT SHALL BE 3/4", UNLESS OTHERWISE NOTED. CONDUIT SIZES NOT IDENTIFIED SHALL BE 3/4" MINIMUM WITH 2#12, 1#12G. G INDICATES GROUND WIRE.
- T — TELEPHONE CONDUIT ONLY. "UNLESS OTHERWISE NOTED".
- CONDUIT RUN – CHANGE IN ELEVATION
- CONDUIT BENDS TOWARD OBSERVER
- CONDUIT BENDS AWAY FROM OBSERVER
- CONDUIT CAPPED, OR SEALED
- FLEXIBLE LIQUID – TIGHT CONDUIT CONNECTION
- C135 — INDICATES CONDUIT NUMBER
- 2a — CEILING OR PENDANT INCANDESCENT, HIGH PRESSURE SODIUM, OR SIMILAR LAMP LUMINAIRE. "2" INDICATES CIRCUIT NUMBER. "a" INDICATES LUMINAIRE CONTROLLED BY SWITCH "a".
- WALL BRACKET INCANDESCENT, HIGH PRESSURE SODIUM, OR SIMILAR LAMP LUMINAIRE WITH EXPOSED BACK BOX AND CONDUIT.
- WALL BRACKET FLOOD OR SPOTLIGHT WITH CONCEALED BACK BOX AND CONDUIT.
- POLE MOUNTED LUMINAIRE DISTRIBUTION TYPE AS INDICATED ON PLAN
- A 2/34 3 — LUMINAIRE TYPE A. 2-34 WATT LAMPS 3 – NUMBER OF TYPE "A" FIXTURES
- FLUORESCENT LUMINAIRE, UNSWITCHED (SWITCHED AT LIGHTING PANEL ONLY)
- E — FLUORESCENT LUMINAIRE ON EMERGENCY CIRCUIT
- FLUORESCENT LUMINAIRE
- BATTERY EMERGENCY LUMINAIRE
- S_a — SINGLE POLE SWITCH. "a" INDICATES CIRCUIT CONTROLLED
- S_2 — DOUBLE POLE SWITCH
- S_3 — THREE-WAY SWITCH
- S_4 — FOUR-WAY SWITCH
- S_K — KEY-OPERATED SWITCH
- S_P — SWITCH AND PILOT LIGHT
- S_M — MANUAL MOTOR STARTER

WALL · FLOOR

- 120V SINGLE RECEPTACLE, NEMA CONFIGURATION 5-20.
- 120V DUPLEX RECEPTACLE, NEMA CONFIGURATION 5-20

River Corridor Closure Contract — Dedicated To Safety Excellence

- 240V SINGLE RECEPTACLE, NEMA CONFIGURATION 6-20
- WELDING RECEPTACLE, 100A, 2W, 3P MOUNT 42" ABOVE FLOOR
- SINGLE SPECIAL PURPOSE RECEPTACLE 480 VAC
- C — CLOCK HANGER RECEPTACLE
- LIGHTING PANEL
- POWER PANEL
- MOTOR CONTROL CENTER
- FLOOR TYPE TELEPHONE OUTLET
- PUBLIC TELEPHONE SYSTEM DEVICE
- PRIVATE TELEPHONE (ANY TYPE) SYSTEM DEVICE
- DISCONNECT SWITCH
- MOTOR STARTER
- M — MOTOR
- SS — PUSHBUTTON STATION "SS" START-STOP, "LOS" LOCKOUT-STOP, "SLOS" START-LOCKOUT-STOP
- JB — RACEWAY BOX "HH" HANDHOLE "JB" JUNCTION BOX "PB" PULLBOX "TB" TERMINAL BOX
- J — JUNCTION BOX OR FITTING
- PSL-1 — FIELD INSTRUMENT I.E. "PSL" PRESSURE SWITCH, "LSH" LEVEL SWITCH, "SV" SOLENOID VALVE
- SV — SOLENOID VALVE
- T — THERMOSTAT
- H — HEATER
- HORN
- 1 — DENOTES REFERENCE TO NOTE 1 I.E. – " SEE NOTE 1 "
- GROUND ROD 3/4" x 10" – 0" (UNLESS OTHERWISE NOTED)
- GROUND ROD AND GROUND TEST WELL
- GROUND CONNECTION BOLTED TYPE
- GROUND CONNECTION – EXOTHEMIC TYPE
- M — MOTOR OPERATED VALVE

ONE LINE DIAGRAM

- BUS
- 2 — ACROSS-THE-LINE, NON-REVERSING NEMA SIZE 2 MAGNETIC STARTER
- 30A — CONTACTOR, SIZE AS NOTED
- 50A — MOLDED CASE CIRCUIT BREAKER, 3 POLE UNLESS OTHERWISE NOTED: 50A.-TRIP RATING IN AMPERE NA- NON-AUTOMATIC MCP – MOTOR CIRCUIT PROTECTOR AT-TRIP RATING (125 AMPS NOTED)
- OR
- 225AF 125AT
- 52 — MEDIUM OR HIGH VOLTAGE DRAWOUT BREAKER
- DRAWOUT BREAKER, SIZE AS NOTED EO – DENOTES ELECTRICALLY OPERATED
- MEDIUM OR HIGH VOLTAGE STARTER
- SURGE ARRESTOR
- 10 — MOTOR – 10 HP NOTED

- 480/120V — TRANSFORMER WITH GROUNDED SECONDARY, KVA SIZE & VOLTAGE RATIO AS NOTED.
- PT (2) — POTENTIAL TRANSFORMER, RATIO AND NUMBER OF PT'S AS NOTED
- CT 100/5 (3) — CURRENT TRANSFORMER, RATIO AND NUMBER OF CT'S AS NOTED
- I — ELECTRICAL INTERLOCK
- ELECTRICAL ENCLOSURE OUTLINE
- MOV — ELECTRICAL MOTOR OPERATED VALVE, WITH INTEGRAL REVERSING STARTER
- DISCONNECT SWITCH, SIZE AS NOTED
- FUSED DISCONNECT SWITCH
- 10 KVAR — CAPACITOR, KVAR AS NOTED
- KWH DM — KILOWATTHOUR METER WITH DEMAND REGISTER
- AM — AMMETER
- VM — VOLTMETER
- PF — POWER FACTOR METER
- VAR — VARMETER
- AS — AMMETER SWITCH
- VS — VOLTMETER SWITCH

SCHEMATIC DIAGRAM

- CONTROL RELAY OR COIL
  - EXAMPLE: TD2 TIME DELAY RELAY NO. 2; CR1 CONTROL RELAY; 1M STARTER NO. 1 MAIN COIL
- N.O. CONTACT
- N.C. CONTACT
- TORQUE SWITCH (SPECIFY WHEN OPEN)
- NORMALLY OPEN LIMIT SWITCH
- NORMALLY CLOSED LIMIT SWITCH
- FLOAT TYPE LIQUID LEVEL SWITCH, CLOSING ON RISING LEVEL
- FLOAT TYPE LIQUID LEVEL SWITCH, OPENING ON RISING LEVEL
- VACUUM OR PRESSURE SWITCH, CLOSING ON RISING PRESSURE
- VACUUM OR PRESSURE SWITCH, OPENING ON RISING PRESSURE
- TEMPERATURE ACTUATED SWITCH; CLOSING ON RISING TEMPERATURE
- TEMPERATURE ACTUATED SWITCH; OPENING ON RISING TEMPERATURE
- FLOW SWITCH (AIR, WATER, ETC.); CLOSING ON FLOW INCREASE
- FLOW SWITCH (AIR, WATER, ETC.); OPENING ON FLOW INCREASE
- NORMALLY OPEN PUSHBUTTON, MOMENTARY CLOSE
- NORMALLY CLOSED PUSHBUTTON, MOMENTARY OPEN

- NO/NC MAINTAINED PUSHBUTTON
- ON OFF — TWO-POSITION SELECTOR SWITCH: H-HAND, M-MANUAL, R-REMOTE, L-LOCAL, A-AUTOMATIC, O-OFF
- H O A — THREE-POSITION SELECTOR SWITCH. (SAME AS ABOVE)
- THREE-POSITION SPRING RETURN-TO-CENTER MOMENTARY CONTACT SWITCH ("LATCH-UNLATCH," "ON-OFF," ETC.)
- SINGLE POLE TOGGLE SWITCH ("ON-OFF", ETC.)
- OL — OVERLOAD RELAY CONTACTS (MAGNETIC)

TIMED CONTACTS – CONTACT ACTION DELAYED AFTER COIL IS:

ENERGIZED

- NORMALLY OPEN WITH TIME DELAY CLOSING
- NORMALLY CLOSED WITH TIME DELAY OPENING

DE-ENERGIZED

- NORMALLY OPEN WITH INSTANT CLOSING AND TIME DELAY OPENING
- NORMALLY CLOSED WITH INSTANT OPENING AND TIME DELAY CLOSING
- MANUAL MOTOR STARTER WITH OVERLOAD PROTECTION
- FUSE
- RES — RESISTOR (FIXED) POTENTIOMETER TYPE
- RESISTOR (CONTINUOUSLY ADJUSTABLE)
- R — PUSH-TO-TEST INDICATING LIGHT
- ETM — ELAPSED TIME METER
- HEATER
- CROSSING OF CONDUCTORS-NOT CONNECTED
- CONNECTION OF CONDUCTORS, FITTING AS REQUIRED
- DISCONNECT SWITCH
- GROUND CONNECTION
- SURGE SUPPRESSOR
- ELECTRICAL CORD CONNECTOR
- G — INDICATING LIGHT G – GREEN, R – RED, A – AMBER
- I/I — SIGNAL ISOLATOR
- M — MOTOR

NOTES:

1. THIS IS A STANDARD LEGEND SHEET. SOME SYMBOLS OR ABBREVIATIONS MAY APPEAR ON THIS DRAWING AND NOT ON THE PLANS.
2. FOR ADDITIONAL ABBREVIATIONS OF OTHER DIVISIONS, SEE OTHER LEGENDS.

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15904 SHT01	600G	8802

NOTES

WASHINGTON CLOSURE HANFORD — JOB NO. 14655 — SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Paul DeBlanke 10/9/07

DOCUMENT NUMBER: 0600X-SC-G0524 05-19 063

SOCX524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mse 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRILL — STATE OF WASHINGTON — 12322 — REGISTERED PROFESSIONAL ENGINEER — EXPIRES: 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CK'R	ORIG/ ENG'R	ENG'R CK'R	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	BEM	JD	RMM	RD	N/A	TFB

SCALE: NA

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 -10
ELECTRICAL SYMBOLS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0104.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0104	0

DRAWING NO.	REV. NO.
0600X-DD-E0105	0

A B B R E V I A T I O N S

A	AMPERE, AUTO, AMMETER, AMP
AC	ALTERNATING CURRENT
A/C	AIR CONDITIONING
AF	AMPERE FRAME SIZE OF CKT. BREAKERS
AFF	ABOVE FINISHED FLOOR
AL	ALUMINUM
AM	AMMETER
ANN	ANNUNCIATOR
AMP	AMPERES, AMPERAGE
APPR	APPROVED
AS	AMMETER SWITCH, ADJUSTABLE SPEED
AT	AMPERE TRIP
ATS	AUTOMATIC TRANSFER SWITCH
AUTO	AUTOMATIC
AWG	AMERICAN WIRE GAUGE
BATT	BATTERY
BKR	BREAKER
BBL	BUBBLER
BLDG	BUILDING
C	CONDUIT, CLOSED
CAB	CABINET
CB	CIRCUIT BREAKER
CKT	CIRCUIT
CO	CONDUIT ONLY
COND	CONDUIT
COMPT	COMPARTMENT
COMPR	COMPRESSDR
CP	CONTROL PANEL
CPT	CONTROL POWER TRANSFORMER (IN INDIVIDUAL STARTER CUBICLE)
CR	CONTROL RELAY (MAGNETICALLY HELD)
CT	CURRENT TRANSFORMER
CU	COPPER
DC	DIRECT CURRENT
DH	DATA HIGHWAY
DISC	DISCONNECT
DISTR	DISTRIBUTION
DPDT	DOUBLE POLE DOUBLE THROW
DWG	DRAWING
E	EMPTY, EMERGENCY
ELEV	ELEVATION
EMERG	EMERGENCY
EMT	ELECTRICAL METALLIC TUBING
ENCL	ENCLOSURE
EP	EXPLOSION PROOF
EQPT	EQUIPMENT
ER	CONDUCTANCE LEVEL RELAY
ETM	ELAPSED TIME METER
EXH	EXHAUST
EXIST	EXISTING
FI	FLOW INDICATOR
F, ~	FREQUENCY
FDR	FEEDER
FLEX	FLEXIBLE
FLUOR	FLUORESCENT
FM	FREQUENCY METER
FUT	FUTURE
FVR	FULL VOLTAGE REVERSING
FVNR	FULL VOLTAGE NON-REVERSING
FWD	FORWARD CONTACTOR COIL
GALV	GALVANIZED
GEN	GENERATOR

HIGH	HIGH SPEED CONTACTOR
HOA	HAND - OFF - AUTOMATIC
HP	HORSE POWER
HPS	HIGH PRESSURE SODIUM
HTR	HEATER
HVAC	HEATING VENTILATION AIR CONDITIONING
HZ	HERTZ
INCAND	INCANDESCENT
IND	INDICATION (SYSTEM)
I/O	INPUT/OUTPUT
INST	INSTANTANEOUS (TD CONTACT)
INSTR	INSTRUMENT
Isc	SHORT CIRCUIT CURRENT, AMPS
J BOX	JUNCTION BOX
JB	JUNCTION BOX
KCMIL	ONE THOUSAND CIRCULAR MILLS
KVA	KILO (1000) VOLT AMPS
KW	KILOWATTS
KWH	KILOWATT HOUR
LC	LIGHTING CONTACTOR
LCB	LOCAL CONTROL BOARD
LCP	LOCAL CONTROL PANEL
LOC	LOCAL
LOS	PUSHBUTTON W/"LOCK-OUT-STOP"
LS	LEVEL SWITCH
LT, LTS	LIGHT, LIGHTS
LTG	LIGHTING
LOW	LOW SPEED CONTACTOR
M	MOTOR CONTACTOR COIL, MOTOR
MA	MILLIAMPS
MAN	MANUAL
MAG	MAGNETIC
MAX	MAXIMUM
MCC	MOTOR CONTROL CENTER
MCB	MAIN CONTROL BOARD
MCP	MOTOR CIRCUIT PROTECTOR
MD	MOTORIZED DAMPER
MH	MANHOLE
MIN	MINUTES, MINIMUM
MLO	MAIN LUGS ONLY
MOV	MOTOR OPERATED VALVE
MS	MANUAL MOTOR STARTER
MT, MTD	MOUNT, MOUNTED
MTR	MOTOR
MUX	MULTIPLEXING PANEL
N	NEUTRAL
NA	NON-AUTOMATIC
NC	NORMALLY CLOSED
NO, NOS	NUMBER, NUMBERS, NORMALLY OPEN
NP	NAMEPLATE
NEC	NATIONAL ELECTRICAL CODE
NIC	NOT IN CONTRACT
NITS	NOT IN THIS SECTION
NTS	NOT TO SCALE
O	OPEN
OC	ON CENTER
CC	CENTER TO CENTER
OL	OVERLOAD RELAY
P	POLE
PB	PUSHBUTTON, PULLBOX
PCM	PROCESS CONTROL MODULE
PCP	PROCESS CONTROL PANEL
PF	POWER FACTOR
PH	PHASE
PNL	PANEL
PNLBD	PANELBOARD

POS	POSITION
POT	POTENTIOMETER
PRI	PRIMARY
PS	PRESSURE SWITCH
PT	POTENTIAL TRANSFORMER
PVC	POLYVINYL CHLORIDE
PW	PART WINDING
PWR	POWER
REC	RECEPTACLE
RECPTS	RECEPTACLES
REQ'D	REQUIRED
REV	REVERSE CONTACTOR COIL
RGS	RIGID GALVANIZED STEEL
RUN	RUN CONTACTOR COIL
RTU	REMOTE TERMINAL UNIT
RVAT	REDUCED VOLTAGE AUTO-TRANSFORMER
RVNR	REDUCED VOLTAGE NON-REVERSING
SCH	SCHEDULE
SEC	SECONDS, SECONDARY
SECT	SECTION
SEL SW	SELECTOR SWITCH
SEQ	SEQUENCE
SHLD	SHIELDED
SHT	SHEET
SIG	SIGNAL
S1, S2	START CONTACTOR COILS
SP	SPARE
SPDT	SINGLE POLE DOUBLE THROW
SPECS	SPECIFICATIONS
SP HTR	SPACE HEATER
SPST	SINGLE POLE SINGLE THROW
ST, SH	SHUNT TRIP
STA	STATION
STD	STANDARO
STL	STEEL
STR	STARTER
SV	SOLENOID VALVE
SW	SWITCH
SYS	SYSTEM
T	TRANSFORMER
TB	TERMINAL BOX
TC	TIME CLOCK
TACH	TACHOMETER
TEMP	TEMPERATURE
TERM	TERMINAL
TH	THERMOSTAT
TM	REPEAT CYCLE TIMER
TD	TIME DELAY RELAY
TR	TIMER
TS	TEMPERATURE SWITCH
TYP	TYPICAL
UG	UNDERGROUND
UH	UNIT HEATER
US	UNIT SUBSTATION
UST	UNIT SUBSTATION TRANSFORMER
V	VOLTAGE, VOLTS
VAR	VAR METER
VFD	VARIABLE FREQUENCY DRIVE
VSD	VARIABLE SPEED DRIVE *(OTHER THAN VFD)*
VP	VAPORPROOF
VS	VARIABLE SPEED, VOLTMETER SWITCH
W	WATTS, WIRE
WHD	WATTHOUR DEMAND METER
WHM	WATTHOUR METER
WP	WEATHERPROOF
XD	TRANSDUCER
XFMR	TRANSFORMER
XMTR	TRANSMITTER

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

G E N E R A L N O T E S

RACEWAY

1. ALL CONDUIT AND CABLE RUNS ARE SHOWN DIAGRAMMATICALLY AND THEY SHALL BE ROUTED TO SUIT FIELD CONDITIONS.
2. THE SUBCONTRACTOR SHALL VERIFY EXACT LOCATION OF TERMINAL BOXES AND CONDUIT ENTRANCES OF ALL EQUIPMENT AGAINST SHOP DRAWINGS BEFORE STUBBING UP CONDUITS.
3. CONNECTION BETWEEN RIGID CONDUIT AND MOTOR TERMINAL BOX SHALL BE LIQUID TIGHT FLEXIBLE CONDUIT.
4. CONDUIT TERMINATING AT SWITCHBOARD, MOTOR CONTROL CENTER, POWER AND LIGHTING PANEL, CONTROL CABINET, ETC. SHALL BE EQUIPPED WITH GROUNDING BUSHING AND SHALL BE GROUNDED WITH NO. 6 GROUND WIRE.
5. INSTALL EXPANSION FITTINGS EVERY 200 FEET OF STRAIGHT RUN OF CONDUITS AND CABLE TRAYS.
6. CONDUIT FITTINGS AND SUPPORTS ARE NOT SHOWN ON THE DRAWINGS. THE SUBCONTRACTOR SHALL PROVIDE ALL FITTINGS AND SUPPORT REQUIRED TO SUIT THE CONDITIONS.
7. THE SUBCONTRACTOR SHALL LIMIT THE NUMBER OF BENDS TO (3)-90 DEGREES BETWEEN ALL POINTS.
8. THE SUBCONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL SLEEVES AND OPENINGS REQUIRED FOR THE PASSAGE OF ELECTRICAL RACEWAYS OR CABLES EVEN WHEN THESE OPENINGS OR SLEEVES ARE NOT SPECIFICALLY SHOWN ON THE DRAWINGS.
9. PROVIDE FLEXIBLE CONDUIT WHERE RIGID CONDUIT TERMINATES AT EQUIPMENT OR WHEN DEVICES ARE SUBJECT TO MOVEMENT FROM VIBRATION, EXPANSION OR CONTRACTION.
10. ALL UNDERGROUND CONDUIT RUNS SHALL BE WITH LONG RADIUS SWEEP BENDS. THE MINIMUM BENDING RADIUS SHALL BE 12 TIMES NOMINAL DIAMETER OF THE CONDUIT, AND NO FACTORY BENDS SHALL BE PERMITTED.
11. ALL UNDERGROUND CONDUITS NOT ENCASED IN CONCRETE SHALL BE PVC SCHEDULE 80, GALVANIZED, PVC COATED UNLESS OTHERWISE NOTED.
12. THE MINIMUM SIZE OF CONDUITS INSTALLED BELOW GRADE SHALL BE 25.4mm (1") UNLESS OTHERWISE NOTED.
13. THE MINIMUM SIZE OF CONDUIT INSTALLED ABOVE GRADE SHALL BE 19.05mm (3/4") UNLESS OTHERWISE NOTED.
14. ALL FLEXIBLE CONDUIT SHALL HAVE OUTER GROUNDING CONDUCTOR.
15. ALL SPARE OR UN-USED CONDUIT SHALL BE PROVIDED WITH A 3/8" NYLON PULL CORD.
16. ALL UNDERGROUND CONDUIT (EXCEPT SINGLE CONDUIT RUNS) SHALL BE CONCRETE ENCASED UNLESS NOTED OTHERWISE.

GROUNDING

1. ALL METALLIC STRUCTURES, METALLIC ENCLOSURES, AND ELECTRICAL EQUIPMENT, SUCH AS STRUCTURAL STEEL, METALLIC RACEWAY, FENCE, STAIR HANDRAILS, LIGHTING POLE, TANK, VESSELS, SWITCHING EQUIPMENT, PANEL, EQUIPMENT ENCLOSURE AND CABINETS GENERATOR, MOTOR, TRANSFORMER, SWITCHGEAR, ETC. SHALL BE PERMANENTLY AND EFFECTIVELY GROUNDED AND GROUND CONNECTION SHALL BE MADE TO THE PLANT GROUND GRID. THE GROUND CONDUCTOR SHALL BE SIZED PER N. E. C. UNLESS OTHERWISE SHOWN.
2. GROUNDING CONDUCTOR STUB-UP AND INSERT LOCATION ARE APPROXIMATE ONLY. THE SUBCONTRACTOR SHALL USE HIS BEST JUDGEMENT FOR CORRECT LOCATIONS IN FIELD.
3. ALL GROUND CONDUCTORS SHALL BE #4/0 SIZE UNLESS OTHERWISE NOTED.
4. ALL GROUND CONDUCTORS SHALL BE BARE, COPPER, STRANDED UNLESS OTHERWISE NOTED.
5. ALL GROUNDING CONDUCTORS SHALL BE MINIMUM OF 18" BELOW GRADE EXCEPT UNDER BUILDING SLAB WHEN THEY SHALL BE MINIMUM OF 6" BELOW SLAB.

WIRING

1. ALL WIRING SIZES SHALL BE AWG UNLESS OTHERWISE NOTED.

EQUIPMENT AND DEVICES

1. LOCATIONS OF EQUIPMENT, CONTROL DEVICES, INSTRUMENTS, BOXES, PANELS, ETC ARE APPROXIMATE ONLY, AND PROPER JUDGEMENT MUST BE EXERCIZED IN EXECUTING THE WORK TO INSURE THE BEST POSSIBLE INSTALLATION.
2. PACKAGE EQUIPMENT: SOME CONDUITS AND WIRES ARE SHOWN ON THE DRAWINGS, BUT IT IS EXPECTED THAT SOME ADDITIONAL CONDUITS AND WIRES MAY BE REQUIRED BY EQUIPMENT MANUFACTURERS TO COMPLETE INSTALLATION. IT IS INCUMBENT UPON THE CONTRACTOR TO COODINATE THIS REQUIREMENT TO MAKE SURE THAT EQUIPMENT SUPPLIER PROVIDES ALL NECESSARY ELECTRICAL INFORMATION. FOR INCLUSION OF COSTS IN BID PACKAGE. ALL NECESSARY MATERIALS AND LABOR TO COMPLETE ELECTRICAL INSTALLATION SHALL BE PROVIDED WHETHER SHOWN OR NOT SHOWN ON THE DRAWINGS. ALL ELECTRICAL WORK SHALL BE IN ACCORDANCE WITH ALL CODES AND STANDARDS PER SPEC. SECTIONS DIVISION 16.
3. ALL EQUIPMENT DIMENSIONS SHOWN ON PLANS AND ELEVATIONS ARE APPROXIMATE ONLY. THE SUBCONTRACTOR SHALL USE SHOP DRAWINGS FOR PROPER LAYOUT, FOUNDATION AND PAD, ETC. FOR FINAL INSTALLATION WITHOUT ANY ADDITIONAL COST TO THE CONTRACTOR.
4. SWITCHGEAR, SWITCHBOARD, MOTOR CONTROL CENTER AND ALL FREE STANDING PANELS SHALL BE SET ON CONCRETE PAD AND LEVELING CHANNELS EMBEDDED IN THE PAD UNLESS OTHERWISE NOTED.

SCHEMATIC DIAGRAMS

1. ALL CONTROLS ARE SHOWN DE-ENERGIZED IN ACCORDANCE WITH ANSI C37.2.
2. ALL CONTROL DIAGRAMS SHDW CONTROL FUNCTION ONLY. SUBCONTRACTOR SHALL INCORPORATE OTHER NECESSARY FUNCTIONS FOR PROPER OPERATIONS AND PROTECTION ON THE SYSTEM.
3. SLAVE RELAY SHALL BE ADDED WHERE REQUIRED TO PROVIDE ALL NECESSARY CONTACTS FOR THE SCHEMATIC DIAGRAMS SHOWN.
4. ALL DEVICES SHOWN ON MOTOR STARTER SCHEMATIC DIAGRAMS SHALL BE MOUNTED IN THE MOTOR STARTER CUBICLES UNLESS OTHERWISE NOTED.
5. ALL DEVICES SHOWN IN THE CONTROL PANEL OR CABINET SHALL BE MOUNTED IN THE CONTROL PANEL OR CABINET UNLESS OTHERWISE NOTED.
6. ALL MOTOR OPERATED VALVES ARE SHOWN FULLY OPEN.

MISCELLANEOUS

1. IN CASE OF INTERFERENCE BETWEEN ELECTRICAL EQUIPMENT SHOWN ON THE DRAWINGS AND THE OTHER EQUIPMENT, THE CONTRACTOR SHALL NOTIFY THE CONTRACTING OFFICER IN WRITING AND THE CONTRACTOR SHALL REVIEW THE PROPOSED CHANGES BEFORE THEY ARE MADE.
2. ALL OUTDOOR OEVICES SHALL BE NEMA 4 RATED.
3. LOCATION OF MANHOLES AND PULLBOXES ARE APPROXIMATE. SUBCONTRACTOR SHALL COORDINATE EXACT LOCATION OF MANHOLES AND PULLBOXES WITH MECHANICAL AND CIVIL WORK.
4. SUBCONTRACTOR SHALL PROVIDE ADDITIONAL PULL BOXES TO THOSE SHOWN WHERE THEY ARE REQUIRED TO MAKE A WORKABLE INSTALLATION.
5. CIRCUITS OF DIFFERENT SERVICE VOLTAGE SHALL BE INSTALLED IN SEPARATE RACEWAYS, MANHOLES, HANDHOLES, PULLBOXES AND JUNCTION BOXES. THE VOLTAGE AND SERVICE LEVELS ARE:
   - (1) 12KV, 13.8KV
   - (2) 120V-480VOLT
   - (3) INSTRUMENTATION LESS THAN 50VDC
   - (4) TELEPHONE AND COMMUNICATIONS.

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15905 SHT01	600G	8802

NOTES

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borland 10/9/07
0600X-SC-G0524 05-19 064
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTD THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRIMAN — STATE OF WASHINGTON — 12322 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES: 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	BM	SD	REM	[illegible]	N/A	[illegible]

SCALE: NA

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC.
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
ELECTRICAL ABREVIATIONS AND GENERAL NOTES

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0105.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0105	0

DRAWING NO.	REV. NO.
0600X-DD-E0106	0

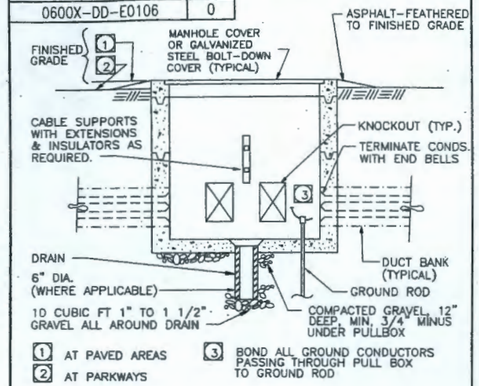

1 TYPICAL PULLBOX
0600X-DD-E0111
NTS

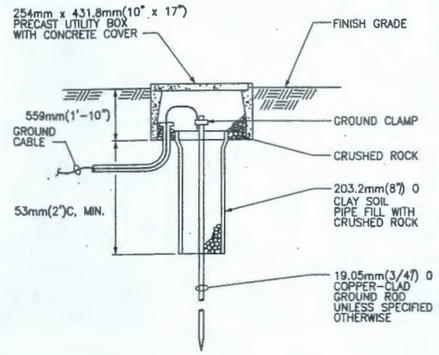

2 GROUND ROD AND WELL
0600X-DD-E0124
NTS

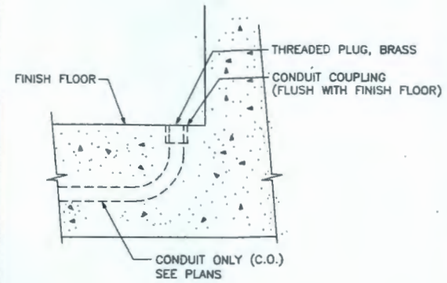

3 CONDUIT TERMINATION FOR FUTURE EQUIP
0600X-DD-E0123
NTS

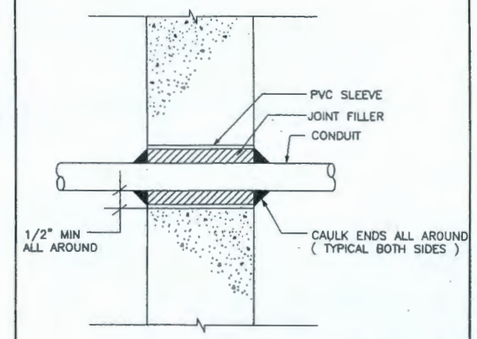

4 CONDUIT PENETRATION AT NEW WALL OR SLAB
0600X-DD-E0123
NTS

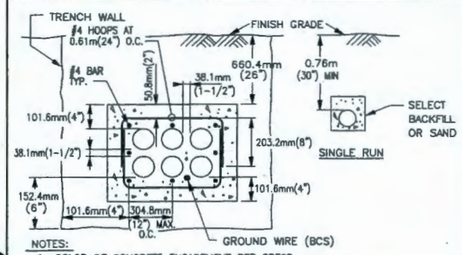

NOTES:
1. COLOR OF CONCRETE ENCASEMENT PER SPECS.
2. TRENCH FOR DUCT BANK SHALL BE MADE MIN. 50.8mm(2") WIDER ON EACH SIDE AND 50.8mm(2") DEEPER THAN DUCT BANK
3. ALL EARTH THAT FALLS BETWEEN AND BELOW CONDUIT WITHIN DUCT BANK AREA SHALL BE REMOVED BEFORE CONCRETE IS POURED AROUND DUCTS
4. SUPPORT CONDUIT AT BOTTOM OF TRENCH ON 152.4mm(6") BLOCK TO ALLOW POURED CONCRETE TO FULLY ENCASE CONDUIT AND REBAR
5. PROVIDE REBAR ONLY WHERE DUCTS ROUTE UNDER ROAD, HEAVY WORK AREA OR AS DEFINED
6. NUMBER OF CONDUITS IN DUCT BANK VARIES; GROUND WIRES ARE NOT REQUIRED FOR ALL DUCT BANKS. SEE DUCT BANK SCHEDULE.

5 TYPICAL DUCT BANK
0600X-DD-E0110, E0111, E0112
NTS

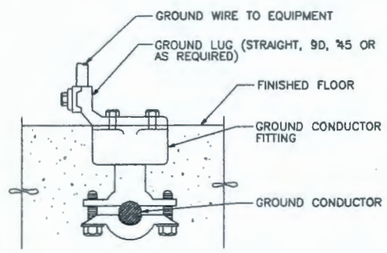

NOTE:
BOLTS SHALL BE INSERTED IN BOLT HOLES BEFORE CONNECTOR IS EMBEDDED.

6 GROUNDING INSERT
0600X-DD-E0124
NTS

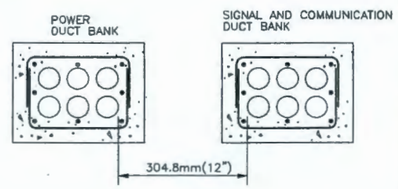

7 DUCT BANK SPACING
0600X-DD-E0111, E0110
NTS

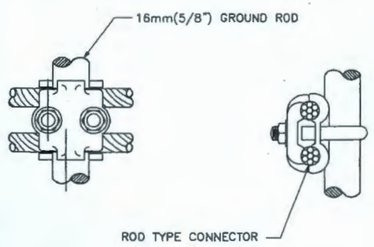

10 CABLE TO ROD CONNECTION
0600X-DD-E0124
NTS

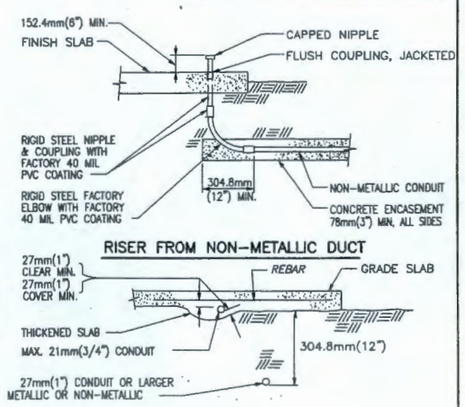

9 CONDUIT PLACEMENT
0600X-DD-E0107
NTS

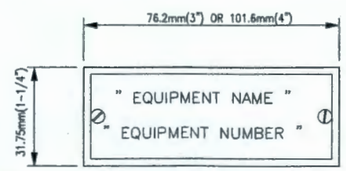

NOTES
1. ALL LETTERS TO BE 6.35mm(1/4") UNLESS NOTED OTHERWISE.
2. ALL NAMEPLATES TO BE MOUNTED ON THE VERTICAL CENTERLINE OF THE CUBICAL OR DEVICE.
3. ATTACH ALL NAMEPLATES WITH STAINLESS STEEL SCREWS.
4. PROVIDE BLANK NAMEPLATES FOR ALL SPARE AND FUTURE DEVICES.

11 NAMEPLATE
0600X-DD-E0116
NTS

River Corridor Closure Contract
Dedicated to Safety Excellence

NOTES

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

DISCIPLINE									
						✓			
SIGNATURE									
DATE									

Dave Doremus 10/3/07
PROJECT ENGINEER — DOCUMENT IDENTIFIER
0600X-SC-G0544 05-19 065
SCHED. NO. — SHED ITEM — SUBMITTAL

S00X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL rse 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRIAM — STATE OF WASHINGTON — 12822 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENGR	ENGR CHK	SYS ENGR	PROJ ENGR
0	9/26/07	ISSUED FOR CONSTRUCTION	RLM	JSP	BJH	MH	N/A	RB

SCALE: NA

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON | WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 – 10
ELECTRICAL DETAILS – 1

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0106.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0106	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15906 SHT01	600G	7301

DRAWING NO.	REV. NO.
0600X-DD-E0107	0

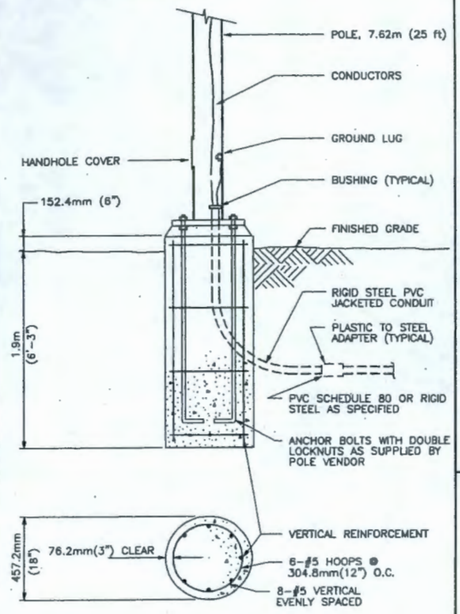

12 UNDERGROUND CONDUIT TO LIGHT POLE

0600X-DD-E0117 (TYPICAL FOR CREST PAD BLDGS)

NTS

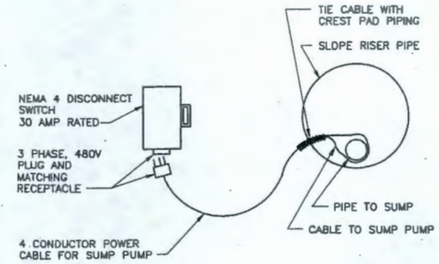

NOTES:

1. TRANSDUCER CABLE CONNECTION SIMILAR WITHOUT DISCONNECT.
2. ATTACH WIRE MESH CABLE SUPPORT GRIP NEAR OUTSIDE END OF RISER PIPE.
3. PLUGS AND RECEPTACLES SHALL BE HEAVY DUTY, THREADED CONNECTING, WEATHERPROOF PIN AND SLEEVE TYPE CONNECTORS.
4. PROVIDE ENGRAVE NAMEPLATE ON FRONT OF DISCONNECT SWITCH, TO READ "HIGH VOLTAGE – DO NOT UNPLUG".
5. INSTALLATION SHALL MATCH PREVIOUS CREST PAD NO.5 WORK FIELD VERIFY AT SITE.
6. DISCONNECT SHALL BE HUBBELL #HBLMITL WITH INTERNAL RECEPTACLE #HBL2730SW OR EQUAL
7. PLUG SHALL BE HUBBELL #HBL2731 OR EQUAL.

13 TRENCH PUMP CABLE SUPPORT AND TERMINATION

0600X-DD-E0123

NTS

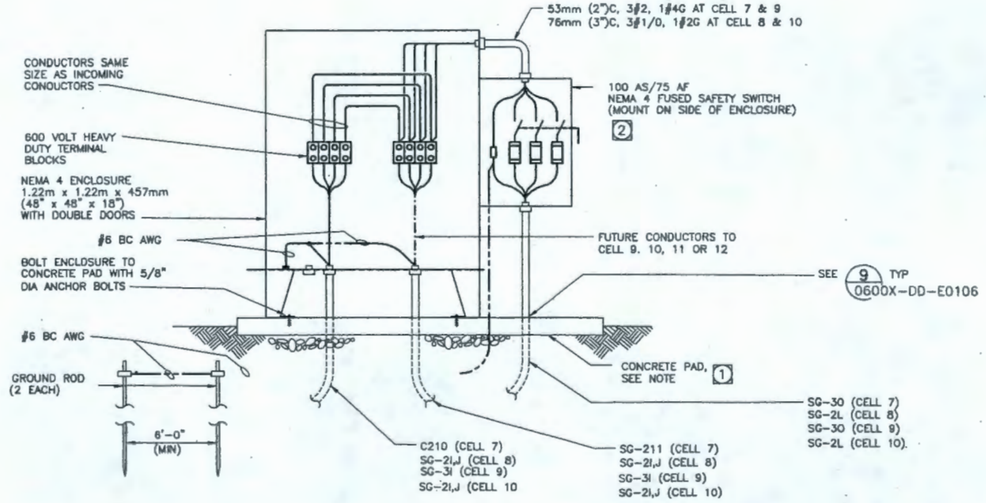

14 LOOP FEED ENCLOSURE 7, 8, 9, 10

0600X-DD-E0111, 0600X-DD-E0112
0600X-DD-E0113

NTS

(COMPONENTS TYPICAL UNLESS NOTED)

NOTES

1. FOR LOOP FEED ENCLOSURE CONCRETE PAD DETAILS, SEE STRUCTURAL DETAIL 5 0600X-DD-C0317
2. PROVIDE AND INSTALL ENGRAVED NAMEPLATE. TO READ: "DISCONNECT FOR MCC-T7"; ADJUST ACCORDINGLY FOR CELLS 8, 9, 10. MOUNT TO FRONT FACE OF DISCONNECT.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. ☑ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

SUBCONTRACTOR											
SUPPLIER											
WCH											

Dec Dorlaug — 10/9/07
0600X-SC-G00344 05-19 006
SCPO No. — SUBC ITEM — SUBMITTAL

5000X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL m.k.c. 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRIAM — STATE OF WASHINGTON — 12322 — REGISTERED PROFESSIONAL ENGINEER — EXPIRES 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CK'R	ORIG/ ENG'R	ENG'R CK'R	SYS ENG'R	PROJ ENG'R
0	9/20/07	ISSUED FOR CONSTRUCTION	JD	JD			N/A	

SCALE: NA

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 – 10
ELECTRICAL DETAILS – 2

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0107.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0107	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15907 SHT01	600G	7301

River Corridor Closure Contract
Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-E0109	0

RACEWAY AND CABLE SCHEDULE (CELLS 7 & 8)

CONDUIT NO.	CONDUCTORS	CONDUIT NO.	CONDUIT SIZE	FUNCTION	FROM	TO	ROUTE	REMARKS
C150	3#12, 1#12 GRD	1	53mm(2")	480V POWER	CELL NO.7 - MCC-T7	PB-PTN9	UNDERGROUND	CELL NO.7 CREST PAD BLDG, (TO C151)
C151	3#12, 1#12 GRD	1	53mm(2")	480V POWER	PB-PTN9	MH-30 (MOV, 2-V-19)	UNDERGROUND	CELL NO.7 CREST PAD BLDG, (TO C150)
C152	6#12, 1#12 GRD, 1-4PR #16 SHLD	1	53mm(2")	SIGNAL	TRENCH PUMP CONTROL PANEL	PB-STN9	UNDERGROUND	CELL NO.7 CREST PAD BLDGL, (TO C205)
C153	4#12, 1#12 GRD	1	53mm(2")	SIGNAL	MOV 2-V-19, FLOOD SWITCH	PB-STN9	UNDERGROUND	MANHOLE MH-30, (TOC205)
C156	EMPTY (SPARE)	1	53mm(2")	POWER	CREST PAD BLDG NO.7	PB-PTN9	UNDERGROUND	WITH PULLCORD
C157	EMPTY (SPARE)	1	53mm(2")	POWER	CREST PAD BLDG NO.7	PB-PTN9	UNDERGROUND	WITH PULLCORD
C158	EMPTY (SPARE)	1	53mm(2")	SIGNAL	CREST PAD BLDG NO.7	PB-STN9	UNDERGROUND	WITH PULLCORD
C159	EMPTY (SPARE)	1	53mm(2")	SIGNAL	CREST PAD BLDG NO.7	PB-STN9	UNDERGROUND	WITH PULLCORD
C160	3#12, 1#12 GRD	1	27mm(1")	480V POWER	CELL NO.8 - MCC-T8	PB-PTS9	UNDERGROUND	CELL NO.8 CREST PAD BLDG, (TO C161)
C161	3#12, 1#12 GRD	1	53mm(2")	480V POWER	PB-PTS9	MH-31 (MOV, 2-V-20)	UNDERGROUND	CELL NO.8 CREST PAD BLDG, (TO C160)
C162	6#12, 1#12 GRD, 1-4PR #16 SHLD	1	53mm(2")	SIGNAL	TRENCH PUMP CONTROL PANEL	PB-STS9	UNDERGROUND	CELL NO.8 CREST PAD BLDG, (TO C206)
C163	4#12, 1#12 GRD	1	53mm(2")	SIGNAL	MOV 2-V-20, FLOOD SWITCH	PB-STS9	UNDERGROUND	MANHOLE MH-31, (TO C206)
C166	EMPTY (SPARE)	1	53mm(2")	POWER	CREST PAD BLDG NO.8	PB-PTS9	UNDERGROUND	WITH PULLCORD
C167	EMPTY (SPARE)	1	53mm(2")	POWER	CREST PAD BLDG NO.8	PB-PTS9	UNDERGROUND	WITH PULLCORD
C168	EMPTY (SPARE)	1	53mm(2")	SIGNAL	CREST PAD BLDG NO.8	PB-STS9	UNDERGROUND	WITH PULLCORD
C169	EMPTY (SPARE)	1	53mm(2")	SIGNAL	CREST PAD BLDG NO.8	PB-STS9	UNDERGROUND	WITH PULLCORD
C205	2-(10#12,1#12GRD,1-4PR #16 SHLD)	3	53mm(2"), 1 SPARE	SIGNAL	PB-STN9	LEACHATE PUMP STATION	UNDERGROUND	USE SPARE CONDUIT SPACE FROM PB-STN7 TO LEACHATE PUMP STATION(CELL 7&9 -C152 & C153) (3)
C206	2-(10#12,1#12GRD,1-4PR #16 SHLD)	3	53mm(2"), 1 SPARE	SIGNAL	PB-STS9	LEACHATE PUMP STATION	UNDERGROUND	USE SPARE CONDUIT SPACE FROM PB-STS7 TO LEACHATE PUMP STATION(CELL 8&10-C162 & C163) (3)
C209	3#1, 1#8GRD	1	53mm(2")	480V POWER	SUBSTATION #2, MDP #2	PB-PTNX	UNDERGROUND	(TO SG-3I, J-N)
C210	3#1, 1#8GRD	1	53mm(2")	480V POWER	PB-PTN9	CELL NO. 7, LOOP FEED ENCLOSURE	UNDERGROUND	
C211	3#1, 1#8GRD	1	53mm(2")	480V POWER	CELL NO. 7, LOOP FEED ENCLOSURE	PB-PTN9	UNDERGROUND	
SG-3I	3#1, 1#8GRD	1	103MM(4")	480V POWER	PB-PTNX [(E) TO PB-PTN8]	PB-PTN9	UNDERGROUND	VIA: PB-PTN8(EXISTING)
SG-3J-N	EMPTY (SPARES)	5	103mm(4")	480V POWER	PB-PTNX [(E) TO PB-PTN8]	PB-PTS9	UNDERGROUND	VIA: PB-PTN8(EXISTING) WITH PULLCORDS
SG-3O	3#2, 1#8 GRD	1	53mm(2")	480V POWER	CELL 7, LOOP FEED ENCLOSURE	MCC-T7	UNDERGROUND	
SG-2I,J,K	2-(3-250KCMIL, 1#2GRD)	3	78mm(3"), 1 SPARE	480V POWER	PB-PTS7	PB-PTS9	UNDERGROUND	VIA: PB-PTS8, LOOP FEED ENCLOSURE #8 (NOT SPARE CONDUIT)
SG-2G,H	2-(3-250KCMIL, 1#2GRD)	2(E)	103mm(4")	480V POWER	LEACHATE 480V SWGR, BKR #8	PB-PTS7	UNDERGROUND	VIA:PB-PN1,PB-PW1,PB-PW3, PB-PTS1, PB-PTS6, USE VARIOUS SIZE CONDUITS (2"-4")
SG-2L	3#1/0, 1#2 GRD	1	78mm(3")	480V POWER	CELL NO. 8, LOOP FEED ENCLOSURE	MCC-T8	UNDERGROUND	FROM FUSED DISCONNECT SWITCH

NOTES

1. DUCT BANK CONDUITS TO BE CONCRETE ENCASED SEE (5) 0600X-DD-E0106 AND (7) 0600X-DD-E0106
2. EXISTING CONDUITS (E); CONDUIT REF. DWG # 0600X-DD-E0076.
3. THE SPARE CABLE SETS IN C205 AND C206 AT PB-STN9 AND PB-STS9 FOR CELLS 9 AND 10 SHALL BE TERMINATED IN AN ENCLOSURE ON TERMINAL BLOCKS LOCATED IN THE PULL BOXES. PULL BOXES SHALL BE SIZED TO FACILITATE TERMINATION AND EXTENSION FOR CELLS 9 AND 10.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

DISCIPLINE	Civil/Structural	Mechanical	Electrical	Instrumentation	Safety	Fire Protection	Quality Assurance	Environmental	Ecology	Cultural Resources	Radiation Protection	Operations	Facility Rep.	Other
DISCIPLINE REVIEWER					✓									
ASSIGNED BY					RB									

Bill Bohlman 10/9/07
DOCUMENT NO. 0600X-SC-E0524 DOC. TYPE 05-19 REVISION 067
SCP/D NO. 500X 531A A00 SUBMITTAL

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mac 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRIMAN — STATE OF WASHINGTON — 12222 — REGISTERED PROFESSIONAL ENGINEER — EXPIRES: 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/26/07	ISSUED FOR CONSTRUCTION						

SCALE: NA

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
ELECTRICAL CABLE AND RACEWAY SCHEDULE

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0109.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0109	0

DUCT BANK SCHEDULE (SOUTH)

SECTION	NEW POWER CONDUIT NUMBERS	NEW SIGNAL CONDUIT NUMBERS
TS8 (1)	SG-2I, SG-2J, SG-2K	C-206

DUCT BANK SCHEDULE (NORTH)

SECTION	NEW POWER CONDUIT NUMBERS	NEW SIGNAL CONDUIT NUMBERS
TN8 (1)	SG-3I, SG-3J, SG-3K, SG-3L, SG-3M, SG-3N,	C-205

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15909 SHT01	600G	7305

River Corridor Closure Contract — Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-E0110	0

RACEWAY AND CABLE SCHEDULE (CELLS 9 & 10)

CONDUIT NO.	CONDUCTORS	CONDUIT NO.	CONDUIT SIZE	FUNCTION	FROM	TO	ROUTE	REMARKS
C150	3#12, 1#12 GRD	1	53mm(2")	480V POWER	CELL NO.9 – MCC–T9	PB–PTN11	UNDERGROUND	CELL NO.9 CREST PAD BLDG (TO C151)
C151	3#12, 1#12 GRD	1	53mm(2")	480V POWER	PB–PTN11	MH–32 (MOV, 2–V–21)	UNDERGROUND	CELL NO.9 CREST PAD BLDG (TO C150)
C152	6#12, 1#12 GRD, 1–4PR #16 SHLD	1	53mm(2")	SIGNAL	TRENCH PUMP CONTROL PANEL	PB–STN11	UNDERGROUND	CELL NO.9 CREST PAD BLDG (TO C205)
C153	4#12, 1#12 GRD	1	53mm(2")	SIGNAL	MOV 2–V–21, FLOOD SWITCH	PB–STN11	UNDERGROUND	MANHOLE MH–32 (TO C205)
C156	EMPTY (SPARE)	1	53mm(2")	POWER	CREST PAD BLDG NO.9	PB–PTN11	UNDERGROUND	WITH PULLCORD
C157	EMPTY (SPARE)	1	53mm(2")	POWER	CREST PAD BLDG NO.9	PB–PTN11	UNDERGROUND	WITH PULLCORD
C158	EMPTY (SPARE)	1	53mm(2")	SIGNAL	CREST PAD BLDG NO.9	PB–STN11	UNDERGROUND	WITH PULLCORD
C159	EMPTY (SPARE)	1	53mm(2")	SIGNAL	CREST PAD BLDG NO.9	PB–STN11	UNDERGROUND	WITH PULLCORD
C160	3#12, 1#12 GRD	1	27mm(1")	480V POWER	CELL NO.9 – MCC–T9	PB–PTS11	UNDERGROUND	CELL NO.10 CREST PAD BLDG (TO C161)
C161	3#12, 1#12 GRD	1	53mm(2")	480V POWER	PB–PTS11	MH–33 (MOV, 2–V–22	UNDERGROUND	CELL NO.10 CREST PAD BLDG (TO C160)
C162	6#12, 1#12 GRD, 1–4PR #16 SHLD	1	53mm(2")	SIGNAL	TRENCH PUMP CONTROL PANEL	PB–STS11	UNDERGROUND	CELL NO.10 CREST PAD BLDG (TO C206)
C163	4#12, 1#12 GRD	1	53mm(2")	SIGNAL	MOV 2–V–18, FLOOD SWITCH	PB–STS11	UNDERGROUND	MANHOLE MH–33 (TO C206)
C164	10#12, 1#12 GRD, 1–4PR #16 SHLD	1	53mm(2")	SIGNAL	PB–STS11	PB–STS10, PB–STS9	UNDERGROUND	
C165	10#12, 1#12 GRD, 1–4PR #16 SHLD	—	EXISTING	SIGNAL	EXST PB–STS9	LEACHATE PUMP STATION	UNDERGROUND	USE SPARE CONDUIT FROM PB–STS9
C166	EMPTY (SPARE)	1	53mm(2")	POWER	CREST PAD BLDG NO.10	PB–PTS11	UNDERGROUND	WITH PULLCORD
C167	EMPTY (SPARE)	1	53mm(2")	POWER	CREST PAD BLDG NO.10	PB–PTS11	UNDERGROUND	WITH PULLCORD
C168	EMPTY (SPARE)	1	53mm(2")	SIGNAL	CREST PAD BLDG NO.10	PB–STS11	UNDERGROUND	WITH PULLCORD
C169	EMPTY (SPARE)	1	53mm(2")	SIGNAL	CREST PAD BLDG NO.10	PB–STS11	UNDERGROUND	WITH PULLCORD
C205	10#12, 1#12 GRD, 1–4PR #16 SHLD	3	53mm(2")	SIGNAL	PB–STN11	PB–STN10, PB–STN9	UNDERGROUND	2 SPARE CONDUITS WITH PULLCORD (2)
C206	10#12, 1#12 GRD, 1–4PR #16 SHLD	3	53mm(2")	SIGNAL	PB–STS11	PB–STS10, PB–STS9	UNDERGROUND	2 SPARE CONDUITS WITH PULLCORD (2)
SG–2I,J	2–(3–250KCMIL, 1#2GRD)	2	78mm(3")	480V POWER	PB–PTS9	PB–PTS11	UNDERGROUND	VIA: PB–PTS10, LOOP FEED ENCLOSURE CELL NO 9
SG–2K	EMPTY (SPARE)	1	78mm(3")	480V POWER	PB–PTS9	PB–PTS11	UNDERGROUND	WITH PULLCORD
SG–2L	3–#1/0, 1#2GRD	1	78mm(3")	480V POWER	LOOP FEED ENCLOSURE CELL NO. 10	PB–PTS11	UNDERGROUND	
SG–3I	3#1, 1#8GRD	1	78mm(3")	480V POWER	PB–PTN9	PB–PTN11	UNDERGROUND	VIA: PB–PTN10, LOOP FEED ENCLOSURE CELL NO 10
SG–3J–L	EMPTY (SPARE)	1	78mm(3")	480V POWER	PB–PTN9	PB–PTN11	UNDERGROUND	WITH PULLCORD VIA: PB–PTN10
SG–3O	3#2,1#8GRD	1	78mm(2")	480V POWER	LOOP FEED ENCLOSURE CELL NO. 9	MCC–T9	UNDERGROUND	

DUCT BANK SCHEDULE (SOUTH)

SECTION	NEW POWER CONDUIT NUMBERS	NEW SIGNAL CONDUIT NUMBERS
TS9 (1)	SG–2I, SG–2J, SG–2K	C–206

DUCT BANK SCHEDULE (NORTH)

SECTION	NEW POWER CONDUIT NUMBERS	NEW SIGNAL CONDUIT NUMBERS
TN9 (1)	SG–3I, SG–3J, SG–3K, SG–3L	C–205

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H–6–15910 SHT01	600G	7305

River Corridor Closure Contract
Dedicated To Safety Excellence

NOTES

(1) DUCT BANK CONDUITS TO BE CONCRETE ENCASED SEE (5) 0600X–DD–E0106 AND (7) 0600X–DD–E0106

(2) SEE (3) 0600X–DD–E0109

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
DATE RECEIVED: 10/9/07
REVIEWED BY: PB
Bill Boehling 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G00244 05-19 068
SCPO NO. SUBCONTRACT NO. SUBMITTAL
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRIAN — STATE OF WASHINGTON — 12232 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION		JD			N/A	

SCALE: NA

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 – 10
ELECTRICAL CABLE AND RACEWAY SCHEDULE

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE–AC06–05RL–14655	6XDE0110.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X–DD–E0110	0

DRAWING NO.	REV. NO.
0600X-DD-E0111	0

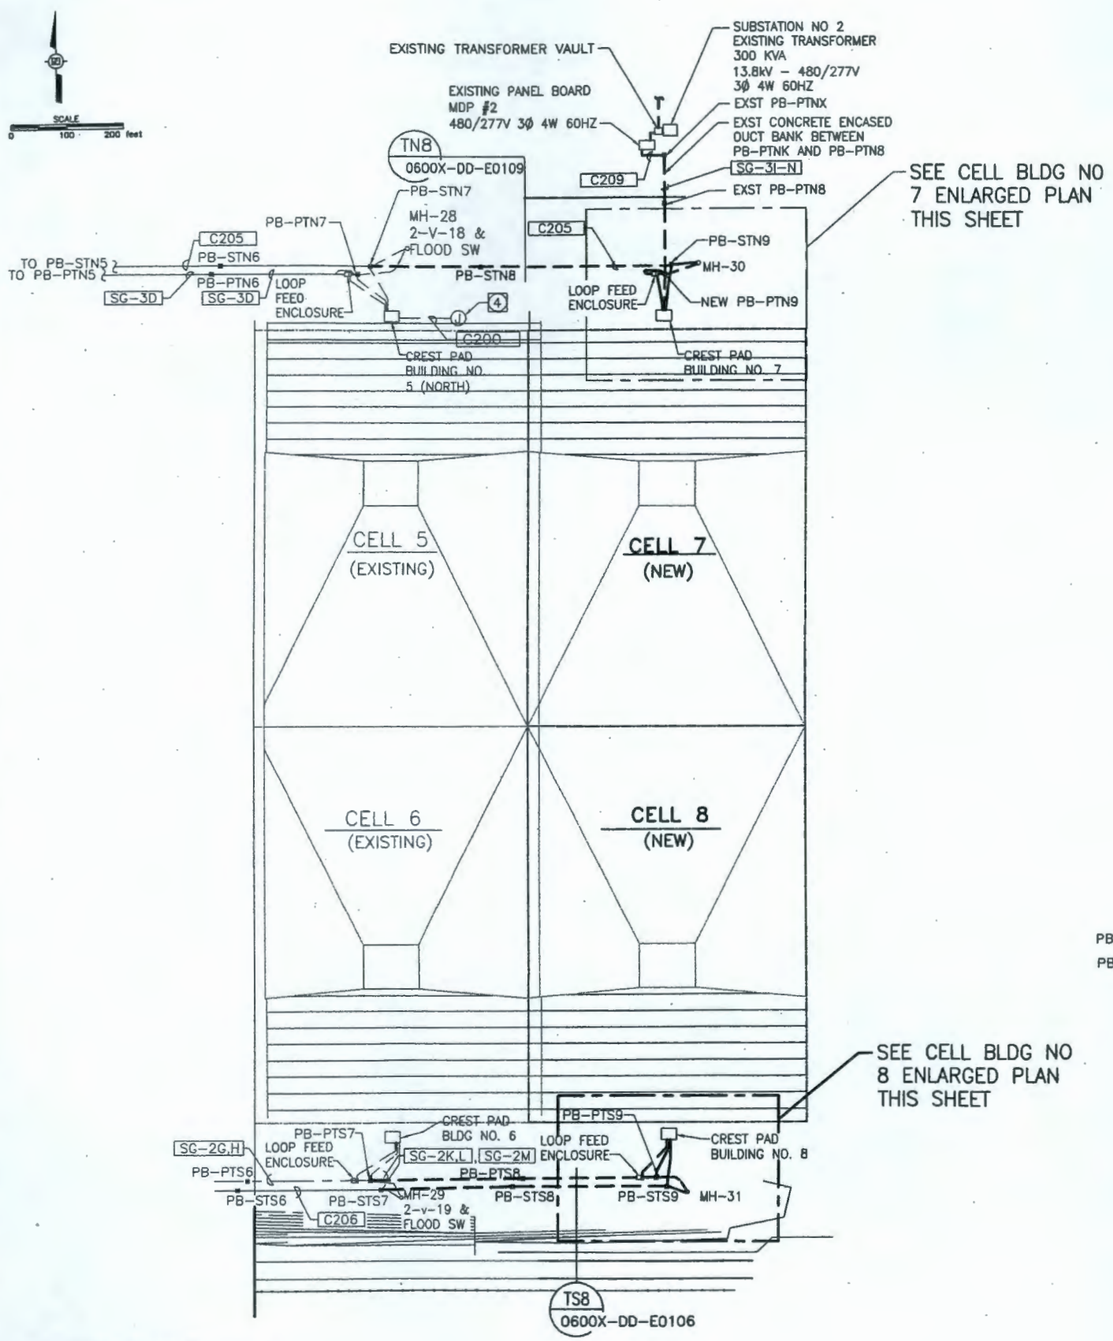

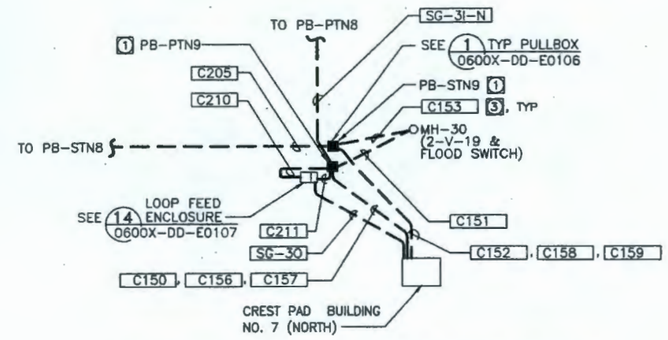

CELL BLDG NO 7 ENLARGED PLAN

NTS

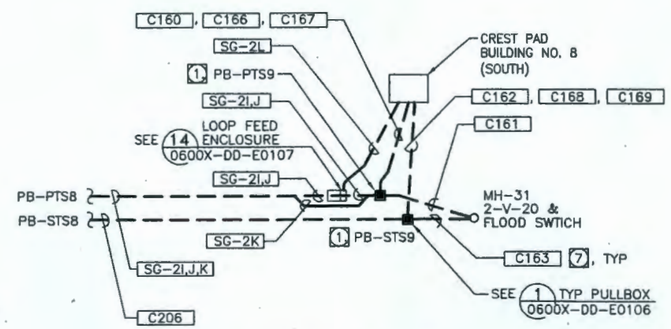

CELL BLDG NO 8 ENLARGED PLAN

NTS

LEGEND	
————	EXISTING
————	NEW

DOCUMENT CONTROL mlc 10/11/07

RECORD INFORMATION		
RECORD NO.	BLDG NO.	INDEX NO.
H-6-15911 SHT01	600G	7301

NOTES

1. ALL PULL BOXES SHALL BE 30" W x 48" L x 40" D (INSIDE DIMENSIONS) UNLESS OTHERWISE NOTED. SEE NOTE 3 ON DWG 0600X-DD-E0109.
2. ALL DUCT BANK CONDUITS TO BE CONCRETE ENCASED UNLESS SPECIFIED OTHERWISE. SEE DETAIL 5 0600X-DD-E0106 AND 7 0600X-DD-E0106
3. SEE DWG 0600X-DD-E0109 FOR RACEWAY AND CABLE SCHEDULE.
4. COORDINATE NEW DUCT BANKS W/NEW YARD PIPING. DUCT ROUTING SHALL MATCH PREVIOUS CELL NO. 5 ROUTING.
5. WHERE NECESSARY TO PULL NEW I & C WIRES IN MH OR PB CONDUITS, WITH EXISTING WIRES, PULL EXISTING WIRES OUT OF CONDUIT AND REPULL WITH THE NEW WIRES WHERE NECESSARY. TO CUT WIRES IN MH OR PB, THE WIRES SHALL BE TERMINATED IN A WEATHER PROOF ENCLOSURE AND TERMINATED ON BLOCKS.
6. RELOCATE 480V #10 CIRCUIT OR SMALLER TO ADJACENT DUCT BANK CONDUITS WHERE NECESSARY TO CLEAR CONDUIT FOR POWER CIRCUIT TO CELL 8.
7. SEE DWG 0600X-DD-E0110 FOR RACEWAY AND CABLE SCHEDULES

Best Available Copy

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1 ☑ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3 ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borlaug 10/9/07
DOCUMENT ID NUMBER
0600X-SC-E0540 05-19 069
SCHED No. SUBSYSTEM SUBMITTAL
500X524R00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRIAM — STATE OF WASHINGTON — 12322 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES: 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	DSIG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	11/12/02	ISSUED FOR CONSTRUCTION	RWM	JD	BH	JKB	MK	RE

SCALE: NA

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.	WEAVER BOOS CONSULTANTS, LLC.
RICHLAND, WASHINGTON	DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
ELECTRICAL SITE PLAN - CELL 7 & 8

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0111.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0111	0

Washington Closure Hanford

River Corridor Closure Contract
Dedicated to Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-E0112	0

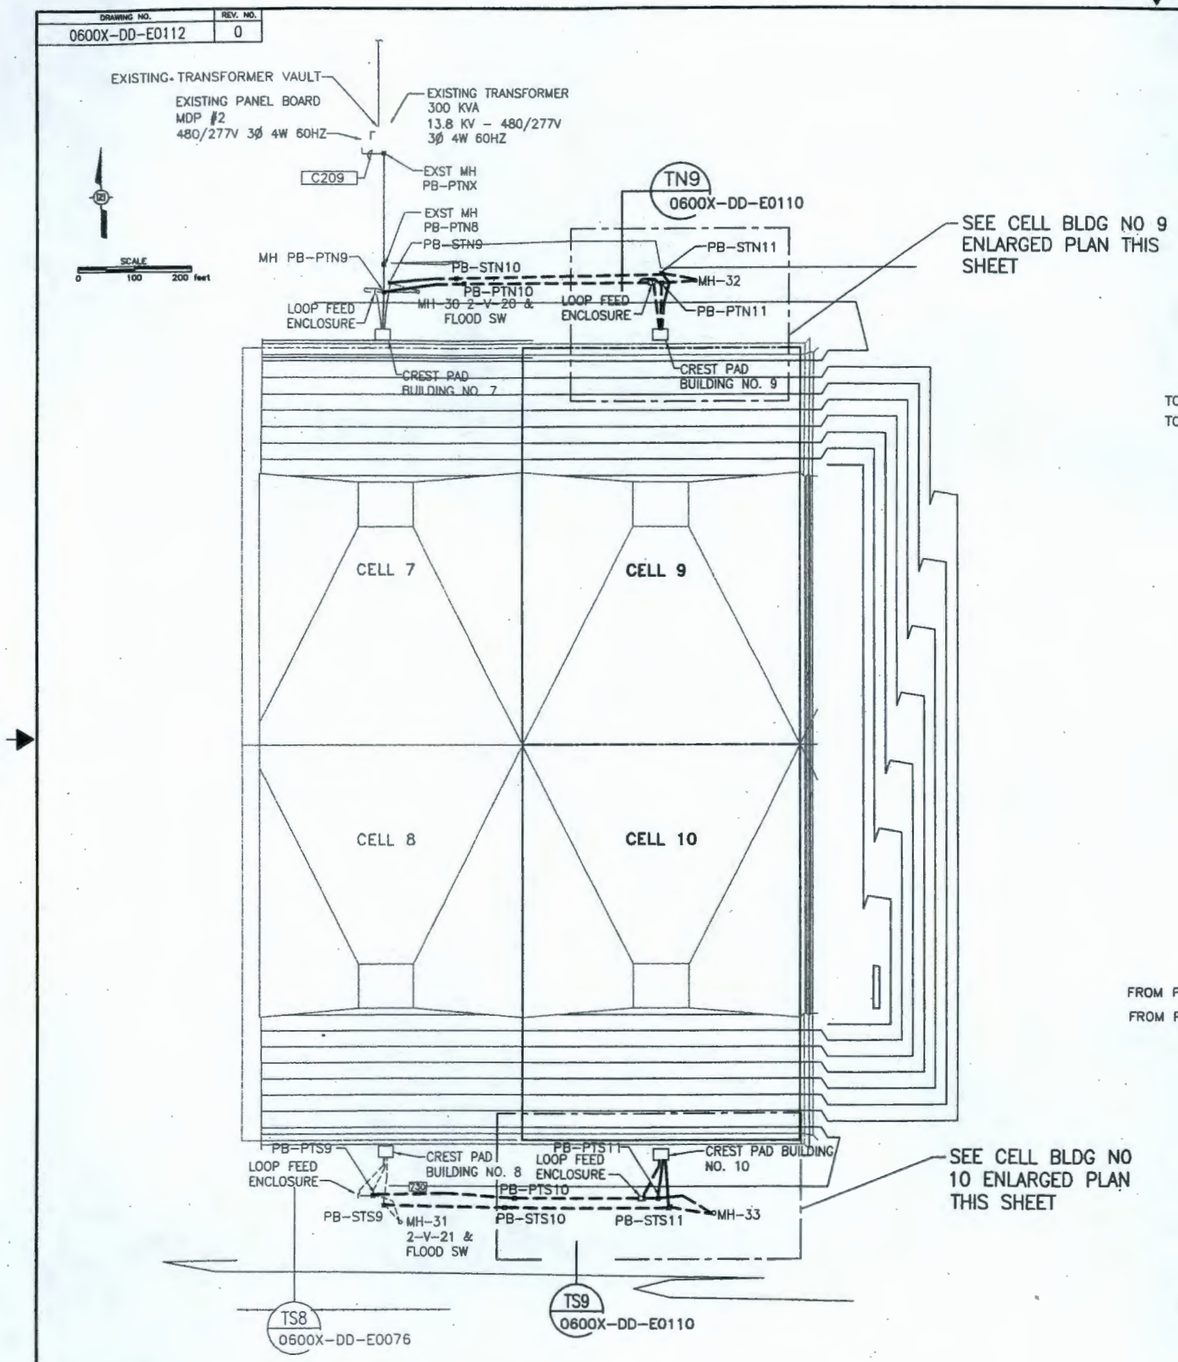

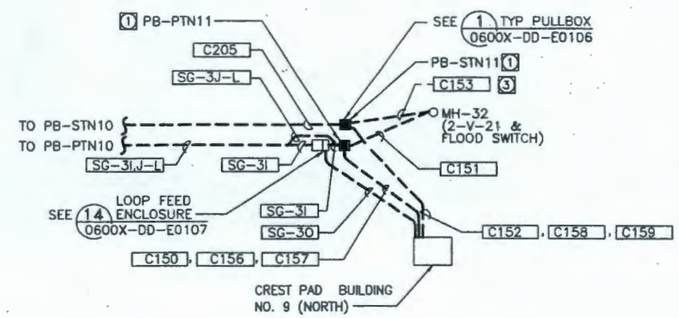

CELL BLDG NO 9 ENLARGED PLAN

NTS

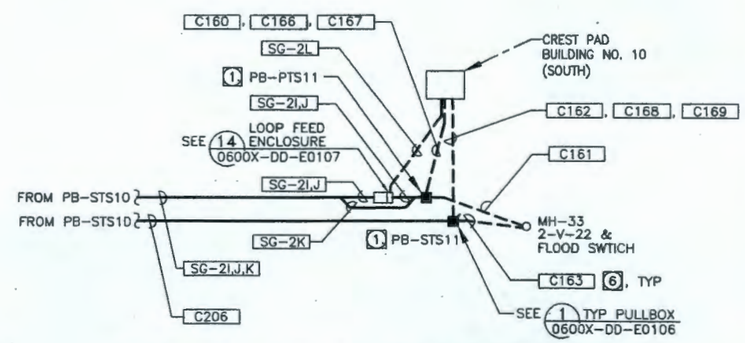

CELL BLDG NO 10 ENLARGED PLAN

NTS

LEGEND	
———	EXISTING
———	NEW

NOTES

1. ALL PULL BOXES SHALL BE 30" W x 48" L x 40" D (INSIDE DIMENSIONS) UNLESS OTHERWISE NOTED
2. ALL DUCT BANK CONDUITS TO BE CONCRETE ENCASED UNLESS SPECIFIED OTHERWISE. SEE DETAIL 5 0600X-DD-E0106 AND 7 0600X-DD-E0106
3. SEE DWG 0600X-DD-E0109 FOR CONDUIT/CONDUCTORS SIZES.
4. COORDINATE NEW DUCT BANKS W/NEW YARD PIPING. DUCT ROUTING SHALL MATCH PREVIOUS CELL NO. 5 ROUTING.
5. MATERIAL AND INSTALLATION EAST OF PB-STN9, PB-PTN9, PB-STS9 AND PB-PTS9 SHALL NOT BE PROVIDED UNLESS SPECIFICALLY DIRECTED TO PERFORM CELL 9 AND 10 WORK.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. [X] Work may proceed.
2. [ ] Revise and resubmit. Work may proceed prior to resubmittal.
3. [ ] Review and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. [ ] Revise and resubmit. Work may not proceed.
5. [ ] Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Boeglage — 10/9/07
Print Name — Date
DOCUMENT ID NUMBER: 0600X-SC-G0584 0579 070
SCPD NO. — SPEC ITEM — SUBMITTAL
500X524 H00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

Best Available Copy

DOCUMENT CONTROL mkc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRIMAN — STATE OF WASHINGTON — 12322 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ENGL/ ENG'R	ENG'R CHK	STR ENG'R	PROJ ENG'R
0	9/24/07	ISSUED FOR CONSTRUCTION	BMM	JD	[illegible]	JWD	[illegible]	[illegible]

SCALE: NA

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
ELECTRICAL SITE PLAN - CELL 9 & 10

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0112.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0112	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15912 SHT01	600G	7301

River Corridor Closure Contract
Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-E0113	0

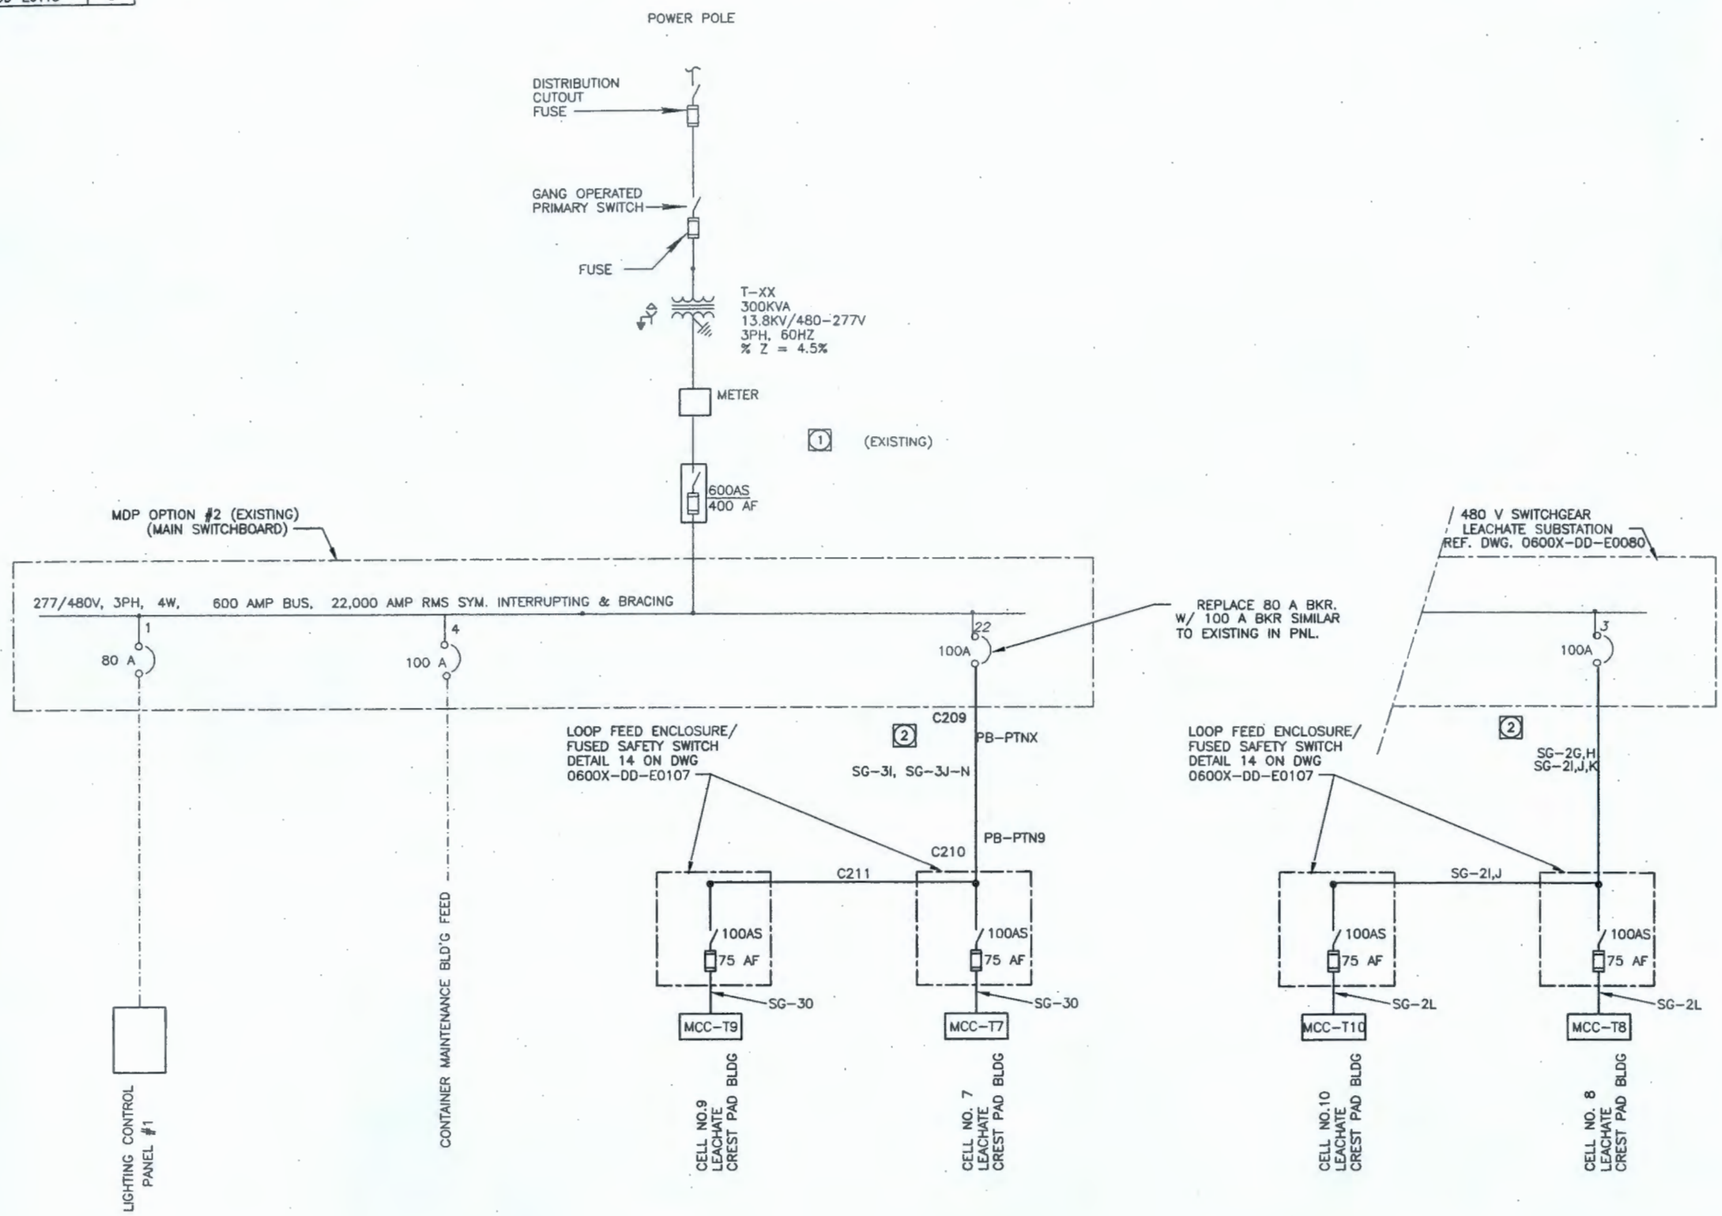

NOTES

1. SEE DWG. 0600X-DD-E0101 FOR UTILITY TO PANEL MDP OPTION #2 DETAILS.
2. SEE DWG 0600X-DD-E0109 AND -E0110 FOR FACILITY RACEWAY AND CABLE SCHEDULE.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. [X] Work may proceed.
2. [ ] Revise and resubmit. Work may proceed prior to resubmittal.
3. [ ] Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. [ ] Revise and resubmit. Work may not proceed.
5. [ ] Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borkowski — 10/9/07
DOCUMENT CLEARANCE
0600X-SC-E0544 — 05-19 — 071
REPO NO. — SUB-ITEM — SUBMITTAL
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

LEGEND

- EXISTING
- NEW

Best Available Copy

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRIDAY — STATE OF WASHINGTON — 12322 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES: 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/26/07	ISSUED FOR CONSTRUCTION						

SCALE: NA

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
ELECTRICAL ONE-LINE SWITCHGEAR

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0113.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0113	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15913 SHT01	600G	7201

River Corridor Contract — Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-E0114	0

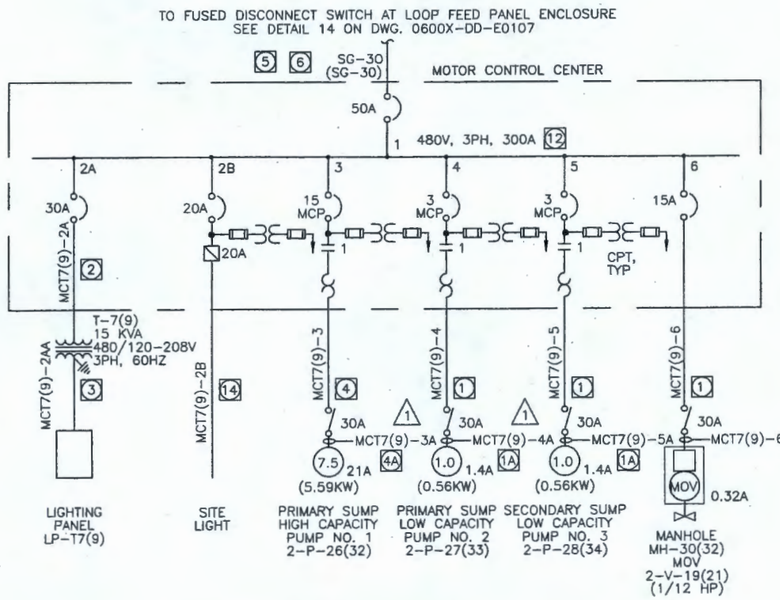

TRENCH CELL 7(9) ONE LINE DIAGRAM

MOTOR CONTROL CENTER MCC-T7(9)

(SEE ELEVATION ON DWG 0600X-DD-E0116

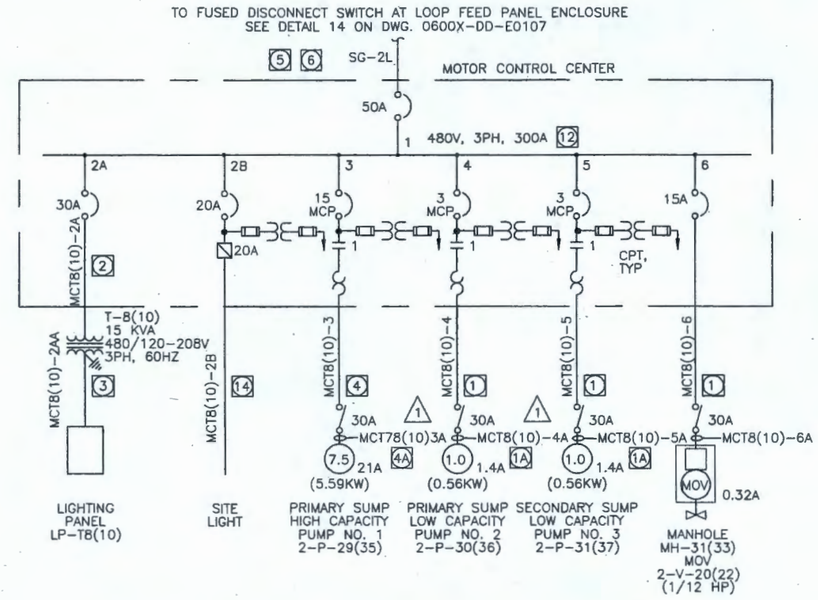

TRENCH CELL 8(10) ONE LINE DIAGRAM

MOTOR CONTROL CENTER MCC-T8(10)

(SEE ELEVATION ON DWG 0600X-DD-E0116

NOTES

1. 25.4mm (1") MIN
2. 21mm (3/4"C), 3#10, 1#10G
3. 27mm (1") C, 4#6, 1#8G
4. 27mm (1") C, 3#10, 1#10G
5. VALUE IN ( ) INDICATES VALUE ASSOCIATED WITH CELL 9 OR 10.
6. SEE DWG 0600X-DD-E0109 AND 0600X-DD-E0110 FOR RACEWAY AND CABLE SIZE.
12. 42,000 AMP MINIMUM RMS SHORT CIRCUIT RATING. BREAKERS TO HAVE 25,000 AMP MINIMUM INTERRUPTING CAPACITY
14. SEE DRAWING 0600X-DD-E0124 FOR CONDUIT AND CONDUCTORS TO LIGHT POLE

1A. 4 # 12AWG. VENDOR SUPPLIED

4A. 4 # 12AWG. VENDOR SUPPLIED

WASHINGTON CLOSURE HANFORD | JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. ☒ Work may proceed.
2. ☐ Review and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not applied.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borlaug 10/9/07
0600X-SC-G0524 05-19 072
SOO/524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mjc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRIMAN, STATE OF WASHINGTON, 18232, REGISTERED PROFESSIONAL ENGINEER
EXPIRES 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	BMT	JD	REN		N/A	

SCALE: NA

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
MCC ONE-LINE DIAGRAMS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0114.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0114	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15914 SHT01	600G	7201

River Corridor Closure Contract
Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-E0116	0

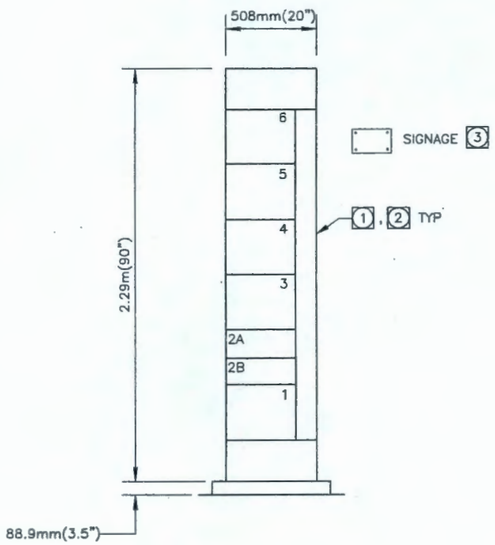

FRONT ELEVATION

MOTOR CONTROL CENTER MCC-T7 (9)

(TRENCH CELL 7(9) CREST PAD BUILDING)

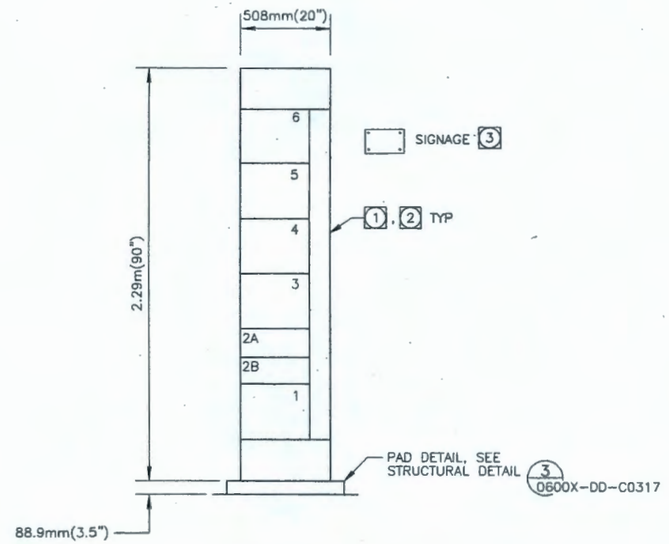

FRONT ELEVATION

MOTOR CONTROL CENTER MCC-T8 (10)

(TRENCH CELL 8 (10) CREST PAD BUILDING)

NOTES

1. FOR TYPICAL NAMEPLATE DETAIL SEE 11 0600X-DD-E0106
2. CONTRACTOR SHALL PROVIDE ARRANGEMENT OF CUBICLES IN NEW MCC IDENTICAL TO EXISTING MCC INSTALLED AT PREVIOUS CELLS 5 AND 6. FIELD VERIFY AT SITE. MCC MANUFACTURER SHALL MATCH CELL 5.
3. PROVIDE AND INSTALL SIGNAGE TO MATCH EXISTING CELLS 5. FIELD VERIFY AT SITE. SIGNAGE TO READ: "SERVICE DISCONNECT FOR THIS BUILDING LOCATED 100 FT NORTH (OR SOUTH) AND IS LABELED DISCONNECT FOR MCC-T7(9) (OR MCC-T8(10))" ACCORDINGLY.
4. VALUE IN ( ) INDICATES VALUE ASSOCIATED WITH CELL 9 OR 10.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655

SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

- 1 ☑ Work may proceed.
- 2 ☐ Revise and resubmit. Work may proceed prior to resubmission.
- 3 ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
- 4 ☐ Revise and resubmit. Work may not proceed.
- 5 ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

DISCIPLINE	CIVIL	STRUCT	MECH	ELEC	I&C	PIPING	PROCESS	HP	ENVIRONMENTAL	QA	SAFETY	FIRE PROT		
SUBMITTED BY					✓									
SUBMITTED TO					PD									

Bill Borlaug 10/9/07

DOCUMENT ID NUMBER: 0600X-SC-G0524 0519 073

SCPO LINE: 500X534A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL RJC 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRIMAN — STATE OF WASHINGTON — 12222 — REGISTERED PROFESSIONAL ENGINEER

EXPIRES: 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DSGN CH'K	DRFT CH'K	DSGN ENG'R	CHK'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	SCM	JD	RDM	RDM	N/A	RM	

SCALE: NTS

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC.
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
MCC DETAILS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0116.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0116	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15916 SHT01	600G	7301

River Corridor Closure Contract — Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-E0117	0

208-120 VOLTS 3 Φ 4 W — 50 AMP MAIN BREAKER — PANELBOARD LP-T7 — LOCATION LEACHATE CELL 7 CREST PAD BUILDING — FEED TOP — MTG SURFACE

LOAD DESCRIPTION	VOLT AMPERE ΦA	ΦB	ΦC	LTG	REC	MIS	CIR	BKR		BKR	CIR	MIS	REC	LTG	VOLT AMPERE ΦA	ΦB	ΦC	LOAD DESCRIPTION
METER ROOM LIGHTS	630			9			1	20		20	2	1			400			TRENCH PUMP CONTROL PANEL
EF-1 ELECT. ROOM		860				1	3	20		20	4	3				100		FLOW TRANSMITTER PANEL
RECPT'S ELECT. ROOM			360		2		5	20		20	6						1100	UH-2 HEATER METER ROOM
RECPT'S METER ROOM	360				2		7	20			8	1			1100			
UH-1 HEATER ELECT. ROOM		1100					9	20		3P	10					1100		
			110			1	11			20	12	1					860	EF-2 METER ROOM
	1100						13	3P		20	14	1						SPARE
SPARE							15	20		20	16	1		5		340		ELECT. RM & OUTSIDE LIGHTS
SPARE							17	20			18							SPACE
SPARE							19	20			20							SPACE
	2090	1960	1460					TOTAL		TOTAL					1500	1540	1960	
	PHASE TOTAL			TOTAL LOAD														
	3590	3500	3420	10.5KVA (29.4AMP)														

208-120 VOLTS 3 Φ 4 W — 50 AMP MAIN BREAKER — PANELBOARD LP-T9 — LOCATION LEACHATE CELL 9 CREST PAD BUILDING — FEED TOP — MTG SURFACE

LOAD DESCRIPTION	VOLT AMPERE ΦA	ΦB	ΦC	LTG	REC	MIS	CIR	BKR		BKR	CIR	MIS	REC	LTG	VOLT AMPERE ΦA	ΦB	ΦC	LOAD DESCRIPTION
METER ROOM LIGHTS	630			9			1	20		20	2	1			400			TRENCH PUMP CONTROL PANEL
EF-1 ELECT. ROOM		860				1	3	20		20	4	3				100		FLOW TRANSMITTER PANEL
RECPT'S ELECT. ROOM			360		2		5	20		20	6						1100	UH-2 HEATER METER ROOM
RECPT'S METER ROOM	360				2		7	20			8	1			1100			
UH-1 HEATER ELECT. ROOM		1100					9	20		3P	10					1100		
			110			1	11			20	12	1					860	EF-2 METER ROOM
	1100						13	3P		20	14	1			136			SPARE
SPARE							15	20		20	16	1		5		340		ELECT. RM & OUTSIDE LIGHTS
SPARE							17	20			18							SPACE
SPARE							19	20			20							SPACE
	2090	1960	1460					TOTAL		TOTAL					1500	1540	1960	
	PHASE TOTAL			TOTAL LOAD														
	3590	3500	3420	10.5KVA (29.4AMP)														

208-120 VOLTS 3 Φ 4 W — 50 AMP MAIN BREAKER — PANELBOARD LP-T8 — LOCATION LEACHATE CELL 8 CREST PAD BUILDING — FEED TOP — MTG SURFACE

LOAD DESCRIPTION	VOLT AMPERE ΦA	ΦB	ΦC	LTG	REC	MIS	CIR	BKR		BKR	CIR	MIS	REC	LTG	VOLT AMPERE ΦA	ΦB	ΦC	LOAD DESCRIPTION
METER ROOM LIGHTS	630			9			1	20		20	2	1			400			TRENCH PUMP CONTROL PANEL
EF-1 ELECT. ROOM		860				1	3	20		20	4	3				100		FLOW TRANSMITTER PANEL
RECPT'S ELECT. ROOM			400		2		5	20		20	6						1100	UH-2 HEATER METER ROOM
RECPT'S METER ROOM	360				2		7	20			8	1			1100			
UH-1 HEATER ELECT. ROOM		1100					9	20		3P	10					1100		
			1100			1	11			20	12	1					860	EF-2 METER ROOM
	1100						13	3P		20	14	1						SPARE
SPARE							15	20		20	16	1		5		340		ELECT. RM & OUTSIDE LIGHTS
SPARE							17	20			18							SPACE
SPARE							19	20			20							SPACE
	2090	1960	1460					TOTAL		TOTAL					1500	1540	1960	
	PHASE TOTAL			TOTAL LOAD														
	3590	3500	3420	10.5KVA (29.1AMP)														

208-120 VOLTS 3 Φ 4 W — 50 AMP MAIN BREAKER — PANELBOARD LP-T10 — LOCATION LEACHATE CELL 10 CREST PAD BUILDING — FEED TOP — MTG SURFACE

LOAD DESCRIPTION	VOLT AMPERE ΦA	ΦB	ΦC	LTG	REC	MIS	CIR	BKR		BKR	CIR	MIS	REC	LTG	VOLT AMPERE ΦA	ΦB	ΦC	LOAD DESCRIPTION
METER ROOM LIGHTS	630			9			1	20		20	2	1			400			TRENCH PUMP CONTROL PANEL
EF-1 ELECT. ROOM		860				1	3	20		20	4	3				100		FLOW TRANSMITTER PANEL
RECPT'S ELECT. ROOM			400		2		5	20		20	6						1100	UH-2 HEATER METER ROOM
RECPT'S METER ROOM	360				2		7	20			8	1			1100			
UH-1 HEATER ELECT. ROOM		1100					9	20		3P	10					1100		
			1100			1	11			20	12	1					860	EF-2 METER ROOM
	1100						13	3P		20	14	1						SPARE
SPARE							15	20		20	16	1		5		340		ELECT. RM & OUTSIDE LIGHTS
SPARE							17	20			18							SPACE
SPARE							19	20			20							SPACE
	2090	1960	1460					TOTAL		TOTAL					1500	1540	1960	
	PHASE TOTAL			TOTAL LOAD														
	3590	3500	3420	10.5KVA (29.1AMP)														

LUMINAIRE SCHEDULE

TYPE	WATTS / LAMP	VOLTS	DESCRIPTION
F5	2-34 W / R.S FLUOR	120	INDUSTRIAL TYPE FLUORESCENT LUMINAIRE, 304.8mm x 1.22m(1'x4'), 2 LAMP, HEAVY GAGE STEEL REFLECTOR, WHITE POLYESTER POWDER ENAMEL FINISH, ELECTRONIC BALLAST LITHONIA EJA 240 SERIES OR EQUAL
H2	50 W / HPS	120	WALL MOUNT ON RECESSED ON OUTLET BOX, HIGH PRESSURE SODIUM, 10" ROUND OPEN BAFFLE, WEATHERPROOF GASKETING, BRONZE FINISH HUBBELL BHI SERIES OR EQUAL
H4	250 W / HPS	480	POLE MOUNTED, HIGH PRESSURE SODIUM, LIGHTWEIGHT ALUMINUM, RECTILINEAR SHAPE, CONTINUOUS GASKET, TEMPERED GLASS LENS FLUSH WITH BOTTOM OF LUMINAIRE, U.L LISTED FOR WET LOCATIONS. (LITHONIA CAT # KSF2-250SR3-480-RP12-DDB CROWFORDSVILLE, IN) OR EQUAL 7.62m(25') ROUND TAPERED ALUMINUM POLE (#TRA-25-7E-DM19-DDB) OR EQUAL SUITABLE FOR 100 MPH WINDS AND MATCHED TO LUMINAIRE, SEE (12) 0600X-DD-E01D7

River Corridor Closure Contract
Dedicated To Safety Excellence

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15917 SHT01	600G	7404

NOTES

1. PANEL LP-T7(9), CIRCUIT NO. 14, INSTALL A 30MA RATED GFCI TYPE CIRCUIT BREAKER.
2. CIRCUIT BREAKERS IN PANELS LP-T7(9) AND LP-T8(10) SHALL BE 10,000 AMP MINIMUM INTERRUPTING RATING.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Dan Boehlke 10/8/07
0600X-SC-G0524 0539 074
SCOX524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mac 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRIMAN — STATE OF WASHINGTON — 12222 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	3/28/07	ISSUED FOR CONSTRUCTION		DD			N/A	

SCALE: NA

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. — RICHLAND, WASHINGTON
WEAVER BOOS CONSULTANTS, LLC. — DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
ELECTRICAL SCHEDULES

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0117.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0117	0

DRAWING NO.	REV. NO.
0600X-DD-E0118	0

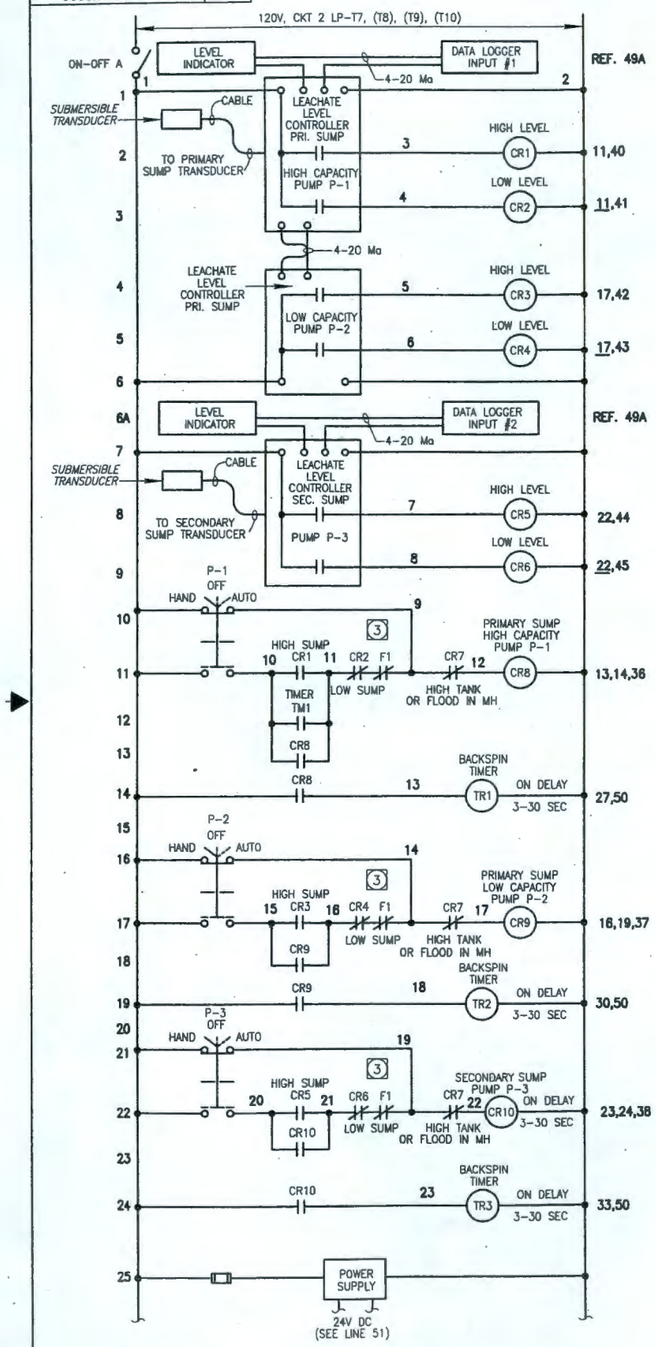

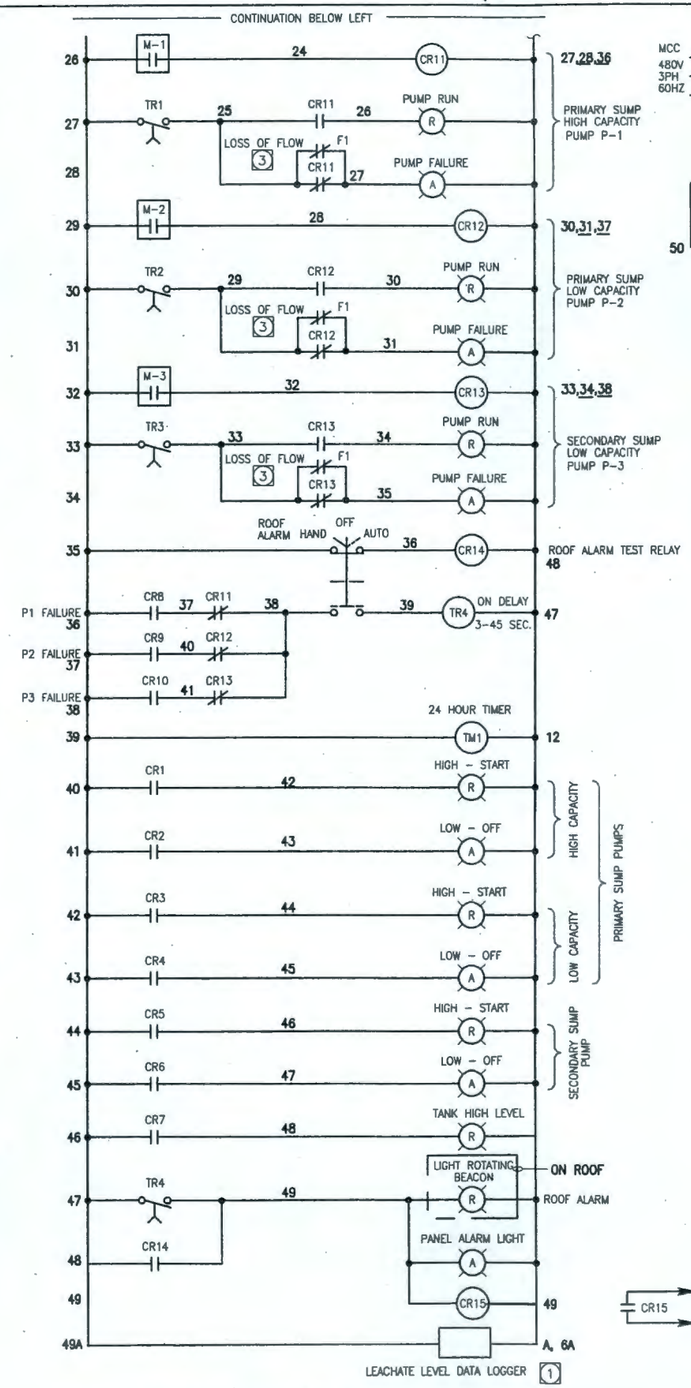

TRENCH PUMP CONTROL PANEL CONTROL SCHEMATIC

TYPICAL FOR CREST PAD BUILDING NO. 7, 8, 9, 10

ALL DEVICES ARE ON CONTROL PANEL UNLESS NOTED OTHERWISE
SEE CONTROL ARRANGEMENT ON DWG 0600X-DD-E0119

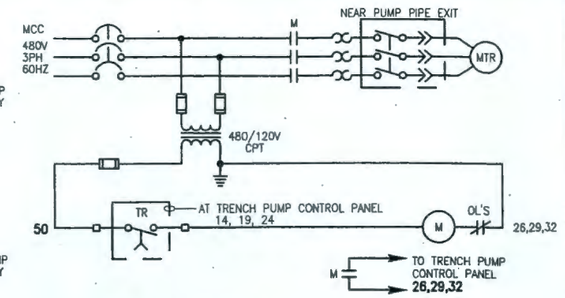

TRENCH PUMP CONTROL SCHEMATIC

(TYP P-1, P-2, P-3)

TRENCH CELLS						
CELL 7 TAG NO.	CELL 8 TAG NO.	CELL 9 TAG NO.	CELL10 TAG NO.	PUMP	M	TR
2-P-26	2-P-29	2-P-32	2-P-35	P-1	M-1	TR1
2-P-27	2-P-30	2-P-33	2-P-36	P-2	M-2	TR2
2-P-28	2-P-31	2-P-34	2-P-37	P-3	M-3	TR3

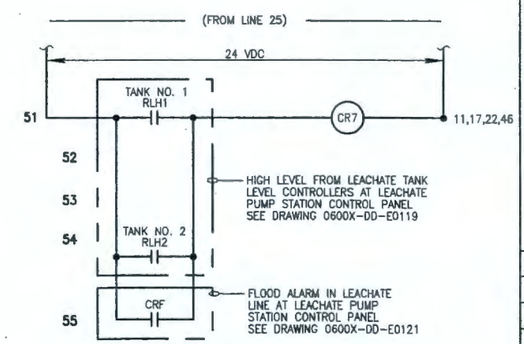

LEVEL AND MANHOLE FLOOD INTERLOCK CONTROL SCHEMATIC

(TRENCH PUMP CONTROL PANEL)

CR15 → TO LEACHATE PUMP CONTROL PANEL SEE DWG 0600X-DD-E0119

NOTES

1. PROVIDE LEACHATE LEVEL (PRIMARY AND SECONDARY) DATA LOGGER.
2. PROVIDE RJ-45 COMMUNICATION PORT ON THE ENCLOSURE (LOWER RIGHT SIDEPANEL) TO THE PLC.
3. CONTACT FROM DIGITAL FLOW INDICATOR; SEE DWG. 0600X-DD-E0120, "CREST PAD LEACHATE FLOW MEASUREMENT"

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Boeh 10/9/07
0600X-SC-G0524 05-19 075
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mjc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRILL — STATE OF WASHINGTON — 12322 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	CHIEF ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/20/07	ISSUED FOR CONSTRUCTION	JD	JD		N/A		

SCALE: NA

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. — RICHLAND, WASHINGTON
WEAVER BOOS CONSULTANTS, LLC. — DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
CONTROL SCHEMATICS - 1

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0118.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0118	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15918 SHT01	600G	7502

River Corridor Closure Contract — Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-E0119	0

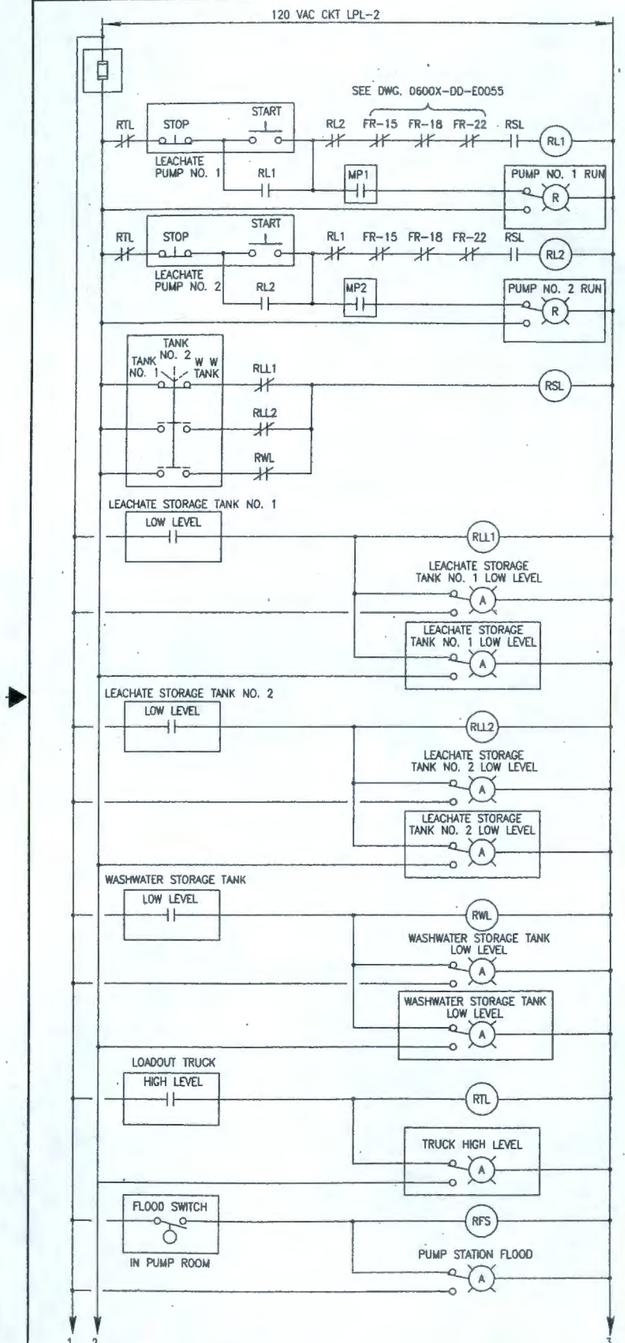

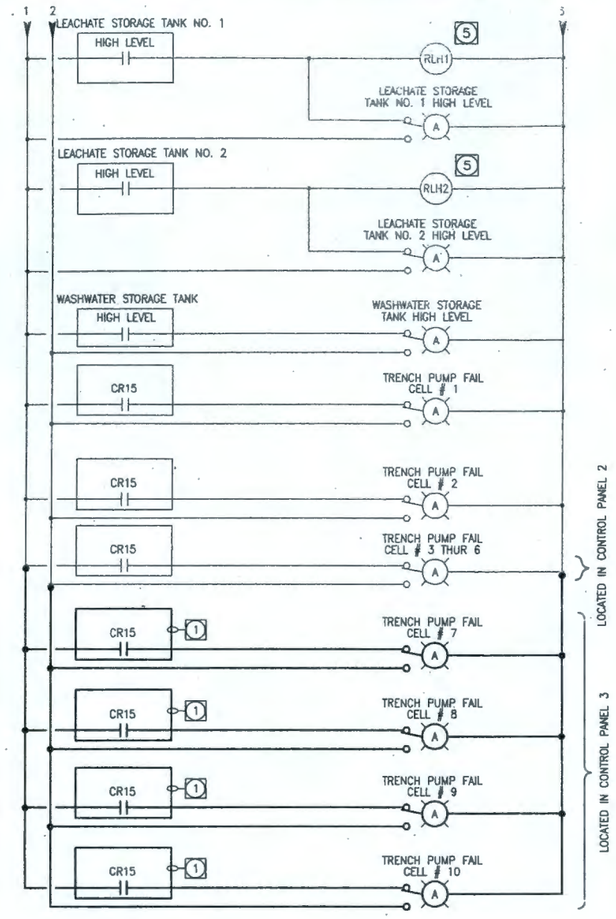

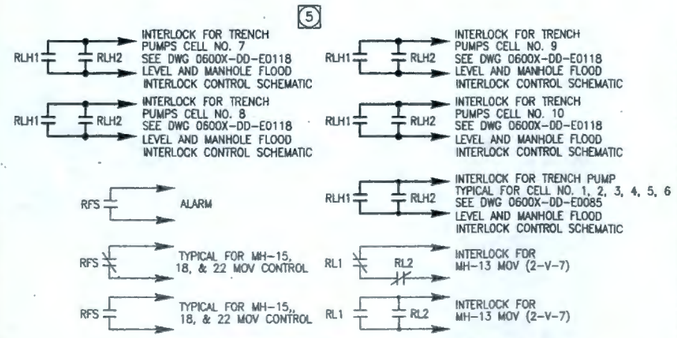

LEACHATE CONTROL PANEL SCHEMATIC

ALL CONTROLS LOCATED IN LEACHATE CONTROL PANEL UNLESS NOTED OTHERWISE (ALSO REF. DWG. 0600X-DD-E0121)

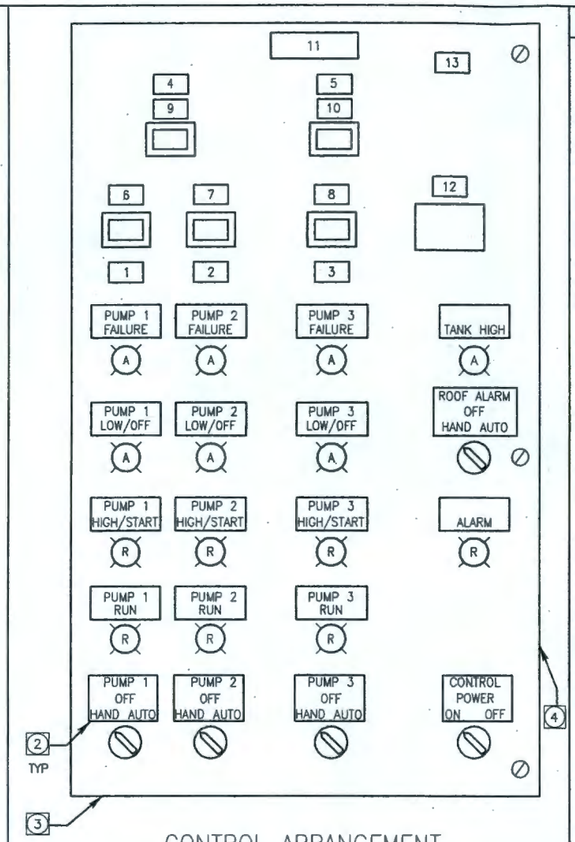

CONTROL ARRANGEMENT
TRENCH PUMP CONTROL PANEL

TYPICAL FOR CREST PAD BUILDING NO. 7, 8, 9, AND 10
SEE DWG 0600X-DD-E0123

NAMEPLATE SCHEDULE	
NO.	INSCRIPTION
1	PUMP 1 HIGH CAPACITY
2	PUMP 2 LOW CAPACITY
3	PUMP 3 LOW CAPACITY
4	PRIMARY SUMP
5	SECONDARY SUMP
6	HIGH FLOW
7	LOW FLOW
8	FLOW
9	PRIMARY SUMP LEVEL
10	SECONDARY SUMP LEVEL
11	TRENCH PUMP CONTROL PANEL
12	LEACHATE LEVEL (PRI-SEC) DATA LOGGER
13	WARNING: MULTIPLE SOURCES FED FROM LP-T(X) CKT. 2 & 4 (FLOW)

(X) = 7,8,9,10, AS APPLICABLE

NOTES

1. AT TRENCH PUMP CONTROL PANEL DWG 0600X-DD-E0118
2. ENGRAVED NAMEPLATES: NOMENCLATURE AND STYLE TO MATCH PREVIOUS TRENCH PUMP CONTROL PANEL INSTALLED IN CREST PAD BUILDING NO. 5 AND NO. 6.
3. TRENCH PUMP CONTROL PANEL. NEMA 12 HINGED ENCLOSURE. MINIMUM ENCLOSURE SIZE SHALL BE 24" WIDE x 42" HIGH x 12" DEEP. CONSTRUCTION FEATURES TO MATCH PREVIOUS TRENCH PUMP CONTROL PANEL INSTALLED IN CREST PAD BUILDING NO. 5 AND NO. 6. PANEL SHALL BE U.L. 508A LABELED.
4. COMMUNICATIONS PORT TO THE PLC
5. PROVIDE ADDITIONAL RLH1 & RLH2 CONTACTS (PARALLEL COILS), IF REQUIRED, FOR CELLS 7-10.

RECEIVED OCT 08 2007 WCH - DOCUMENT CONTROL
0600X-SC-60524-05-19-076
500X5241A00

LEGEND
EXISTING
NEW

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1 ☐ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3 ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "hold" placed on the contract.
Bill Borkowski 10/9/07
0600X-SC-60524 05-19 076

Best Available Copy
DOCUMENT CONTROL mc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERGANS — STATE OF WASHINGTON — 18322 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRN'T CK'R	ORIG/ ENG'R	ENG'R CK'R	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	JD	JD	REM	N/A	

SCALE: NA

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON
WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
CONTROL SCHEMATICS - 2

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0119.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0119	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15919 SHT01	600G	7502

River Corridor Closure Contract
Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-E0120	0

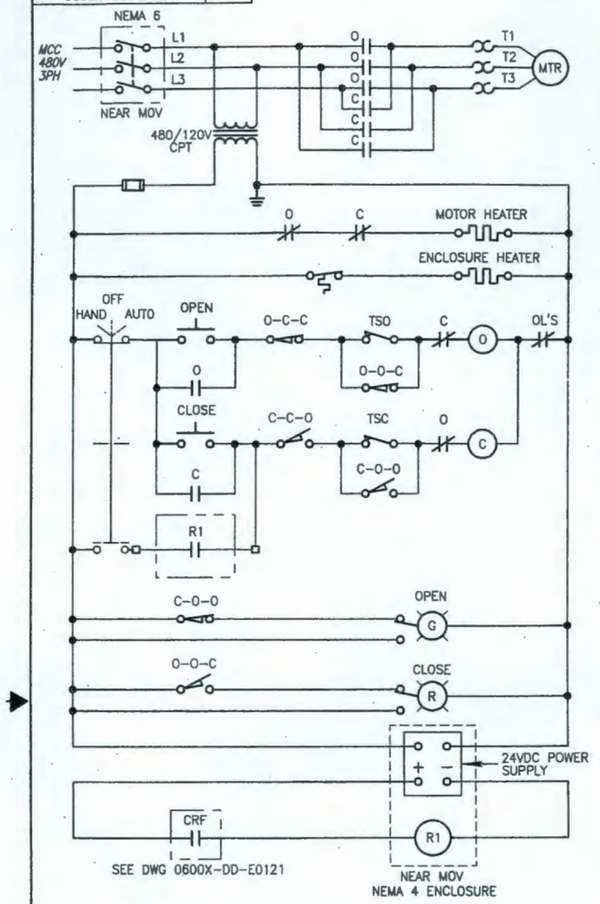

MANHOLE NUMBER	MOV TAG NUMBER
MH-30	2-V-19
MH-31	2-V-20
MH-32	2-V-21
MH-33	2-V-22

ALL CONTROLS ARE AT VALVE OPERATOR UNLESS NOTED OTHERWISE

MOTOR OPERATED VALVE (MOV) CONTROL SCHEMATIC

NOTE:
CONTRACTOR SHALL INSTALL EQUIPMENT INSIDE NEW MANHOLES IDENTICAL TO EXISTING MANHOLES AT PREVIOUS CELL NO. 5 AND 6. FIELD VERIFY AT EXISTING SITE.

River Corridor Closure Contract
Dedicated To Safety Excellence

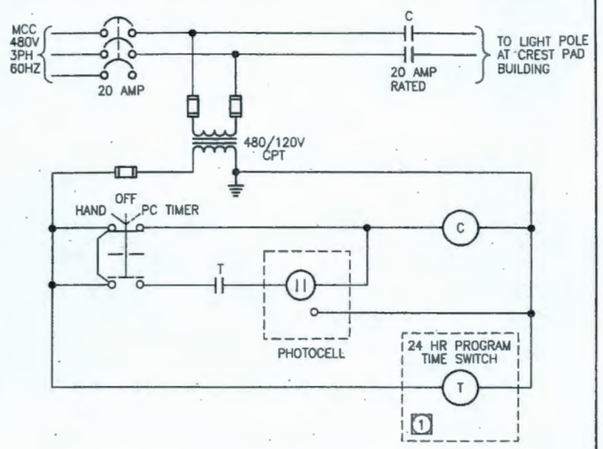

LIGHT POLE AT CREST PAD BUILDING LIGHTING CONTROL DIAGRAM

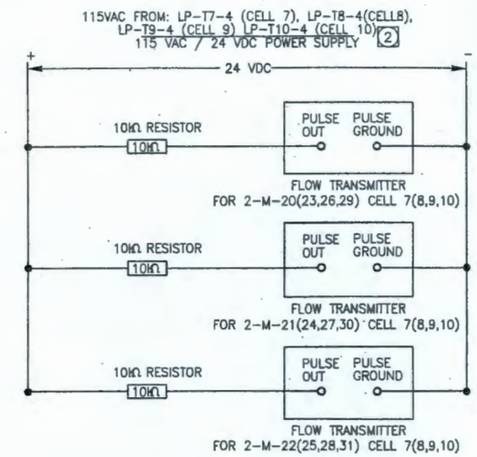

MOUNT IN NEMA 12 BOX ✳

POWER SUPPLY FOR FLOW TRANSMITTERS FOR FLOWMETERS 2-M-20 THRU 2-M-31

✳ SEE DRAWING 0600X-DD-E0123

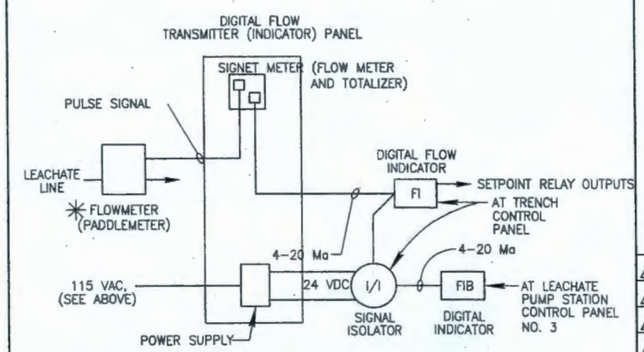

CREST PAD LEACHATE FLOW MEASUREMENT

TYPICAL FOR FLOWMETER (PADDLEMETER) NO. 2-M-20, 2-M-21, 2-M-22, CELL 7
2-M-23, 2-M-24, 2-M-25, CELL 8
2-M-26, 2-M-27, 2-M-28, CELL 9
2-M-29, 2-M-30, 2-M-31, CELL 10

✳SEE MECHANICAL SCHEDULE

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15920 SHT01	600G	7502

NOTES

1. PROVIDE AND INSTALL TIMESWITCH AS FOLLOWS: INTERMATIC, INC. MODEL T-103, OR EQUAL. 24 HOUR DIAL TIME SWITCH, DOUBLE POLE, SINGLE THROW 40 AMP/POLE 12 ON/OFF OPERATIONS EACH DAY, 120 VOLT INPUT, NEMA 1 ENCLOSURE.
2. POWER SUPPLY LOCATED INSIDE FLOW TRANSMITTER PANEL.



RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mjc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERKMAN — STATE OF WASHINGTON — REGISTERED PROFESSIONAL ENGINEER
EXPIRES 11-30-07

REV.	DATE	DESCRIPTION	DRAWN BY	DRFT CHK	ORIG/ ENG'R	ENG'R CHK	EVS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	BM	JD	RM	RB	NA	RB

SCALE: NA

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC.
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
CONTROL SCHEMATICS - 3

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0120.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0120	0

DRAWING NO.	REV. NO.
0600X-DD-E0121	0

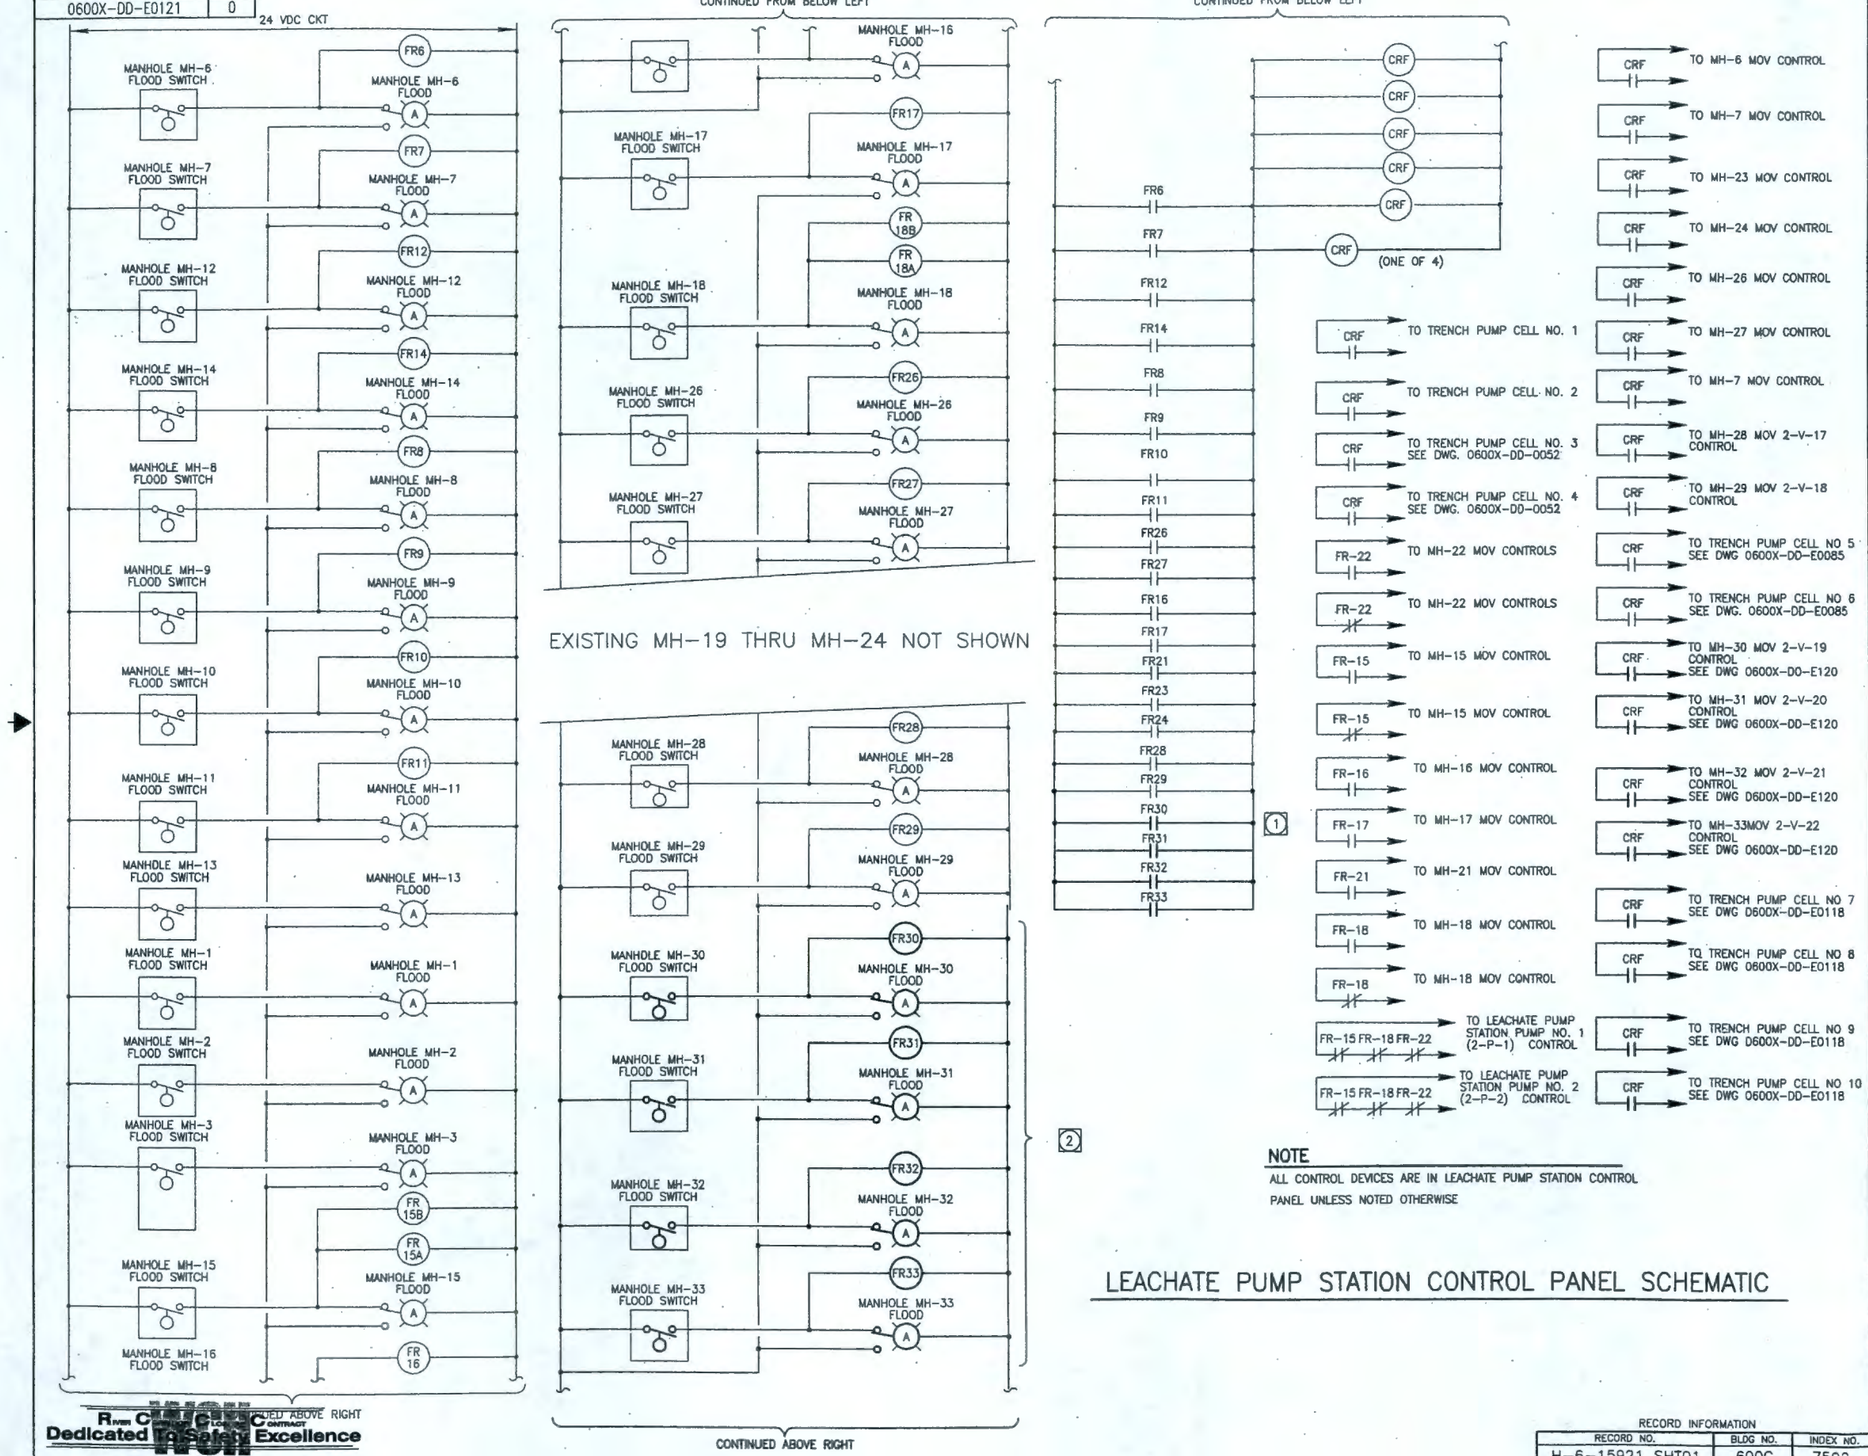

NOTES

1. CONNECT MH-30, MH-31 AND MH-32 FLOOD SWITCH ALARMS INTO SPARE ALARM LIGHTS (PROVIDE RELAYS, ALARM LIGHT, FOR MH-33 FLOOD SWITCH) IN LEACHATE PUMP STATION CONTROL PANEL. RUN NEW CRF RELAY SIGNAL TO TRENCH PUMPS AND MOV AT CELLS 7, 8, 9 AND 10 PUMPS.
2. NEW RELAYS AND INDICATING LIGHTS TO MATCH EXISTING.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1 ☒ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3 ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Bowling 10/8/07
Reviewer Signature — Document Number — Rev. — Date
0600X-SC-G0532 05-19 078
ECN-0, No. — Item — Submittal — Version
SCOX5247R00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

LEGEND

- EXISTING
- NEW

DOCUMENT CONTROL mjc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRIMAN — STATE OF WASHINGTON — 19622 — REGISTERED PROFESSIONAL ENGINEER
Date 11-30-07

REV.	DATE	DESCRIPTION	DRAWN BY	ENG'R CH'K	CHGD ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	BM	JD	BM		N/A	B

SCALE: NA

NOTE

ALL CONTROL DEVICES ARE IN LEACHATE PUMP STATION CONTROL PANEL UNLESS NOTED OTHERWISE

LEACHATE PUMP STATION CONTROL PANEL SCHEMATIC

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. — RICHLAND, WASHINGTON
WEAVER BOOS CONSULTANTS, LLC. — DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 – 10
CONTROL SCHEMATICS – 4

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0121.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0121	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15921 SHT01	600G	7502

Dedicated to Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-E0122	0

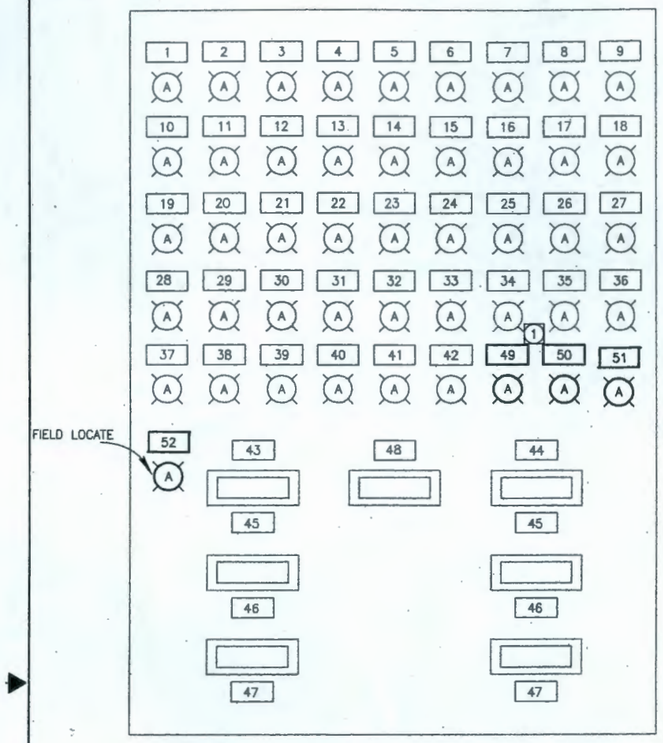

EXISTING LEACHATE PUMP STATION CONTROL PANEL

NAMEPLATE SCHEDULE			
NO.	INSCRIPTION	NO.	INSCRIPTION
1	MH-10 FLOOD	26	MH-17 MOISTURE
2	MH-11 FLOOD	27	MH-18 MOISTURE
3	MH-9 FLOOD	28	MH-24 FLOOD
4	MH-8 FLOOD	29	MH-21 MOISTURE
5	MH-7 FLOOD	30	MH-22 MOISTURE
6	MH-12 FLOOD	31	MH-28 FLOOD
7	MH-26 FLOOD	32	MH-29 FLOOD
8	MH-27 FLOOD	33	PUMP STATION FLOOD
9	MH-6 FLOOD	34	HIGH LEVEL LIFT STATION NO. 1
10	MH-14 FLOOD	35	TRENCH CELL 1 PUMP FAIL
11	MH-15 FLOOD	36	TRENCH CELL 2 PUMP FAIL
12	MH-17 FLOOD	37	STORAGE TANK NO. 1 HIGH LEVEL
13	MH-21 FLOOD	38	STORAGE TANK NO. 1 LOW LEVEL
14	MH-16 FLOOD	39	STORAGE TANK NO. 2 LOW LEVEL
15	MH-18 FLOOD	40	STORAGE TANK NO. 2 LOW LEVEL
16	MH-22 FLOOD	41	WASHWATER TANK HIGH LEVEL
17	MH-13 FLOOD	42	WASHWATER TANK LOW LEVEL
18	MH-1 FLOOD	43	TRENCH CELL 1 LEACHATE PUMP FLOW
19	MH-2 FLOOD	44	TRENCH CELL 2 LEACHATE PUMP FLOW
20	MH-3 FLOOD	45	PUMP 1
21	MH-19 FLOOD	46	PUMP 2
22	MH-20 FLOOD	47	PUMP 3
23	MH-15 MOISTURE	48	FLOW TO LOADOUT TRUCK
24	MH-23 FLOOD	49	MH-30 FLOOD
25	MH-16 MOISTURE	50	MH-31 FLOOD
		51	MH-32 FLOOD
		52	MH-33 FLOOD

1

1

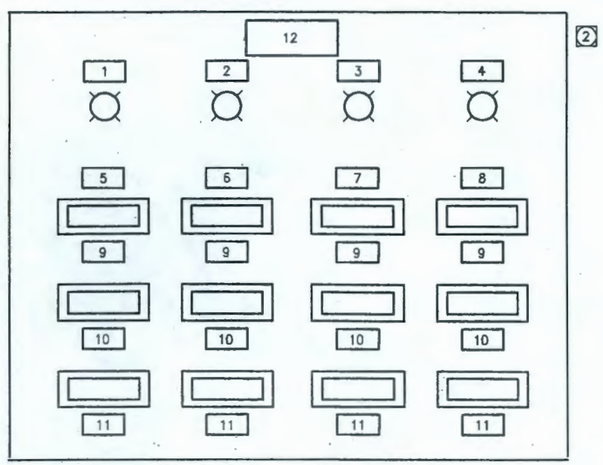

2

NEW LEACHATE PUMP STATION CONTROL PANEL NO. 3

NAMEPLATE SCHEDULE	
NO.	INSCRIPTION
1	TRENCH CELL 7 FAIL
2	TRENCH CELL 8 FAIL
3	TRENCH CELL 9 FAIL
4	TRENCH CELL 10 FAIL
5	TRENCH CELL 7 LEACHATE PUMP FLOW
6	TRENCH CELL 8 LEACHATE PUMP FLOW
7	TRENCH CELL 9 LEACHATE PUMP FLOW
8	TRENCH CELL 10 LEACHATE PUMP FLOW
9	PUMP 1
10	PUMP 2
11	PUMP 3
12	LEACHATE P.S. CONTROL PANEL NO. 3

NOTES

1. COMPONENTS ARE EXISTING (49, 50, 51) PROVIDE NEW FOR 52. PROVIDE TERMINALS BLOCKS AND WIRING TO MATCH EXISTING. REPLACE EXISTING NAMEPLATES WITH NEW INSCRIPTIONS PER SCHEDULES.

2. MOUNT LEACHATE PUMP STATION CONTROL PANEL NO. 3 EAST OF LEACHATE PUMP STATION CONTROL PANEL AND SIMILAR TO CONTROL PANEL NO. 2.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1 ☑ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3 ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Bostwick 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G0024 05-19 079
SCP-S No. — SUBSYSTEM — SUBMITTAL

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

500X 524 R00

LEGEND
EXISTING
NEW

Best Available Copy

DOCUMENT CONTROL mjc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRILL — STATE OF WASHINGTON — 12822 — REGISTERED PROFESSIONAL ENGINEER — EXPIRES: 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	DSGN/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION					N/A	

SCALE: NA

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 – 10
CONTROL SCHEMATICS – 5

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0122.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0122	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15922 SHT01	600G	7502

River Corridor Closure Contract — Dedicated to Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-E0123	0

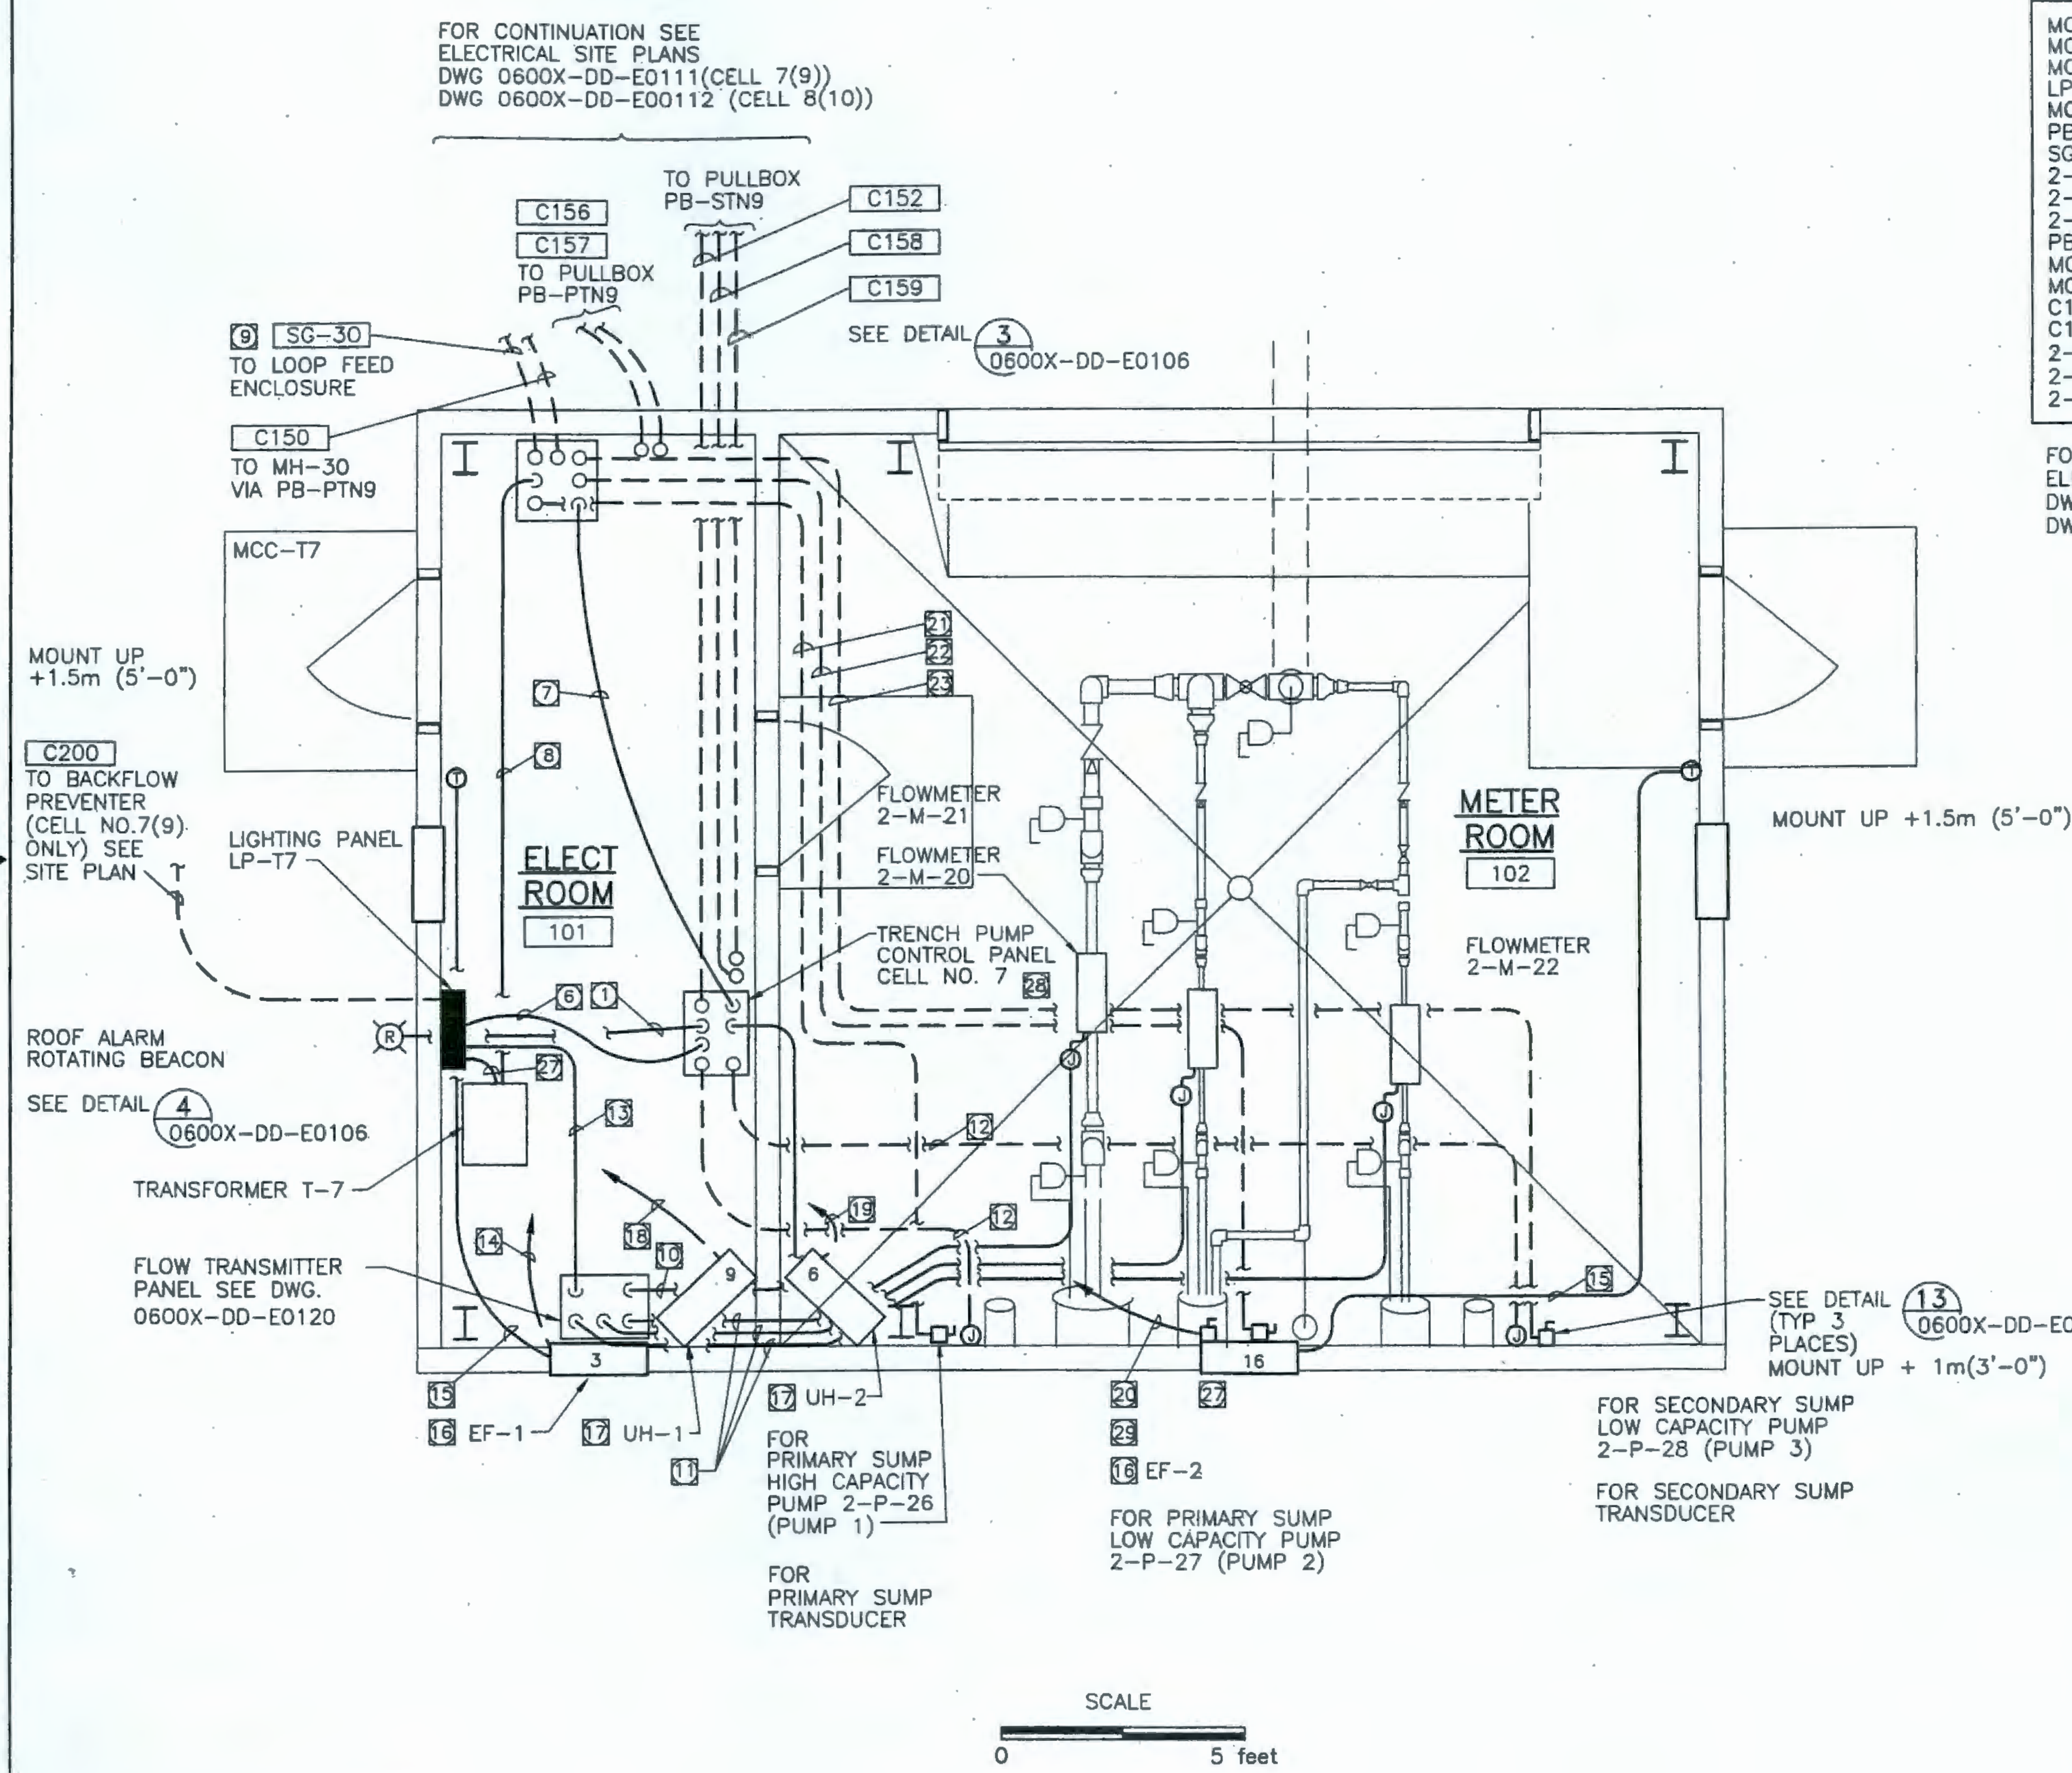

THIS DRAWING SHOWS CONDUIT AND EQUIPMENT FOR LEACHATE COLLECTION AT CELL NO. 7. ARRANGEMENT FOR CELL # 8,9,10 ARE SIMILAR WITH THE TAG NUMBER CHANGES.

CELL 7	CELL 8	CELL 9	CELL 10
MCT7-3	MCT8-3	MCT9-3	MCT10-3
MCT7-4	MCT8-4	MCT9-4	MCT10-4
MCT7-5	MCT8-5	MCT9-5	MCT10-5
LP-T7	LP-T8	LP-T9	LP-T10
MCC-T7	MCC-T8	MCC-T9	MCC-T10
PB-STN9	PB-STS9	PB-STN11	PB-STS11
SG-30	SG-2L	SG-30	SG-2L
2-M-20	2-M-23	2-M-26	2-M-29
2-M-21	2-M-24	2-M-27	2-M-30
2-M-22	2-M-25	2-M-28	2-M-31
PB-PTN9	PB-PTS9	PB-PTN11	PB-PTS11
MCT7-2A	MCT8-2A	MCT9-2A	MCT10-2A
MCT7-2AA	MCT8-2AA	MCT9-2AA	MCT10-2AA
C150	C160	C150	C160
C152	C162	C152	C162
2-P-26	2-P-29	2-P-32	2-P-35
2-P-27	2-P-30	2-P-33	2-P-36
2-P-28	2-P-31	2-P-34	2-P-37

FOR CONTINUATION SEE ELECTRICAL SITE PLANS
DWG 0600X-DD-E0111(CELL 7(9))
DWG 0600X-DD-E00112 (CELL 8(10))

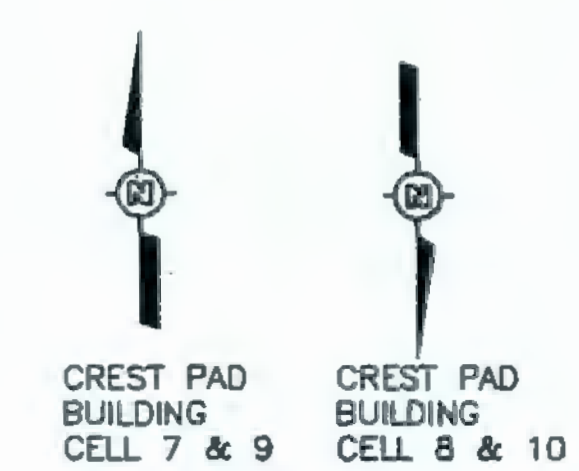

NOTES

1. 19.05mm (3/4")C, 2#12, 1#12G
2. VALUE IN () INDICATE VALUE ASSOC. WITH CELL 9 OR 10
3. NOT USED
4. NOT USED
5. NOT USED
6. 25.4mm (1")C, 2#12, 1#12G
7. 25.4mm (1")C, 20 #14, 1#14G
8. MCT7-2A
9. SEE DWG 0600X-DD-E0110 FOR CONDUIT/CONDUCTOR SIZES
10. 25.4mm (1")C, 3-2/C #16 SHLD
11. 19.05mm (3/4")C, 2/C #16 SHLD
12. 25.4mm (1")C, VENDOR CABLE
13. 19.05mm (3/4")C, 3#10, 1#10G TO LP-T7
14. 19.05mm (3/4")C, 2#12, 1#12G TO LP-T7
15. 19.05mm (3/4")C, 2#12, 1#12G
16. 1/2HP 120VAC 1 PHASE PROP TYPE EXHAUST FAN.
17. 3 KW UNIT HEATER
18. 19.05mm (3/4")C, 3#12, 1#12G TO LP-T7
19. 19.05mm (3/4")C, 3#12, 1#12G TO LP-T7
20. 19.05mm (3/4")C, 3#12, 1#12G TO LP-T7
21. MCT7-3, SEE ONE LINE DIAGRAM DWG 0600X-DD-E0115
22. MCT7-4, SEE ONE LINE DIAGRAM DWG 0600X-DD-E0115
23. MCT7-5, SEE ONE LINE DIAGRAM DWG 0600X-DD-E0115
24. NOT USED
25. FIELD ROUTE ALL CONDUIT ON WALLS.
26. NOT USED
27. 25.4mm (1")C, 4#6, 1#10G
28. SEE CONTROL DIAGRAM ON DWG 0600X-DD-E0118
29. MOUNT DISCONNECT SWITCHES FOR UNIT HEATERS AND EXHAUST FANS ON WALL ADJACENT TO UNITS.

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MERRIMAN · STATE OF WASHINGTON · 12322 · REGISTERED PROFESSIONAL ENGINEER · EXPIRES 11-30-08

DOCUMENT CONTROL mlc 10/11/07

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

WASHINGTON CLOSURE HANFORD · JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☑ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borlaug 10/9/07
0600X-SC-G0524 05-19 080
500X524A00

△							
△							
△							
△							
0	9/28/07	ISSUED FOR CONSTRUCTION	[illegible]	SD	[illegible]	N/A	[illegible]
REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS, LLC.
DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY CELLS 7 - 10 CREST PAD ELECTRICAL POWER PLAN

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0123.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0123	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15923 SHT01	600G	7301

River Corridor Closure Contract
Dedicated To Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-E0124	0

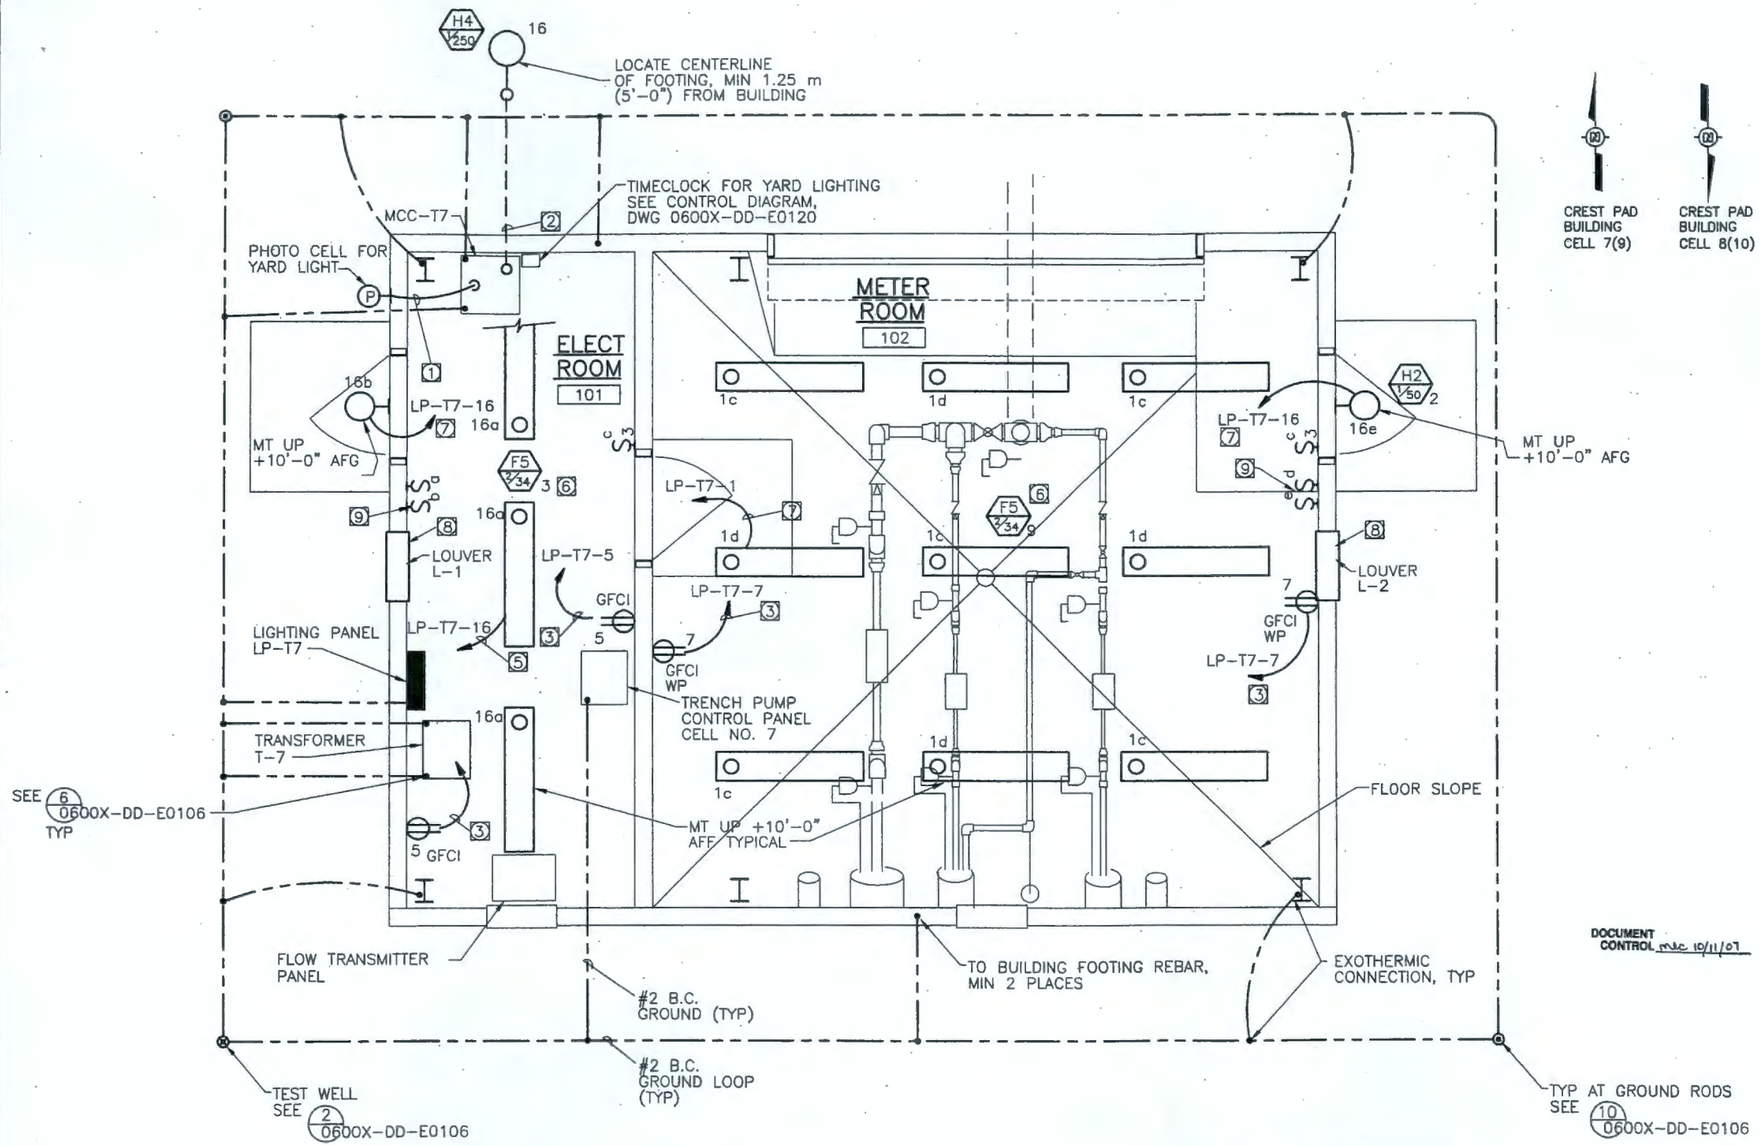

NOTES

1. 21mm (3/4")C, 3#12
2. 27mm (1")C, 2#10, 1#10G
3. 21mm (3/4")C, 2#12, 1#12G
4. NOT USED
5. 21mm (3/4")C, 2#12, 1#12G
6. FOR LUMINAIRE SCHEDULE SEE DWG 0600X-DD-E0117
7. 19.05mm (3/4")C, 2#12, 1#12G
8. 609.6mm x 609.6mm (24"x24") LOUVER W/SELF-CLOSING DAMPER
9. ENGRAVE SWITCHPLATES Sb AND Se TO READ: "EXTERIOR DOORLIGHT".
10. CIRCUIT NUMBERS ARE SHOWN ADJACENT TO LIGHTS, RECEPTACLES AND EQUIPMENT. FURNISH, INSTALL AND CONNECT THE QUANTITY OF CONDUCTORS IN CONDUIT AS REQUIRED FOR THE COMBINATION OF LIGHTS, LIGHT SWITCHES, RECEPTACLES AND EQUIPMENT CONNECTIONS ASSIGNED TO THE BRANCH CIRCUIT SHOWN. PROVIDE NO. 12 WIRE WITH NO. 12 GROUND IN 3/4" CONDUIT FOR CIRCUIT LENGTHS LESS THAN 75 FEET. PROVIDE NO. 10 WIRE FOR LENGTHS GREATER THAN 75 FEET.

THIS DRAWING SHOWS CONDUIT AND EQUIPMENT FOR LEACHATE COLLECTION AT CELL NO. 7. ARRANGEMENT FOR CELL NO. 8,9&10 IS SIMILAR WITH THE TAG NUMBER CHANGES.

CELL 7	CELL 8	CELL 9	CELL 10
LP-T7 MCC-T7 MCT7-2B	LP-T8 MCC-T8 MCT8-2B	LP-T9 MCC-T9 MCT9-2B	LP-T10 MCC-T10 MCT10-2B

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

RAYMOND E. MCKOWN — STATE OF WASHINGTON — 22223 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES: 11-30-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	BM	JD	REM	REM	N/A	[illegible]

SCALE: NA

DOCUMENT CONTROL mjc 10/11/07

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON	WEAVER BOOS CONSULTANTS, LLC. DENVER, COLORADO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 – 10
CREST PAD ELECTRICAL LIGHTING PLAN

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDE0124.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-E0124	0

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Review and resubmit. Work may proceed prior to resubmittal.
3. ☐ Review and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Review and resubmit. Work may not proceed.
5. ☐ Permission to proceed not applied.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Bowman 10/9/07
DOCUMENT ID NUMBER 0600X-SC-G0324 05-19 081
SOPO No. ITEM SUBMITTAL
500X524ADD

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

RECORD INFORMATION		
RECORD NO.	BLDG NO.	INDEX NO.
H-6-15924 SHT01	600G	7401

River Corridor Closure Contract
Dedicated to Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-M0022	0

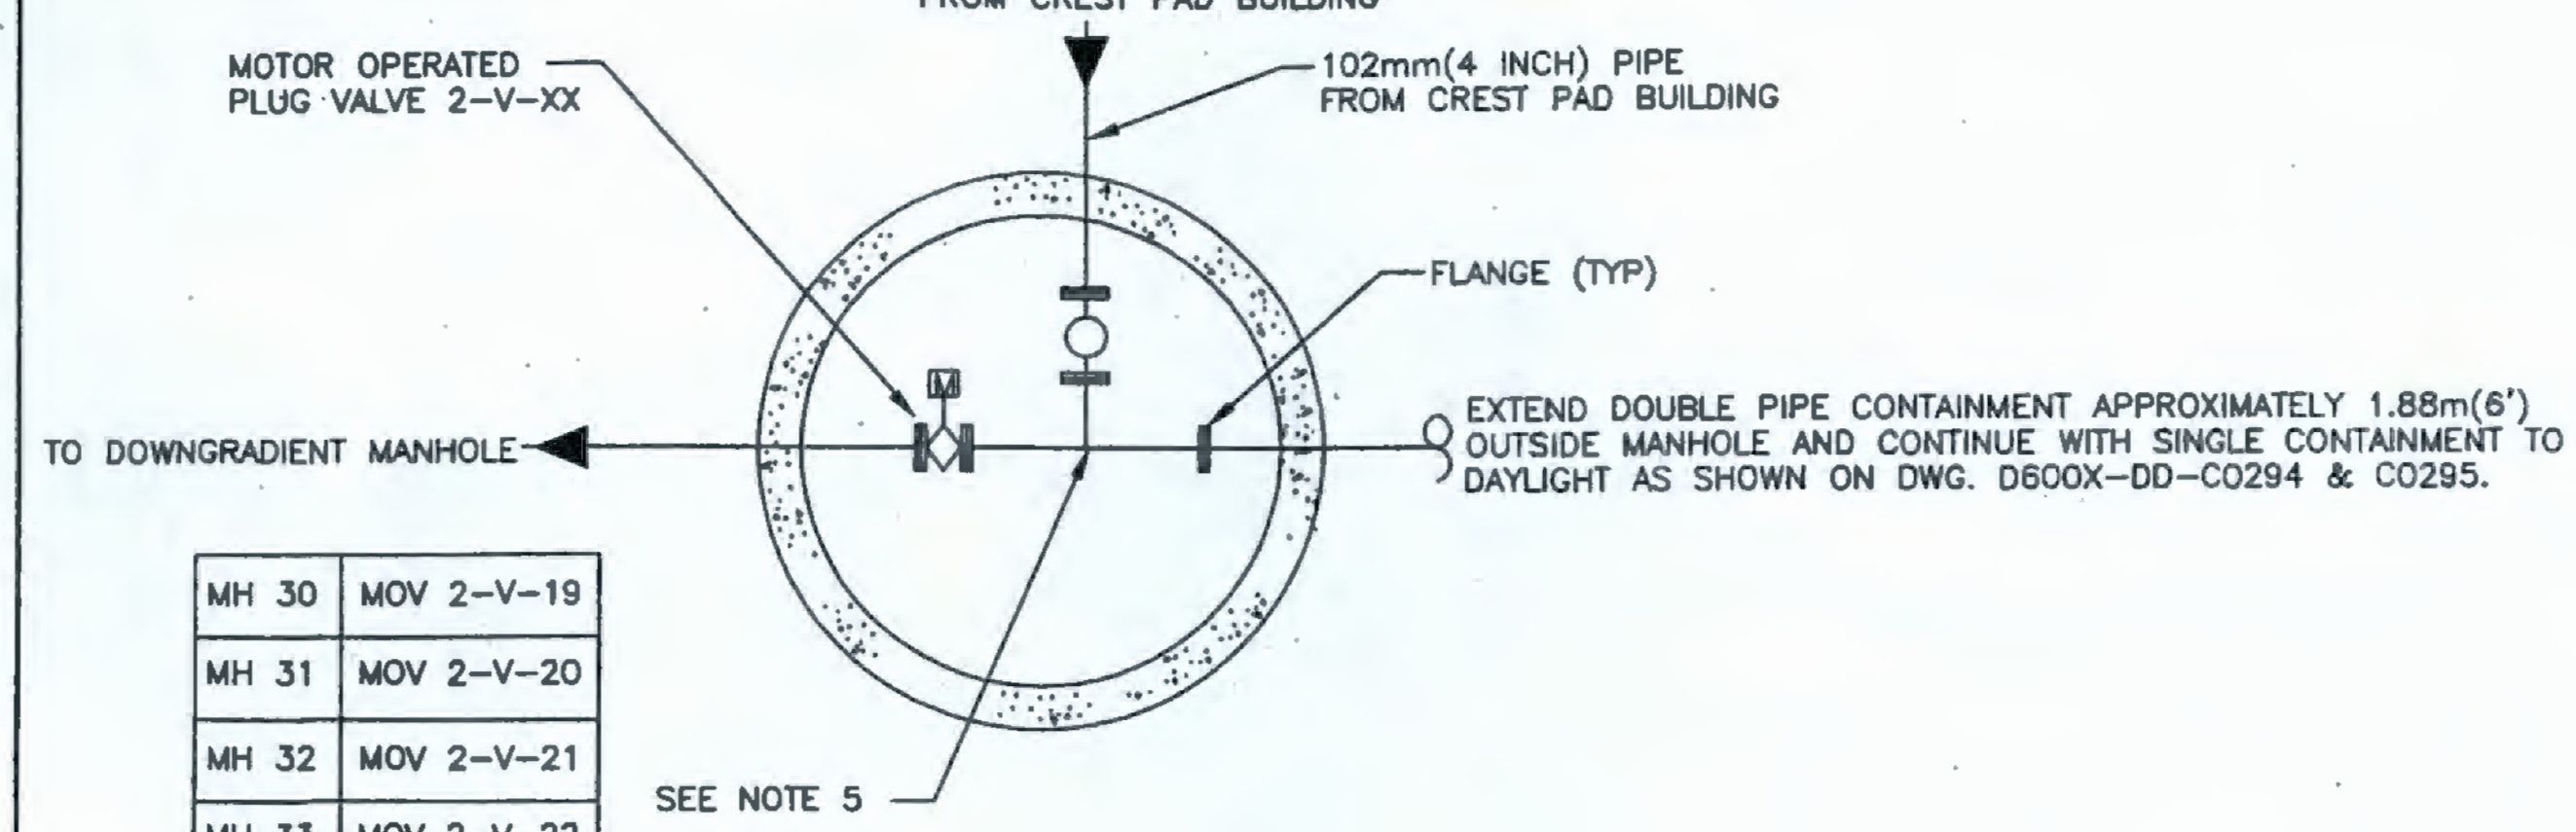

MH 30	MOV 2-V-19
MH 31	MOV 2-V-20
MH 32	MOV 2-V-21
MH 33	MOV 2-V-22

NOTES:

1. ALL JOINTS ARE FUSION WELDED UNLESS SHOWN OTHERWISE.
2. PROVIDE PIPE SUPPORTS AS PER MANUFACTURERS RECOMMENDATIONS.
3. CONTRACTOR SHALL USE THE SMALLEST PIPE SEGMENTS POSSIBLE FOR FABRICATING FITTINGS.
4. SECONDARY CONTAINMENT AND PENETRATION DETAILS NOT SHOWN.
5. MANHOLE COORDINATE LOCATION IS AT INTERSECTION OF PIPES. SEE MANHOLE SCHEDULE ON 0600X-DD-M0023.
6. 4" PIPE FROM CELL 7 & 9 CREST PAD BUILDING PENETRATES NORTH SIDE OF MANHOLE-(SHOWN ABOVE). 4" PIPE FROM CELL 8 & 10 CREST PAD BUILDING PENTETRATES SOUTH SIDE OF MANHOLE.

(1) MANHOLE 30, 31, 32 & 33 TIE-IN DETAIL

0600X-DD-C0292 NTS

NOTES

WASHINGTON CLOSURE HANFORD	JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP	

1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmission.
3. ☐ Revise and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Bill Borlaug 10/9/07

0600X-SC-G0524 05-19 082

SCP.O. No. / SIRS ITEM / SUBMITTAL

mjp 10/9/07

S00X P524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

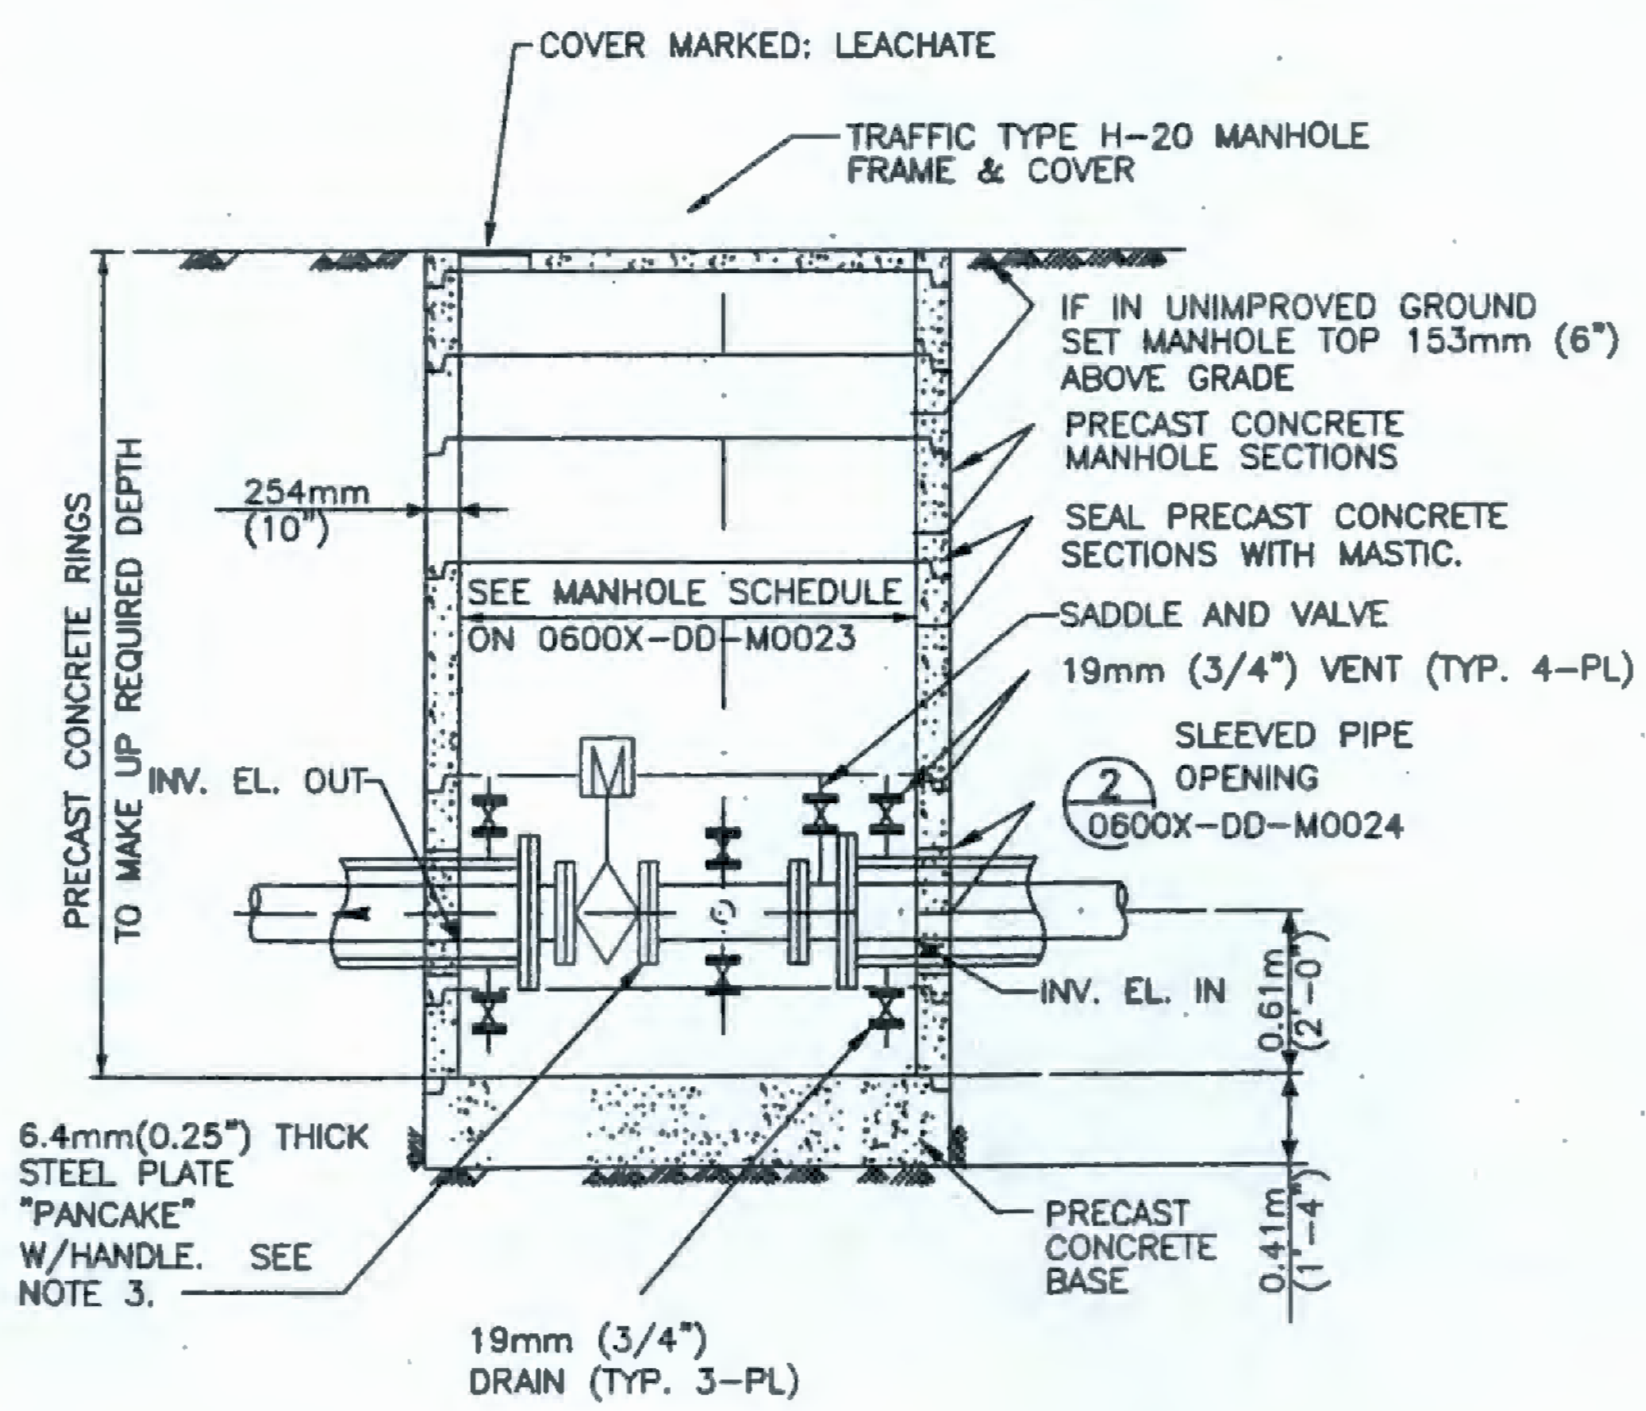

(B) SECTION

NOTE:

1. PROVIDE INDIVIDUAL RUNG LADDER OR FIXED LADDER CONFORMING TO OSHA REQUIREMENTS.
2. VENTS AND DRAINS SHALL BE INSTALLED ON ALL THREE CONTAINMENT PIPES IN MANHOLE.
3. INSTALL "PANCAKE" TO ALLOW COLLECTION OF CLEAN LEACHATE WATER PRIOR TO WASTE PLACEMENT.
4. DETAILS FOR MANHOLE 7 & 9 SHOWN. FOR MANHOLES 30 AND 32 10"x4" TEE, INLET BLIND FLANGE REVERSED (COMING OUT THROUGH RIGHT SIDE OF PLAN VIEW).
5. INSTALL CONFINED SPACE POSTINGS, COORDINATE WITH CONTRACTOR

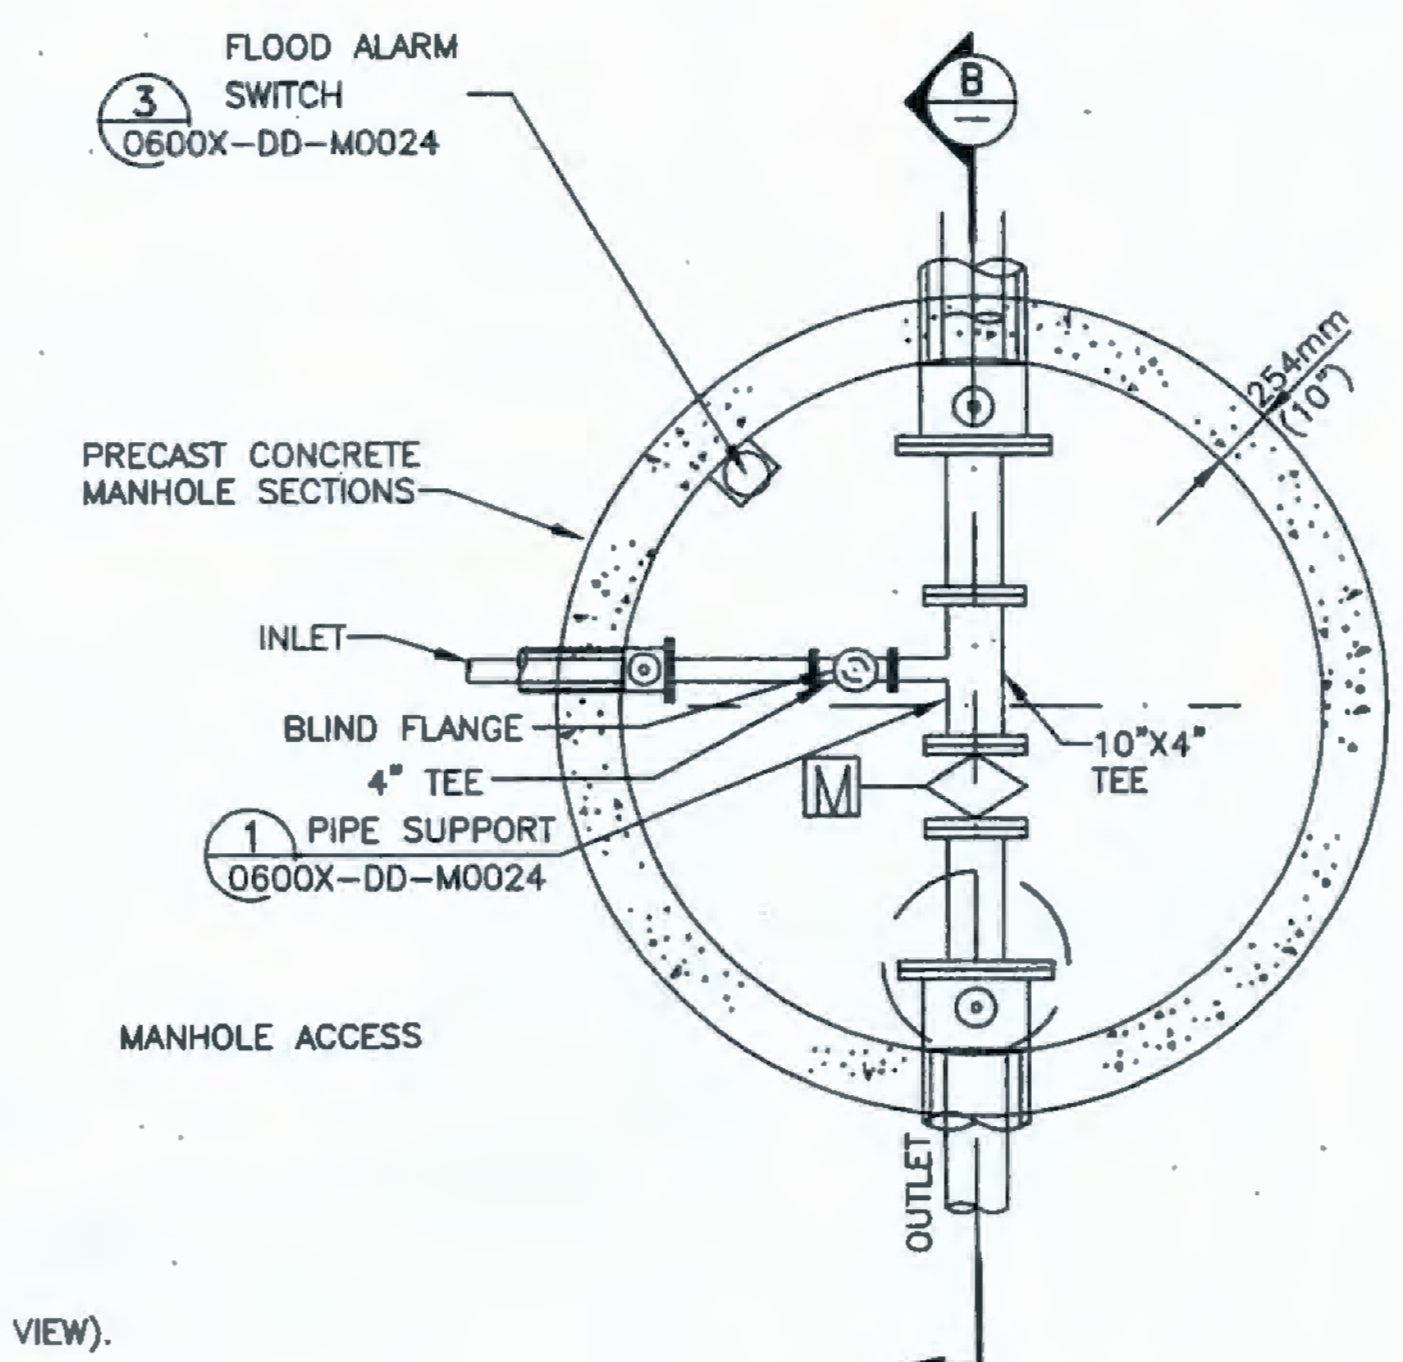

PLAN

(2) MANHOLE 30, 31, 32 & 33 DETAILS

0600X-DD-C0292 NTS

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) D. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

TONY R. BENEGAS — STATE OF WASHINGTON — 27910 REGISTERED PROFESSIONAL ENGINEER

EXPIRES 11-22-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	ZEM	JD	WB	REM	N/A	WB

SCALE: XX

U.S. DEPARTMENT OF ENERGY

DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS LLC
DENVER, CO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
PIPING DETAILS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDM0022.DWG

TASK	DRAWING NO.	REV. NO.
EDRF	0600X-DD-M0022	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15925 SHT01	600G	9901

River Corridor Closure Contract
Dedicated To Safety Excellence
WCH

2334_WCH-SUBJING 09/05

DRAWING NO.	REV. NO.
0600X-DD-M0023	0

PUMP SCHEDULE

EQUIPMENT NO.	LOCATION	SERVICE	PIPE FLOW	T.D.H.	MOTOR SIZE (MIN)	TYPE	REMARKS
2-P-26	TRENCH CELL 7 PRIMARY SUMP	LEACHATE	6.31 l/S (140gpm)	35.05m (115 ft)	3.73kw (5.0hp)	SUBMERSIBLE CENTRIFUGAL	MOUNTED ON WHEELED TROLLEYS
2-P-27	TRENCH CELL 7 PRIMARY SUMP	LEACHATE	0.95 l/S (15gpm)	42.67m (140 ft)	0.56kw (0.75hp)	SUBMERSIBLE CENTRIFUGAL	MOUNTED ON WHEELED TROLLEYS
2-P-28	TRENCH CELL 7 SECONDARY SUMP	LEACHATE	0.95 l/S (15gpm)	42.67m (140 ft)	0.56kw (0.75hp)	SUBMERSIBLE CENTRIFUGAL	MOUNTED ON WHEELED TROLLEYS
2-P-29	TRENCH CELL 8 PRIMARY SUMP	LEACHATE	6.31 l/S (140gpm)	35.05m (115 ft)	3.73kw (5.0hp)	SUBMERSIBLE CENTRIFUGAL	MOUNTED ON WHEELED TROLLEYS
2-P-30	TRENCH CELL 8 PRIMARY SUMP	LEACHATE	0.95 l/S (15gpm)	42.67m (140 ft)	0.56kw (0.75hp)	SUBMERSIBLE CENTRIFUGAL	MOUNTED ON WHEELED TROLLEYS
2-P-31	TRENCH CELL 8 SECONDARY SUMP	LEACHATE	0.95 l/S (15gpm)	42.67m (140 ft)	0.56kw (0.75hp)	SUBMERSIBLE CENTRIFUGAL	MOUNTED ON WHEELED TROLLEYS
2-P-32	TRENCH CELL 9 PRIMARY SUMP	LEACHATE	6.31 l/S (140gpm)	35.05m (115 ft)	3.73kw (5.0hp)	SUBMERSIBLE CENTRIFUGAL	MOUNTED ON WHEELED TROLLEYS
2-P-33	TRENCH CELL 9 PRIMARY SUMP	LEACHATE	0.95 l/S (15gpm)	42.67m (140 ft)	0.56kw (0.75hp)	SUBMERSIBLE CENTRIFUGAL	MOUNTED ON WHEELED TROLLEYS
2-P-34	TRENCH CELL 9 SECONDARY SUMP	LEACHATE	0.95 l/S (15gpm)	42.67m (140 ft)	0.56kw (0.75hp)	SUBMERSIBLE CENTRIFUGAL	MOUNTED ON WHEELED TROLLEYS
2-P-35	TRENCH CELL 10 PRIMARY SUMP	LEACHATE	6.31 l/S (140gpm)	35.05m (115 ft)	3.73kw (5.0hp)	SUBMERSIBLE CENTRIFUGAL	MOUNTED ON WHEELED TROLLEYS
2-P-36	TRENCH CELL 10 PRIMARY SUMP	LEACHATE	0.95 l/S (15gpm)	42.67m (140 ft)	0.56kw (0.75hp)	SUBMERSIBLE CENTRIFUGAL	MOUNTED ON WHEELED TROLLEYS
2-P-37	TRENCH CELL 10 SECONDARY SUMP	LEACHATE	0.95 l/S (15gpm)	42.67m (140 ft)	0.56kw (0.75hp)	SUBMERSIBLE CENTRIFUGAL	MOUNTED ON WHEELED TROLLEYS

VALVE SCHEDULE (203mm(8") AND LARGER MECHANICAL AND ALL MOTORIZED)

VALVE NO.	LOCATION	SERVICE	TYPE	SIZE	PRESSURE (PSI)	OPERATOR	REMARKS
2-V-19	MH-30	LEACHATE	ECCENTRIC PLUG VALVE	254.2mm (10 in)	1034 kPa (150 psi)	MOTORIZED	
2-V-20	MH-31	LEACHATE	ECCENTRIC PLUG VALVE	254.2mm (10 in)	1034 kPa (150 psi)	MOTORIZED	
2-V-21	MH-32	LEACHATE	ECCENTRIC PLUG VALVE	254.2mm (10 in)	1034 kPa (150 psi)	MOTORIZED	
2-V-22	MH-33	LEACHATE	ECCENTRIC PLUG VALVE	254.2mm (10 in)	1034 kPa (150 psi)	MOTORIZED	

METER SCHEDULE

METER NO.	LOCATION	SERVICE	TYPE	PIPE SIZE	FLOW RANGE	REMARKS
2-M-20	CREST PAD CELL 7	LEACHATE	PADDLE METER	50.8mm (2")	0-12.6 l/S (0-200gpm)	
2-M-21	CREST PAD CELL 7	LEACHATE	PADDLE METER	19.1mm (3/4")	0-1.6 l/S (0-25gpm)	
2-M-22	CREST PAD CELL 7	LEACHATE	PADDLE METER	19.1mm (3/4")	0-1.6 l/S (0-25gpm)	
2-M-23	CREST PAD CELL 8	LEACHATE	PADDLE METER	50.8mm (2")	0-12.6 l/S (0-200gpm)	
2-M-24	CREST PAD CELL 8	LEACHATE	PADDLE METER	19.1mm (3/4")	0-1.6 l/S (0-25gpm)	
2-M-25	CREST PAD CELL 8	LEACHATE	PADDLE METER	19.1mm (3/4")	0-1.6 l/S (0-25gpm)	
2-M-26	CREST PAD CELL 9	LEACHATE	PADDLE METER	50.8mm (2")	0-12.6 l/S (0-200gpm)	
2-M-27	CREST PAD CELL 9	LEACHATE	PADDLE METER	19.1mm (3/4")	0-1.6 l/S (0-25gpm)	
2-M-28	CREST PAD CELL 9	LEACHATE	PADDLE METER	19.1mm (3/4")	0-1.6 l/S (0-25gpm)	
2-M-29	CREST PAD CELL 10	LEACHATE	PADDLE METER	50.8mm (2")	0-12.6 l/S (0-200gpm)	
2-M-30	CREST PAD CELL 10	LEACHATE	PADDLE METER	19.1mm (3/4")	0-1.6 l/S (0-25gpm)	
2-M-31	CREST PAD CELL 10	LEACHATE	PADDLE METER	19.1mm (3/4")	0-1.6 l/S (0-25gpm)	

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. ☒ Work may proceed.
2. ☐ Review and resubmit. Work may proceed prior to resubmittal.
3. ☐ Review and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Review and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

REVIEW STAMP																		
REVIEW STAMP																		
SIGNATURE																		

Bill Bonlacey — 10/5/07
PROJECT ENGINEER — DOCUMENT ID NUMBER
0600X-SC-G0524 05-79 083
SCP.O. NO. — DATE ITEM — SUBMITTAL
500X524A00

NOTES

1. SEE ELECTRICAL DRAWING 0600X-DD-E0090 FOR UNIT HEATERS, EXHAUST FANS AND LOUVERS.
2. SEE DRAWING 0600X-DD-CD261 FOR COORDINATE INFORMATION.
3. LEAKAGE ALLOWANCE IS AS FOLLOWS:
   (A) PIPES SO DESIGNATED SHALL SHOW ZERO LEAKAGE.
   (B) PIPES SO DESIGNATED SHALL NOT SHOW A LOSS OF PRESSURE OF MORE THAN 5 PERCENT.
   (C) SEE SPECS.
4. FOR FIELD TEST PROCEDURES AND ADDITIONAL TEST REQUIREMENTS, SEE PIPING SECTION OF SPECIFICATIONS.
5. ANY ALLOWABLE DEVIATION FROM THE PIPING MATERIALS OR FIELD TEST REQUIREMENTS SHOWN WILL BE NOTED IN THE SPECIFICATIONS OR ON THE DRAWINGS.
6. FOR VALVES 8 INCHES AND LARGER SEE VALVE SCHEDULE. FOR SPECIAL VALVES SEE SPECIFICATIONS.
7. VALVES 2-1/2 INCH AND SMALLER MAY HAVE SCREWED ENDS VALVES 3 INCH AND LARGER SHALL HAVE FLANGED ENDS, UNLESS OTHERWISE SHOWN OR SPECIFIED.
8. CELLS 7-10 MECHANICAL SCHEDULES CONTINUED ON 0600X-DD-M0025, CELLS 7-10 MECHANICAL SCHEDULES.

TYPICAL PIPE DESIGNATION:

MATERIAL GROUP NUMBER

2" RW (2)

PIPE DIAMETER — FLUID ABBREVIATION

DOCUMENT CONTROL 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

TOM R. BENLAGHA — STATE OF WASHINGTON — 27910 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES 11-22-08

PIPING IDENTIFICATION SCHEDULE

FLUID ABBREVIATION	FUNCTION	PIPING MATERIALS (SEE SCHEDULE BELOW)				FIELD TEST REQUIREMENTS (SEE NOTE 4 AND NOTE 5)		
		EXPOSED PIPING		BURIED PIPING		MINIMUM TEST PRESSURE PSI	TEST MEDIUM	LEAKAGE ALLOWANCE (SEE NOTE 3)
		2 IN. DIA. AND SMALLER	2-1/2 IN. DIA. AND LARGER	2 IN. DIA. AND SMALLER	2-1/2 IN. DIA. AND LARGER			
CN	CONTAINER PIPE	--	--	--	26	SEE SPEC	WATER	(C)
LC	LEACHATE COLLECTION	--	--	--	25	--	--	--
LCC	LEACHATE COLLECTION CLEANOUT	--	26	--	26	--	--	--
LE	LEACHATE	16	16	26	26	SEE SPEC	WATER	(C)
RW	RAW WATER (NON-POTABLE)	--	--	--	35,25	SEE SPEC	WATER	(C)
TSR	TRENCH SUMP RISER PIPE	--	26	--	25,26	--	--	--
TSS	TRENCH SUMP SIGNAL CABLE PIPE	--	--	37	--	--	--	--
LYS	LYSIMETER ACCESS PIPE	--	26	--	25, 26	--	--	--

MANHOLE SCHEDULE
(SEE NOTE 2)

COORDINATE NO.	MANHOLE NO.	INVERT ELEV. IN	INVERT ELEV. OUT	SIDE INLET ELEV.	TOP OF MH ELEV.	DIA. m(FT)	NOTES
3525	MH-28	722.57	722.53	722.78	730.30	2.13(7)	
3527	MH-29	722.57	722.53	722.78	730.30	2.13(7)	
3528	MH-30	724.07	724.04	724.28	730.30	3.05(10)	INVERT EL PIPES IN/OUT-10" LE(26). SIDE INLET 4" LE(26)
3529	MH-31	724.07	724.04	724.28	730.30	3.05(10)	INVERT EL PIPES IN/OUT-10" LE(26). SIDE INLET 4" LE(26)
3530	MH-32	725.57	725.54	725.78	730.30	3.05(10)	INVERT EL PIPES IN/OUT-10" LE(26). SIDE INLET 4" LE(26)
3531	MH-33	725.57	725.54	725.78	730.30	3.05(10)	INVERT EL PIPES IN/OUT-10" LE(26). SIDE INLET 4" LE(26)

REV. NO.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	ORIG/ ENG'R	ENG'R CH'K	SYS. ENG'R	PROJ ENG'R
0	9/12/07	ISSUED FOR CONSTRUCTION	[illegible]	JD	TAB	PEK	N/A	TAB

SCALE: XX

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANT LLC
DENVER, CO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
MECHANICAL SCHEDULES

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDM0023.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-M0023	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15926 SHT01	600G	9901

River Corridor Closure Contract — Dedicated to Safety Excellence — WCH

DRAWING NO.	REV. NO.
0600X-DD-M0024	0

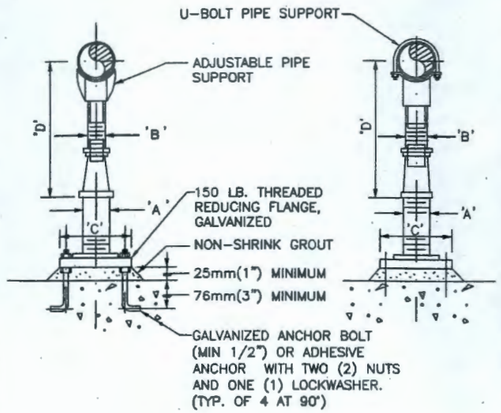

ADJUSTABLE PIPE SUPPORT
APPROXIMATE DIMENSIONS IN MM(INCHES)

PIPE SIZE	'A'	'B'	'C'	'D' MINIMUM	'D' MAXIMUM
64mm(2-1/2")	64mm(2-1/2")	38mm(1-1/2")	229mm(9")	203mm(8")	292mm(11-1/2")
76mm(3")	64mm(2-1/2")	38mm(1-1/2")	229mm(9")	210mm(8-1/4")	298mm(11-3/4")
89mm(3-1/2")	64mm(2-1/2")	38mm(1-1/2")	229mm(9")	216mm(8-1/2")	305mm(12")
102mm(4")	76mm(3")	* 64mm(2-1/2")	229mm(9")	260mm(10-1/4")	356mm(14")
152mm(6")	76mm(3")	* 64mm(2-1/2")	229mm(9")	295mm(11-5/8")	387mm(15-1/4")
203mm(8")	76mm(3")	* 64mm(2-1/2")	229mm(9")	346mm(13-5/8")	419mm(16-1/2")
254mm(10")	76mm(3")	* 64mm(2-1/2")	229mm(9")	371mm(14-5/8")	464mm(18-1/4")
305mm(12")	76mm(3")	* 64mm(2-1/2")	229mm(9")	397mm(15-5/8")	502mm(19-3/4")
356mm(14")	102mm(4")	76mm(3")	279mm(11")	479mm(18-7/8")	527mm(20-3/4")
406mm(16")	102mm(4")	76mm(3")	279mm(11")	505mm(19-7/8")	565mm(22-1/4")
457mm(18")	152mm(6")	89mm(3-1/2")	343mm(13-1/2")	540mm(21-1/4")	610mm(24")
508mm(20")	152mm(6")	89mm(3-1/2")	343mm(13-1/2")	591mm(23-1/4")	648mm(25-1/2")
610mm(24")	152mm(6")	102mm(4")	343mm(13-1/2")	673mm(26-1/2")	718mm(28-1/4)
762mm(30")	152mm(6")	102mm(4")	343mm(13-1/2")	752mm(29-5/8")	800mm(31-1/2")
813mm(32")	152mm(8")	102mm(4")	343mm(13-1/2")	778mm(30-5/8")	832mm(32-3/4")
914mm(36")	152mm(6")	102mm(4")	343mm(13-1/2")	829mm(32-5/8)	883mm(34-3/4")

* SEE MFR.

1 ADJUSTABLE PIPE SUPPORT WITH OR WITHOUT U-BOLT
0600X-DD-M0022 NTS

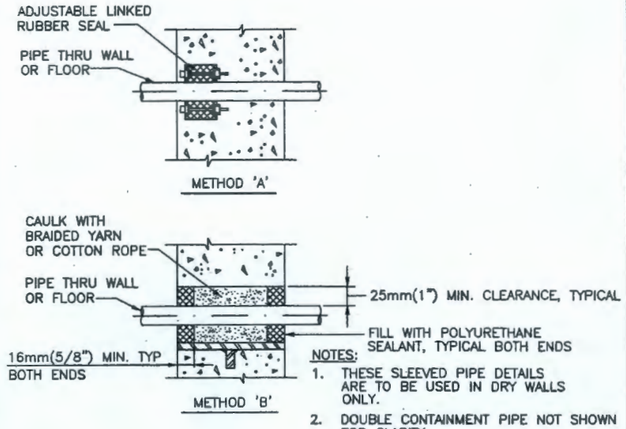

NOTES:
1. THESE SLEEVED PIPE DETAILS ARE TO BE USED IN DRY WALLS ONLY.
2. DOUBLE CONTAINMENT PIPE NOT SHOWN FOR CLARITY.

2 SLEEVED PIPE OPENING
0600X-DD-M0022, M0027 NTS

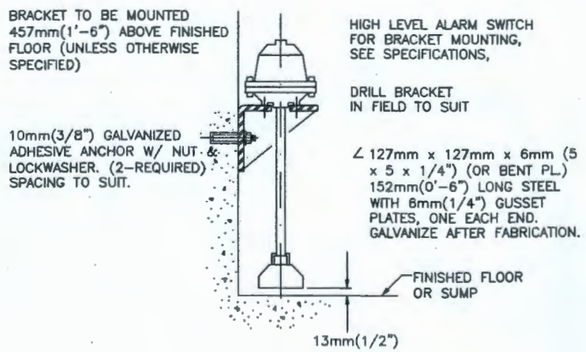

3 FLOOD ALARM SWITCH
0600X-DD-M0022 NTS

NOTES

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Precautions to proceed not applied.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

Document Number: 0600X-SC-G0534 05-19 084
Date: 10/9/07

500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mjc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) D. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

TONY R. BENEDICT — STATE OF WASHINGTON — 27840 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES 11-22-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG/ ENG'N	ENG'N CHK	SYS ENG'N	PROJ ENG'N
0	9/28/07	ISSUED FOR CONSTRUCTION	BRA	JD	TRB	RLM	N/A	TRB

SCALE: XX

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS LLC
DENVER, CO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 – 10
MECHANICAL DETAILS

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDM0024.DWG

TASK	DRAWING NO.	REV. NO.
EDRF	0600X-DD-M0024	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15927 SHT01	600G	9901

River Corridor Closure Contract
Dedicated to Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-M0025	0

PIPING MATERIAL SCHEDULE
(SEE NOTE 5)

GROUP NO.	PIPE	FITTINGS	VALVES, 8 INCHES AND SMALLER (SEE NOTE 6 & 7)
16	POLYVINYL CHLORIDE, SCHEDULE 80, SEE SPECS	POLYVINYL CHLORIDE, SCHEDULE 80 SEE SPECS	POLYVINYL CHLORIDE, BALL OR LIFT CHECK.
25	HDPE PERFORATED, CELL CLASSIFICATION 345434C ASTM D-2513 AND 3350, RESIN TYPE PE 3408	HDPE, THERMAL BUTT-FUSION	-------
26	HDPE, CELL CLASSIFICATION 345434C ASTM D-2513 AND 3350; RESIN TYPE PE 3408	HDPE, THERMAL BUTT-FUSION, ASTM D-792	-------
35	POLYVINYL CHLORIDE TYPE 1, GRADE 1, 18 ASTM D1784, AWWA C900	SHORT BODY CAST IRON OR DUCTILE IRON AWWA C110	SEE SPECS
37	POLYVINYL CHLORIDE, SCHEDULE 40: TYPE 1, GRADE 1, OR CLASS 12454-13 CONFORMING TO ASTM D1784, AND ASTM D1785	POLYVINYL CHLORIDE, SCHEDULE 40, ASTM D2466 AND ASTM D2467 FOR SOCKET WELD. USE SCHEDULE 80 ASTM D2464 FITTINGS FOR ANY FITTINGS REQUIRING THREADS.	-------

NOTES

1. SEE ELECTRICAL DRAWING 0600X-DD-E0090 FOR UNIT HEATERS, EXHAUST FANS AND LOUVERS.
2. SEE DRAWING 0600X-DD-C0260 FOR COORDINATE INFORMATION.
3. LEAKAGE ALLOWANCE IS AS FOLLOWS:
   (A) PIPES SO DESIGNATED SHALL SHOW ZERO LEAKAGE.
   (B) PIPES SO DESIGNATED SHALL NOT SHOW A LOSS OF PRESSURE OF MORE THAN 5 PERCENT.
   (C) SEE SPECS.
4. FOR FIELD TEST PROCEDURES AND ADDITIONAL TEST REQUIREMENTS, SEE PIPING SECTION OF SPECIFICATIONS.
5. ANY ALLOWABLE DEVIATION FROM THE PIPING MATERIALS OR FIELD TEST REQUIREMENTS SHOWN WILL BE NOTED IN THE SPECIFICATIONS OR ON THE DRAWINGS.
6. FOR VALVES 8 INCHES AND LARGER SEE VALVE SCHEDULE. FOR SPECIAL VALVES SEE SPECIFICATIONS.
7. VALVES 2-1/2 INCH AND SMALLER MAY HAVE SCREWED ENDS VALVES 3 INCH AND LARGER SHALL HAVE FLANGED ENDS, UNLESS OTHERWISE SHOWN OR SPECIFIED.
8. CONTINUED FROM 0600X-DD-M0023, CELLS 7-10 MECHANICAL SCHEDULES.

TYPICAL PIPE DESIGNATION:

MATERIAL GROUP NUMBER

2" RW (2)

PIPE DIAMETER — FLUID ABBREVIATION

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) 0. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

TONY R. BENEDICT — STATE OF WASHINGTON — 22 — REGISTERED PROFESSIONAL ENGINEER

EXPIRES 11-22-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CHK	ORIG ENG'R	ENG'R CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	EDR	JD	TAP	RCW	N/A	TAP

SCALE: XX

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS LLC DENVER, CO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 - 10
MECHANICAL SCHEDULES

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDM0025.DWG

TASK	DRAWING NO.	REV. NO.
EDRF	0600X-DD-M0025	0

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP

1. [X] Work may proceed.
2. [ ] Review and resubmit. Work may proceed prior to resubmission.
3. [ ] Review and resubmit. Work may proceed prior to resubmission subject to resolution of indicated comments.
4. [ ] Review and resubmit. Work may not proceed.
5. [ ] Permission to proceed not required.

Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.

DISPOSITION CODES	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
DISPOSITION																				

Signature of Supplier/Subcontractor: Bill Delaney — Date: 10/9/07

DOCUMENT ID NUMBER: 0600X-EC-60524 — SCP-G No. 05-19 — SUBMITTAL: 0035

500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15928 SHT01	600G	9901

River Corridor Closure Contract — Dedicated to Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-M0027	0

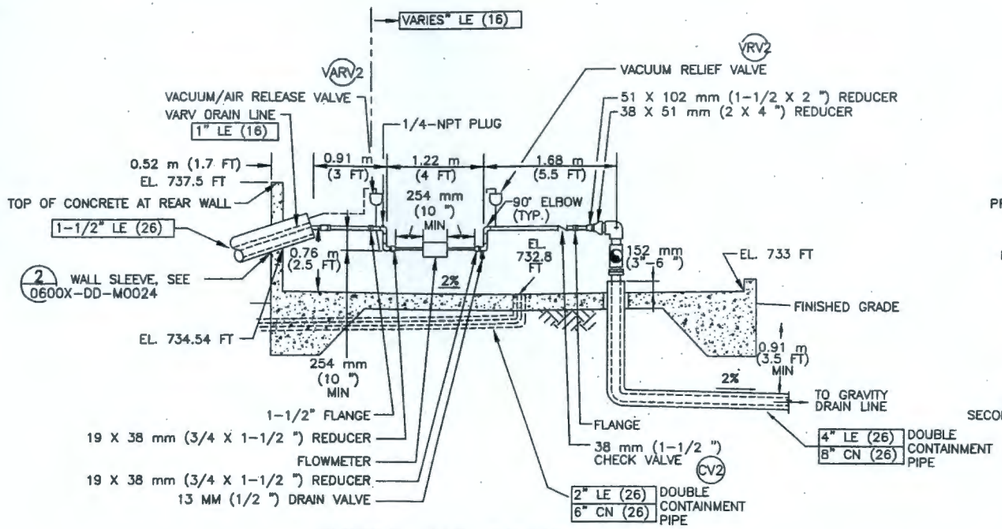

A CREST PAD PROFILE, LOW CAPACITY LINE (PRIMARY)

(NOTE 2)

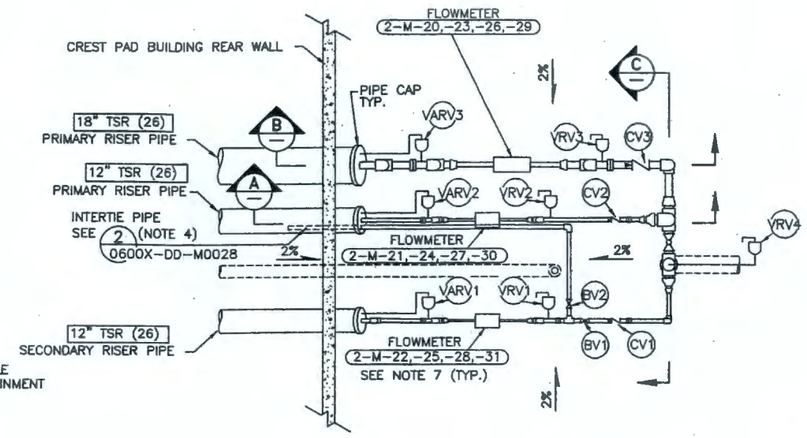

1 CREST PAD PIPING PLAN

0600X-DD-C0291 (NOTES 1, 3)

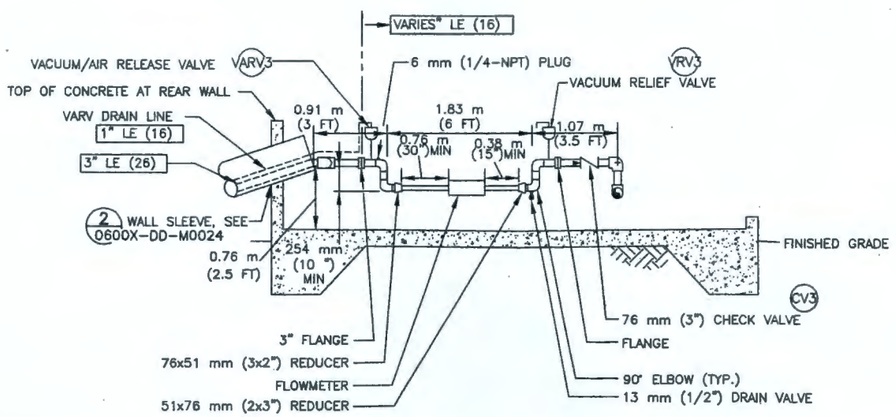

B CREST PAD PROFILE, HIGH CAPACITY LINE (PRIMARY)

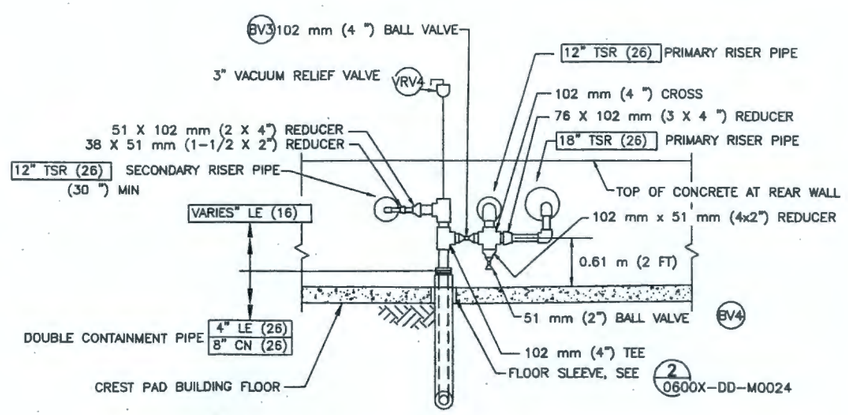

C HEADER PIPE ELEVATION

NOTES

1. PIPE SUPPORTS, PIPE CAPS, JUNCTION BOXES, AND CONDUIT NOT SHOWN.
2. SECONDARY LOW-CAPACITY DISCHARGE LINE GENERALLY SIMILAR.
3. ALL PIPING CONNECTIONS SHALL ALLOW REMOVAL AND REPLACEMENT OF ALL VALVES, METERS, AND SIMILAR COMPONENTS WITHOUT CUTTING OF PIPE OR FITTINGS.
4. EXTEND INTERTIE PIPE 0.9 m (3 FT) INTO PRIMARY RISER PIPE.
5. SEE 1 0600X-DD-M0024 FOR CREST PAD BLDG. PIPE SUPPORT DETAILS.
6. SEE SPECIFICATION 0600X-SP-M0029 FOR VALVE INFORMATION AND IDENTIFICATION TAGS.
7. FLOWMETER IDENTIFICATION NUMBERS SHOWN FOR BOTH CREST PAD BUILDINGS, SEE METER SCHEDULE ON 0600X-DD-M0023.

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1 ☒ Work may proceed.
2 ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3 ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4 ☐ Revise and resubmit. Work may not proceed.
5 ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
DISCIPLINE: CIVIL
DISCIPLINE: MECHANICAL
Bill Bozlaugh — 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G0594 — 05-19 — 086
SUBMITTAL: 500X-B44-A00

LEGEND

(BV1) VALVE NUMBER

DOCUMENT CONTROL mlc 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

TONY R. BENEGAS — STATE OF WASHINGTON — 27916 — REGISTERED PROFESSIONAL ENGINEER — EXPIRES 11-22-07

REV.	DATE	DESCRIPTION	DRAWN BY	CHKT CHK	CHKV ENG'R	CHKTR CHK	SYS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	BEB	JD		BEM	N/A	

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC. RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS LLC DENVER, CO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 – 10
CREST PAD DETAILS – 1

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDM0027.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-M0027	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15930 SHT01	600G	9901

River Corridor Closure Contract — Dedicated to Safety Excellence

DRAWING NO.	REV. NO.
0600X-DD-M0028	0

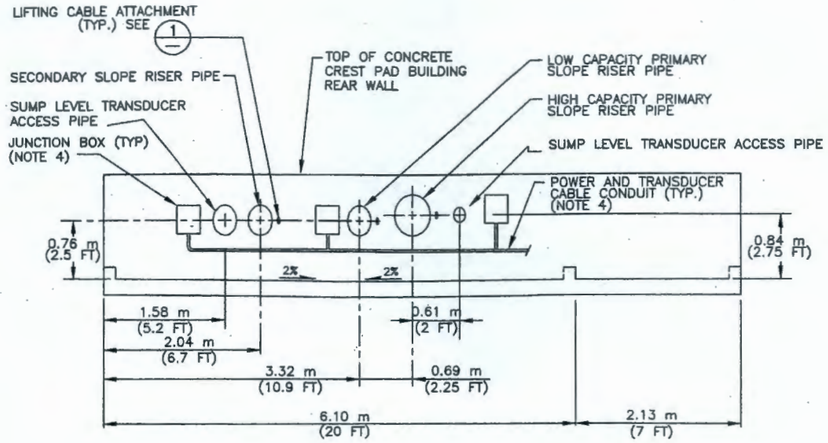

A CREST WALL ELEVATION
0600X-DD-C0291

SCALE
0 3 6 feet

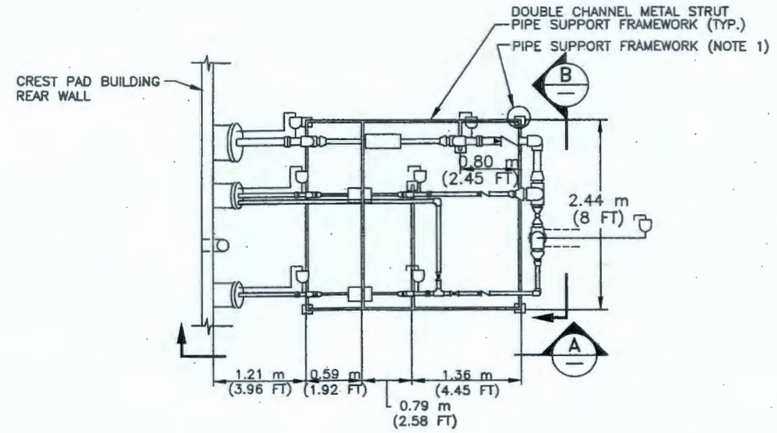

1 PIPE SUPPORT PLAN LAYOUT
0600X-DD-M0027 (NOTES 1, 2, 3)

SCALE
0 3 6 feet

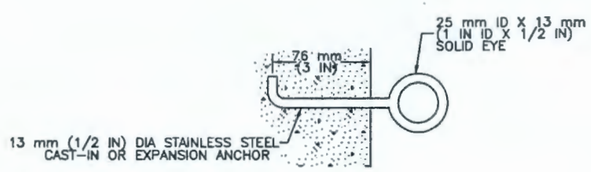

1 LIFTING CABLE ATTACHMENT DETAIL
NTS

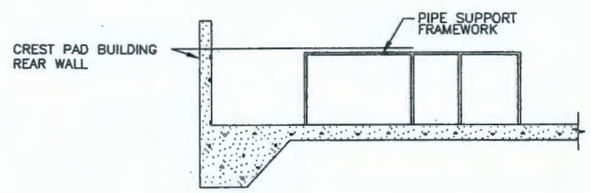

A PIPE SUPPORT SIDE VIEW

SCALE
0 3 6 feet

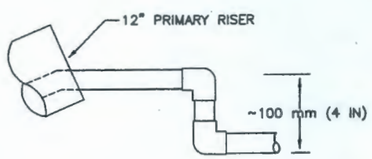

2 INTERTIE DETAIL (ELEVATION)
0600X-DD-M0027 NTS

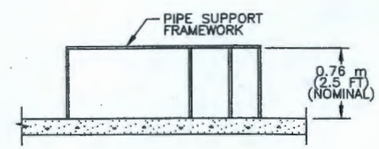

B PIPE SUPPORT END VIEW

SCALE
0 3 6 feet

NOTES

1. BOLT FRAMEWORK TO CONCRETE FLOOR USING NUMBER, SIZE, AND TYPE OF ANCHOR BOLTS PER FRAMEWORK MANUFACTURER'S RECOMMENDATIONS.
2. PIPE SUPPORT LAYOUT MAY BE ADJUSTED TO SUIT FIELD CONDITIONS WITH APPROVAL OF CONTRACTING OFFICER.
3. CREST PAD BUILDING NOT SHOWN.
4. LOCATE JUNCTION BOXES AND CONDUITS AS CONVENIENT SUBJECT TO CONTRACTOR'S APPROVAL.
5. SEE 0600X-DD-E0090 FOR ADDITIONAL ELECTRICAL DETAILS.

WASHINGTON CLOSURE HANFORD — JOB NO. 14655
SUPPLIER/SUBCONTRACTOR DOCUMENT STATUS STAMP
1. ☒ Work may proceed.
2. ☐ Revise and resubmit. Work may proceed prior to resubmittal.
3. ☐ Revise and resubmit. Work may proceed prior to resubmittal subject to resolution of indicated comments.
4. ☐ Revise and resubmit. Work may not proceed.
5. ☐ Permission to proceed not required.
Permission to proceed does not constitute acceptance of approval of design details, calculations, analyses, test methods, or materials developed or selected by the supplier/subcontractor and does not relieve supplier/subcontractor from full compliance with contractual obligations or release any "holds" placed on the contract.
Bill Bellamy 10/9/07
DOCUMENT ID NUMBER: 0600X-SC-G0524 02-19 087
SUPPL. NO. DISC. CODE SEQUENCE NO.
500X524A00

RECEIVED
OCT 08 2007
WCH - DOCUMENT CONTROL

DOCUMENT CONTROL mse 10/11/07

MY STAMP AND SEAL APPLY TO THOSE CHANGES MADE IN REVISION(S) E. THE ORIGINAL DESIGN WAS NOT PREPARED UNDER MY DIRECTION.

THIS DRAWING HAS BEEN PREPARED IN PART ON THE BASIS OF INFORMATION COMPILED AND FURNISHED BY OTHERS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH HAVE BEEN INCORPORATED INTO THIS DOCUMENT AS A RESULT.

TONY R. BENGOA — STATE OF WASHINGTON — 22810 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES 11-22-08

REV.	DATE	DESCRIPTION	DRAWN BY	DRAFT CH'K	CHKD/ ENG'R	ENG'R CH'K	STS ENG'R	PROJ ENG'R
0	9/28/07	ISSUED FOR CONSTRUCTION	[illegible]	JJD	TMB	DEN	N/A	[illegible]

SCALE: AS SHOWN

U.S. DEPARTMENT OF ENERGY
DOE RICHLAND OPERATIONS OFFICE
RIVER CORRIDOR CLOSURE CONTRACT

WASHINGTON CLOSURE HANFORD LLC.
RICHLAND, WASHINGTON

WEAVER BOOS CONSULTANTS LLC
DENVER, CO

ENVIRONMENTAL RESTORATION DISPOSAL FACILITY
CELLS 7 – 10
CREST PAD DETAILS – 2

WCH JOB NO.	DOE CONTRACT NO.	CADD FILENAME
14655	DE-AC06-05RL-14655	6XDM0028.DWG

TASK	DRAWING NO.	REV. NO.
ERDF	0600X-DD-M0028	0

RECORD INFORMATION

RECORD NO.	BLDG NO.	INDEX NO.
H-6-15931 SHT01	600G	9901

River Corridor Closure Contract — Dedicated To Safety Excellence