

1230955


Department of Energy
Richland Operations Office
P.O. Box 550
Richland, Washington 99352

AUG 24 2015

15-ESQ-0101

Ms. J. A. Hedges, Program Manager
Nuclear Waste Program
Washington State Department of Ecology
3100 Port of Benton Boulevard
Richland, Washington 99354

Mr. D. Dossett, Unit Manager
Air Permits Unit AWT-150
U.S. Environmental Protection Agency
Region 10 Administrator
1200 Sixth Avenue, Suite 900
Seattle, Washington 98101

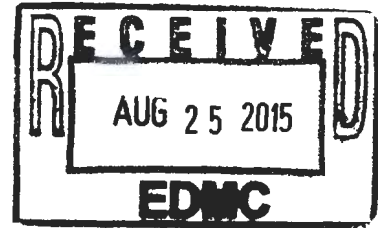

Addressees:

TRANSMITTAL OF NOTIFICATION OF CHANGE NOT REQUIRING PERMIT REVISION,
PERMIT NUMBER 00-05-006, RENEWAL 2, FOR REMOVAL FROM SERVICE OF FAST
FLUX TEST FACILITY (FFTF) EMERGENCY GENERATOR (400 E-4250 001, G-3)

In accordance with Section 5.8 of the Hanford Site Air Operating Permit (AOP), Number: 00-05-006, Renewal 2, this letter transmits a written notice for permanently shutting down an emission unit to the Washington State Department of Ecology and the U.S. Environmental Protection Agency. The FFTF Emergency Generator 400 E-4250 001, G-3 was removed from service in 2006 after cessation of operations at the FFTF. In accordance with AOP Standard Terms and Conditions 5.8.1, periodic monitoring (i.e., at least once per calendar quarter) for visible emissions will no longer be performed as required by the AOP Attachment 1, Table 1.4. There are no plans to operate the emergency generator in the future. The unit has been electrically isolated from automatic startup, the batteries disconnected and removed, and the generator physically isolated from the fuel source.

Attached is a Notification of Change Not Requiring Permit Revision requesting removal of Emergency Generator 400 E-4250 001, G-3 from AOP Attachment 1, Table 1.4, Internal Combustion Engines: 500 Horsepower and Greater.


Addressees
15-ESQ-0101

-2-

AUG 24 2015

If you have any questions, please contact me, or your staff may contact Ed MacAlister, Director, Environmental, Safety, and Quality, on (509) 373-0462.

Sincerely,

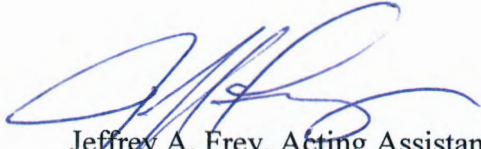

Jeffrey A. Frey, Acting Assistant Manager
for Safety and Environment

ESQ:ETF

Attachment

cc w/attach:

R. H. Engelmann, CHPRC

D. A. Faulk, EPA

P. M. Gent, Ecology

R. A. Kaldor, MSA

P. T. Karschnia, CHPRC

D. Zhen, EPA

Administrative Record

Environmental Portal

cc w/o attach:

G. Bohnee, NPT

R. Jim, YN

K. Niles, OR DOE

R. Skeen, CTUIR

ATTACHMENT

NOTIFICATION OF CHANGE NOT REQUIRING PERMIT REVISION
Section 502(2)(10) Change

Consisting of 2 pages,
including this cover page

NOTIFICATION OF CHANGE NOT REQUIRING PERMIT REVISION

Section 502(2)(10) Change*

This notification is provided to the Washington State Department of Ecology, Washington State Department of Health, and the U.S. Environmental Protection Agency as notice of a change not requiring permit revision described as follows.

This change is allowed pursuant to WAC 173-401-722(1), WAC 173-401-722(2) and WAC 173-401-722(5):

1. Change is not a Title I modification.
2. Change does not result in emissions that exceed those allowable under the permit, whether expressed as a rate of emissions, or in total emissions.
3. Change does not alter permit terms that are necessary to enforce limitations on emissions from units covered by the permit;
4. Notification is proved to Ecology, WDOH, and EPA at least 7 days before making the change, and
5. Change does not violate applicable requirements or contravene enforceable permit terms and conditions that are monitoring (including test methods), recordkeeping, reporting, or compliance certification requirements.
6. A source making a change under this section shall comply with applicable preconstruction review requirements established pursuant to RCW 70.94.152.

Permit Number: 00-05-006

Provide the following information pursuant to WAC-173-401-722(2)(a):

Description of the change:
Remove emergency generator 400 E-4250 001, G-3 from AOP Table 1.4, Internal Combustion Engines: 500 Horsepower and Greater.
Date of change:
Seven (7) days following the submittal of the request
Describe the emissions resulting from the change:
There will be no future emissions from this unit. The Fast Flux Testing Facility (FFTF) emergency generator (400 E-4250 001, G-3) has been removed from service in conjunction with cessation of FFTF operations. There are no plans to operate the emergency generator in the future. The unit has been electrically isolated from automatic startup, the batteries disconnected and removed and the generator physically isolated from the fuel source.
List any permit term or condition that will no longer be applicable as a result of the change:
All permit terms and conditions of the AOP will no longer be applicable.

* WAC 173-401-200(30) states that "Section 502(b)(10) changes" are changes that contravene an express permit term. Such changes do not include changes that would violate applicable requirements or contravene enforceable permit terms and conditions that are monitoring (including test methods), recordkeeping, reporting or compliance certification requirements.