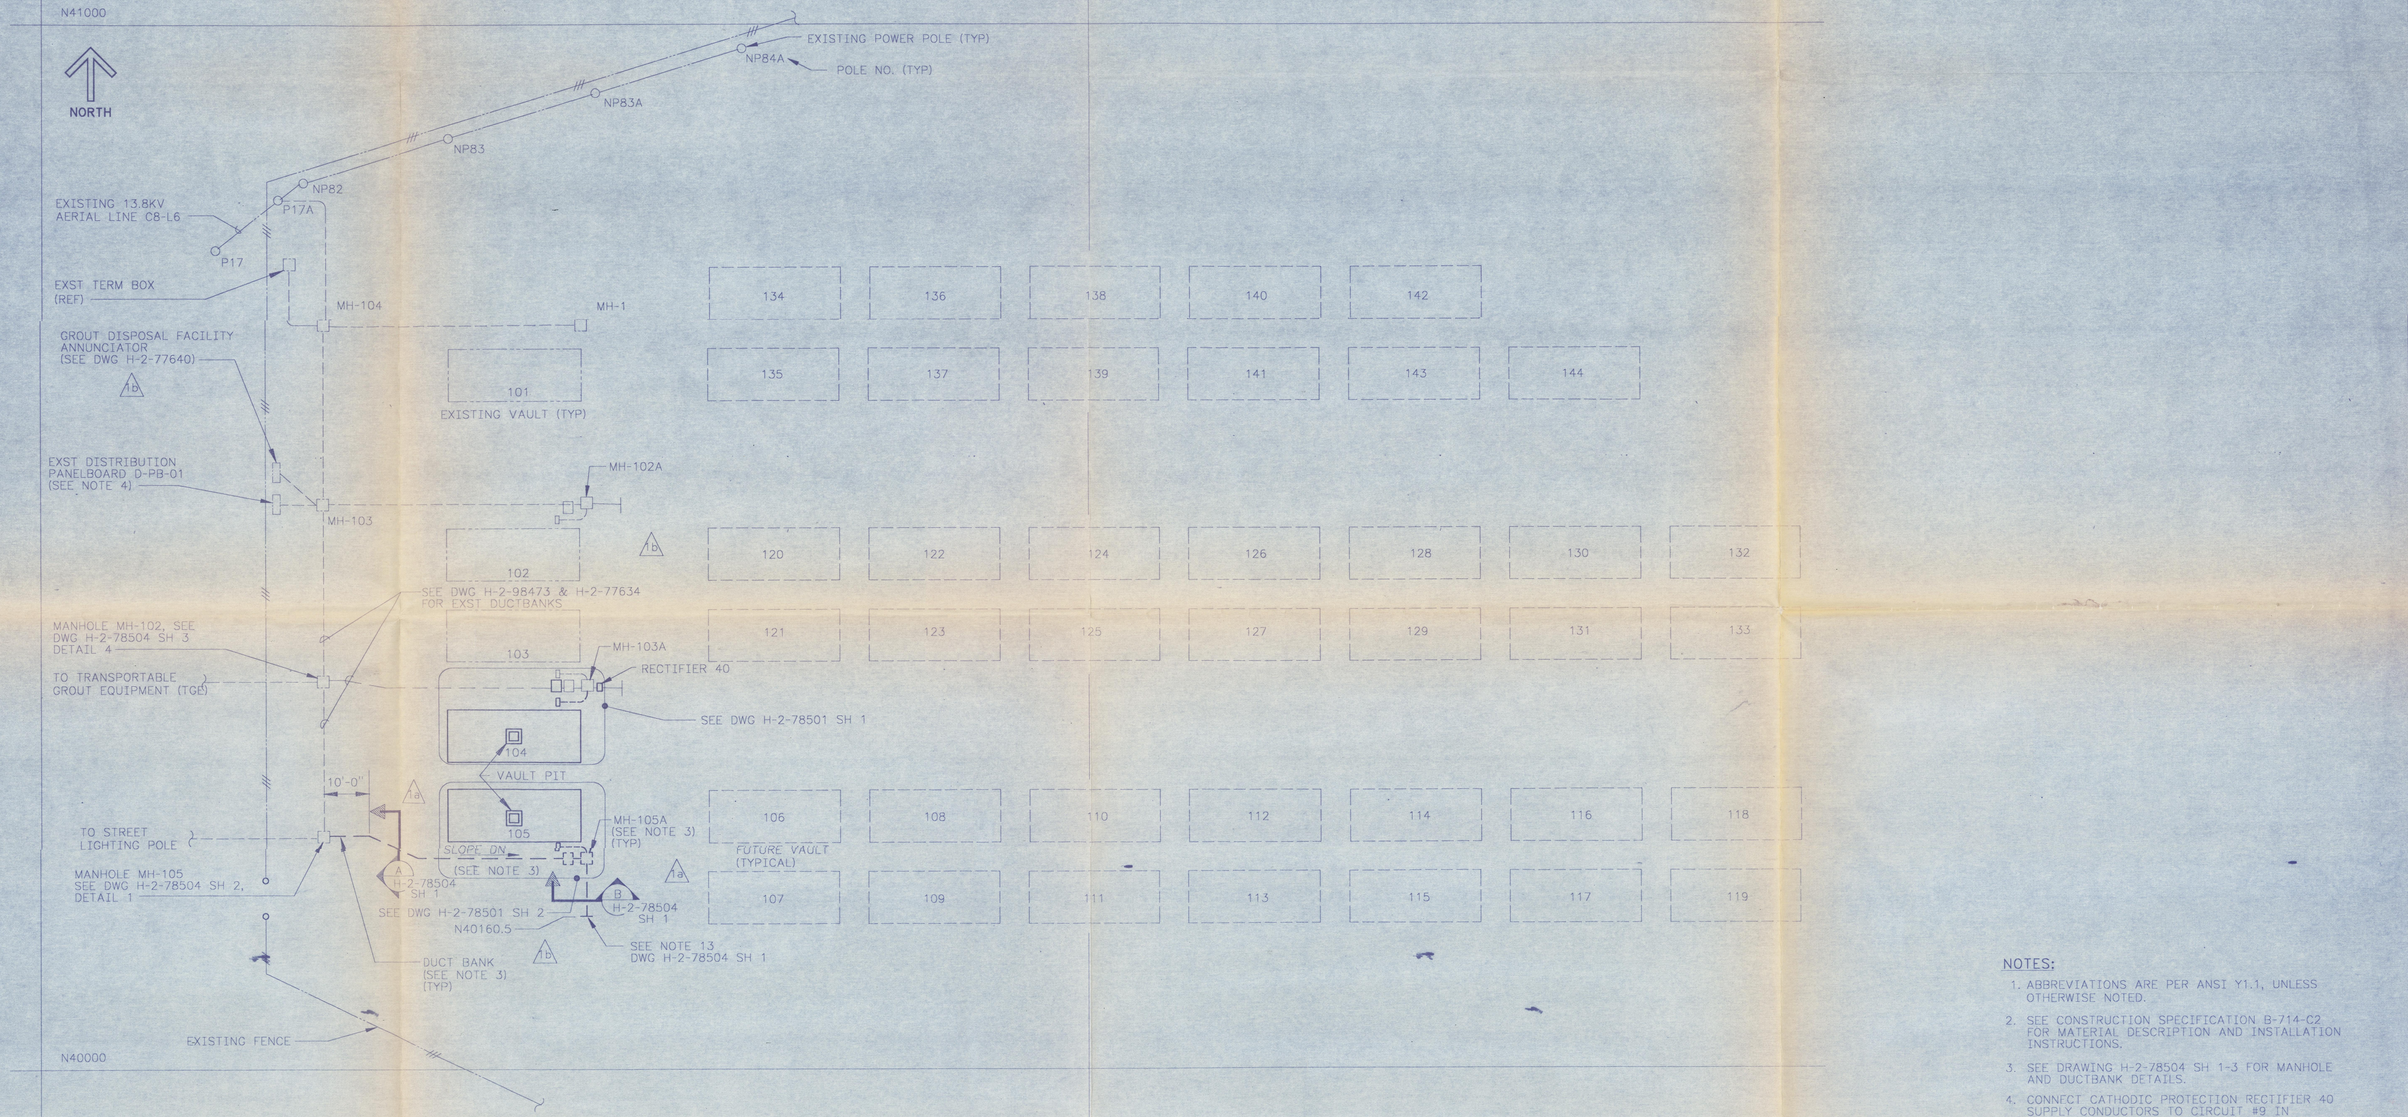

PLAN
SCALE: 1"=60'-0"

NOTES:

1. ABBREVIATIONS ARE PER ANSI Y1.1, UNLESS OTHERWISE NOTED.
2. SEE CONSTRUCTION SPECIFICATION B-714-C2 FOR MATERIAL DESCRIPTION AND INSTALLATION INSTRUCTIONS.
3. SEE DRAWING H-2-78504 SH 1-3 FOR MANHOLE AND DUCTBANK DETAILS.
4. CONNECT CATHODIC PROTECTION RECTIFIER 40 SUPPLY CONDUCTORS TO CIRCUIT #9 IN DISTRIBUTION PANELBOARD D-PB-01.

DOES NOT CONTAIN CLASSIFIED OR UNCLASSIFIED CONTROLLED NUCLEAR INFORMATION

Reviewing Official/ADC
Kaiser Engineers Hanford Company
1-8-91
Date

JAN 1991 RECEIVED EDMC

REV 1 1-8-91

DRAWING TRACEABILITY LIST			
NUMBER	TITLE	REFERENCES	
		NEXT USED ON	
H-2-77640	ELEC ELEM DIAG LEAK DET ANN		
H-2-77634	ELEC SITE PLAN		
H-2-98473	ELEC SITE & VAULT PL & DET		
H-2-78443	DRAWING LIST		

REVISIONS					
REV NO.	DESCRIPTION	REV BY	DATE	KEH APPROVALS	APVD FOR IMPL/ENG FOR DATE
M	b)B-714-53,ZE8,D6,C6 a)B-714-30,ZC6,C7	TEC	1-26-90		
RS 1	THRU B-714-61 GENL REV; INCORP ALL ECN'S			1-7-91	1-9-91
MF				1-9-91 EDH	TDM 1/9/91
					Chng 1/10/91

CAD FILE B078500A CAD CODE 2U:SUN:ACD2:10.0:NN

DRAWN JL BRINKLEY DATE	M	U.S. DEPARTMENT OF ENERGY	
CHECKED G. KUBINSKI 10-27-89		RICHLAND OPERATIONS OFFICE	
SAFETY J. ARCHIBALD 10-31-89		KAISER ENGINEERS HANFORD COMPANY	
ENVIR R. HOLLENBECK 10-31-89		ELECTRICAL SITE PLAN	
QE L. GADDIS 11-1-89			
QE T. DIAS 11-1-89			
LEAD ENG APVD A. SNOWHITE 10-27-89			
APPROVED FOR IMPLEMENTATION BY SR BRIGGS FOR WHC DATE 10/31/89		PROJECT B-714 GROUT VAULT PAIR (218-E-16-104 & 105)	
		SIZE F / BLDG NO. 218-E-16 / INDEX NO. 7301 Z306 / DWG NO. H-2-78500 / REV NO. 1	
		SCALE SHOWN / JOB NO. ER8159 / SHEET 1 OF 1	

IMPACT LEVEL 2 EDT 151655

KEHCAD 1

0012459